


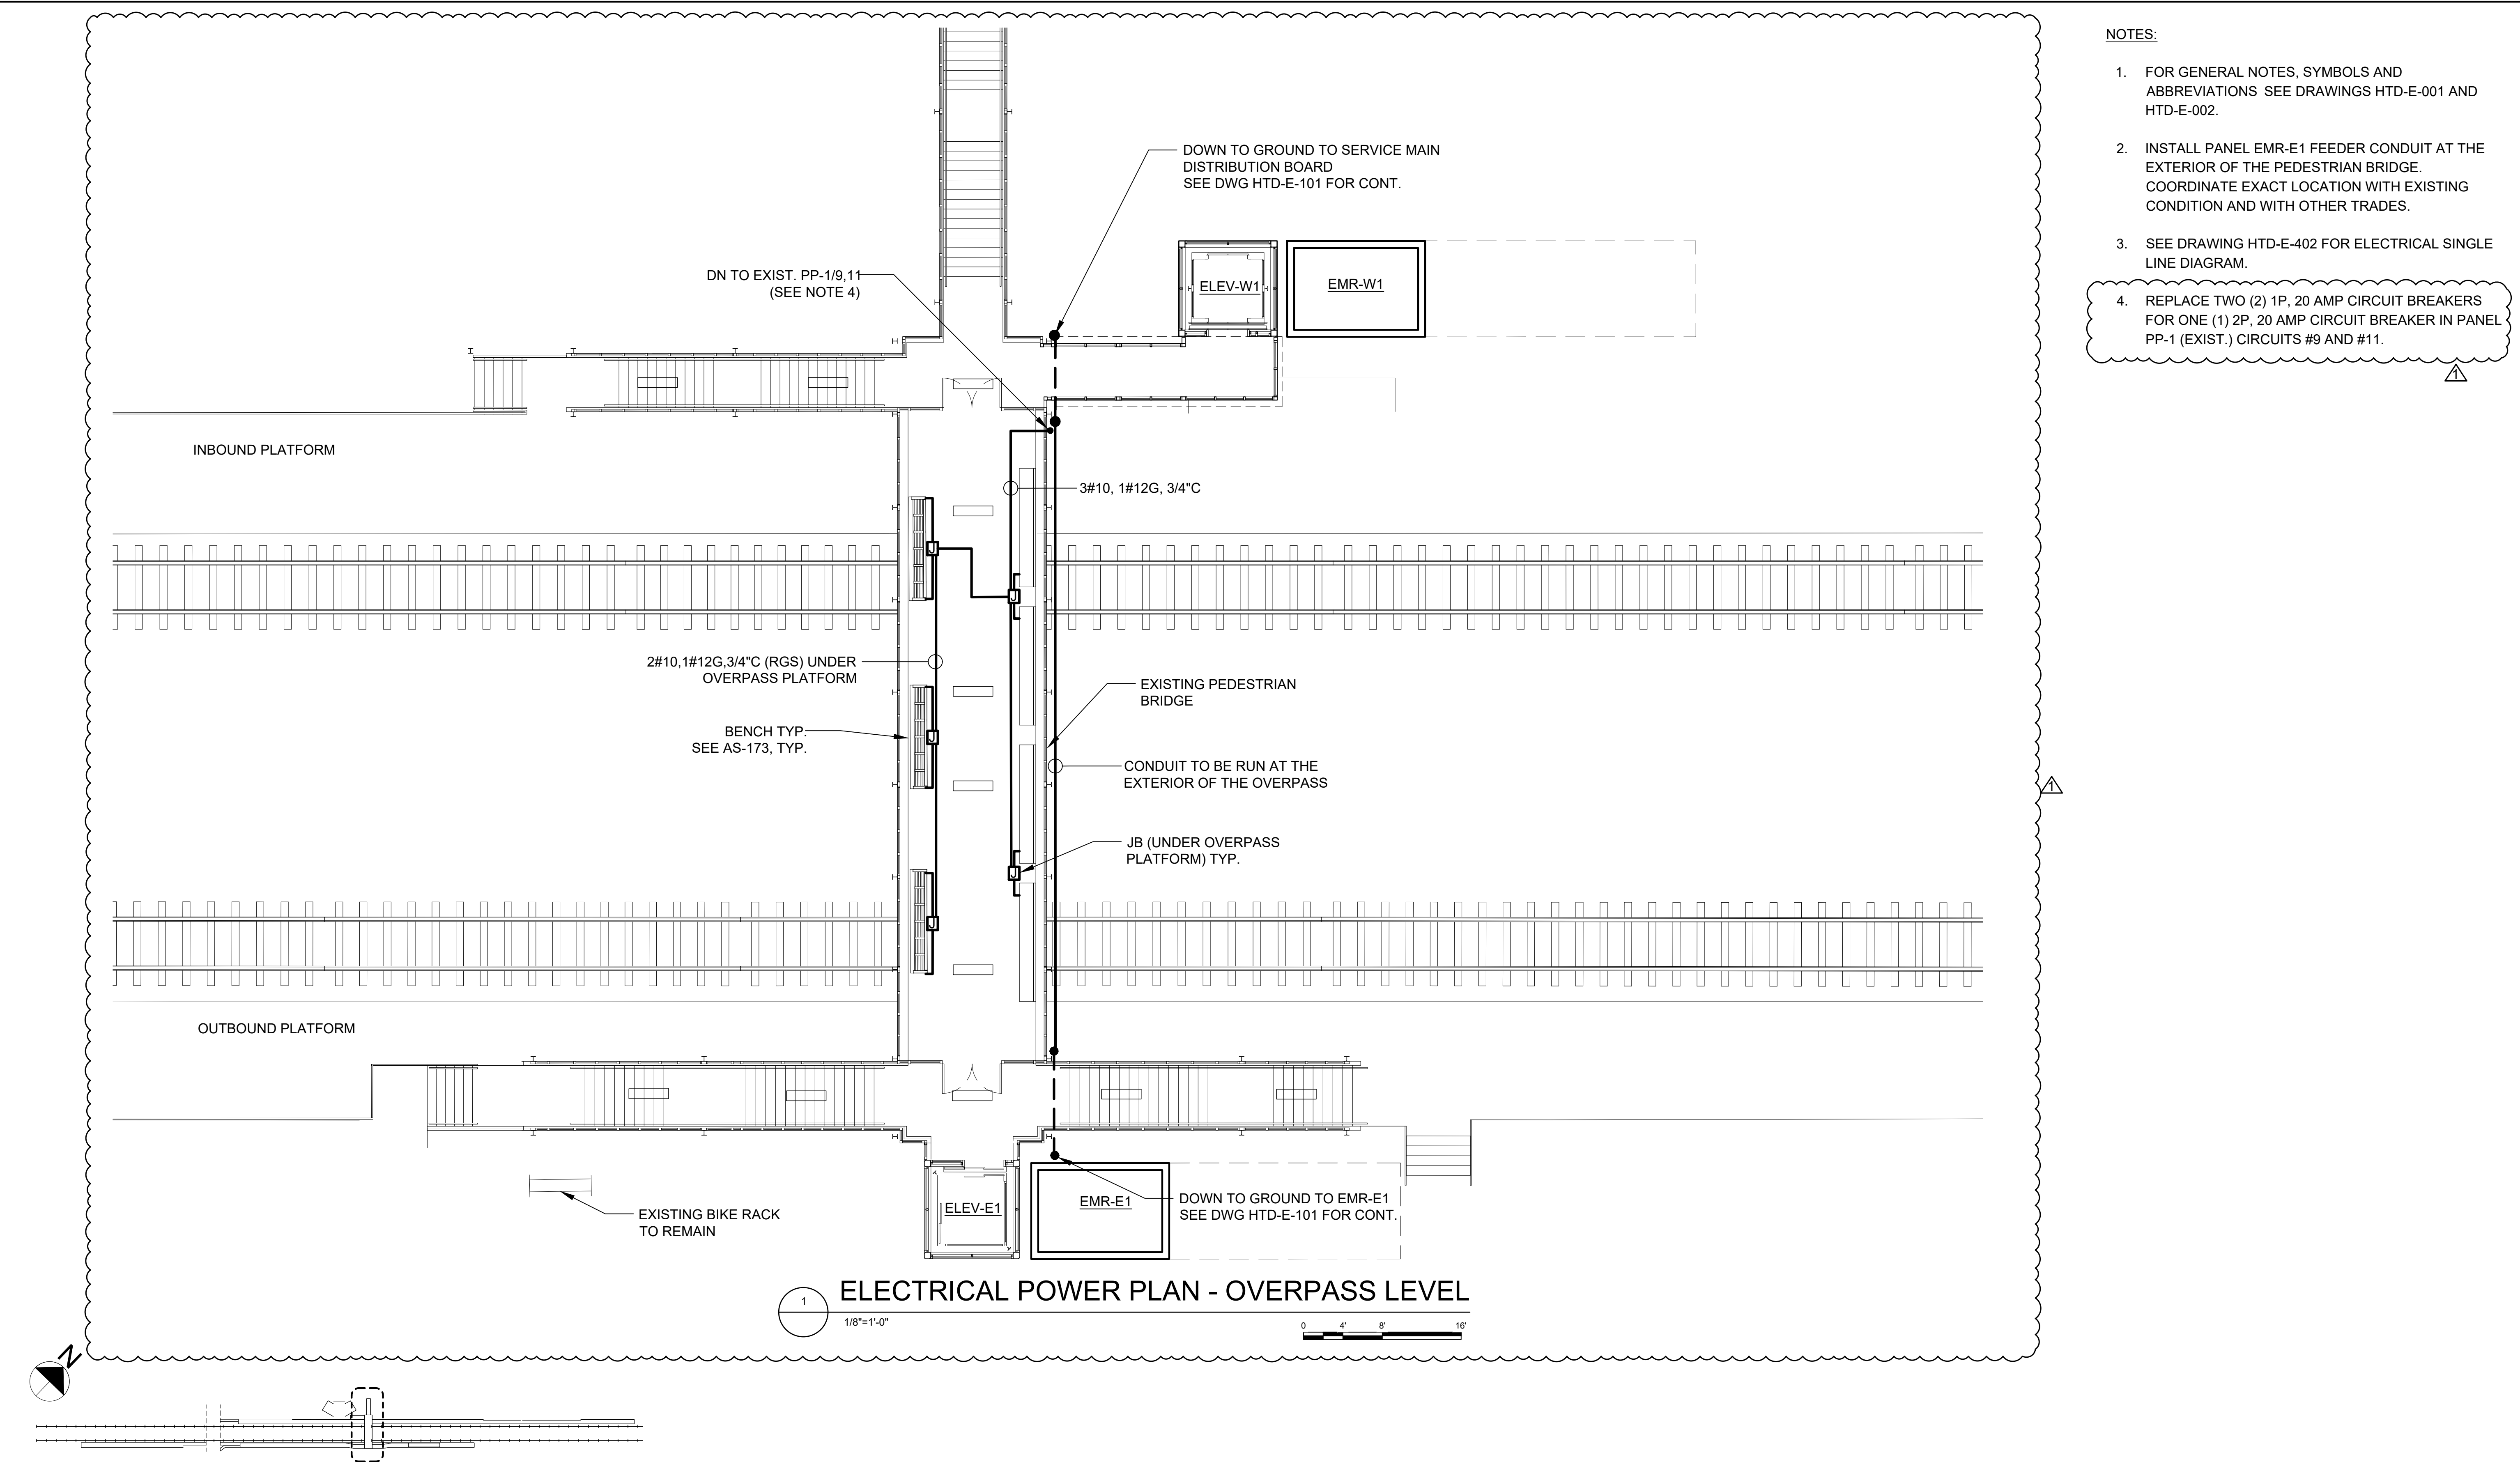

- NOTES:
- FOR GENERAL NOTES, SYMBOLS AND ABBREVIATIONS SEE DRAWINGS HTD-E-001 AND HTD-E-002.
 - INSTALL PANEL EMR-E1 FEEDER CONDUIT AT THE EXTERIOR OF THE PEDESTRIAN BRIDGE. COORDINATE EXACT LOCATION WITH EXISTING CONDITION AND WITH OTHER TRADES.
 - SEE DRAWING HTD-E-402 FOR ELECTRICAL SINGLE LINE DIAGRAM.
 - REPLACE TWO (2) 1P, 20 AMP CIRCUIT BREAKERS FOR ONE (1) 2P, 20 AMP CIRCUIT BREAKER IN PANEL PP-1 (EXIST.) CIRCUITS #9 AND #11.

KEY PLAN

DESIGNED	VC	CONFORMED										STV100 Years225 PARK AVENUE SOUTH, NEW YORK, NY 10003 MTA Metro-North Railroad420 Lexington Avenue, New York, NY 10017		TITLE		CONTRACT NO.											
DRAWN	SK													HARTSDALE AND SCARSDALE STATION IMPROVEMENTS		1000106733											
CHECKED	GG													ELECTRICAL POWER PLAN - OVERPASS LEVEL		SCALE	DATE										
APPROVED	GG													HARTSDALE STATION		1/8"=1'-0"	08/03/2021										
REVISION												REVISION												DRAWING NO.		HTD-E-102	
																								SHEET 71 OF 99			

3.3 CLEANING

- A. Remove all loose materials, crating and packing materials from premises.

END OF SECTION

