
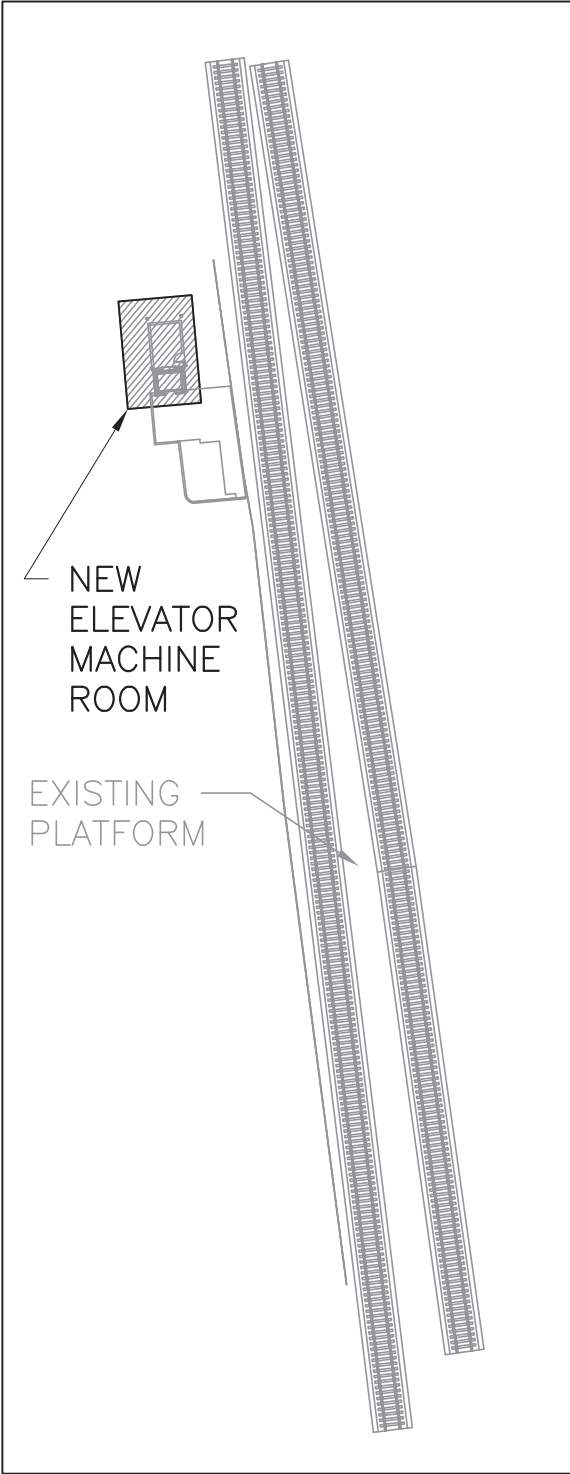


- NOTES:
- FOR SYMBOLS, ABBREVIATIONS AND GENERAL NOTES, SEE DRAWING P-001
- SUMP PUMP DISCHARGE NOTES:
- PROVIDE ELECTRICAL HEAT TRACING ON PUMPED DISCHARGE LINES CONTAINING STANDING WATER.
 - INSULATE ALL HEAT TRACED PUMP DISCHARGE LINES.

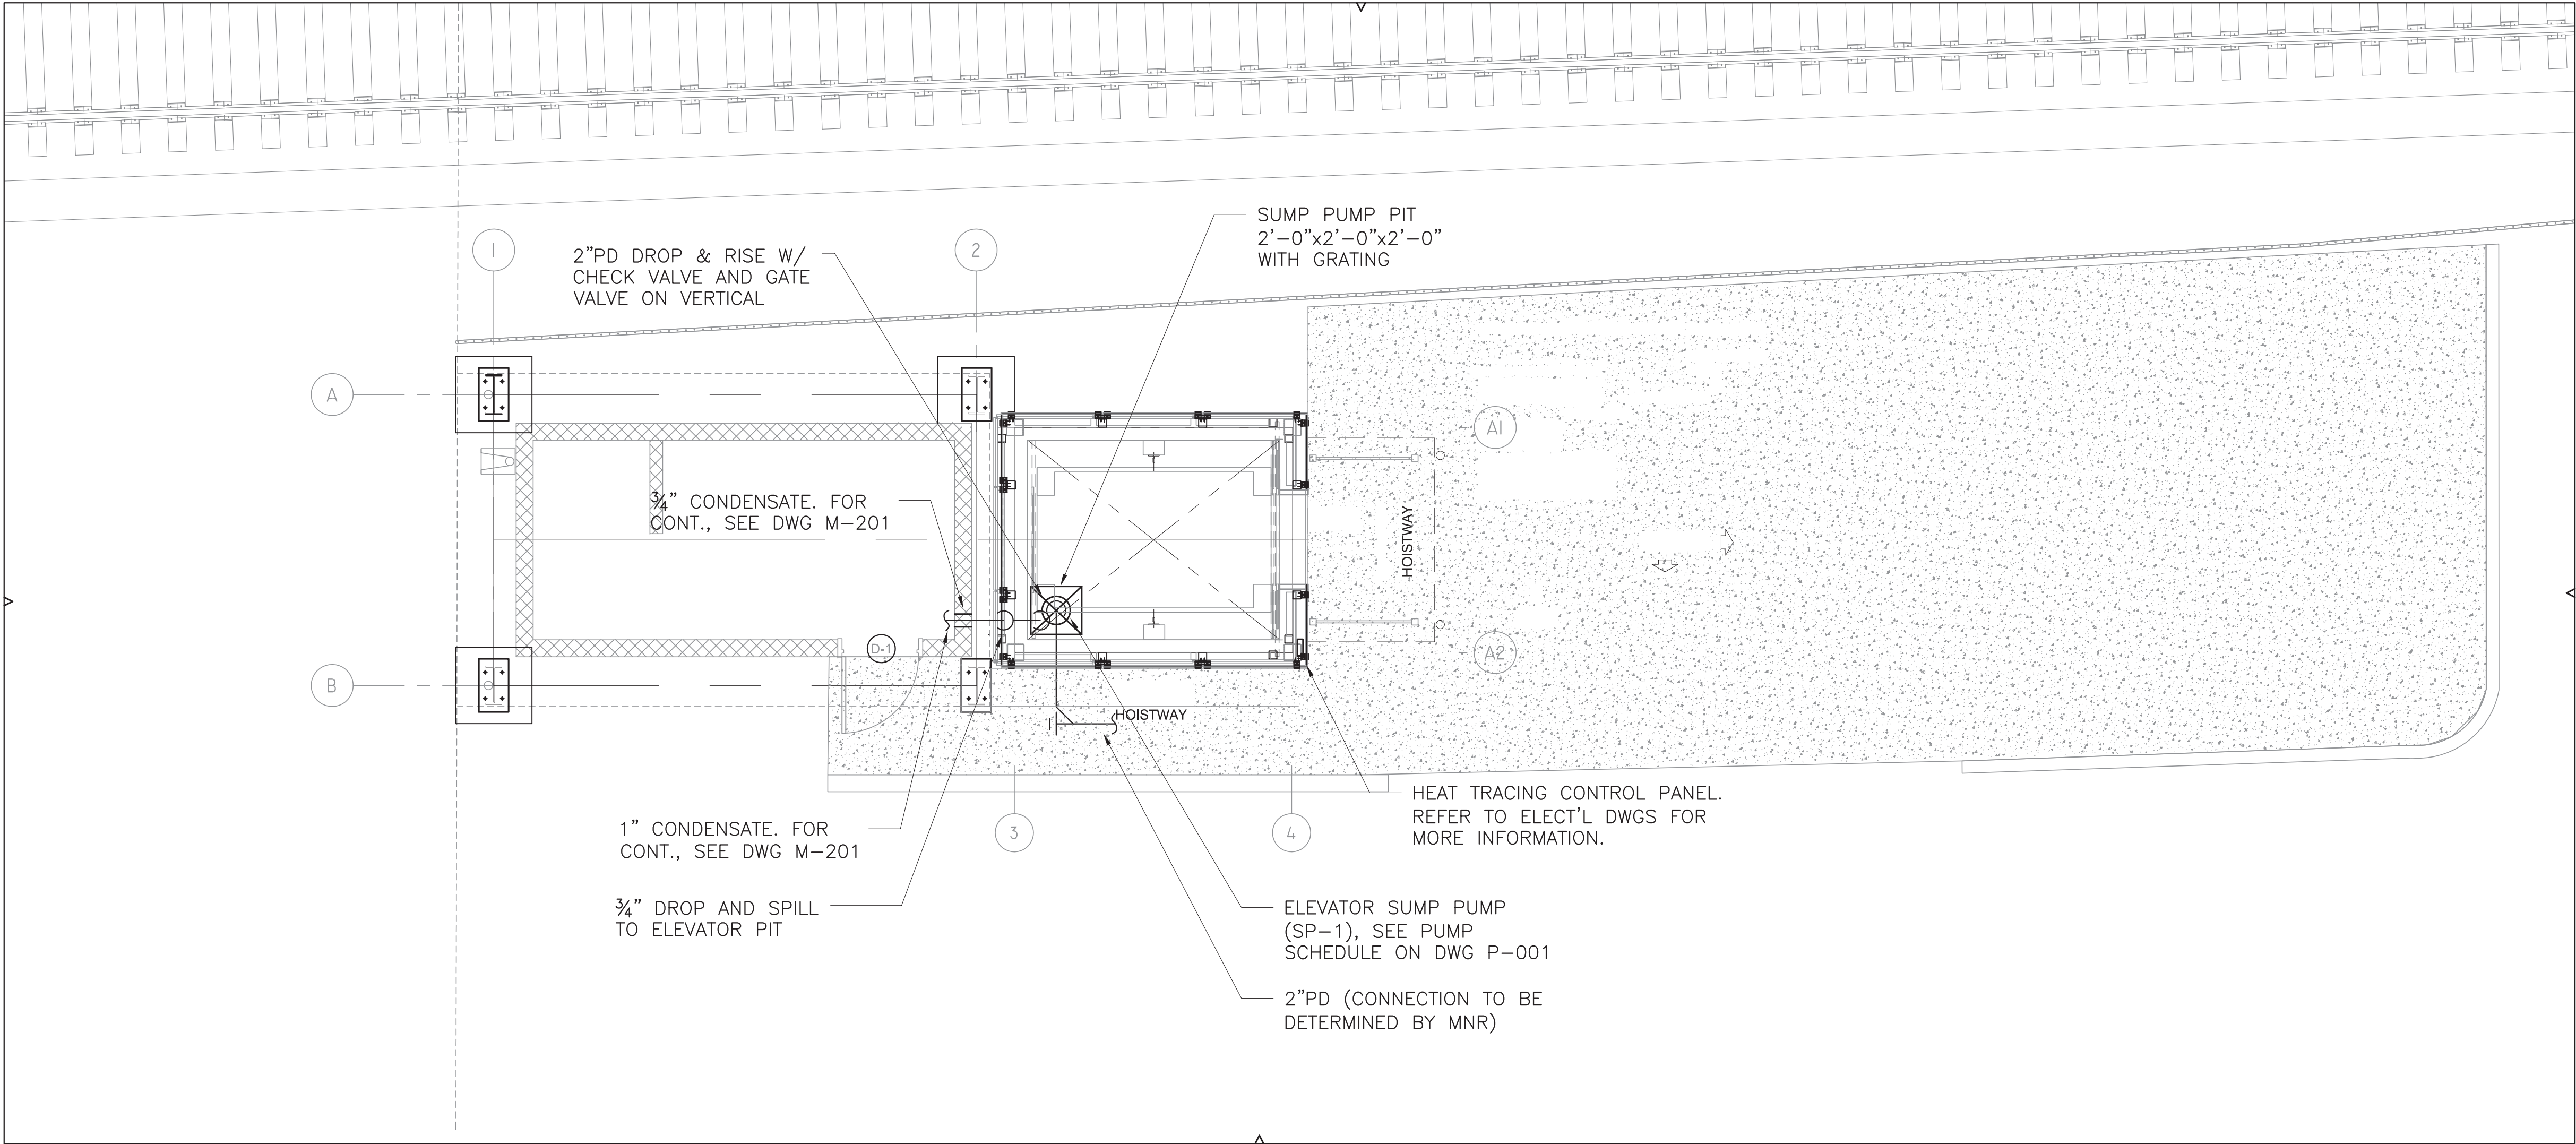

1 PLUMBING STATION LEVEL NEW ELEVATOR MACHINE ROOM PART PLAN
P-201 SCALE: 1/4"=1'-0"

STATION LEVEL
0' 64' 128'
1/64"=1'-0"

Jprago 11/18/2019 3:38:20 PM

DESIGNED J. PREGO		CONFORMED												
DRAWN J. PREGO														
CHECKED J. CRESPO														
APPROVED AR. GULERIA, P.E.														
		NO.	DATE	DRWN	CHKD	APPVD	NO.	DATE	DRWN	CHKD	APPVD			
		REVISIONS						REVISIONS						

A.G Consulting Engineering, PC
131 West 33rd Street, Suite 12B
New York, NY 10001
Tel. (212) 268-0950
Fax (212) 268-7497

Metro-North Railroad
347 Madison Avenue
New York, NY 10017

TITLE METRO-NORTH STATION IMPROVEMENTS PURDY'S STATION STATION LEVEL NEW ELEVATOR MACHINE ROOM PART PLAN		CONTRACT NO. 1000106733	
SCALE AS NOTED	DATE 11-20-2019	DRAWING NO. P-201	
		SHEET 57 OF 76	

100% DESIGN SUBMISSION