




 $1/8'' = 1'-0''$

 $1/8'' = 1'-0''$

 $1/8'' = 1'-0''$

- ① MOUNT UNIT VENTILATOR ABOVE CEILING. COORDINATE WITH ANY CEILING UTILITIES. MAINTAIN ACCESS FOR FILTER CHANGES. ALL SUPPLY AND RETURN DUCTWORK SHALL BE LINED. EXTEND EXISTING CONTROLS TO NEW UNIT LOCATION.
- ② PLENUM RETURN.
- ③ DUCTWORK LOCATED IN ATTIC SPACE.
- ④ PROVIDE NEW UNIT VENTILATOR IN EXISTING LOCATION. EXTEND EXISTING UTILITIES TO NEW UNIT. COORDINATE NEW INSTALLATION WITH EXISTING CABINETS.
- ⑤ REROUTE EXISTING DUCTWORK AS NEEDED TO ACCOMMODATE NEW INSTALLATION.

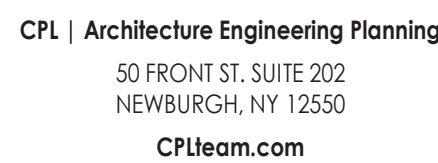

Project Number
13940.18
Client Name

Project Name
**PHASE 3: HERITAGE MIDDLE
SCHOOL 2019 CAPITAL
IMPROVEMENT PROJECT**

SED Number
44-16-00-01-0-039-01

No.	Date	Description
2	9/23/21	BID ADDENDUM #2

No.	Date	Description
2	9/23/21	BID ADDENDUM #2

Issued	Scale
09/09/2021	As indicated

CONSTRUCTION DOCUMENTS


NRH JJM

Drawing Number

HMS
H202D



S:\Projects\Newburgh ECSD\Heritage MS Additn & Reno\0 Design\06 CAD\Revit 9/23/2021 11:29:52 AM

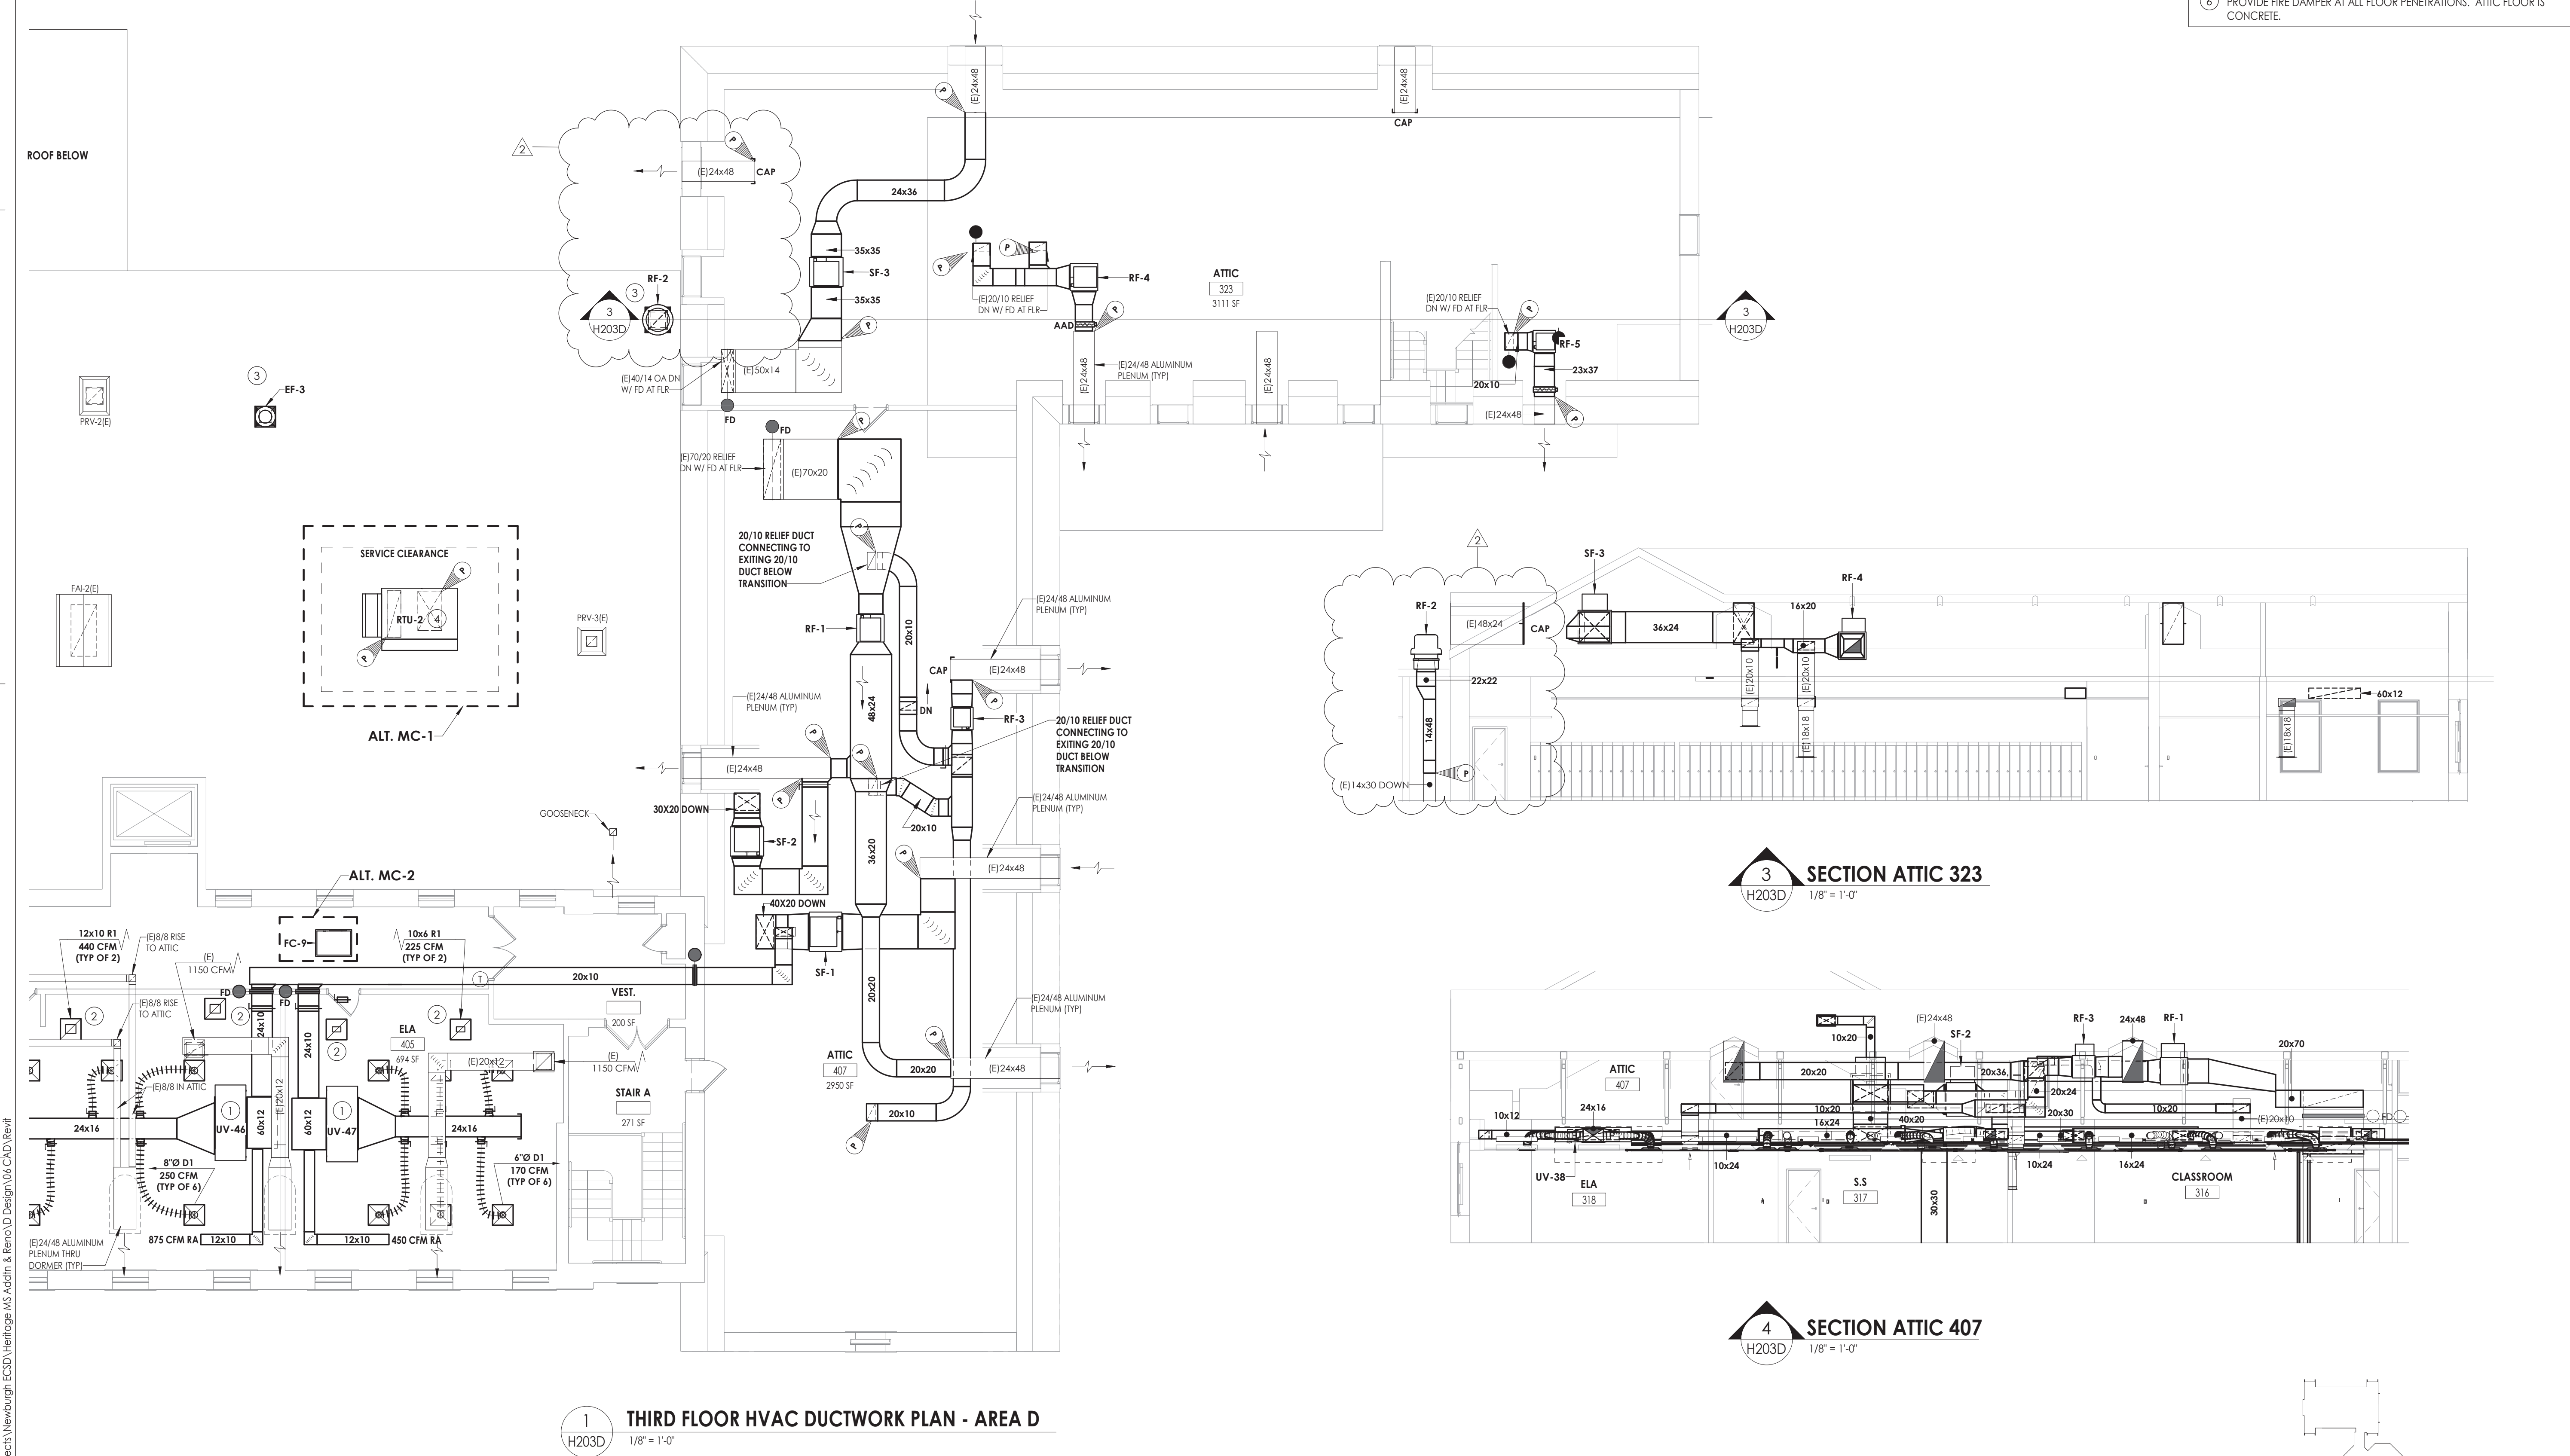

- KEY NOTES**
- 1 MOUNT UNIT VENTILATOR ABOVE CEILING. COORDINATE WITH ANY CEILING UTILITIES. MAINTAIN ACCESS FOR FILTER CHANGES. ALL SUPPLY AND RETURN DUCTWORK SHALL BE LINED. EXTEND EXISTING CONTROLS TO NEW UNIT LOCATION.
 - 2 PLENUM RETURN.
 - 3 EXHAUST FANS SHALL BE PROVIDED WITH NEW CURB. CONNECT TO EXISTING DUCT RISERS.
 - 4 ROOFTOP UNIT SHALL BE PROVIDED WITH A NEW CURB. CONNECT TO EXISTING DUCT RISER.
 - 5 UNIT VENTILATORS SHALL BE INSTALLED IN ATTIC SPACE. EACH DROP THROUGH CONCRETE FLOOR SHALL BE PROVIDED WITH NEW FIRE DAMPER.
 - 6 PROVIDE FIRE DAMPER AT ALL FLOOR PENETRATIONS. ATTIC FLOOR IS CONCRETE.

CPL | Architecture Engineering Planning
50 FRONT ST, SUITE 202
NEWBURGH, NY 12550
CPLteam.com

PROJECT INFORMATION

Project Number	13940.18
Client Name	NEWBURGH ENLARGED CITY SCHOOL DISTRICT
Project Name	PHASE 3: HERITAGE MIDDLE SCHOOL 2019 CAPITAL IMPROVEMENT PROJECT
Project Address	405 Union Avenue, New Windsor, NY 12553
SED Number	44-16-00-01-0-039-011

PROJECT ISSUE SCHEDULE

No.	Date	Description
2	9/23/21	BID ADDENDUM #2

IT IS A VIOLATION OF THE NEW YORK STATE EDUCATION LAW AND THE COMMISSIONER'S REGULATIONS FOR ANY PERSON UNLESS ACTING UNDER THE DIRECTION OF A LICENSED ARCHITECT, ENGINEER OR LAND SURVEYOR TO ALTER AN ITEM IN ANY WAY IF AN ITEM BEARING THE SEAL OF AN ARCHITECT, ENGINEER OR SURVEYOR IS ALTERED. THE ALTERING PARTY SHALL AFFIX TO THE ITEM THEIR SEAL AND THE NOTATION "ALTERED BY" FOLLOWED BY THEIR SIGNATURE AND THE DATE OF SUCH ALTERATION, AND A SPECIFIC DESCRIPTION OF THE ALTERATION.

SHEET INFORMATION

Issued	09/09/2021	Scale	As indicated
Project Status	CONSTRUCTION DOCUMENTS		
Drawn By	NRH	Checked By	JJM
Drawing Title	THIRD FLOOR HVAC DUCTWORK PLAN - AREA D		

Drawing Number
HMS H203D