


PLUMBING EQUIPMENT SCHEDULE CONT'			
SYMBOL	MANUFACTURER	CATALOG #	DESCRIPTION
HS-1	JUST	A-544-FS-T	HANDWASH SINK WALL MOUNTED 20 GAUGE TYPE 304 STAINLESS STEEL, 8" ON CENTER 2-HOLE BACK MOUNT. FAUCET J5-47-TG5A 2.2 GPM, DRAIN J-15-FS, TRAP JTN-150, BRASS STEM STOPS, 17 GAUGE CHROME PLATED BRASS P-TRAP W/CLEANOUT AND BASKET STRAINER. IPS TRUEBRO LAV GUARD INSULATION KIT. INSTALL IN ACCORDANCE WITH ANSI A117.1 AND ADA STANDARDS FOR HANDICAP ACCESSIBILITY.
MS-1	FIAT	M5B2424	MOP SERVICE BASIN, MOLDED STONE (24" x 24" x 10" HIGH), WITH WALL GUARD (M5B2424) AND MOP HANGER (B84-CC).
	ADVANCED TABCO	K-240	SERVICE FAUCET WITH METAL HANDLES, VACUUM BREAKER W/HOOK, TOP BRACE AND INTEGRAL STOPS.
SS-1	ELKAY	E55B2520C	SERVICE SINK, WALL MOUNTED CONSTRUCTED OF TYPE 304 (18-8) STAINLESS STEEL WITH WALL HANGER, 3" CAST IRON P-TRAP (LK173) AND CLEANOUT.
		LK907BROT2LH	UTILITY FAUCET WITH METAL HANDLES, VACUUM BREAKER, TOP BRACE AND INTEGRAL STOPS.
S-1	JUST	DLXD-2133-A-GR	DROP-IN DOUBLE SINK SELF-RIM CONSTRUCTED OF 18 GAUGE TYPE 304 STAINLESS STEEL, BOWL (2) (16" W x 14" L x 12" D), DECK MOUNTED FAUCET (1) HOLE CENTERED WITH STAINLESS BASKET 1/2", 17 GAUGE CHROME PLATED BRASS P-TRAP W/CLEANOUT AND BRASS STEM STOPS.
	AMERICAN STANDARD	4432.350	EDGEWATER SEMI-PROFESSIONAL KITCHEN FAUCET, METAL REINFORCED HOSE , PULL-DOWN SELECTFLO 4 FUNCTION SPRAY HEAD (1)-HOLE APPLICATION
S-2	ADVANCED TABCO	43-2-36-24	REGALINE TWO COMPARTMENT SINK EACH (16"L x 20"W x 12"D) WITH ONE DRAINBOARD AND STAINLESS STEEL LEGS, CONSTRUCTED OF 16 GAUGE TYPE 304 STAINLESS STEEL W/8" BACKSPLASH FAUCET HOLES 8" CENTERS.
	T&S BRASS	B-0133-ADF-B	PRE-RINSE 8" WALL MOUNT WITH ADD-ON MIXING FAUCET, 12" SWING NOZZLE, 18" RIGID RISER, 44" FLEXIBLE STAINLESS STEEL HOSE, LEVER HANDLES, 6" ADJUSTABLE WALL BRACKET, SPRAY HOLDER, CHECK VALVES, BRASS STEM STOPS, 17 GAUGE CHROME PLATED DRAIN W/CLEANOUT AND BASKET STRAINER.
S-3	ADVANCED TABCO	44-62-36-24RL	REGALINE TWO COMPARTMENT SINK EACH (18"L x 24"W x 11"D) WITH TWO DRAINBOARDS AND STAINLESS STEEL LEGS. CONSTRUCTED OF 14 GAUGE TYPE 304 STAINLESS STEEL W/11" BACKSPLASH FAUCET HOLES 8" CENTERS.
	T&S BRASS	B-0133-ADF-B	PRE-RINSE 8" WALL MOUNT WITH ADD-ON MIXING FAUCET, 12" SWING NOZZLE, 18" RIGID RISER, 44" FLEXIBLE STAINLESS STEEL HOSE, LEVER HANDLES, 6" ADJUSTABLE WALL BRACKET, SPRAY HOLDER, CHECK VALVES, BRASS STEM STOPS, 17 GAUGE CHROME PLATED DRAIN W/CLEANOUT AND BASKET STRAINER.
S-4	ADVANCE TABCO	DI-1-1515	DROP-IN SINK SELF-RIMMED CONSTRUCTED OF 20 GAUGE TYPE 304 STAINLESS STEEL, BOWL (12-1/4" L x 10-1/4" W x 6" D), DECK MOUNTED 8 1/2" GOOSENECK 4" O.C. - (MODEL K-55), STAINLESS STEEL BASKET 1/2", 17 GAUGE CHROME PLATED BRASS P-TRAP, W/CLEANOUT AND, BRASS STEM STOPS.
S-5	ADVANCE TABCO	DI-1-168	DROP-IN SINK SELF-RIMMED CONSTRUCTED OF 20 GAUGE TYPE 304 STAINLESS STEEL, BOWL (16" L x 14" W x 8" D), DECK MOUNTED 8 1/2" GOOSENECK 4" O.C. - (MODEL K-52), STAINLESS STEEL BASKET 1/2", 17 GAUGE CHROME PLATED BRASS P-TRAP, W/CLEANOUT AND, BRASS STEM STOPS.
S-6	JUST	SL-ADA-1613 -A-GR	LEDGE TYPE - SINGLE BOWL SINK WALL 18 GAUGE TYPE 304 STAINLESS STEEL, BOWL (10" L x 10" W x 4 1/2" D), (3)-HOLE 4" ON CENTERS, FAUCET J-1174-R, 2.2 GPM, DRAIN SYSTEM J-ADA-35, BRASS STEM STOPS, 17 GAUGE CHROME PLATED BRASS P-TRAP W/CLEANOUT AND 3/8" BASKET STRAINER. IPS TRUEBRO LAV GUARD INSULATION KIT. INSTALL IN ACCORDANCE WITH ANSI A117.1 AND ADA STANDARDS FOR HANDICAP ACCESSIBILITY.
PS-1	_____	_____	EXISTING 3-BAY POT SINK AND FAUCET PROVIDED BY OWNER
PS-2	_____	_____	EXISTING 2-BAY POT SINK AND FAUCET PROVIDED BY OWNER
BS-1	REGENCY	600B31014213	THREE BOWL UNDERBAR HAND SINK EACH (10"L x 14"W x 10"D) WITH TWO DRAINBOARDS AND STAINLESS STEEL LEGS, CONSTRUCTED OF 18 GAUGE TYPE 304 STAINLESS STEEL W/3" HIGH BACKSPLASH AND FAUCET.
DF-1	ELKAY	LVRGB05K	VANDAL RESISTANT BOTTLE FILLING STATION SINGLE FILTERED VANDAL RESISTANT ELECTRIC WATER COOLER. CHILLING CAPACITY OF 8 GALLONS PER HOUR OF 50°F DRINKING WATER AT 40°F AMBIENT. ELECTRICAL: 115V/60Hz, 5.0 FULL LOAD AMPS, 370 WATTS. ADA COMPLIANT, NSF 61 CERTIFIED.
DF-2	ELKAY	LVRCHD(17)05C	HEAVY DUTY, 14 GAUGE STAINLESS STEEL BI-LEVEL WALL-MOUNTED WATER COOLER FILTERED VANDAL RESISTANT. ELECTRIC WATER COOLER, CHILLING CAPACITY OF 8 GALLONS PER HOUR OF 50°F DRINKING WATER AT 40°F AMBIENT. ELECTRICAL: 115V/60Hz, 4.0 FULL LOAD AMPS, 370 WATTS. ADA COMPLIANT, NSF 61 CERTIFIED.
PF-1	T&S	BF-0299-24DJ	POT FILLER, SINGLE WALL MOUNT BIG-FLO FAUCET W/24" DOUBLE JOINT NOZZLE, 4-ARM HANDLE & 3/4" STREET ELBOW
EW-1	BRADLEY	61540	AQUAGUARD GRAVITY-FLOW PORTABLE EYEWASH, 16 GALLON WITH EPOXY COATED STEEL BRACKET FOR MOUNTING WALL UNIT ON WALL.
LB-1	SYMMONS	W602X	LAUNDRY-MATE SUPPLY AND DRAIN FIXTURE FOR 1/2" COPPER AND 2" DRAIN WITH SERVICE STOPS
WB-1	OATEY	12K	WALL BOX WITH BRASS VALVE & COPPER CONNECTION.
NFHB-1	WOODFORD	6T	3/4" WALL HYDRANT NON-FREEZE, SELF-DRAINING, VANDAL RESISTANT INTEGRAL VACUUM BREAKER, KEY OPERATED, CHROME FINISH.
C.O.	_____	_____	CLEANOUT
F.C.O.	_____	_____	FLOOR CLEANOUT PEDESTRIAN TRAFFIC SEE DETAIL #1 ON DRAWING (P200)
F.C.O.-1	_____	_____	FLOOR CLEANOUT VEHICLE/TRUCK TRAFFIC (SEE DETAIL #8 ON DRAWING (P200)
W.C.O.	_____	_____	WALL CLEANOUT SEE DETAIL #2 ON DRAWING (P200)
EX.C.O.	_____	_____	EXTERIOR CLEANOUT SEE DETAIL #7 ON DRAWING (P200)
TPU-1	MIFAB	MI-300-625 -120	ELECTRONIC RAP SEAL PRIMER SYSTEM WITH ENCLOSURE, AIR GAP, SOLENOID VALVE, ADJUSTABLE TIMER AND MI-DU DISTRIBUTION UNIT (MI-DI-625) WITH (5) 3/8" PIPE CONNECTIONS, CAP UNUSED PIPE CONNECTIONS - 120V/1. MOUNT UNIT AS DIRECTED IN FIELD BY ARCHITECT
TP-1	MIFAB	M-500, MI-DU MI-GAP	TRAP SEAL PRIMER WITH DISTRIBUTION UNIT TO SERVE UP TO FOUR (4) FLOOR DRAINS AND AIR GAP FITTINGS (MI-6AP).
P-1	GRUNDFOS	UP 15-42B7	DOMESTIC HOT WATER RECIRCULATION PUMP, BRONZE BODY WITH AQUASTAT AND "UP" TIMER. 8 GPM @ 10 FEET OF HEAD 1/25 HP - 120V/1
FW-1	GUARDIAN	61991	PEDESTAL-MOUNT EMERGENCY COMBINATION EYE/FACE WASH AND SHOWER SAFETY STATION. STAINLESS STEEL BOWL, DUAL AERATED SPRAY HEADS WITH DUST COVER, 10" DIA. SHOWER HEAD ADA ACCESSIBLE, 1 1/4" NPT SUPPLY AND 1/2" NPTF DRAIN WITH ELBOW AND FAUCET EXTENDED TO 6" A.F.F. FC20 REGULATES SHOWER FLOW TO 20 GPM. INSTALL IN ACCORDANCE WITH ANSI A117.1 AND ADA STANDARDS FOR HANDICAP ACCESSIBILITY.
	GUARDIAN	TMV 6380OLF	EMERGENCY EYE/FACE/ASH MIXING VALVE - 29.0 GPM @ 10 PSI DROP. MIXING VALVE WILL CLOSE DOWN ON FAILURE OF COLD WATER. SPECIAL INTERNAL COLD WATER BYPASS. COMPLIANCE WITH ANSI Z 358.1
WBP-1	CENTRIFRO/XYLEM	5AVN110H04	TRUCK FILL NON-POTABLE WATER BOOSTER PUMP AQUAVAR VARIABLE SPEED CONSTANT PRESSURE SYSTEM, 5 HP IFC CONTROLLER, WALL MOUNT KIT, LCC- STAINLESS STEEL PUMP, TRANSDUCER, V45P (13.9 GALLON) EXPANSION TANK, PRESSURE GAUGE AND DISCHARGE PIPE TEE, CONTROLLER PREWIRED, CHECKVALVE ON DISCHARGE, RELIEF VALVE. 50 GPM @ 60 PSI BOOST. PUMP (E-HM 4-STAGE) - 5.0 HP - 208V/1
WBP-2	GRUNDFOS	MPC-E 2GRE 10-6	POTABLE WATER BOOSTER VARIABLE SPEED PACKAGED PUMPING SYSTEM, DUPLEX 5 HP TEFC MOTOR PUMP, 60 GPM @ 208 FEET HEAD (2) PUMPS, CONTROL PANEL, INDIVIDUAL PUMP FAULT LIGHTS ON THE CONTROL PANEL, INDIVIDUAL PUMP DISCONNECT SWITCHES, WATER PRESENCE SENSOR ON THE SUCTION MANIFOLD IN PLACE OF THE SUCTION TRANSDUCER, LIGHTING PROTECTION, NORMAL/EMERGENCY SWITCHES, EXPANSION TANK THE JOHN WOOD COMPANY MODEL J4WR-20-602, PANEL MOUNTED PUMP RUN LIGHTS, AUDIO FAULT INDICATOR HORN WITH SILENCE BUTTON, DOME LIGHT AND FACTORY AUTHORIZED START-UP. 208V/3.
SP-1	STANCOR	SE-50	OIL-MINDER SIMPLEX PUMP AND CONTROL SYSTEM, NEMA 4X CORROSION RESISTANT POLYCARBONATE ENCLOSURE, STAINLESS STEEL SENSOR PROBE, DIRECT PLUG-IN POWER SOURCE, SOLID STATE COMPONENTS, ALARMS, LIGHTS, SILENCE SWITCH, REMOTE MONITORING CIRCUIT FOR OIL, HIGH LIQUID AND HIGH AMPERAGE CONDITIONS. FACTORY ASSEMBLED AND TESTED. 74 GPM @ 37 FT HEAD. - 1/2 HP - 120V/1
WH-1, 2	TRIANGLETUBE	SMART 100	INDIRECT DOMESTIC WATER HEATER,

PLUMBING EQUIPMENT SCHEDULE			
SYMBOL	MANUFACTURER	CATALOG #	DESCRIPTION
			SANITARY PIPING, SCHEDULE 40 PVC, PVC FITTINGS WITH SOLVENT WELDED JOINTS BELOW GRADE. SERVICE HEIGHT CAST IRON HUBLESS PIPE WITH NEOPRENE GASKET, STAINLESS STEEL CLAMP AND SHIELD ASSEMBLY JOINTS 6" ABOVE GRADE. SCHEDULE 40 PVC WITH SOLVENT WELDED JOINTS 6" ABOVE GRADE MAY BE USED IN NONE CEILING RETURN AIR PLENUM SPACES. SEE HVAC DRAWINGS. PVC MAY NOT BE USED IN HVAC CEILING RETURN AIR PLENUM SPACES.
			VENT PIPING, SCHEDULE 40 PVC, PVC FITTINGS WITH SOLVENT WELDED JOINTS BELOW GRADE AND SERVICE HEIGHT CAST IRON HUBLESS PIPE WITH NEOPRENE GASKET, STAINLESS STEEL CLAMP AND SHIELD ASSEMBLY JOINTS 6" ABOVE GRADE. SCHEDULE 40 PVC WITH SOLVENT WELDED JOINTS 6" ABOVE GRADE MAY BE USED IN NONE HVAC CEILING PLENUM SPACES. SEE HVAC DRAWINGS. PVC MAY NOT BE USED IN HVAC CEILING RETURN AIR PLENUM SPACES.
			DOMESTIC COLD WATER PIPING, COPPER TYPE "L" WITH LEADFREE SOLDER JOINTS ABOVE GRADE AND COPPER TYPE "K" FOR UNDERGROUND PIPING. NO JOINTS PERMITTED BELOW GRADE. INSULATE UNDERGROUND WITH 1" THICK ELASTOMERIC INSULATION. INSULATE ALL ABOVE GROUND PIPING WITH ½" THICK FIBERGLASS PIPE INSULATION WITH VAPOR PROOF JACKET, TAPED JOINTS AND PVC FITTING COVERS. EXPOSED PIPING SHALL BE COVERED WITH PVC PIPE COVER AND PAINTED. (1) - COAT PRIMER, (2) COATS - PAINT. COLOR AS DIRECTED BY ARCHITECT
			DOMESTIC HOT WATER PIPING, COPPER TYPE "L" WITH LEADFREE SOLDER JOINTS ABOVE GRADE AND COPPER TYPE "K" FOR UNDERGROUND PIPING. NO JOINTS PERMITTED BELOW GRADE. INSULATE UNDERGROUND PIPING UP TO 1½" DIA WITH 1" AND PIPING ABOVE 1½" DIA USE 1½" THICK ELASTOMERIC INSULATION. INSULATE ALL ABOVE GROUND PIPING UP TO 1½" DIA WITH 1" AND PIPING ABOVE 1½" DIA USE 1½" THICK FIBERGLASS PIPE INSULATION WITH VAPOR PROOF JACKET, TAPED JOINTS AND PVC FITTING COVERS. EXPOSED PIPING SHALL BE COVERED WITH PVC PIPE COVER AND PAINTED. (1) - COAT PRIMER, (2) COATS - PAINT. COLOR AS DIRECTED BY ARCHITECT
			DOMESTIC HOT WATER RECIRCULATION PIPING, COPPER TYPE "L" WITH LEADFREE SOLDER JOINTS ABOVE GRADE AND COPPER TYPE "K" FOR UNDERGROUND PIPING. NO JOINTS PERMITTED BELOW GRADE. INSULATE UNDERGROUND PIPING UP TO 1½" DIA WITH 1" AND PIPING ABOVE 1½" DIA USE 1½" THICK ELASTOMERIC INSULATION. INSULATE ALL ABOVE GROUND PIPING UP TO 1½" DIA WITH 1" AND PIPING ABOVE 1½" DIA USE 1½" THICK FIBERGLASS PIPE INSULATION WITH VAPOR PROOF JACKET, TAPED JOINTS AND PVC FITTING COVERS. EXPOSED PIPING SHALL BE COVERED WITH PVC PIPE COVER AND PAINTED. (1) - COAT PRIMER, (2) COATS - PAINT. COLOR AS DIRECTED BY ARCHITECT
			NON-POTABLE TRUCK FILL WATER PIPING, COPPER TYPE "L" WITH LEADFREE SOLDER JOINTS ABOVE GRADE AND COPPER TYPE "K" FOR UNDERGROUND PIPING. NO JOINTS PERMITTED BELOW GRADE. INSULATE UNDERGROUND WITH 1" THICK ELASTOMERIC INSULATION. INSULATE ALL ABOVE GROUND PIPING WITH ½" THICK FIBERGLASS PIPE INSULATION WITH VAPOR PROOF JACKET, TAPED JOINTS AND PVC FITTING COVERS. EXPOSED PIPING SHALL BE COVERED WITH PVC PIPE COVER AND PAINTED. (1) - COAT PRIMER, (2) COATS - PAINT. COLOR AS DIRECTED BY ARCHITECT
			COMPRESSED AIR PIPING, SCHEDULE 40 GALVANIZED STEEL WITH SCREWED JOINTS AND FITTINGS A120 STANDARD WEIGHT.
			FORCED SANITARY MAIN PIPE, COPPER TYPE "L" WITH LEADFREE SOLDER JOINTS.
			COMPRESSED AIR QUICK DISCONNECT FITTINGS. COORDINATE EXACT SIZE AND TYPE WITH FIRE DEPARTMENT.
	POTTER ROEMER	4065	TRUCK FILL ANGLE HOSE VALVE, 2 ½" POLISHED CHROME. WITH (½" OR ¾") HOSE ADAPTER FITTING AS APPROVED BY FIRE DEPARTMENT PRIOR TO INSTALLATION.
	NIBCO		BALL VALVE, BRONZE BODY, FULL PORT.
			TRAP
	HANNY	818-25-26B	WATER HOSE REEL, HEAVY-DUTY SERIES 800, ¾" ID HOSE - 70 FEET LENGTH FLEX TROL, 1000 PSI, ¾" HOSE CONNECTION WITH MOUNTING BRACKETS, HOSE INLET KIT, HOSE STOP KIT AND NOZZLE (AS SELECTED BY FIRE COMPANY). EXACT LOCATION AND MOUNTING HEIGHT AS DIRECTED BY ARCHITECT.
	T4S BRASS	MY-0711-12N-BV	WASHDOWN STATION ¾" HOT & COLD WITH CHECKVALVES, BALL VALVES, STAINLESS STEEL HOSE RACK, ¾" OUTLET HOSE CONNECTION.
	HANNY	N716-19-20-10-5J	COMPRESSED AIR HOSE REEL, HEAVY-DUTY SERIES N700, ¾" ID HOSE - 50 FEET LENGTH, 3000 PSI, ½" HOSE CONNECTION WITH MOUNTING BRACKETS, HOSE INLET KIT, HOSE STOP KIT AND QUICK DISCONNECT AIR FITTING (AS SELECTED BY FIRE COMPANY). EXACT LOCATION AND MOUNTING HEIGHT AS DIRECTED BY ARCHITECT.
	COXREELS	C-L-350-5012-A	DUAL PURPOSE HOSE REELS C-SERIES - COMPRESSED AIR/ELECTRIC HOSE REEL. SPRING DRIVEN, ¾" ID HOSE - 50 FEET LENGTH, 300 PSI. ELECTRIC CORD 12/3 - 50 FEET SINGLE INDUSTRIAL RECEPTACLE - 20 AMP. ½" HOSE CONNECTION WITH MOUNTING BRACKETS, HOSE INLET KIT, HOSE STOP KIT AND QUICK DISCONNECT AIR FITTING (AS SELECTED BY FIRE COMPANY). EXACT LOCATION AND MOUNTING HEIGHT AS DIRECTED BY ARCHITECT.
	SA	Z-1700 SERIES	WATER HAMMER ARRESTER, STAINLESS STEEL CONSTRUCTION, PRESSURIZED COMPRESSION CHAMBER, COMPLIANT WITH FDI STANDARD WH-201.
	AMERICAN STANDARD	3351.101	AFWall EL 120 ELONGATED WALL HUNG FLUSH VALVE TOILET. VITREOUS CHINA, DIRECT-FED SIPHON JET, ½" TOP SPUD INLET, OPEN FRONT SEAT LESS COVER, AND WALL MOUNT CARRIER. COLOR AS DIRECTED BY ARCHITECT. INSTALL FIXTURE IN ACCORDANCE WITH ANSI A117.1 AND ADA STANDARDS FOR HANDICAP ACCESSIBILITY.
	SLOAN	111-128 ES-6	EXPOSED SENSOR OPERATED WATER CLOSET FLUSHOMETER, LOW CONSUMPTION (1.6 GPF) WITH EL-154 TRANSFORMER (120 VAC / 24 VAC).
	AMERICAN STANDARD	3351.101	AFWall EL 120 ELONGATED WALL HUNG FLUSH VALVE TOILET. VITREOUS CHINA, DIRECT-FED SIPHON JET, ½" TOP SPUD INLET, OPEN FRONT SEAT LESS COVER, AND WALL MOUNT CARRIER. COLOR AS DIRECTED BY ARCHITECT.
	SLOAN	111-128 ES-6	EXPOSED SENSOR OPERATED WATER CLOSET FLUSHOMETER, LOW CONSUMPTION (1.6 GPF) WITH EL-154 TRANSFORMER (120 VAC / 24 VAC).
	AMERICAN STANDARD	6504.001	WASHBROOK URINAL CONSTRUCTED OF VITREOUS CHINA, TOP SPUD LOW CONSUMPTION (0.5 GPF). COLOR AS DIRECTED BY ARCHITECT. INSTALL IN ACCORDANCE WITH ANSI A117.1 AND ADA STANDARDS FOR HANDICAP ACCESSIBILITY
	SLOAN	186-0.5 ES-5	EXPOSED SENSOR OPERATED URINAL FLUSHOMETER, LOW CONSUMPTION (0.5 GPF) WITH EL-154 TRANSFORMER (120 VAC / 24 VAC).
	AMERICAN STANDARD	6504.001	WASHBROOK URINAL CONSTRUCTED OF VITREOUS CHINA, TOP SPUD LOW CONSUMPTION (0.5 GPF). COLOR AS DIRECTED BY ARCHITECT.
	SLOAN	186-0.5 ES-5	EXPOSED SENSOR OPERATED URINAL FLUSHOMETER, LOW CONSUMPTION (0.5 GPF) WITH EL-154 TRANSFORMER (120 VAC / 24 VAC).
			SOLID SURFACE COUNTERTOP WITH INTEGRAL SINK
	SLOAN	ETF-600	OPTIMA ELECTRONIC HAND WASHING FAUCET 0.5 GPM VANDAL RESISTANT SPRAY HEAD. SENSOR ACTIVATED WITH 4" DECK PLATE, SOLID BRASS SOLENOID, PLUS-IN TRANSFORMER 120 VAC / 12 VDC. THERMOSTATIC MIXING VALVE, KEY OPERATED STOPS, IT GAUGE P-TRAP W/CLEANOUT AND GRID STRAINER. IPS TRUEBRO LAV GUARD INSULATION KIT. INSTALL IN ACCORDANCE WITH ANSI A117.1 AND ADA STANDARDS FOR HANDICAP ACCESSIBILITY - 120 VAC/24 VAC.
	AMERICAN STANDARD	0355.034	LUCERNE HAND HUNG LAVATORY VITREOUS CHINA, ADA, 4" CENTERS FAUCET HOLES, EXTRA RIGHT HAND HOLE. FLOOR MOUNTED CONCEALED ARM SUPPORT CARRIER, SOAP DISPENSER CHROME, CHROME OFFSET GRID DRAIN WITH OVERFLOW AND IT GAUGE TRAP, CHROME WATER SUPPLIES AND KEY OPERATED STOPS, IPS TRUEBRO LAV GUARD INSULATION KIT. INSTALL IN ACCORDANCE WITH ANSI A117.1 AND ADA STANDARDS FOR HANDICAP ACCESSIBILITY.
	ZURN	Z1231	CONCEALED ARM SUPPORT CARRIER FOR WALL LAVATORIES.
	SLOAN	ETF-600	OPTIMA ELECTRONIC HAND WASHING FAUCET 0.5 GPM VANDAL RESISTANT SPRAY HEAD. SENSOR ACTIVATED WITH 4" DECK PLATE, SOLID BRASS SOLENOID, PLUS-IN TRANSFORMER 12

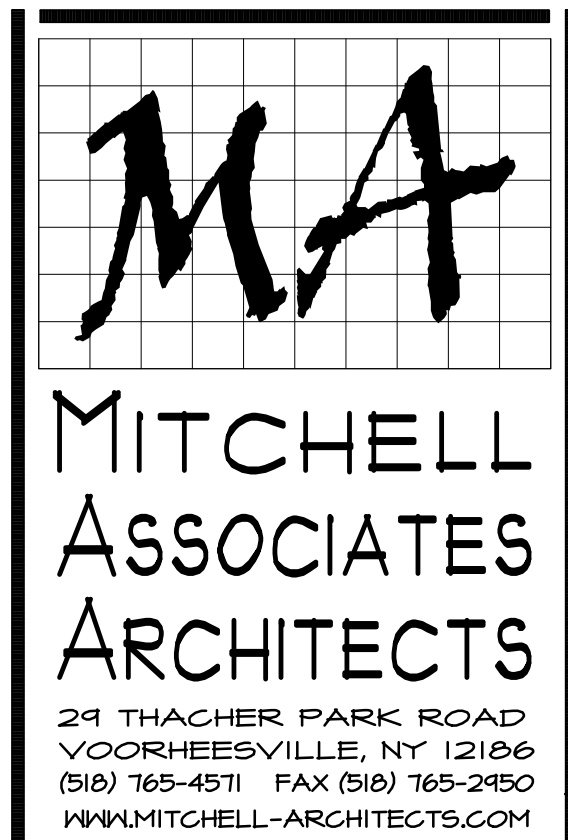

EMERGENCY
SERVICE
FACILITIES

CONSULTANTS:

**INSITE ENGINEERING SURVEYING
& LANDSCAPE ARCHITECTURE, P.C.**
3 GARRET PLACE
CARMEL, NY 10512
(845) 225-9690 FAX: (845) 225-9717

CRAIG A. MALONEY P.E.
STRUCTURAL ENGINEERING CONSULTANT
3 BENEDICT COURT
BALLSTON SPA, NY 12020
(518) 584-9444 FAX: (518) 584-9455

GERARD ASSOCIATES
CONSULTING ENGINEERS, P.C.
MECHANICAL, PLUMBING
AND ELECTRICAL
223 MAIN STREET
GOSHEN, NY 10924
(845) 291-1272
GAC9011

[illegible]

COPYRIGHT 2012
MITCHELL ASSOCIATES ARCHITECTS
UNAUTHORIZED ALTERATION OR ADDITION
TO THIS DOCUMENT IS A VIOLATION OF LAW

NEW STATION
FOR
PUTNAM VALLEY
FIRE STATION #1

OSCAWANA LAKE ROAD
PUTNAM VALLEY, NEW YORK

REVISION HISTORY		
	DATE	DESCRIPTION
1		
2		
3		
4		
5		
6		
7		
8		

PLUMBING:
EQUIPMENT
SCHEDULES

SCALE: AS NOTED
DWG. BY: KC
DWG. DATE: 12/16/2020
STATUS: HEALTH DEPARTMENT

