



KLS
ARCHITECT

Restaurant Depot / BREWSTER, NY

BREWSTER NY 10509

THESE DOCUMENTS CONTAIN INFORMATION PROPRIETARY TO ADA ARCHITECTS, INC.
UNAUTHORIZED USE OF THESE DOCUMENTS IS EXPRESSLY PROHIBITED UNLESS AGREED UPON IN WRITING.

DANBURY ROAD LOT 48 | BLOCK 0002

REVISIONS


#	DATE	TYPE
1		
2		
3		
4		
5		
6		
7		
8		
9		
10		

ROOF PLAN - GAS
PIPING

DATE: 9/10/2020

JOB NO. 19230

P1.2
SHEET NO.

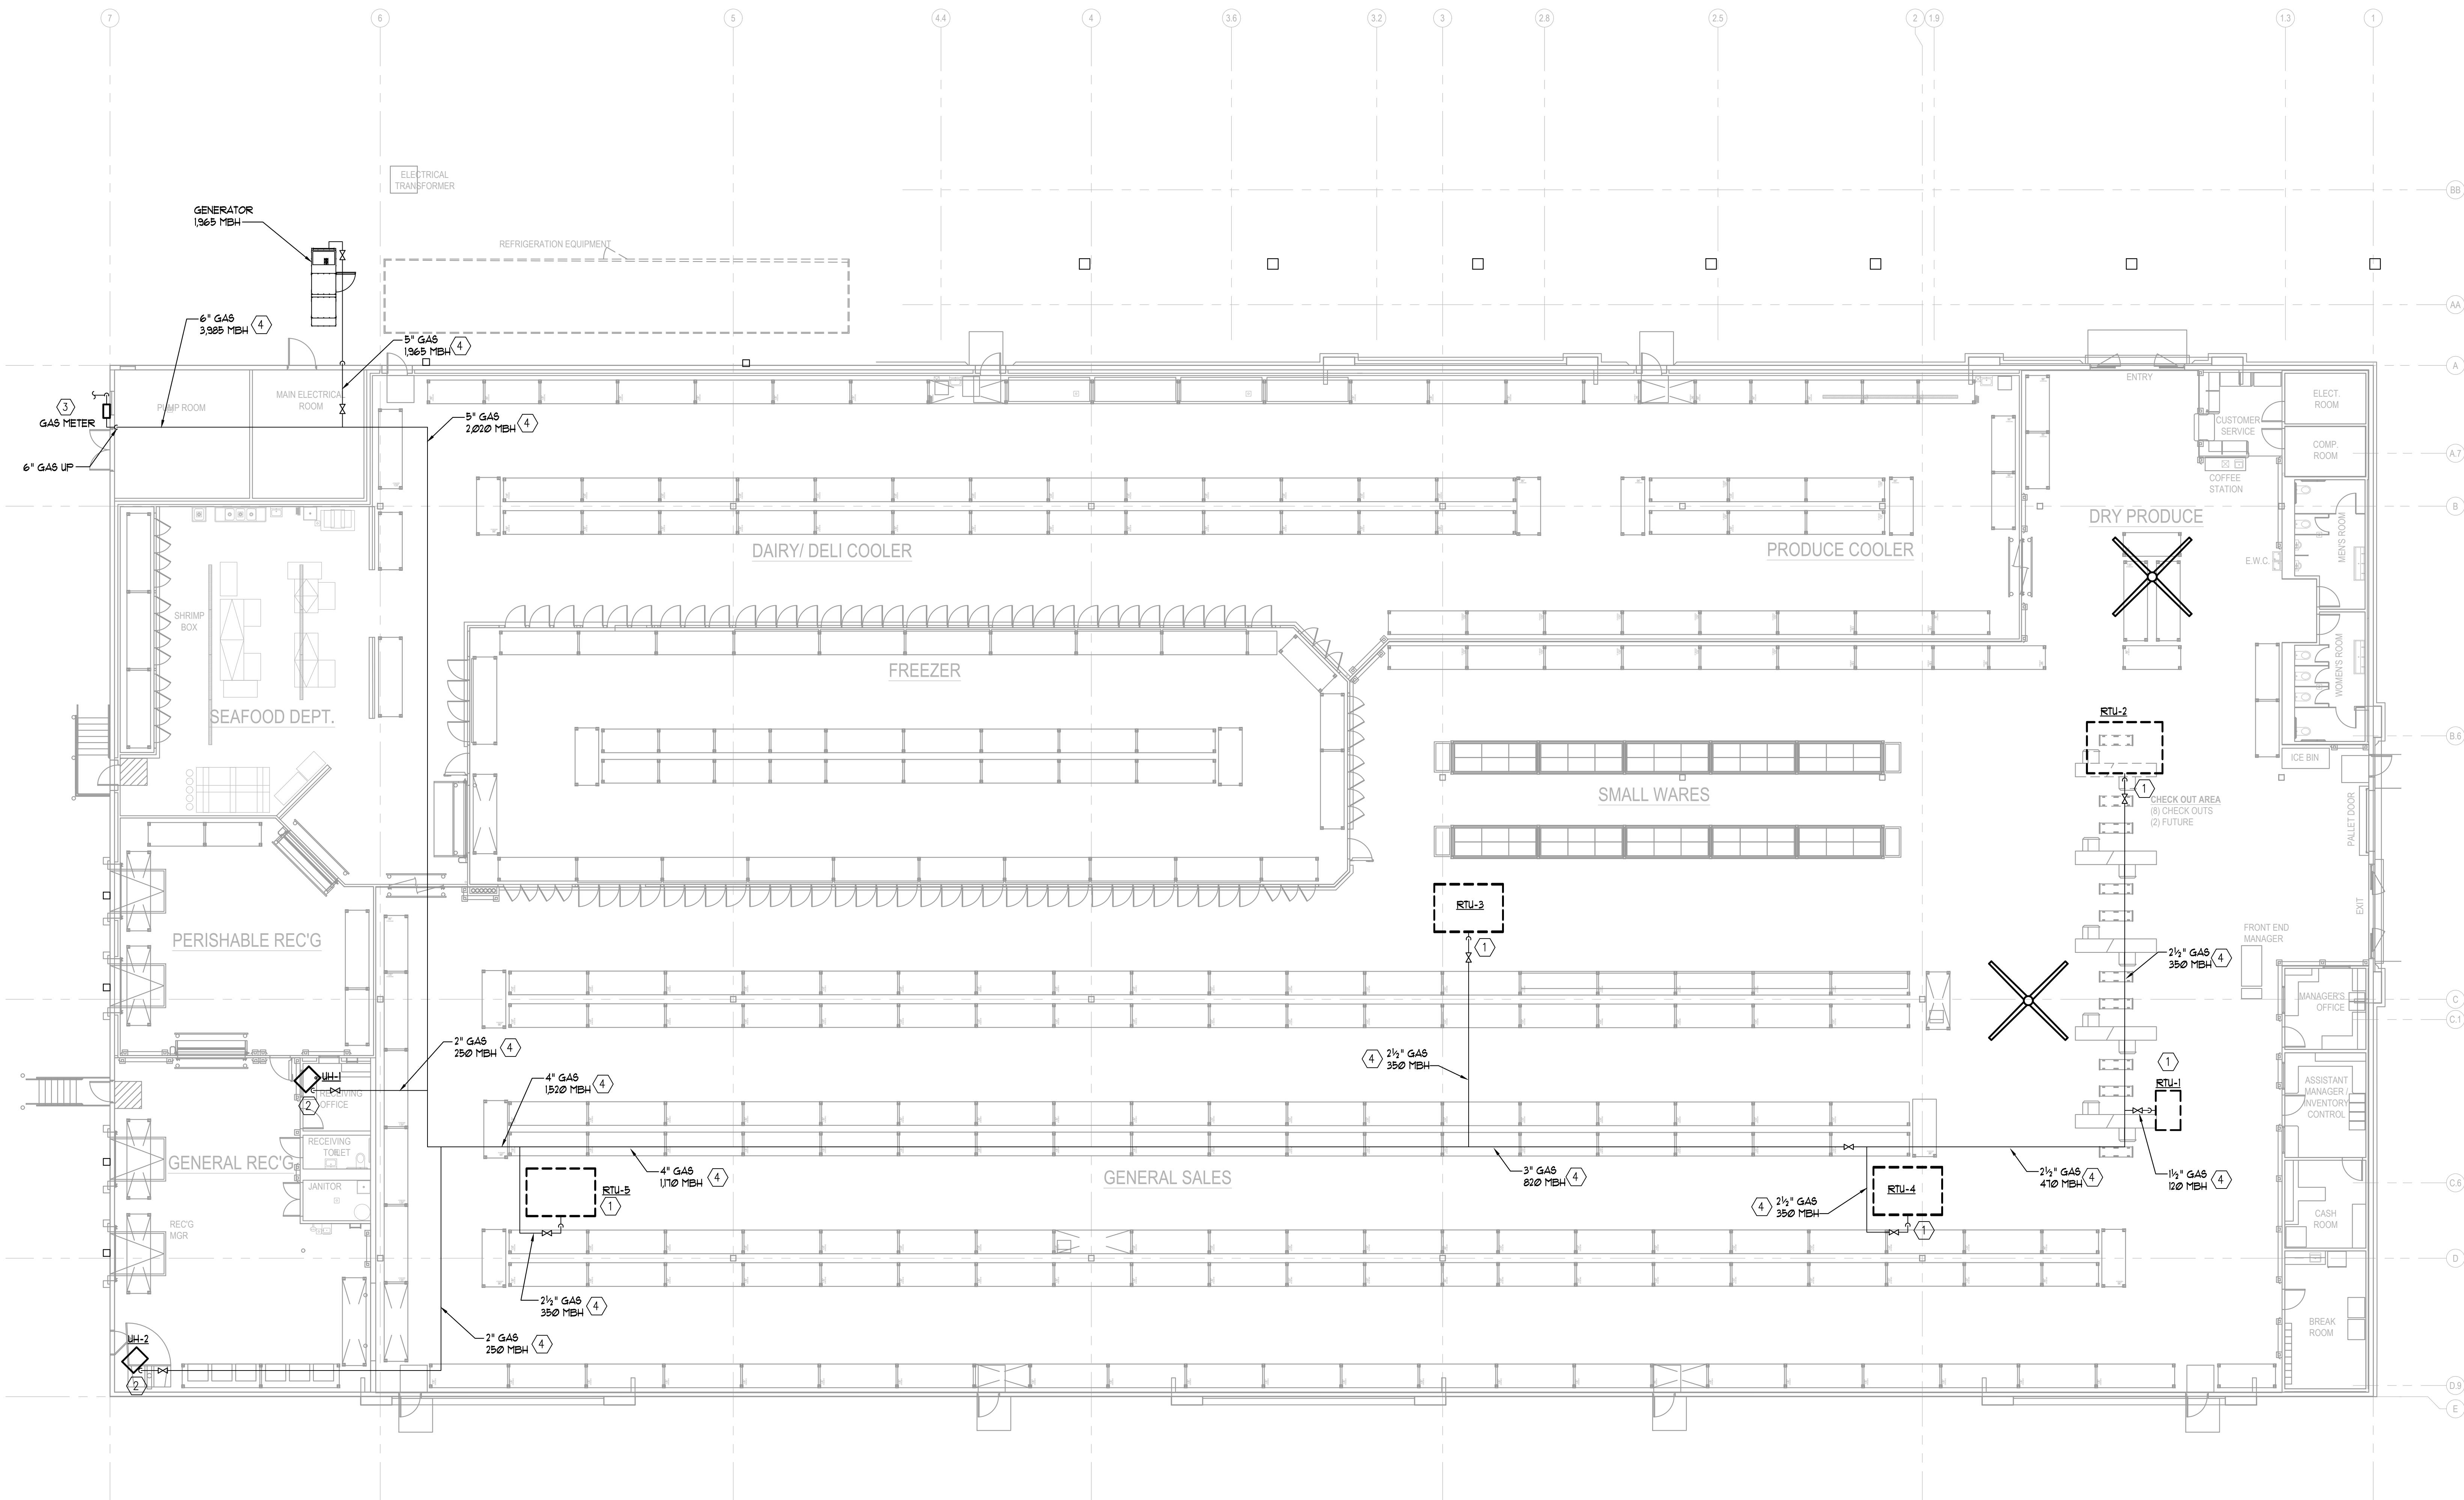

1 ROOF PLAN — GAS PIPING
P1.2 3/32" = 1'-0"

KEY NOTES
(APPLIES THIS SHEET ONLY)

1. ROUTE GAS PIPE UP THROUGH ROOF AND CONNECT GAS PIPE TO RTU WITH GAS COCK, PRESSURE REGULATOR, AND DIRT LEG. REFER TO 11/M7.2.
2. CONNECT GAS PIPE TO UNIT HEATER WITH GAS COCK, PRESSURE REGULATOR, AND DIRT LEG. REFER TO 10/M7.2.
3. COORDINATE EXACT GAS METER LOCATION WITH ARCHITECT AND GAS COMPANY. METER SHALL BE CAPABLE OF PROVIDING 3,985 CFH AT LOW PRESSURE DEVELOPED LENGTH 500 FT. CONTRACTOR TO PROVIDE CORRECT METER AND REGULATOR SIZE TO MEET CFH REQUIREMENTS. MAKE CONNECTION TO METER WITH GAS COCK AND DIRT LEG.
4. GAS PIPING ROUTED IN JOIST AND SHALL BE LOW PRESSURE. PIPE SHALL BE RUN ABOVE THE BOTTOM CHORD OF THE JOISTS AND SUPPORTED FROM THE TOP CHORD.