



















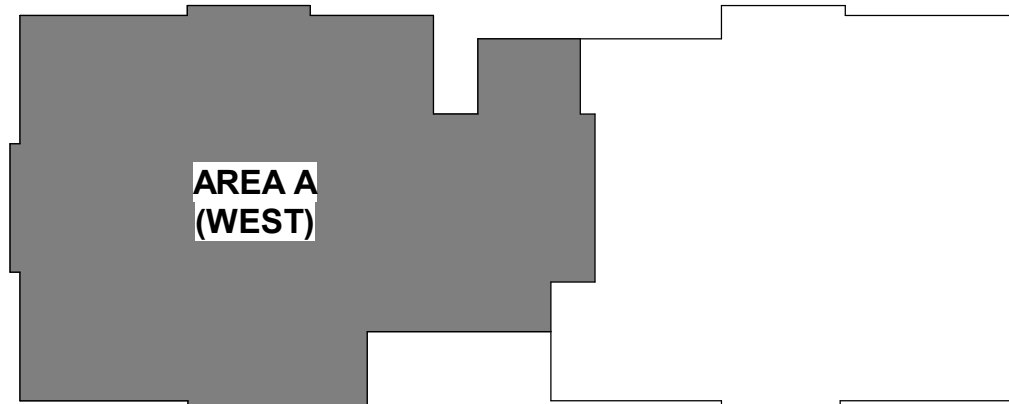


## LIGHTING FIXTURES LEGEND

	2X4 FIXTURE - RECESSED, SURFACE, OR PENDANT MOUNTED - TYPE AS SPECIFIED
	2X4 LIFE SAFETY BRANCH FIXTURE - RECESSED, SURFACE, OR PENDANT MOUNTED - TYPE AS SPECIFIED
	1X4 FIXTURE - RECESSED, SURFACE, OR PENDANT MOUNTED - TYPE AS SPECIFIED
	1X4 LIFE SAFETY BRANCH FIXTURE - RECESSED, SURFACE, OR PENDANT MOUNTED - TYPE AS SPECIFIED
	LIGHTING FIXTURE - RECESSED OR SURFACE MOUNTED - TYPE AS SPECIFIED
	LIFE SAFETY BRANCH LIGHTING FIXTURE - RECESSED OR SURFACE - TYPE AS SPECIFIED
	LIGHTING FIXTURE - PENDANT MOUNTED - TYPE AS SPECIFIED
	LIFE SAFETY BRANCH LIGHTING FIXTURE - PENDANT - TYPE AS SPECIFIED
	WALL MOUNTED - TYPE AS SPECIFIED
	LIFE SAFETY BRANCH WALL FLUSH MOUNTED - TYPE AS SPECIFIED
	EXIT SIGN - CEILING MOUNTED - TYPE AS SPECIFIED
	EXIT SIGN - WALL MOUNTED - TYPE AS SPECIFIED
	SINGLE-POLE, 3-WAY SWITCHES (48°AFF)
	LOCAL WALL DIMMER SWITCH (48° AFF)
	FAN SWITCH (48° AFF)
	WALL MOUNTED OCCUPANCY SENSOR SWITCH; DUAL TECHNOLOGY (PASSIVE INFRARED/ULTRASONIC)
	CEILING MOUNTED DAYLIGHT SENSOR
	CEILING MOUNTED OCCUPANCY/VACANCY SENSOR; DUAL TECHNOLOGY (PASSIVE INFRARED/ULTRASONIC)
	ROOM CONTROLLER (REFER TO PLANS)
	EMERGENCY RELAY (REFER TO PLANS)

- A. CONTRACTOR SHALL BE RESPONSIBLE FOR IDENTIFICATION OF ALL RATED WALLS, CEILINGS AND SLABS AND THEIR SPECIFIED RATING. ON ARCHITECT'S REQUEST, CONTRACTOR SHALL PROVIDE MATERIALS SHALL MEET THE UL RATING OF THE RATED WALLS, CEILINGS AND SLABS ASSEMBLY. CONTRACTOR SHALL PROVIDE ALL MATERIALS INSTALLED IN ACCORDANCE WITH THE RATED APPLICATION.
- B. ALL OCCUPANCY/VACANCY SENSORS SHALL TURN OFF WITHIN 20 MINUTES OF THE SPACE BECOMING UNOCCUPIED.
- C. OCCUPANCY SENSORS SHALL FAILSAFE "ON".
- D. ALL COMMON AREAS SHALL BE CONTROLLED VIA LCP - LIGHTING CONTROL PANEL FOR DIMMING CONTROL OF THE LIGHTING. FOR STAFF AREAS, THE FACILITY COMMON AREAS SHALL REMAIN "ON 247". THE LIGHTING CONTROL PANEL WILL DIM THE LIGHTING DOWN TO 30% WHEN NO MOTION IS DETECTED IN THE SPACE. WHEN CEILING SENSORS DETECT MOTION, THE LIGHTING WILL DIM UP TO 100%.
- E. WHERE MULTIPLE SWITCHES ARE SHOWN AT THE SAME LOCATION, THEY SHALL BE GANGED TOGETHER WITH A COMMON GANG SWITCH AND ONE LINE VOLTAGE SWITCH SHALL BE A PUSH BUTTON TYPE WITH OTHERWISE NOTED.
- F. FOR EACH EXIT SIGN, CONTRACTOR SHALL PROVIDE UN-SWITCHED HOT FROM A SAFETY CIRCUIT.
- G. FIXTURES INDICATED WITH "A" SHALL BE CONTROLLED VIA "DS" DAYLIGHT SENSING. FIXTURE SHALL BE MOUNTED AT 10' ABOVE FINISH FLOOR.
- H. FIXTURE "Q" SHALL AIM TO ART ON WALL. COORDINATE EXACT LOCATION AND AIMING WITH ARCHITECT AND OWNER.
- I. WALL SCONCES INDICATED WITH AN "H" SHALL BE MOUNTED 58" AFF AND VARYING FIXTURE INDICATED WITH "B" SHALL BE MOUNTED 90" AFF UNLESS OTHERWISE NOTED.

- 1 MOUNT SCONCE AT EVERY UNIT ENTRY DOOR AT THE LATCH SIDE BY 10" OFF CENTER FROM THE EDGE OF THE DOOR.
- 2 TIE NEW LIGHTING FIXTURE TO EXISTING CORRIDOR LIGHTING CIRCUIT FROM BUILDING #6 IN THIS AREA.
- 3 THE DESIGN INTENT IS TO REMOVE ALL EXISTING LIGHTING FIXTURES IN THIS CORRIDOR. MAINTAIN EXISTING LIGHTING CIRCUIT AND CONTROLS FOR NEW WORK. LIGHT FIXTURES SHOWN ARE NEW FIXTURES.
- 4 TIE UPGRADED LIGHTING FIXTURE'S CIRCUIT TO EXISTING BUILDING 6'S LIGHTING CIRCUIT PREVIOUSLY SERVICING SPACE. MAINTAIN EXISTING CONTROLS.



Project Number	620-334
Building Number	CLC
Drawing Number	EL101A