



THESE DRAWINGS AND DESIGNS ARE THE PROPERTY OF STINARD ARCHITECTURE, INC. AND SHALL NOT BE REPRODUCED OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, ELECTRONIC OR MECHANICAL, WITHOUT THE WRITTEN PERMISSION OF STINARD ARCHITECTURE, INC. THESE DRAWINGS ARE TO BE USED IN CONJUNCTION WITH THE ISSUED PERMIT. ANY CHANGES TO THE DESIGN OR CONSTRUCTION SHALL BE THE RESPONSIBILITY OF THE ARCHITECT. THE ARCHITECT DOES NOT WARRANT OR GUARANTEE THE ACCURACY OF THE INFORMATION PROVIDED HEREON. THE ARCHITECT SHALL NOT BE RESPONSIBLE FOR ANY DISCREPANCIES BETWEEN THE DRAWINGS AND THE CONSTRUCTION. DO NOT SCALE DRAWINGS.

Life Storage #230
Self Storage Phase II
1639 Route 22
Brewster, NY 10509



ISSUE: FOR CONSTRUCTION
REVISIONS:

PROJECT NUMBER	201941
DATE	6-5-20


SHEET NUMBER
M1.2

GENERAL NOTES

- A. EACH SUPPLY DIFFUSER/REGISTER RUNOUT SHALL BE PROVIDED WITH A VOLUME DAMPER. REFER TO THE DIFFUSER TAKE-OFF DETAIL FOR ADDITIONAL INFORMATION.
- B. DRAWINGS ARE DIAGRAMMATIC ONLY; FINAL ROUTING OF DUCTWORK AND EQUIPMENT LOCATIONS SHALL BE DETERMINED IN THE FIELD. ADDITIONAL OFFSETS, ELBOWS, ETC. SHALL BE PROVIDED AND INSTALLED WITHOUT ADDITIONAL COST TO THE OWNER.
- C. ALL DUCTWORK SHALL BE INSTALLED AS HIGH AS POSSIBLE (MINIMUM ELEVATION, 8'-4" ABOVE FINISHED FLOOR).
- D. MAINTAIN A MINIMUM CLEARANCE OF 1'-0" BETWEEN FLUE DISCHARGE AND MECHANICAL AIR INTAKES.

KEYNOTES

- ① REFER TO CONDENSATE RISER DIAGRAM ON SHEET NO.2.

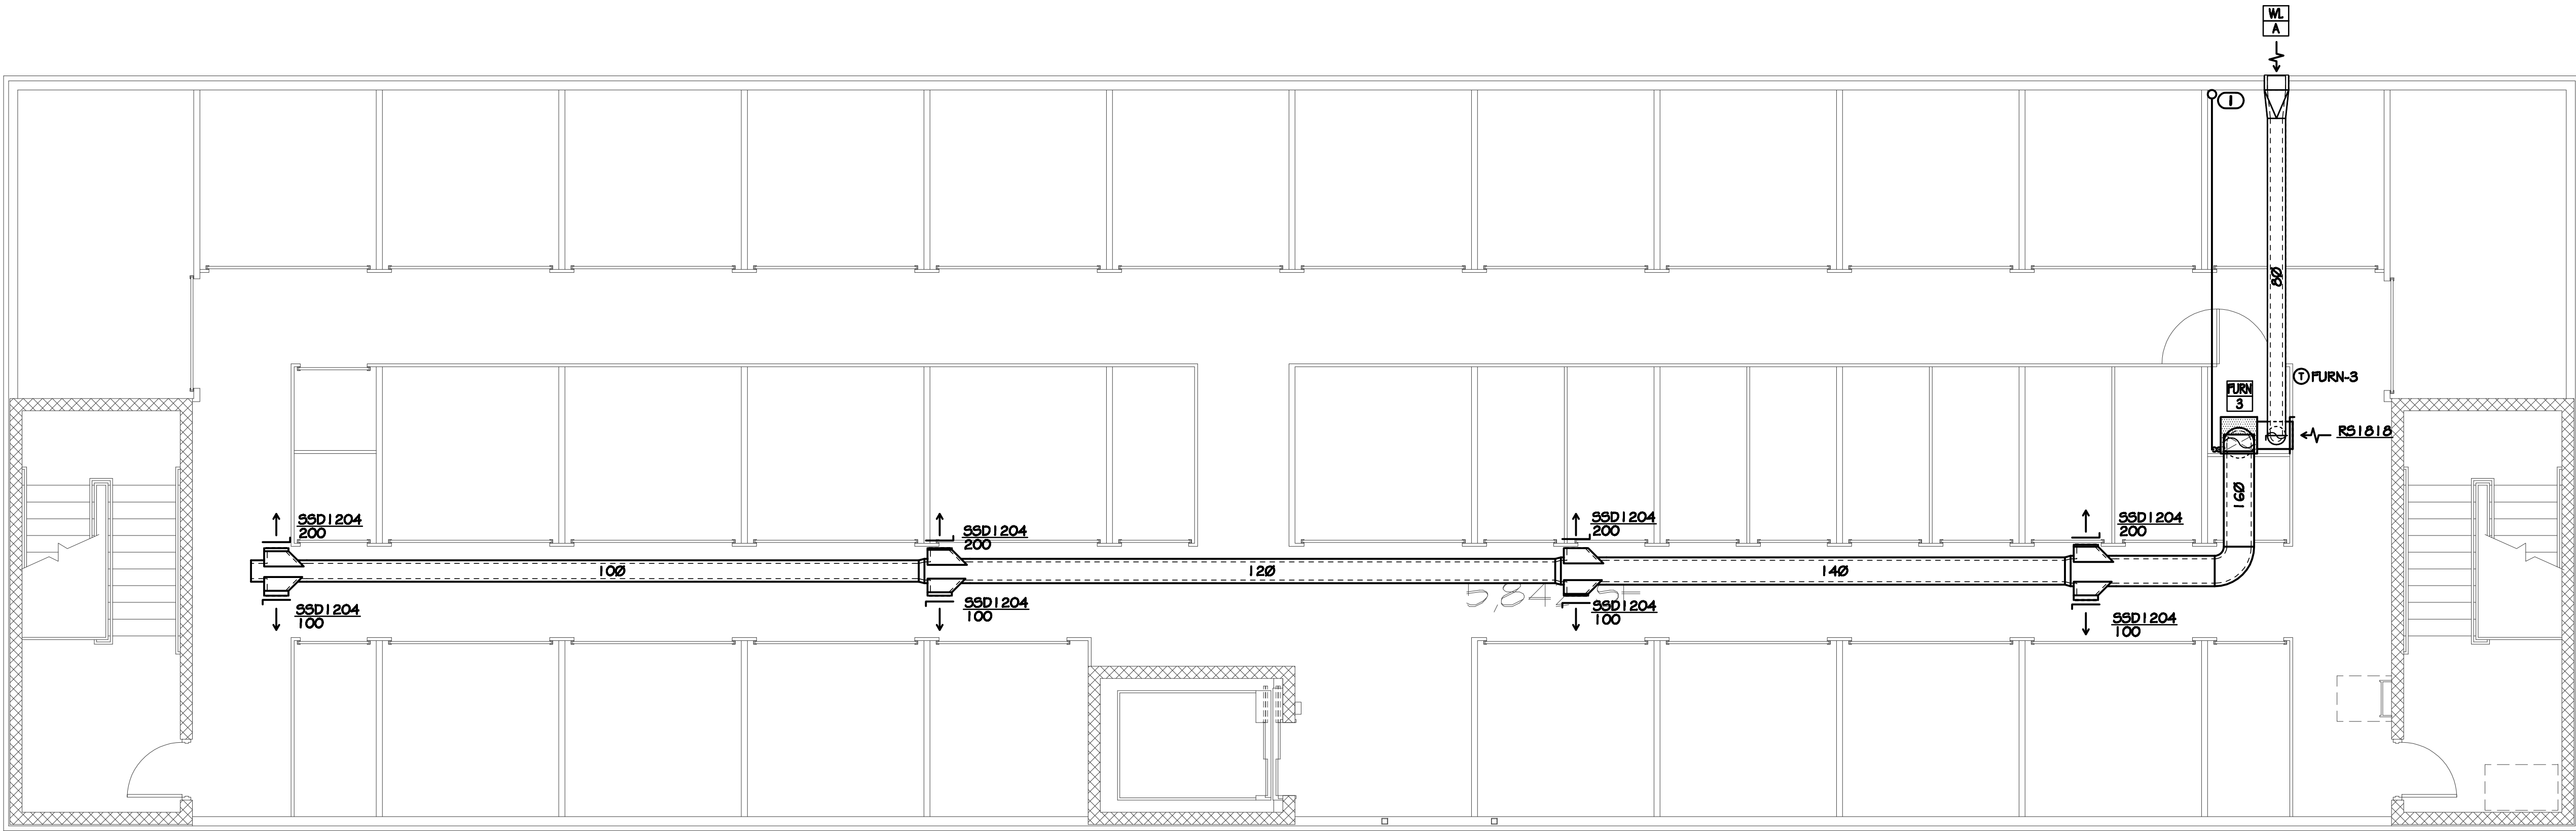

SECOND FLOOR PLAN
SCALE: 3/16" = 1'-0"