



1 2 3 4 5 6 7 9 10 11 12 13 14 15 16 17 18

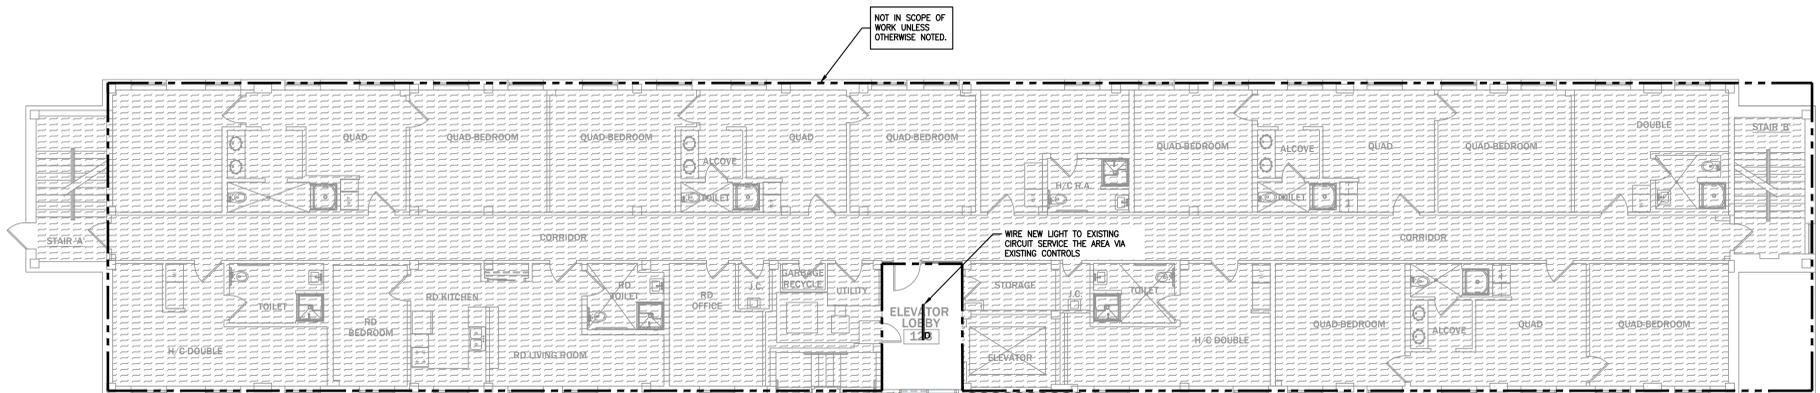


A
B
C
D
F

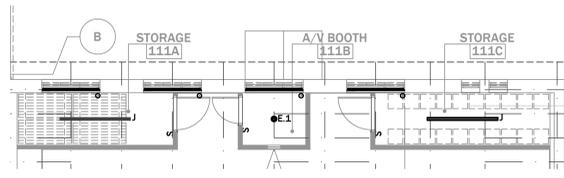

BOOTH / STORAGE LIGHTING PLAN
SCALE: 1/8"=1'-0"

LIGHTING NOTES:

1. ALL BATTERY PACKS AND EXIT SIGNS ARE TO BE CIRCUITED TO THE UNSWITCHED LEG OF THE LOCAL LIGHTING CIRCUIT.
2. ALL LIGHTING FIXTURE LOCATIONS AND MOUNTING HEIGHTS ARE TO BE COORDINATED WITH THE ARCHITECTURAL DRAWINGS.
3. LIGHTING CIRCUIT NUMBERS AND PANELS ARE SHOWN ON PLANS, UNLESS OTHERWISE NOTED.
4. ALL LIGHTING CONTROL SWITCHES SHALL BE GANGED TOGETHER, HAVE A COMMON FACE PLATE AND BE LABELED WITH THE AREA OF CONTROL.
5. ALL OCCUPANCY SENSORS IN A SPACE ARE TO BE INTERCONNECTED SUCH THAT ALL LIGHTING FIXTURES WITHIN THE SPACE ARE TURNED ON WHEN ANY OCCUPANCY SENSOR IS ACTIVATED, UNLESS OTHERWISE NOTED.
6. CONTRACTOR SHALL PROVIDE A MANUALLY CONTROLLED OVERRIDE WALL SWITCH FOR ROOM OCCUPANCY SENSORS.
7. ALL EMERGENCY LIGHTING AND EXIT SIGNS ARE CIRCUITED TO EMERGENCY PANEL AS SHOWN ON PLANS, UNLESS NOTED OTHERWISE.
8. ALL LIGHTING BRANCH CIRCUIT HOMERUNS SHALL BE WIRED VIA THE BUILDING MECHANICAL CONTROL CABINET. CONTROL CABINET PROVIDED BY MECHANICAL CONTRACTOR COORDINATE CONTROL PROGRAMMING OF ALL LIGHTING CIRCUITS WITH THE ARCHITECT AND THE MECHANICAL CONTRACTOR.
9. MECHANICAL CONTRACTOR SHALL PROVIDE LOW VOLTAGE PUSHBUTTON DIGITAL SWITCH UNIT FOR PROGRAMMED OCCUPANT OVERRIDE OF AUTOMATIC LIGHTING SHUTOFF TO A MAXIMUM OF 4 HOURS (REFER TO ASHRAE/IESNA STANDARD 90.1) UNIT SHALL BE WIRED TO THE BUILDING MECHANICAL/LIGHTING CONTROL CABINET.

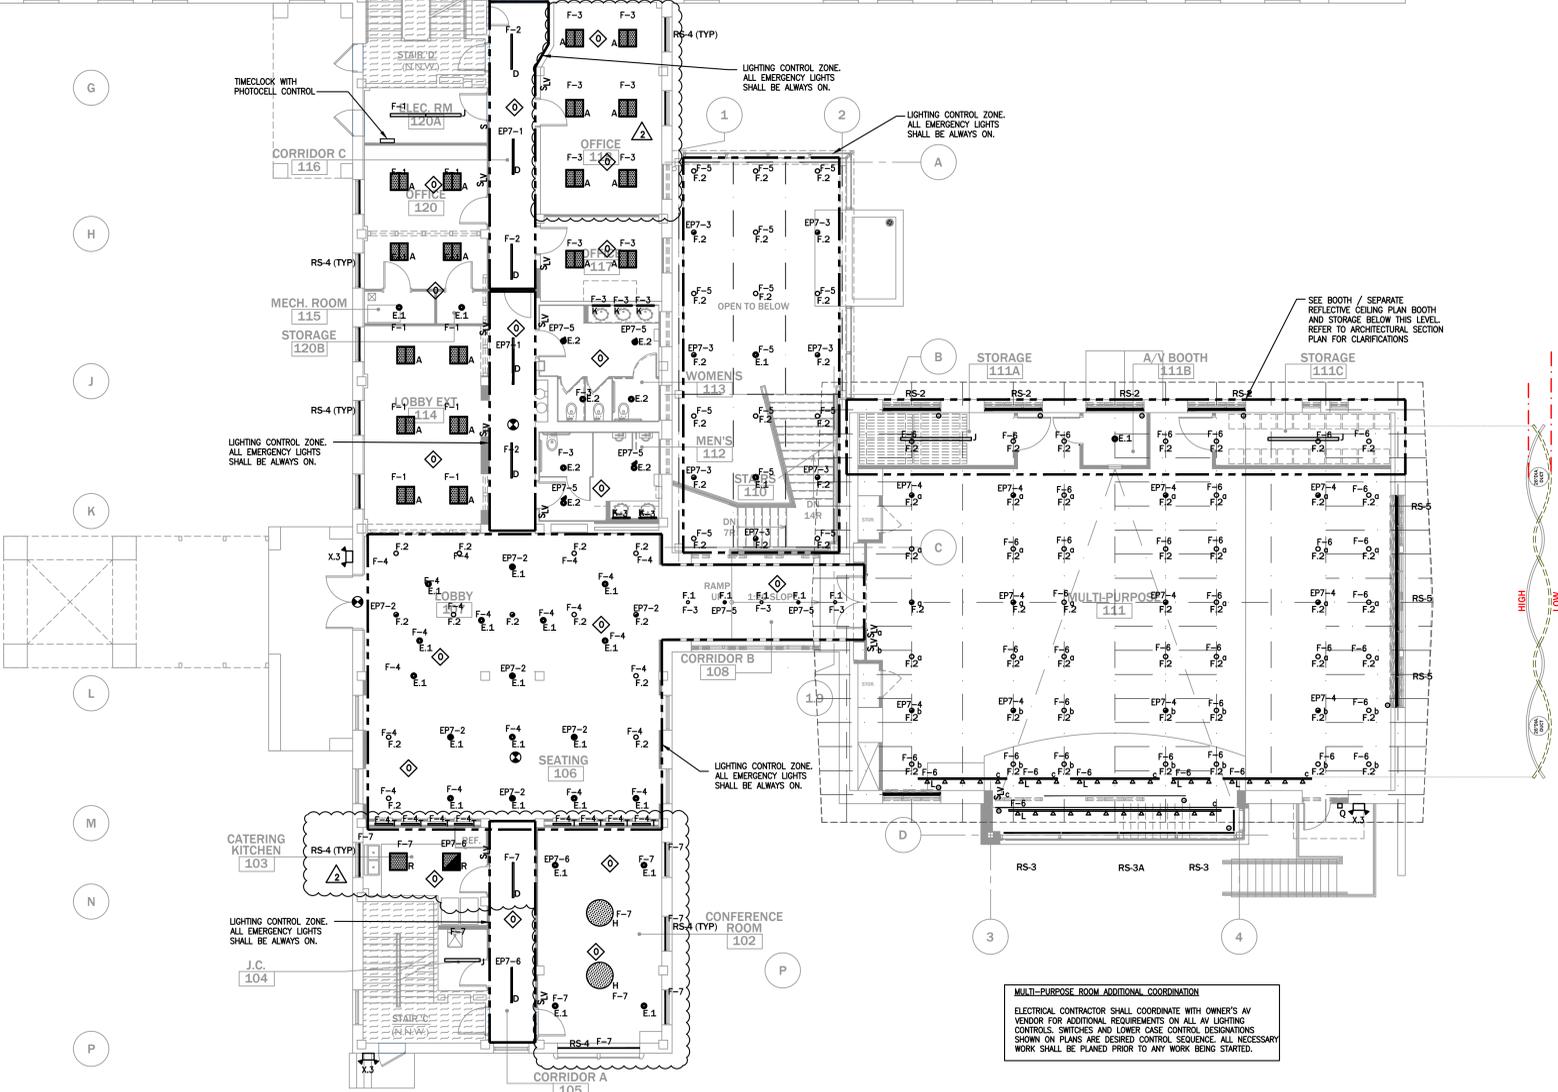


G
H
J
K
L
M
N
P

7 9 10 11

FIRST FLOOR - LIGHTING PLAN
SCALE: 1/8"=1'-0"

NOTICE
THE DELIVERY OF THIS DRAWING SHOULD NOT BE CONSTRUED TO PROVIDE AN EXPRESS WARRANTY OR GUARANTEE TO ANYONE THAT ALL THE DIMENSIONS AND DETAILS ARE EXACT OR TO INDICATE THAT THE USE OF THIS DRAWING IMPLIES THE REVIEW AND APPROVAL BY THE DESIGN PROFESSIONAL OF ANY FUTURE USE. ANY USE OF THIS INFORMATION WITHOUT THE WRITTEN APPROVAL OF THE DESIGN PROFESSIONAL IS AT THE SOLE RISK AND LIABILITY OF THE USER. THE DESIGN PROFESSIONAL RESERVES THE RIGHT TO REMOVE OUR PROFESSIONAL SEAL AND/OR TITLE BLOCK.

NOTICE
THE SCHEDULES AND DRAWINGS REPRESENT ONLY CERTAIN REQUIREMENTS OF THE PROJECT. THERE ARE ADDITIONAL REQUIREMENTS IN THE SPECIFICATIONS BOOKLET WHICH THE CONTRACTOR IS BOUND TO PROVIDE. A SUPPLIER OR CONTRACTOR'S PRICING, WHICH IS BASED ONLY ON DRAWINGS OR SCHEDULES, MAY LEAVE IMPORTANT COSTS UNACCOUNTED FOR WHICH WILL ULTIMATELY BE THE CONTRACTOR OR SUPPLIER'S RESPONSIBILITY TO PROVIDE.



KIMMEL BOGRETTE
Architecture + Site

482 Norriswood Road, Suite 200
Blue Bell, PA 19422
Phone: 610.834.7805
Facsimile: 610.834.7815

© COPYRIGHT 2021 KIMMEL BOGRETTE ARCHITECTURE + SITE, INC. ALL RIGHTS RESERVED.



McHUGH
ENGINEERING ASSOCIATES INC.

188 Pine Street, Suite 300
Plymouth Meeting, PA 19068
Phone: 610.261.1100
Fax: 610.261.1101

MOUNT SAINT MARY COLLEGE, GUZMAN HALL
COMMUNITY WELLNESS CENTER

330 POWELL AVE.
NEWBURGH, NY 12550

Construction Issue Date:	Drawn By: AFMTZ/PR	Checked By:	Scale: AS NOTED
Sheet Name: FIRST FLOOR PLAN - LIGHTING - ELECTRICAL	Progress Prints:	Bid Set: 08/09/21	
Revisions:			
1			
2			
3			

E1.2