

STORAGE PLAN (ALTERNATE)

SCALE: 1/8"=1'-0"

GENERAL PLUMBING NOTES:

1. COORDINATE ALL BELOW GRADE PLUMBING PIPING WITH FOUNDATION ELEVATIONS AND SITE UTILITY INVERTS. VERIFY EXISTING ELEVATIONS AND INVERTS PRIOR TO CONSTRUCTION.
2. PROVIDE WATER HAMMER ARRESTORS IN CONFORMANCE WITH PDI AND LOCAL ORDINANCES AT FLUSH VALVES, LAUNDRY WASHING MACHINES (COMMERCIAL AND RESIDENTIAL), SOLENOIDS, FAST CLOSING VALVES, ETC.
3. DO NOT ROUTE PLUMBING PIPING THROUGH ELECTRICAL ROOMS, ELECTRICAL CLOSETS, OR DATA COMMUNICATION CENTERS.
4. DO NOT ROUTE PLUMBING PIPING THROUGH ELEVATOR SHAFT UNLESS PIPING IS DEDICATED TO SHAFT. DO NOT ROUTE PLUMBING PIPING THROUGH UTILITY CHASES UNLESS CHASE IS DEDICATED FOR PLUMBING SERVICES.
5. PROVIDE SHUT OFF VALVES CLOSE TO MANS ON EACH BRANCH AND RISER SERVING PLUMBING FIXTURES, CASEWORK OR EQUIPMENT. PROVIDE SHUT OFF VALVES ON EACH WATER SUPPLY TO PLUMBING FIXTURES THAT DO NOT HAVE SUPPLY STOPS.
6. PROVIDE CLOSED CELL MOLDED VINYL INSULATION ON EXPOSED LAVATORY DRAINS, TRAPS, AND SUPPLIES.
7. COORDINATE LOCATIONS OF FLOOR DRAINS AND ROOF DRAINS WITH ARCHITECTURAL PLANS.
8. PROVIDE CLEANOUTS AT THE BASE OF ALL RAINWATER CONDUCTORS AND SANITARY WASTE STACKS.
9. *ONLY APPLIES FOR EXISTING* PROVIDE NONCOMBUSTIBLE INSULATION ON ALL PLASTIC PIPING IN PLENUM SPACES. INSULATION SHALL HAVE A FLAME SPREAD RATING OF NOT MORE THAN 25 AND A SMOKE DEVELOPED RATING OF NOT MORE THAN 50 IN CONFORMANCE WITH ASTM E84.
10. ALL VENTS THROUGH THE ROOF SHALL BE MINIMALLY 10'-0" FROM OUTSIDE AIR INTAKES.
11. REFER TO DOMESTIC WATER AND SANITARY RISER DIAGRAMS FOR ADDITIONAL PIPE SIZE INFORMATION.

PLUMBING KEY NOTES:


- 1 CONTRACTOR TO FIELD VERIFY SANITARY INVERTS PRIOR TO ROUGH-IN.
- 2 COORDINATE LOCATION OF FLUSH VALVE TRANSFORMER WITH THE ELECTRICAL CONTRACTOR.
- 3 REFER TO CIVIL PLANS FOR CONTINUATION.
- 4 4" DOWNSPOUT BOOT. REFER TO DETAIL.
- 5 OFFSET BELOW FLOOR.
- 6 OFFSET IN CEILING ABOVE.
- 7 EXTEND AND CONNECT TO EXISTING VENT STACK.
- 8 PROVIDE NEW FIXTURES IN THE EXISTING LOCATIONS FOR THE RESTROOM. COORDINATE ROUGH IN.
- 9 PROVIDE ROOF DRAIN. REFER TO DETAIL. COORDINATE LOCATION WITH ARCHITECTURAL PLANS.
- 10 PROVIDE OVERFLOW ROOF DRAIN. COORDINATE LOCATION WITH ARCHITECTURAL PLANS.
- 11 OVERFLOW DISCHARGE NOZZLE. REFER TO DETAIL.
- 12 PROVIDE ICE MAKER SUPPLY BOX.

GROUND FLOOR PLAN

SCALE: 1/8"=1'-0"

THE DELIVERY OF THIS DRAWING SHOULD NOT BE CONSTRUED TO PROVIDE AN EXPRESS WARRANTY OR GUARANTEE TO ANYONE THAT ALL THE DIMENSIONS AND DETAILS ARE EXACT OR TO INDICATE THAT THE USE OF THIS DRAWING IMPLIES THE REVIEW AND APPROVAL BY THE DESIGN PROFESSIONAL OF ANY FUTURE USE. ANY USE OF THIS INFORMATION WITHOUT THE WRITTEN APPROVAL BY THE DESIGN PROFESSIONAL IS AT THE SOLE RISK AND LIABILITY OF THE USER. THE DESIGN PROFESSIONAL RESERVES THE RIGHT TO REMOVE OUR PROFESSIONAL SEAL AND/OR TITLE BLOCK.

NOTICE
THE SCHEDULES AND DRAWINGS REPRESENT ONLY CERTAIN REQUIREMENTS OF THE PROJECT. THERE ARE ADDITIONAL REQUIREMENTS IN THE SPECIFICATIONS BOOKLET WHICH THE CONTRACTOR IS BOUND TO PROVIDE. A SUPPLIER OR CONTRACTOR'S PRICING, WHICH IS BASED ONLY ON DRAWINGS OR SCHEDULES, MAY LEAVE IMPORTANT COSTS UNACCOUNTED FOR WHICH WILL ULTIMATELY BE THE CONTRACTOR OR SUPPLIER'S RESPONSIBILITY TO PROVIDE.

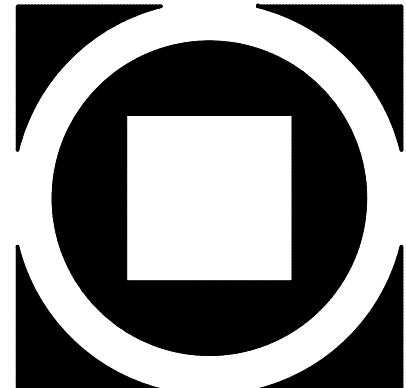

KIMMEL BOGRETTE
Architecture + Site
482 Norrisown Road, Suite 200
Blue Bell, PA 19422
Phone: 610.834.7805
Facsimile: 610.834.7815
© COPYRIGHT 2021 KIMMEL BOGRETTE ARCHITECTURE + SITE, INC. ALL RIGHTS RESERVED



MOUNT SAINT MARY COLLEGE, GUZMAN HALL
COMMUNITY WELLNESS CENTER
330 POWELL AVE.
NEWBURGH, NY 12550

Construction Issue Date:	Drawn By:	Checked By:	Scale:
AFM/PZ/PR	AFM/PZ/PR	AS NOTED	AS NOTED

Sheet Name:	Revisions:
GROUND FLOOR PLAN - PLUMBING	
Progress Prints:	
Bid Set 08/09/21	

PI.1