

**888 resorts World Dr
Monticello, NY 12701**

120 HUYSHOPE AVENUE
SUITE 400
HARTFORD, CT 06106
860.247.9226

© 2021 JCJ Architecture

CONSULTANT:

R.G. Vanderwell Engineers, LLP : 617.423.7423 TEL
274 Summer Street : 617.423.7401 FAX
Boston, MA 02210 : vanderwell.com


JOB	30860.00
-----	----------

SCALE 1/8" = 1'-0"

REVISIONS

PIPING ROOF

M-11

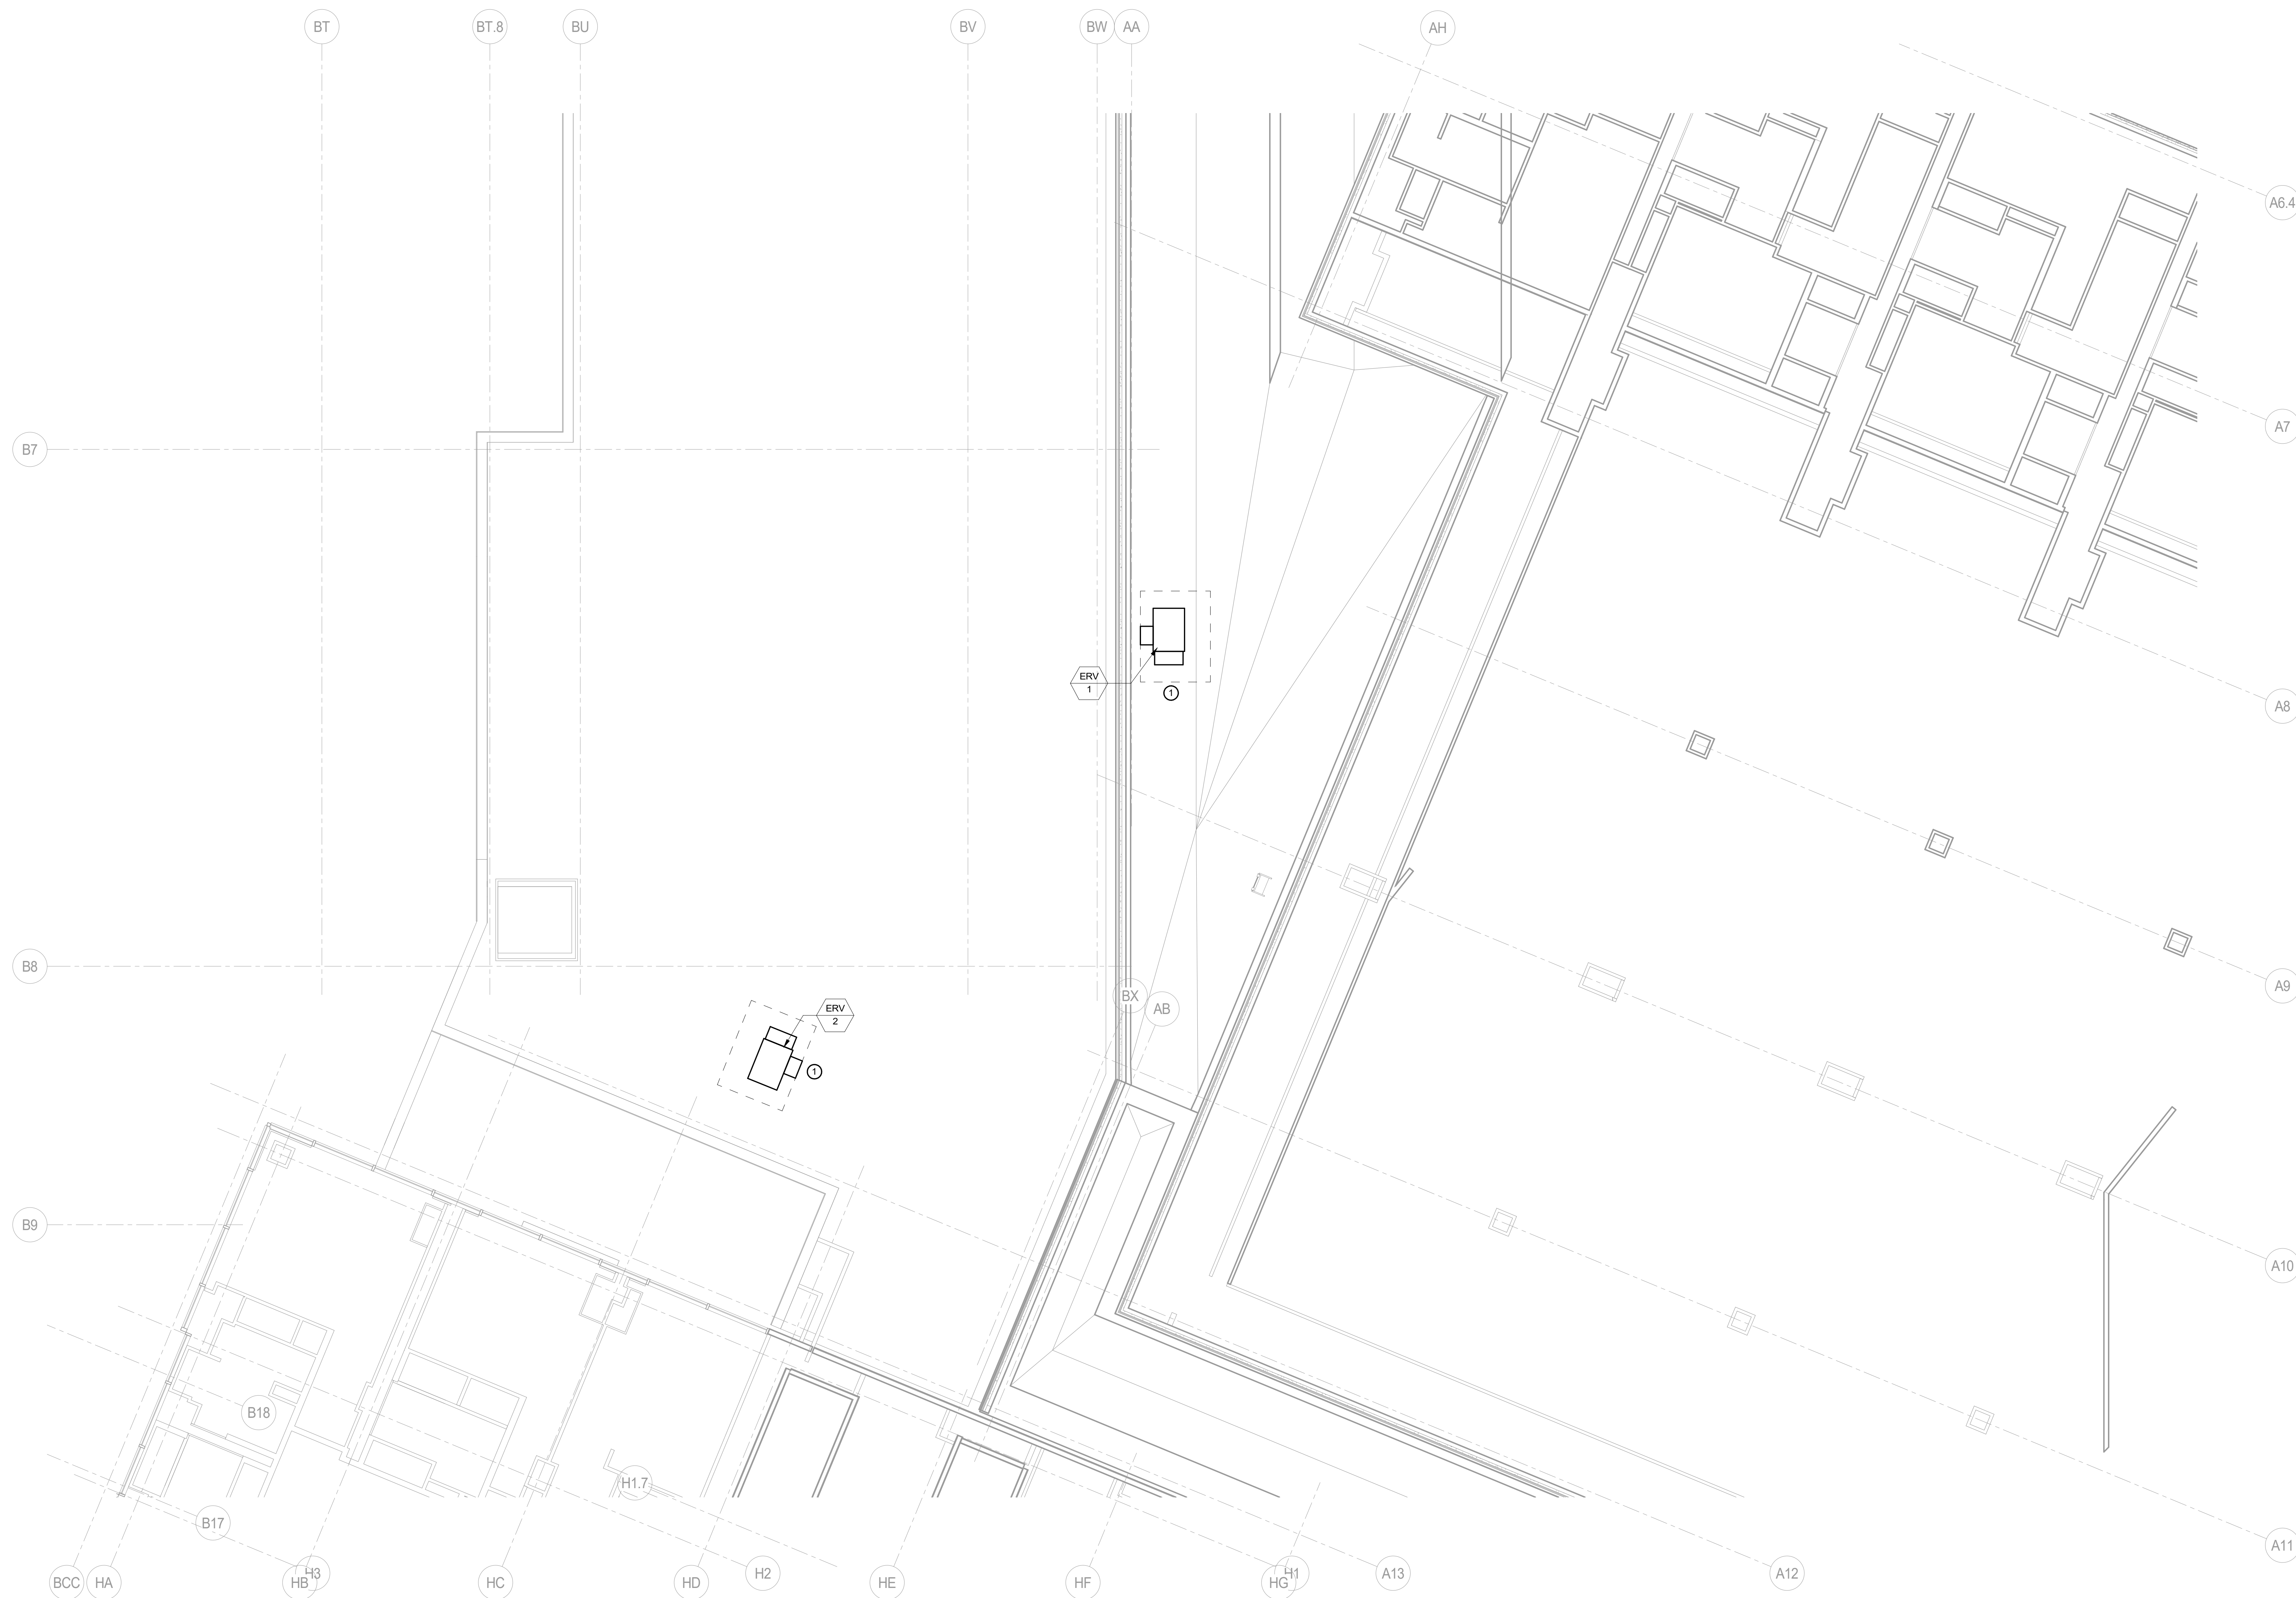

① HVAC PIPING - LOW ROOF
1/8" = 1'-0"

GENERAL NOTES:

1. ALL THERMOSTATS LOCATED ON PERIMETER WALLS & COLUMNS SHALL BE PROVIDED WITH INSULATED BACKPLATES
2. CONTRACTOR SHALL MAINTAIN BUILDING MANAGEMENT AIR QUALITY STANDARD DURING CONSTRUCTION.
3. COORDINATE ANY/ALL BASE BUILDING EQUIPMENT OR SYSTEM SHUTDOWN REQUIREMENTS WITH OWNER.

KEY NOTES:

1. COORDINATE FINAL LOCATION IN FIELD. MAINTAIN 10' CLEARANCE FROM ALL EXISTING EXHAUST.