



1 FIRST FLOOR PLAN - MECHANICAL REMOVALS


SCALE: 1/4" = 1'-0"

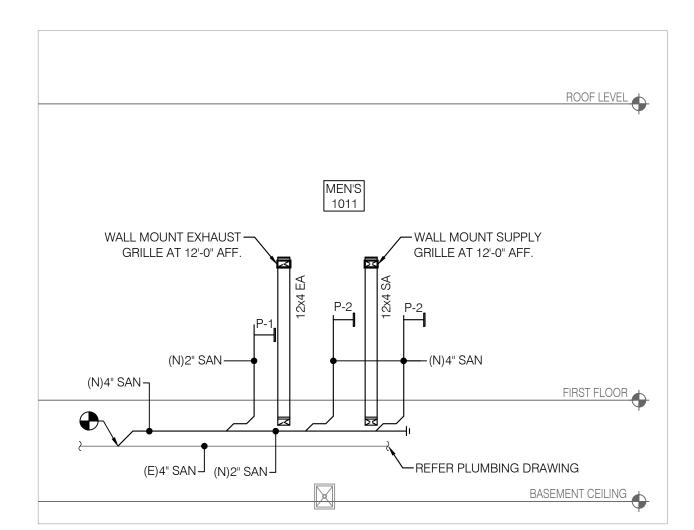

B SECTIONAL 1-102.00 SCALE: NTS


SECTIONAL VIEW OF DUCT AND SANITARY PIPE COORDINATION

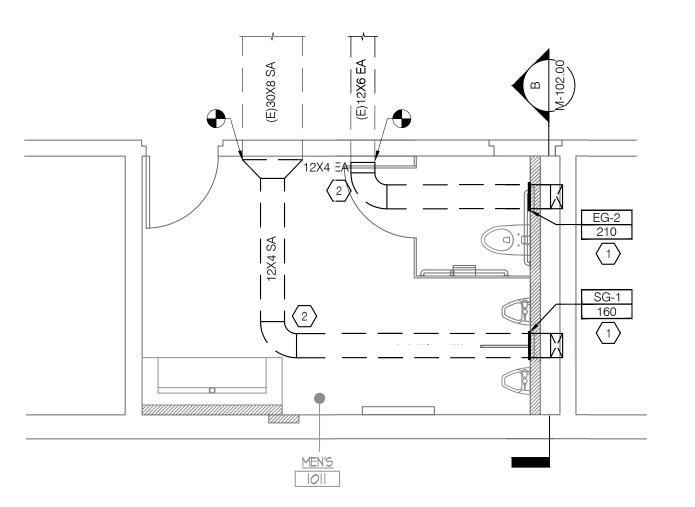

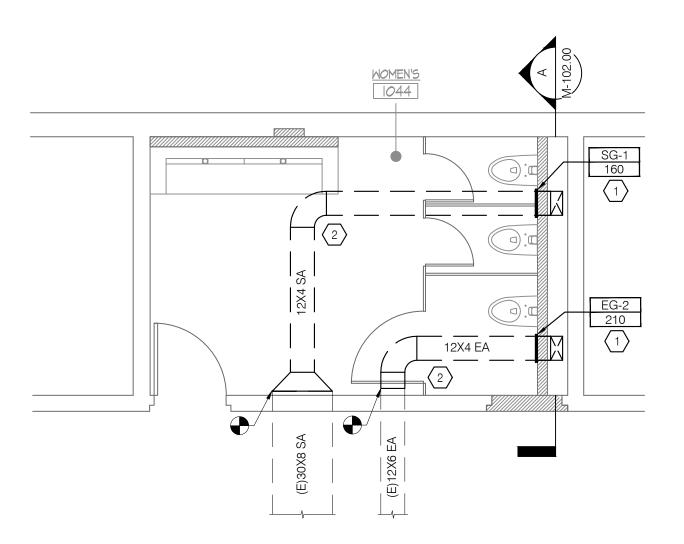

FIRST FLOOR PLAN - MECHANICAL NEW WORK

SCALE: 1/4" = 1'-0"

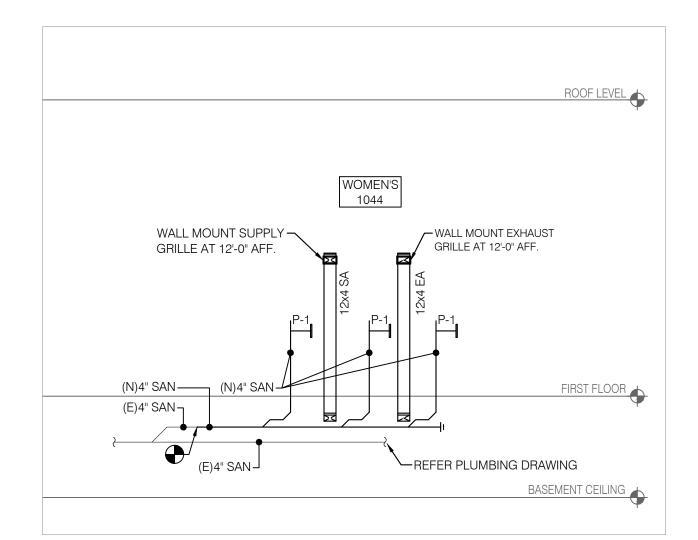

M-102.00

SECTIONAL VIEW OF DUCT AND SANITARY PIPE COORDINATION

GENERAL NOTES

- A. EXISTING WORK SHOWN IS BASED ON AVAILABLE DOCUMENTATION AND SPOT CHECKS ON SURVEY. CONTRACTOR TO FIELD VERIFY EXISTING CONDITIONS AND COORDINATE WITH ENGINEER PRIOR TO PROCEEDING WITH WORK.
- B. THE DEMOLITION PLAN IS INTENDED TO PROVIDE THE CONTRACTOR WITH A GENERAL KNOWLEDGE OF THE EXISTING CONDITIONS WITHIN THE PROJECT AREA.
- THE PROJECT AREA.

 CONTRACTOR SHALL SCHEDULE ALL WORK IN ACCORDANCE WITH
- D. CONTRACTOR TO FIELD COORDINATE ALL REMOVAL/ STORAGE/DISPOSAL OF EXISTING EQUIPMENT WITH THE OWNER.

OWNER'S REQUIREMENTS.

- E. CONTRACTOR TO COORDINATE WITH ARCHITECT AND STRUCTURAL ENGINEER TO PATCH AND REPAIR AREAS AFFECTED BY DEMOLITION
- F. CONTRACTOR TO REINSTALL ALL THERMOSTATS OR SENSORS AFFECTED BY DEMOLITION.

DEMOLITION KEY NOTES

- 1. REMOVE EXISTING DUCTWORK AND ALL ASSOCIATED AIR DEVICES ACCESSORIES/FITTINGS, INSULATION, HANGERS, SUPPORTS, ETC., WITHIN THE WORK AREA SHOWN.
- 2. EXISTING SUPPLY & EXHAUST DUCTS RUNNING IN CEILING BELOW TO REMAIN.

ALL IDEAS, DESIGNS, ARRANGEMENTS AND PLANS INDICATED OR REPRESENTED BY THIS DRAWING ARE OWNED BY, AND THE PROPERTY OF RONNETTE RILEY ARCHITECT AND WERE CREATED, EVOLVED AND DEVELOPED FOR THE USE ON, AND IN CONNECTION WITH THE SPECIFIED PROJECT. NONE OF SUCH IDEAS, DESIGNS, ARRANGEMENTS OR PLANS SHALL BE USED BY OR DISCLOSED TO ANY PERSON, FIRM OR CORPORATION FOR ANY PURPOSE WHATSOEVER WITHOUT THE WRITTEN PERMISSION OF RONNETTE RILEY ARCHITECT. © Copyright Ronnette Riley Architect 2020

Ronnette Riley Architect

RESTROOM RENOVATION

PURCHASE COLLEGE

STATE UNIVERSITY OF NEW YORK

735 Anderson Hill Rd.

Purchase, NY 10577

PHASE 2:

MUSIC BUILDING DANCE BUILDING

PHYS. ED. BUILDING LIBRARY

494 Eighth Avenue, 15th Floor New York, NY 10001 T 212 594 4015 F 212 594 2868 www.ronnetteriley.com


MEP Engineer

SETTY & Associates, Ltd
149 W 36th Street, 8th floor
New York, NY 10018
T 646 253 9000
F 646 224 8497

Rev Date Issue
29 April 2022 Issue for Bid

⟨#⟩ SHEET KEY NOTES

- 1. PROVIDE WALL MOUNT SUPPLY AND EXHAUST GRILLE AT 12'-0" AFF. AND CONNECT TO THE RESPECTIVE MAIN DUCTS RUNNING IN BELOW PLENUM.
- 2. NEW SUPPLY AND EXHAUST DUCT RUNNING IN CEILING BELOW. CONTRACTOR TO COORDINATE WITH OTHER DISCIPLINES.

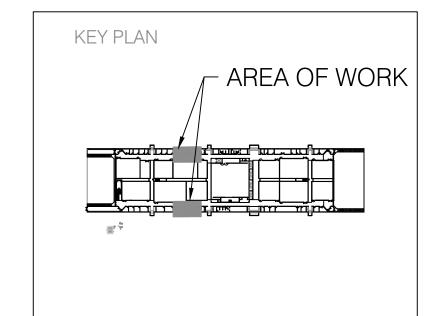

DANCE INSTRUCTIONAL FACILITIES - MECHANICAL PLANS

Date 01-16-2020
Project No. 1944
Drawing By AKV
CHK By BS
Scale AS NOTED

