


KEY PLAN

- NOTES:**
1. DEVICE PLACEMENT, RISER DEPICTION, CABLE TYPES AND ROUTES, DEVICE TERMINATION AND OTHERS ARE FOR REFERENCE ONLY.
  2. THE CONTRACTOR IS RESPONSIBLE FOR UNDERSTANDING AND VERIFYING THE ENTIRE DRAWINGS SET AND SPECIFICATIONS, VERIFY ACTUAL FIELD CONDITIONS AND DELIVER A TURN KEY SOLUTION TO COY BOE.
  3. CONTRACTOR TO VERIFY CAMERAS FIELD OF VIEW AND ADJUST AS NEEDED TO THE SATISFACTION OF BOE SECURITY MANAGER.
  4. PRIOR TO PULLING CAT-6 WIRES, CONTRACTOR TO VERIFY CABLE LENGTH DOES NOT TO EXCEED 300' WHEN BROUGHT TO CLOSEST CLOSET.
  5. ALL CAT-6 CABLES TO BE TESTED AND CERTIFIED AS PER BID DOCUMENT
  6. CONTRACTOR TO MARK ANY DEVIATIONS FROM THE PROVIDED RISER AND NOTE ON THE "AS BUILT"
  7. CONTRACTOR TO PRODUCE AND DELIVER A BOUND "AS BUILT" SET IN BOTH "D" SIZE HARD COPY (2 SETS) AND A CD WITH .PDF FORMAT.
  8. CONTRACTOR IS RESPONSIBLE FOR SYSTEM COMMISSIONING. ITG'S ROLE IS LIMITED TO SYSTEM PROGRAMMING ONLY.

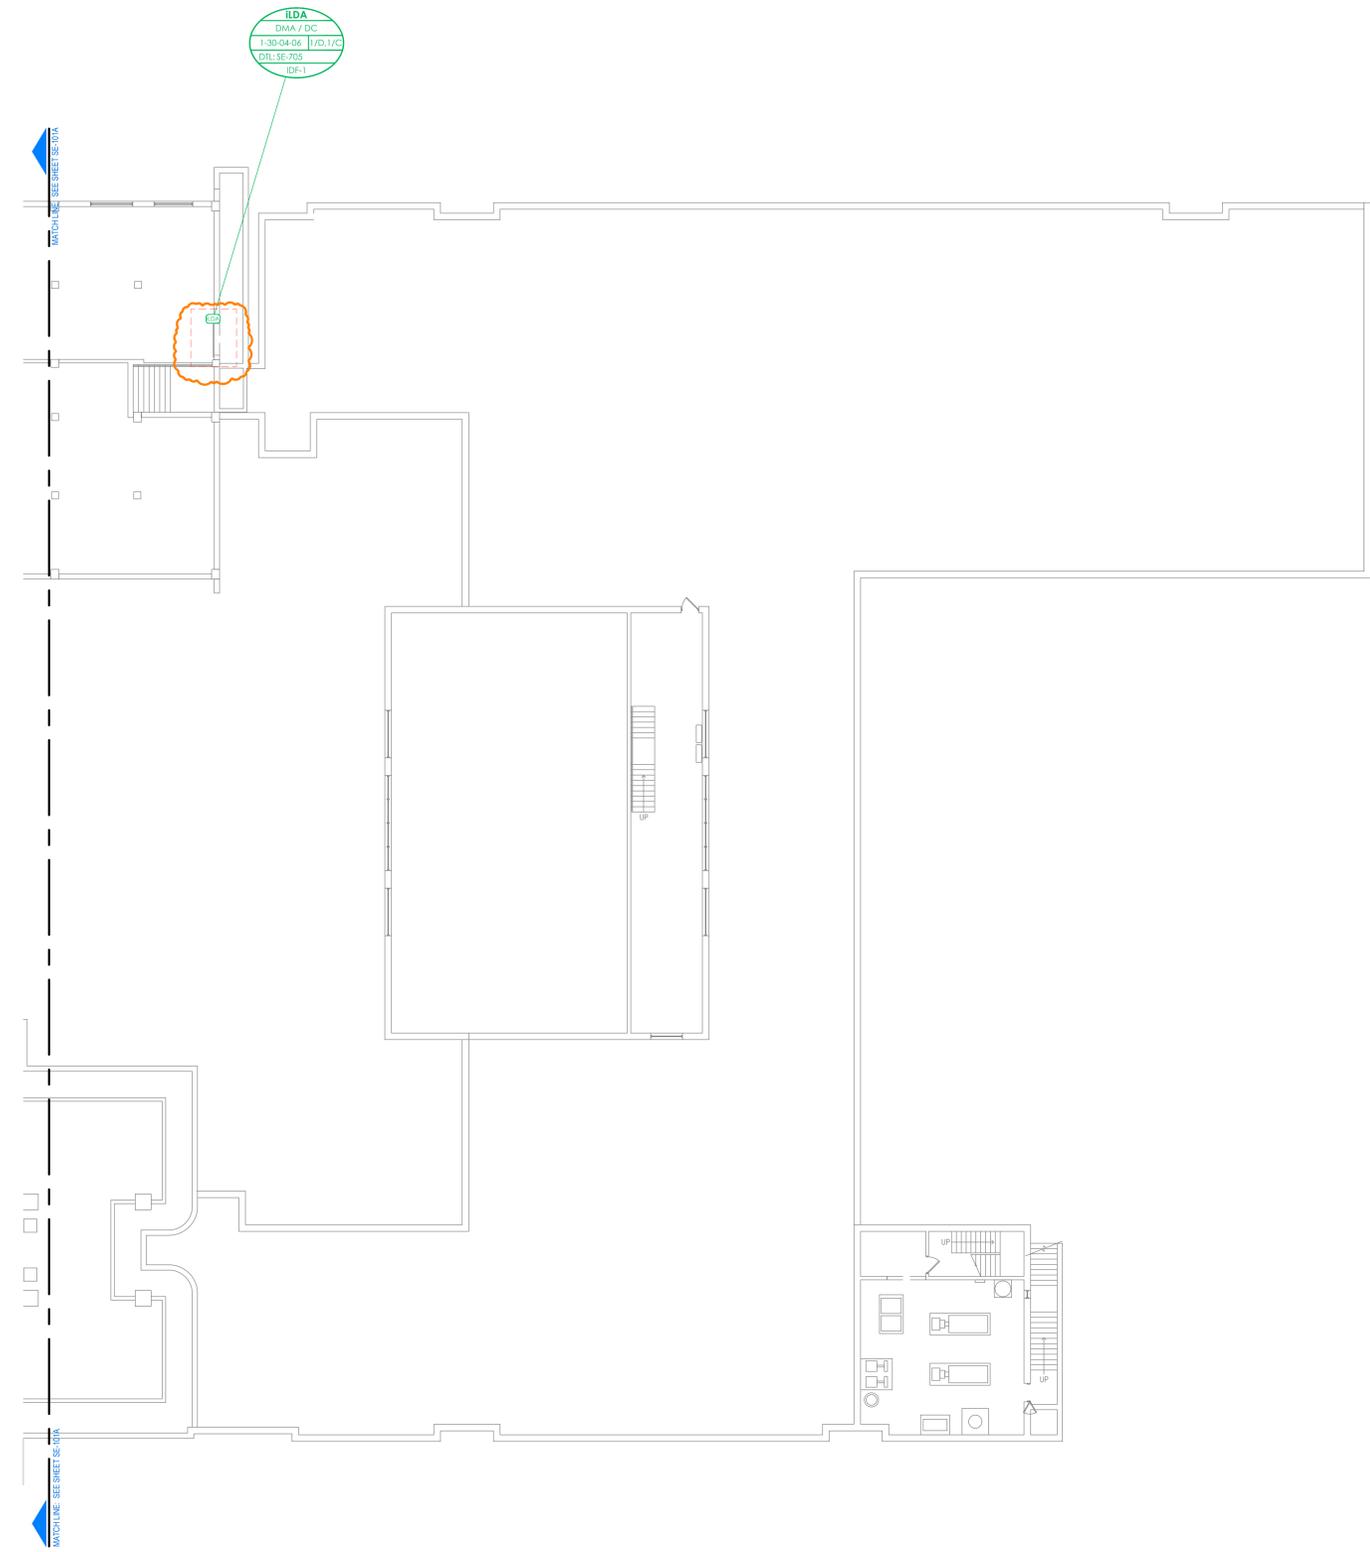

ILDA  
DMA / DC  
1-30-04-06 / 170,172  
DTE: SE-100B  
(DF-1)

ISSUED FOR:

DATE	COMMENTS
12/21/2021	FIRST SUBMISSION
1/8/2022	SECOND SUBMISSION
1/14/2022	THIRD SUBMISSION
2/18/2022	SEGMENTED SUBMISSION



The CAD set and all inventions, ideas, designs, details and methods shown here are the property of ITG Larson, Inc. and may not be used, altered, reproduced, or distributed without ITG's written consent and permission.

PROJECT:  
**WESTCHESTER HILLS SCHOOL 29**  
47 CROYDON RD  
YONKERS, NY 10710

TITLE:  
**SECURITY UPDATE PROJECT BASEMENT - B**

XX	XX	XX
DESIGNED BY	DRAWN BY	CHECKED BY
WORK ORDER NO:	DATE	12/18/2021
XXXXXX	SCALE	N.T.S.
S.A. NO:	DRAWING NO:	SE-100B
XXXXXX		

