
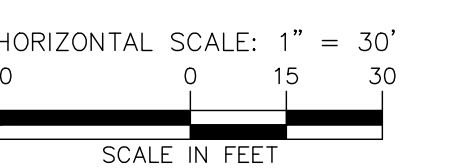


- NOTES:
- UNLESS OTHERWISE SPECIFIED, PIPE FOR WATER SUPPLY AND DISTRIBUTION LINES SHALL BE POLYVINYL CHLORIDE PRESSURE PIPE (PVC-P), CLASS 235 PSI, OR 18" WITH PUSH-ON JOINTS IN ACCORDANCE WITH AWWA C-300 (BLUE BRUTE).
  - WATER MAIN SHALL HAVE A MINIMUM 18" CLEARANCE TO SANITARY SEWER AND DRAINAGE PIPES AND A MINIMUM 12" CLEARANCE TO ALL OTHER UTILITIES.

PROFILES

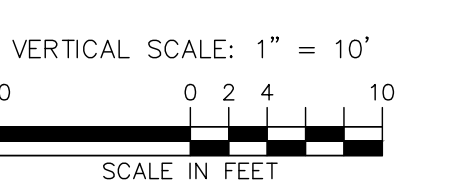

10/14/2022	REV. FOR NYCDP SUBMISSION	3
03/25/2022	REV. PER TOWN COMMENTS	2
03/07/2022	REV. PER TOWN COMMENTS	1
Date	Description	No.
Revisions		

WARNING: IT IS A VIOLATION OF THE NYS EDUCATION LAW ARTICLE 146 FOR ANY PERSON, UNLESS HE IS ACTING UNDER THE DIRECTION OF A LICENSED PROFESSIONAL ENGINEER, LAND SURVEYOR OR GEOLOGIST, TO ALTER THIS ITEM IN ANY WAY.



Signature: [Signature]  
PROFESSIONAL ENGINEER N.Y. Lic. No. 081473

Date: 11/7/2022

LEED-AP

081473

www.langan.com

T: 914.323.7400 F: 914.323.7401

One North Broadway, Suite 910  
White Plains, NY 10601

LANGAN

Langan Engineering, Environmental, Surveying,  
Landscape Architecture, and Geology, D.P.C.

Project  
LINCOLN LOGISTICS  
BREWSTER  
TOWN OF SOUTHEAST  
PUTNAM COUNTY NEW YORK

Drawing Title  
WATERLINE  
PROFILES (4 OF 9)

Project No.  
190065201  
Date  
1/28/2022  
Drawn By  
JMSK  
Checked By  
CZ/MF  
Drawing No.  
C-313  
Sheet 32 of 97