


4 INCH FROM SOUTHERN WELL TO WATER TREATMENT (VIEW A: SEE PLAN C-301)


HORIZONTAL SCALE: 1" = 30'
VERTICAL SCALE: 1" = 10'

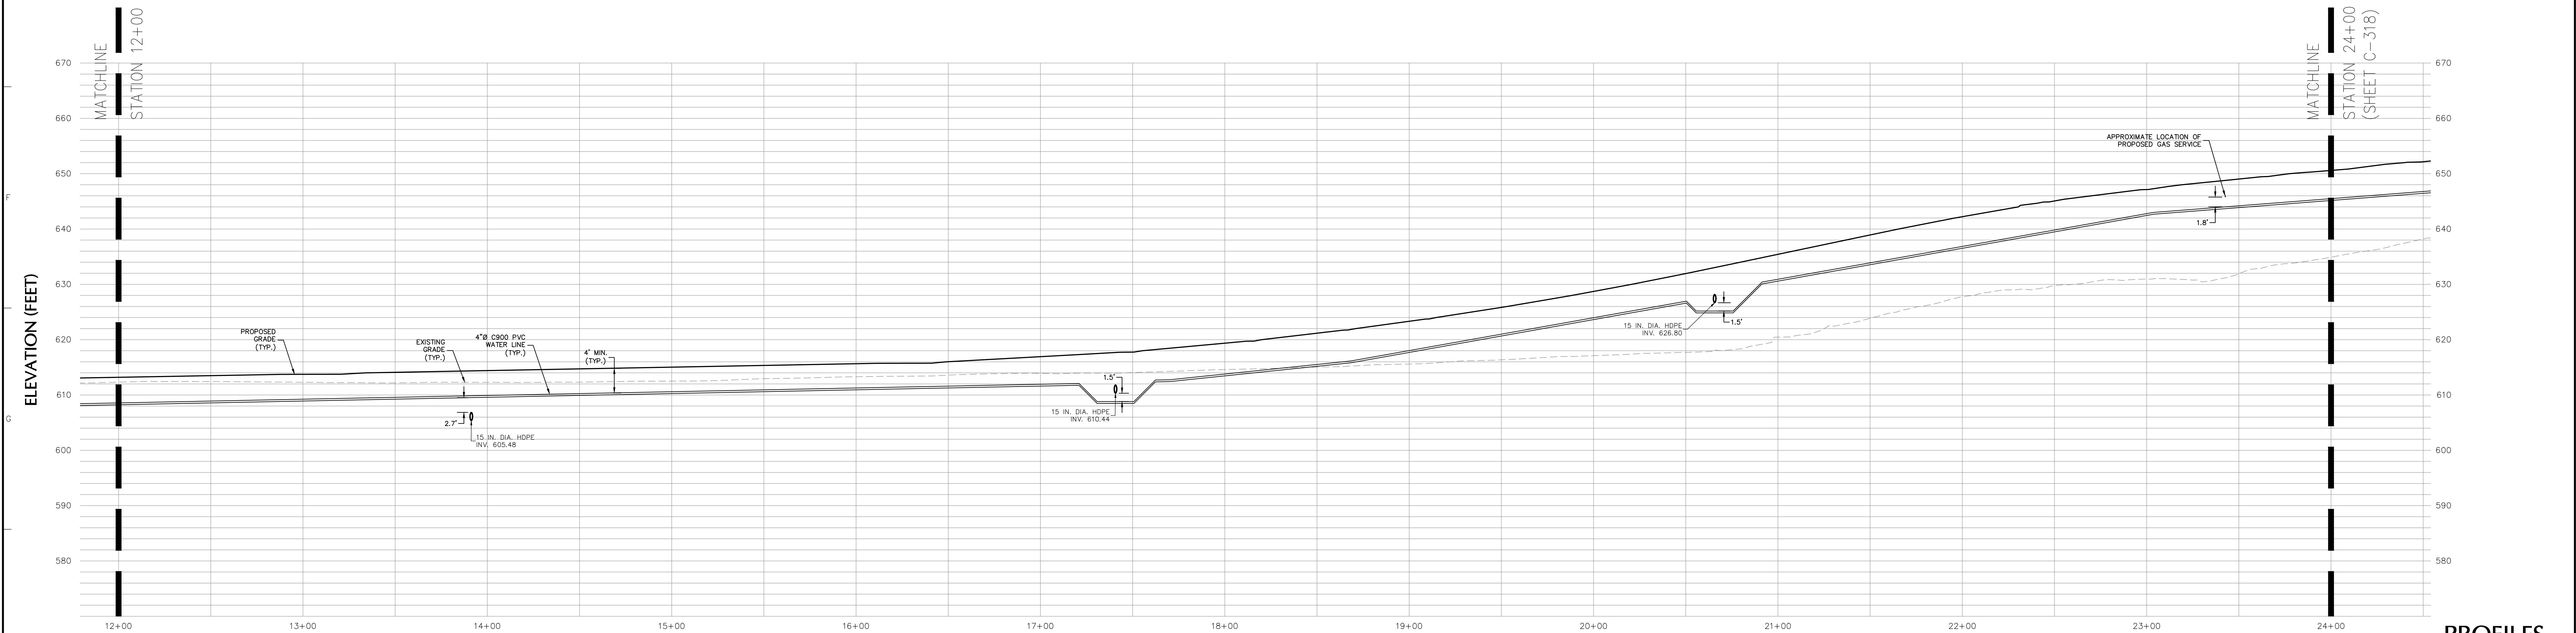

4 INCH FROM SOUTHERN WELL TO WATER TREATMENT (VIEW B: SEE PLANS C-301 & C-302)

HORIZONTAL SCALE: 1" = 30'
VERTICAL SCALE: 1" = 10'

- NOTES:**
- UNLESS OTHERWISE SPECIFIED, PIPE FOR WATER SUPPLY AND DISTRIBUTION LINES SHALL BE POLYVINYL CHLORIDE PRESSURE PIPE (PVC), CLASS 250 PSI, DR 18, WITH PUSH-ON JOINTS IN ACCORDANCE WITH AWWA C-900 (BLUE BRUTE).
 - WATER MAIN SHALL HAVE A MINIMUM 18" CLEARANCE TO SANITARY SEWER AND DRAINAGE PIPES AND A MINIMUM 12" CLEARANCE TO ALL OTHER UTILITIES.

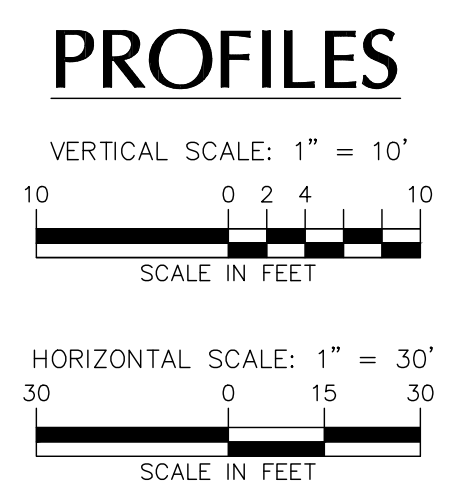

10/14/2022	REV. FOR NYCDP SUBMISSION	3
03/25/2022	REV. PER TOWN COMMENTS	2
03/07/2022	REV. PER TOWN COMMENTS	1
Date	Description	No.
Revisions		

WARNING: IT IS A VIOLATION OF THE NYS EDUCATION LAW ARTICLE 146 FOR ANY PERSON, UNLESS HE IS ACTING UNDER THE DIRECTION OF A LICENSED PROFESSIONAL ENGINEER, LAND SURVEYOR OR GEOLOGIST, TO ALTER THIS ITEM IN ANY WAY.

Signature: *[Signature]* Date: 11/7/2022

PROFESSIONAL ENGINEER NY Lic. No. 081473

LEED-AP

LANGAN

Langan Engineering, Environmental, Surveying, Landscape Architecture, and Geology, D.P.C.

One North Broadway, Suite 910
White Plains, NY 10601

T: 914.323.7400 F: 914.323.7401 www.langan.com

Project: LINCOLN LOGISTICS BREWSTER

TOWN OF SOUTHEAST PUTNAM COUNTY NEW YORK

Drawing Title: WATERLINE PROFILES (8 OF 9)

Project No. 190065201

Date: 1/28/2022

Drawn By: JMSK

Checked By: CZ/MF

Drawing No. C-317

Sheet 36 of 97