

NOTES:


1. UNLESS OTHERWISE SPECIFIED, PIPE FOR WATER SUPPLY AND DISTRIBUTION LINES SHALL BE POLYVINYL CHLORIDE PRESSURE PIPE (PVCP), CLASS 235 PSI, DR 18, WITH PUSH-ON JOINTS IN ACCORDANCE WITH AWWA C-900 (BLUE BRUTE).

2. WATER MAIN SHALL HAVE A MINIMUM 18" CLEARANCE TO SANITARY SEWER AND DRAINAGE PIPES AND A MINIMUM 12" CLEARANCE TO ALL OTHER UTILITIES.

PROFILES


Checked By


Date: 10/17/2022 Time: 17:43 User: jmacalintal Style Table: Langan.stb Layout: C-318 Document Code: 190065201-0501-CU202-0109



HORIZONTAL SCALE: 1" = 30'

t No. Drawing No. 190065201

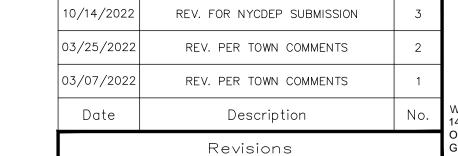

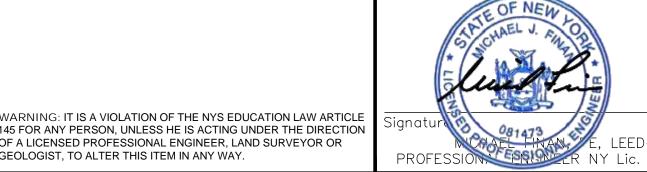



LINCOLN LOGISTICS BREWSTER

**NEW YORK** 

TOWN OF SOUTHEAST

WATERLINE PROFILES (9 OF 9) C-318

Sheet **37** of **97**