

TILT WALL PANEL NOTES

The tilt wall contractor shall review and verify all dimensions, openings, and weld plate connections. Report any discrepancies to the Structural Engineer prior to casting panels.

The panels are drawn viewed from the inside of the building, unless noted other wise and shall be cast with the exterior face down.

Concrete shall be normal weight Type II with a 28 day compressive strength of 4,000 psi. See specs for additional criteria. Concrete shall reach a minimum of 3,000 psi minimum compressive strength and 500 psi flexural strength minimum.

All reinforcing steel shall conform to ASTM A-615 Gr. 60

Reinforcing steel to be welded shall conform to ASTM A706.

Casting slab shall be cured and sealed. Saw cuts, cracks, or joints shall be filled and leveled with a sealant to minimize transfer of lines to the exterior panel face.

The contractor shall be responsible for the compatibility of the curing agents, sealants, and releasing agents required for this project.

All burrs, honey comb and pockets shall be removed and repaired after erection.

The centerline of single mat steel shall coincide with the structural thickness of the panel. Panels with 2 layers of mat steel shall have a minimum of 1 1/4" at interior face, 1 3/4" @ exterior face. See panel drawings for reinforcing requirements. Chairs shall be all plastic.

Provide 2 - #5 continuous each face at the bottom, top, and sides of each panel and at the head, jams, and sill of each opening and future knock-out unless noted otherwise.

Provide 1-#5 x 3'-0" each face placed diagonally at the corner of each opening and at corner notches in the panels.

Exposed edges of panels shall be chamfered, except at the inside edge of overhead doors and where otherwise noted.

See Architectural drawings for panel finishes, reveals, chamfers, and details not shown. Unless otherwise indicated, All panels shall receive a steel troweled finish on the interior surface.


The panels have been designed for in service conditions only. The contractor shall be responsible for the panel lifting design and methods. No allowance has been provided for stress created in the panels during erection. The contractor shall have the panels investigated by a professional Engineer to design panel lifting system.

Lifting inserts visible after final construction shall be patched and finished. Holes in the slab on grade due to braces and/or nailing shall be patched and ground smooth.


Temporary bracing of the panels shall not be removed until after the slab leave out has been poured and the roof diaphragm construction has been completed.

The contractor shall provide the following submittals:


1. Reinforcement layout
2. Embed layout
3. Additional reinforcement for panel erection
4. Erection hardware and lift Engineering

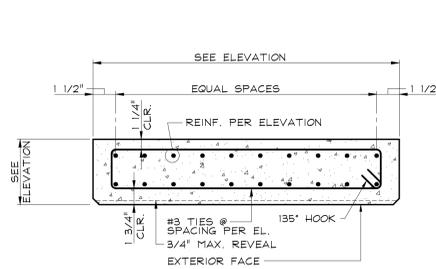


TYP. PANEL LEG DETAIL
SCALE: NONE

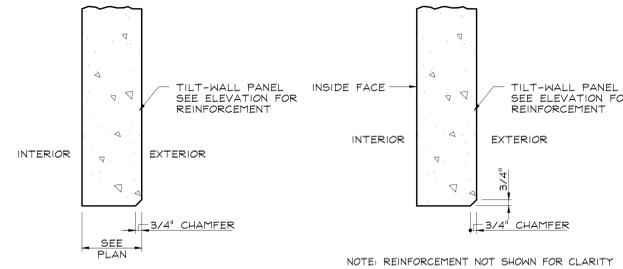


TYPICAL EDGE CONDITION @ OPNGS.
SCALE: NONE
NOTE: REINFORCEMENT NOT SHOWN FOR CLARITY




TYP. OPENING DETAIL @ JAMB
SCALE: NONE

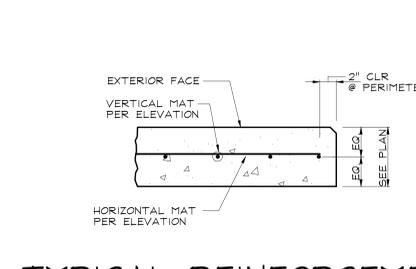


TYPICAL REINFORCEMENT SECTION AT PANEL WITH 1 LAYER OF STEEL
SCALE: NONE




TYPICAL REINFORCEMENT SECTION AT PANEL WITH 2 LAYERS OF STEEL
SCALE: NONE




TYP. PANEL JOINT DETAIL
SCALE: NONE

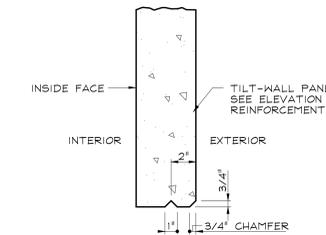

TYP. OVERHEAD DOOR HEAD DETAIL
SCALE: NONE

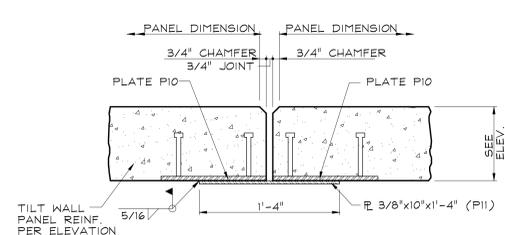


SECTION 1
SCALE: 1 1/2" = 1'-0"

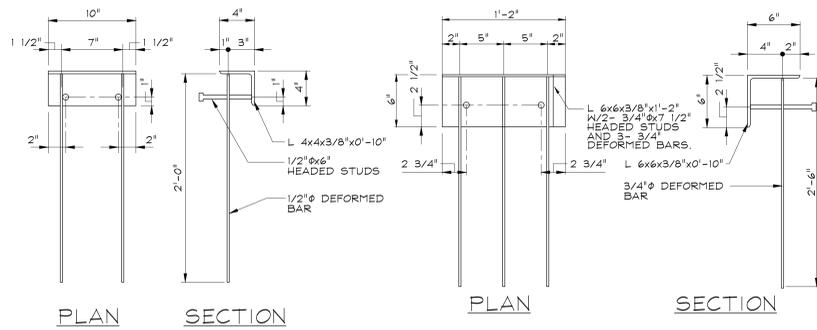


P1
SCALE: 1 1/2" = 1'-0"

P2
SCALE: 1 1/2" = 1'-0"

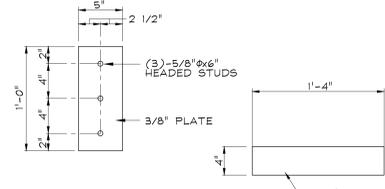


P3
SCALE: 1 1/2" = 1'-0"


P4
SCALE: 1 1/2" = 1'-0"




P5/P5A
SCALE: 1 1/2" = 1'-0"




P6
SCALE: 1 1/2" = 1'-0"




P7
SCALE: 1 1/2" = 1'-0"




P8
SCALE: 1 1/2" = 1'-0"



P9
SCALE: 1 1/2" = 1'-0"



P10
SCALE: 1 1/2" = 1'-0"



P11
SCALE: 1 1/2" = 1'-0"

DESIGNER / BUILDER
ARCO
DESIGN/BUILD INDUSTRIAL
44 SOUTH BROADWAY, SUITE 1003
WHITE PLAINS, NY 10601
P: 914.821.5535 F: 914.306.6010

ADBI / DESIGN SERVICES
Lincoln Equities Group, LLC

PROJECT TITLE
LINCOLN EQUITIES - NY-312 - BLDG B
NY-312 & PUGSLEY RD, SOUTHEAST, NY 10509

ARCHITECT
ADBI / DESIGN SERVICES LLC
44 SOUTH BROADWAY, SUITE 1003
WHITE PLAINS, NY 10601

CIVIL ENGINEER
LANGAN ENGINEERING
300 KIMBALL DRIVE
PARLISHPANY, NJ 07054

STRUCTURAL ENGINEER
SMITH, ROBERTS AND ASSOCIATES, INC.
6501 BLUFF RD
INDIANAPOLIS, INDIANA 46217

MECHANICAL ENGINEER
NATIONAL DESIGN BUILD SERVICES
11840 BORMAN DRIVE
ST. LOUIS, MO 63146

ELECTRICAL ENGINEER
FXB ENGINEERING
6 CHRISTY DRIVE, SUITE 307
CHADDS FORD, PA 19317

PLUMBING ENGINEER
MCCARTHY ENGINEERING ASSOCIATES, INC.
315 EAST SECOND STREET
BOYERTOWN, PA 19512

FIRE PROTECTION ENGINEER
SA COMUNALE CO. INC.
2900 NEWPARK DRIVE
BARBERTON, OH 44203

SEAL

KEY PLAN

SUBMITTALS

NO.	DATE	DESCRIPTION
1	6.9.2022	PERMIT
2	7.8.2022	FIG. STEPS
3	9.30.2022	100% TILT WALL SET
3	10.14.2022	REV 3 AS NOTED

PROJECT NO. AS286-21 | NY131 | 21-155
DRAWN BY CEO

SHEET TITLE
TILT WALL DETAILS

SHEET NO.
T2.3