Key Notes:

1. DISCONNECT, REMOVE & PROPERLY DISPOSE OF EXISTING DISTRIBUTION PANEL. MAINTAIN EXISTING DISTRIBUTION WIRING FOR CONNECTION TO REPLACEMENT PANEL. REFER TO ONE-LINE DIAGRAM FOR INSTRUCTIONS FOR EXISTING CONDUITS AND FEEDERS
2. DISCONNECT, REMOVE & PROPERLY DISPOSE OF EXISTING TRANSFORMER. REFER TO ONE-LINE DIAGRAM FOR INSTRUCTIONS FOR EXISTING CONDUITS AND FEEDERS

General Notes:

1. IN ALL AREAS WITH EXISTING CEILINGS TO REMAIN, ELECTRICAL CONTRACTOR IS RESPONSIBLE TO REMOVE AND REINSTALL CEILING TILES AND GRID AS NECESSARY TO COMPLETE REMOVAL AND INSTALLATION OF LIGHTING, WIRING, CONDUIT, JUNCTION BOXES, ETC.
2. PRIOR TO REPLACEMENT OF ELECTRICAL PANELS, PERFORM FIELD WORK TO DETERMINE QUANTITIES, SIZES AND RATINGS OF ALL EXISTING BRANCH CIRCUIT BREAKERS. PROVIDE REPLACEMENT PANELS WITH SAME BREAKER CONFIGURATION FOR THE EXISTING BRANCH CIRCUITS.
3. MAINTAIN ALL EXISTING BRANCH CIRCUITS. MODIFY AS NECESSARY TO EXTEND EXISTING CIRCUITRY AND CONNECT TO REPLACEMENT PANELS.

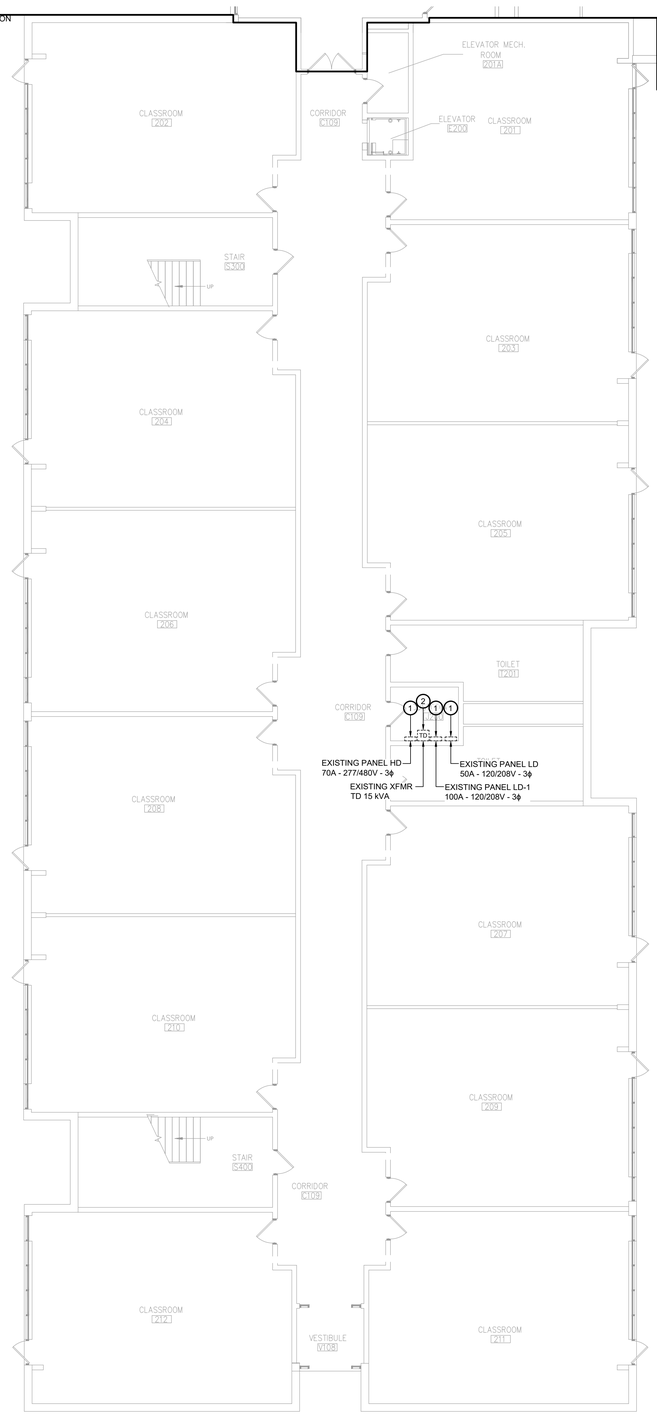

1 ED313 Area E First Floor Electrical Demolition Plan
Scale: 1/8" = 1'-0"

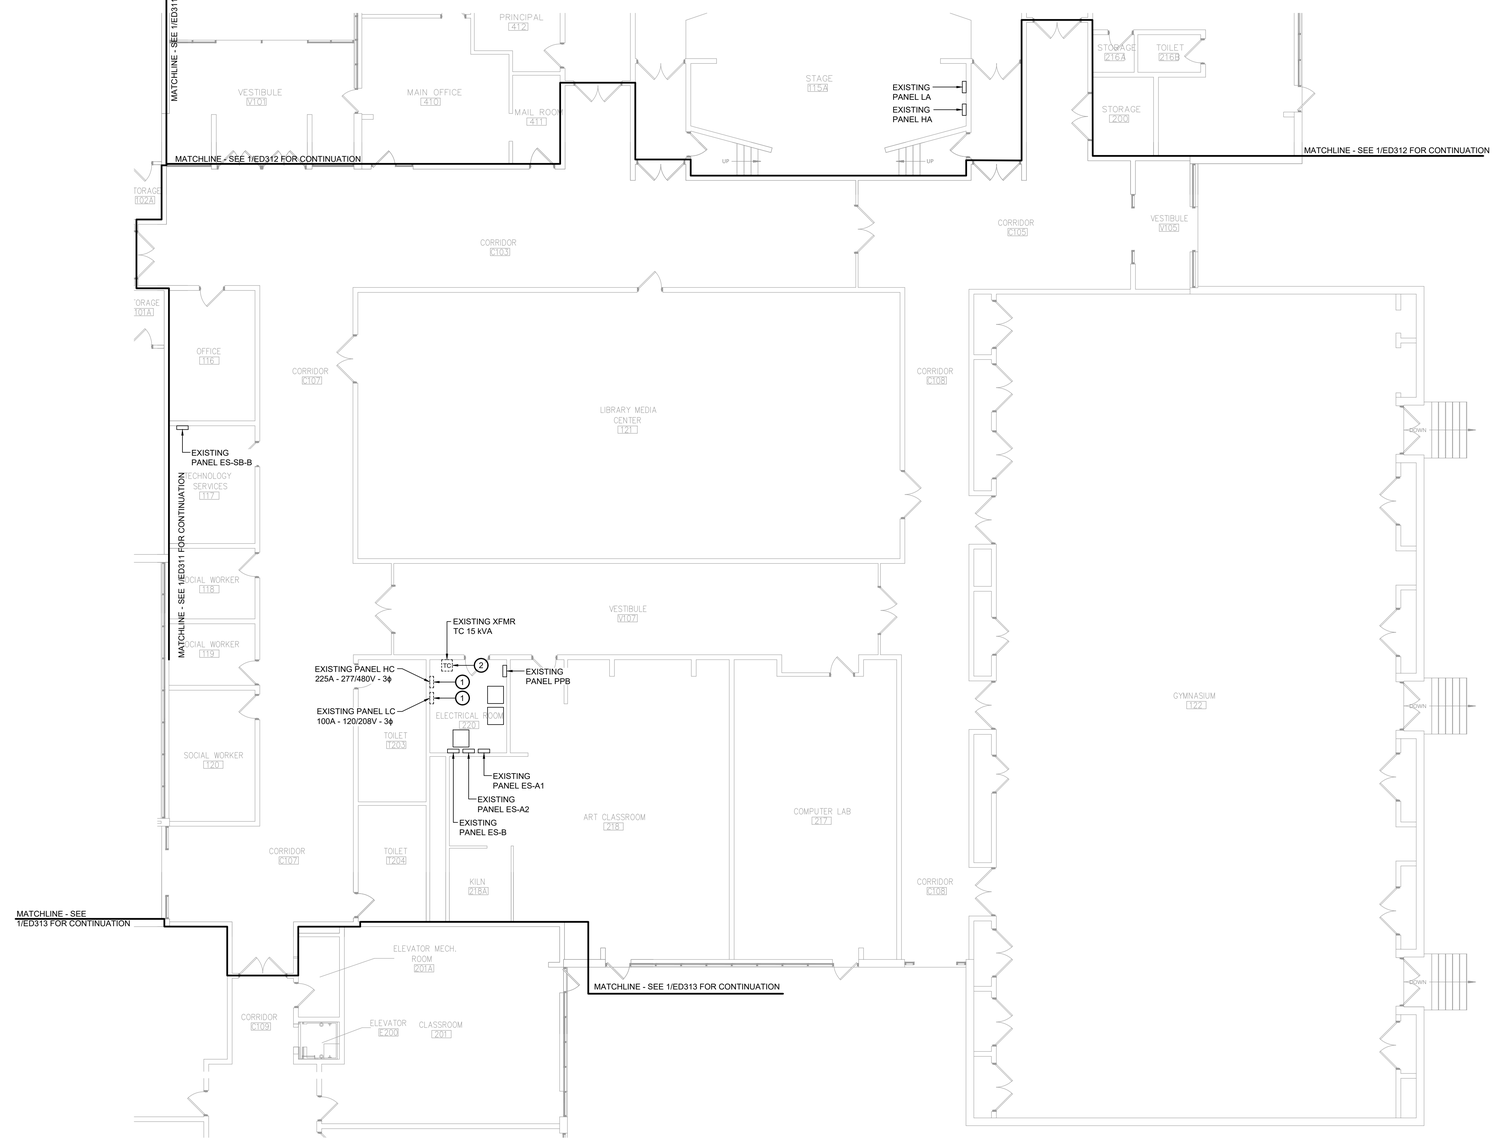

2 ED313 Area D First Floor Electrical Demolition Plan
Scale: 1/8" = 1'-0"

KEY PLAN

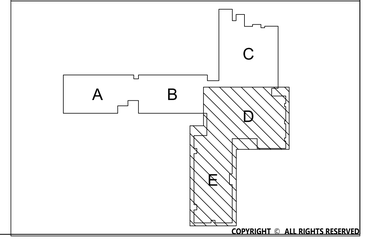

COPYRIGHT © ALL RIGHTS RESERVED

19 Front St. - Newburgh - New York 12550-7601
845 - 561 - 3179 www.csarchpc.com
CSARCH

Consultant

BLAKE ENGINEERING PLLC
MECHANICAL ELECTRICAL PLUMBING FIRE PROTECTION CONSULTANTS

Project Title

HIGHLAND CENTRAL SCHOOL DISTRICT
HIGHLAND ELEMENTARY SCHOOL
2022 CAPITAL IMPROVEMENT PROJECT - PHASE 1

STATE OF NEW YORK · MATTHEW GEORGE BLAKE · 098039 · LICENSED PROFESSIONAL ENGINEER

Expiration Date: 05-31-2025

DATE	DESCRIPTION

Drawn By:	BJK
Checked By:	BJK
Proj. #:	62-08-03-04-0-010-014
CSArch Proj. #:	197-2201.01
Issued for Bid:	8/18/23

Sheet Title

AREA D & E FIRST FLOOR ELECTRICAL DEMOLITION PLANS

Sheet No.

HES ED313

CONSTRUCTION DOCUMENTS