


## 2022 CAPITAL IMPROVEMENT PROJECT - PHASE 1

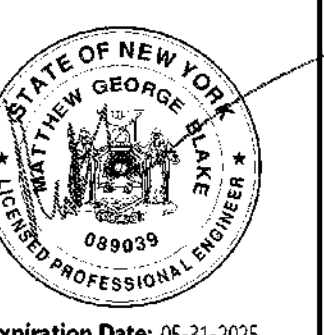

Expiration Date: 06-30-2025

[illegible]

By:	BJK
Red By:	BJK
#:	62-08-03-04-0-010-014
h Proj. #:	197-2201.01
l for Bid:	8/18/23

Title


AREA E SECOND  
FLOOR  
FIGHTING PLAN

No. HES  
E223

## INSTRUCTION DOCUMENTS


General Notes:

1. IN ALL AREAS WITH EXISTING CEILINGS TO REMAIN, ELECTRICAL CONTRACTOR IS RESPONSIBLE TO REMOVE AND REINSTALL CEILING TILES AND GRID AS NECESSARY TO COMPLETE REMOVAL AND INSTALLATION OF LIGHTING WIRING, CONDUIT, JUNCTION BOXES, ETC.
2. WALL MOUNTED EMERGENCY LIGHTING IN CORRIDORS IS EXISTING TO REMAIN WHERE SHOWN ON THE PLANS.
3. WALL MOUNTED EXIT LIGHTING IN CORRIDORS IS EXISTING TO REMAIN WHERE SHOWN ON THE PLANS. CONTRACTOR SHALL ADJUST PLACEMENT OF EXISTING FIXTURES IF NEEDED TO ACCOMMODATE CEILING REPLACEMENT.

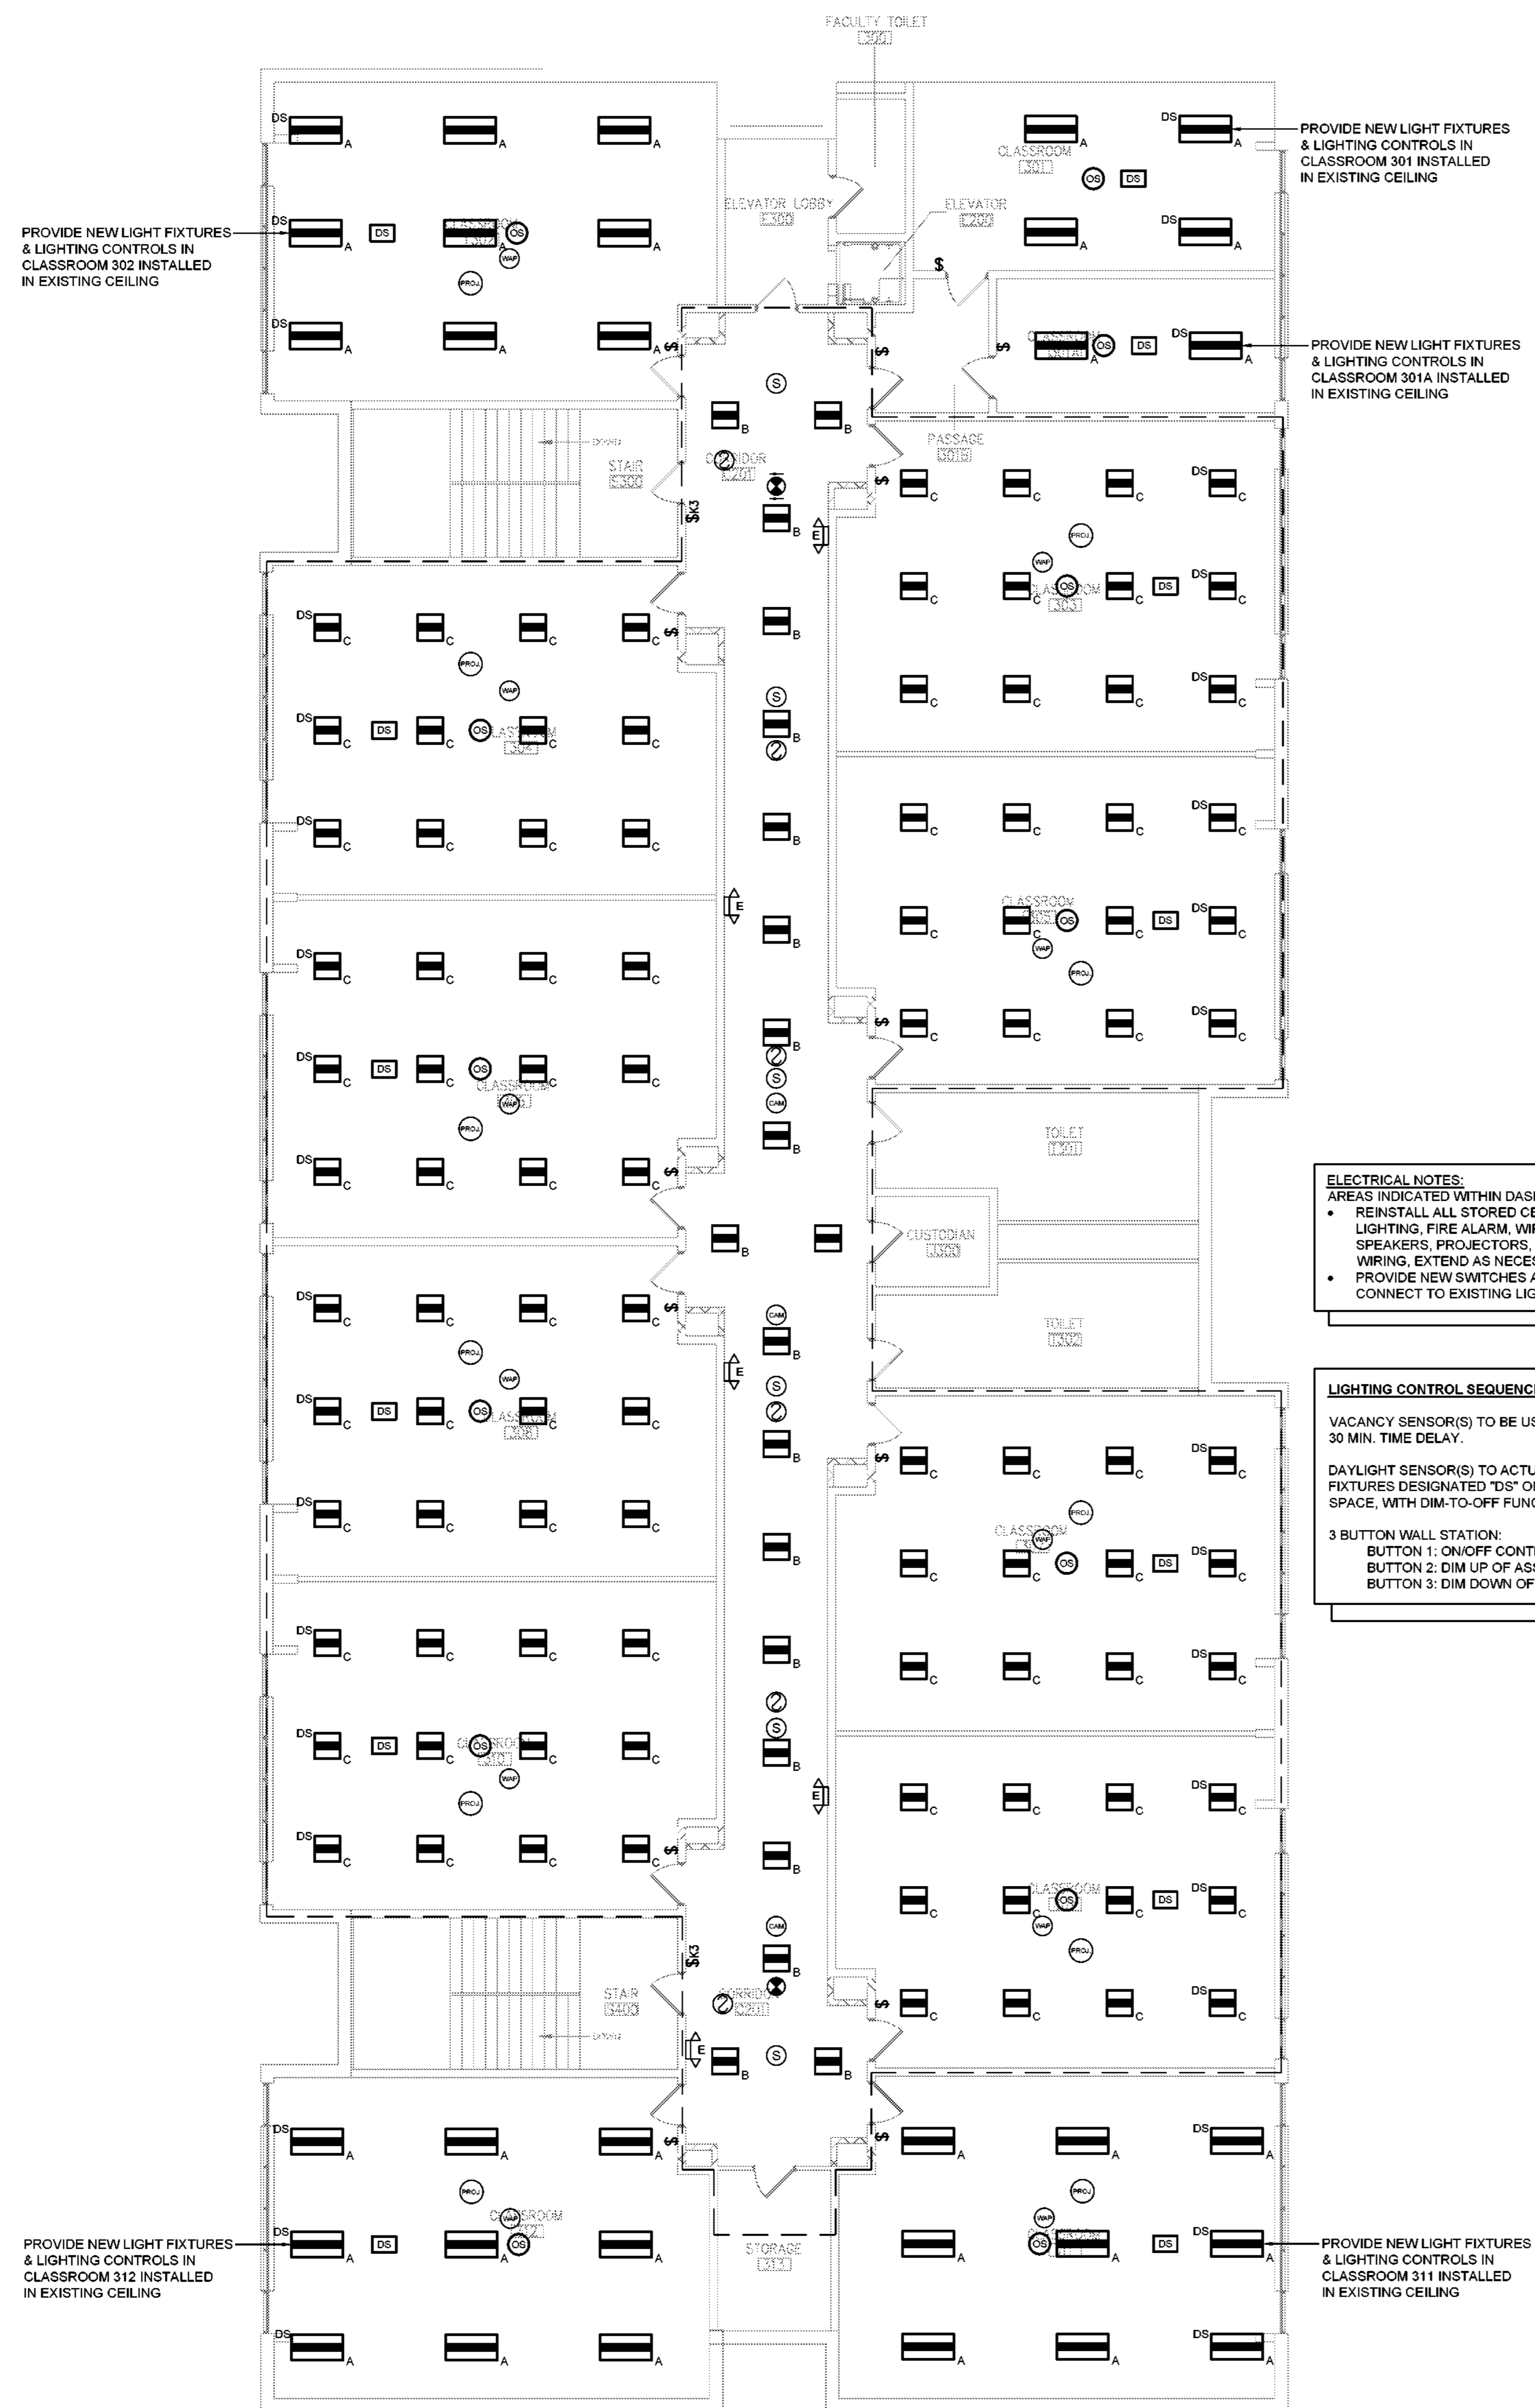

1 Area E Second Floor Lighting Plan  
E223 Scale: 1/8" = 1'-0"

Scale: 1/8" = 1'-0"

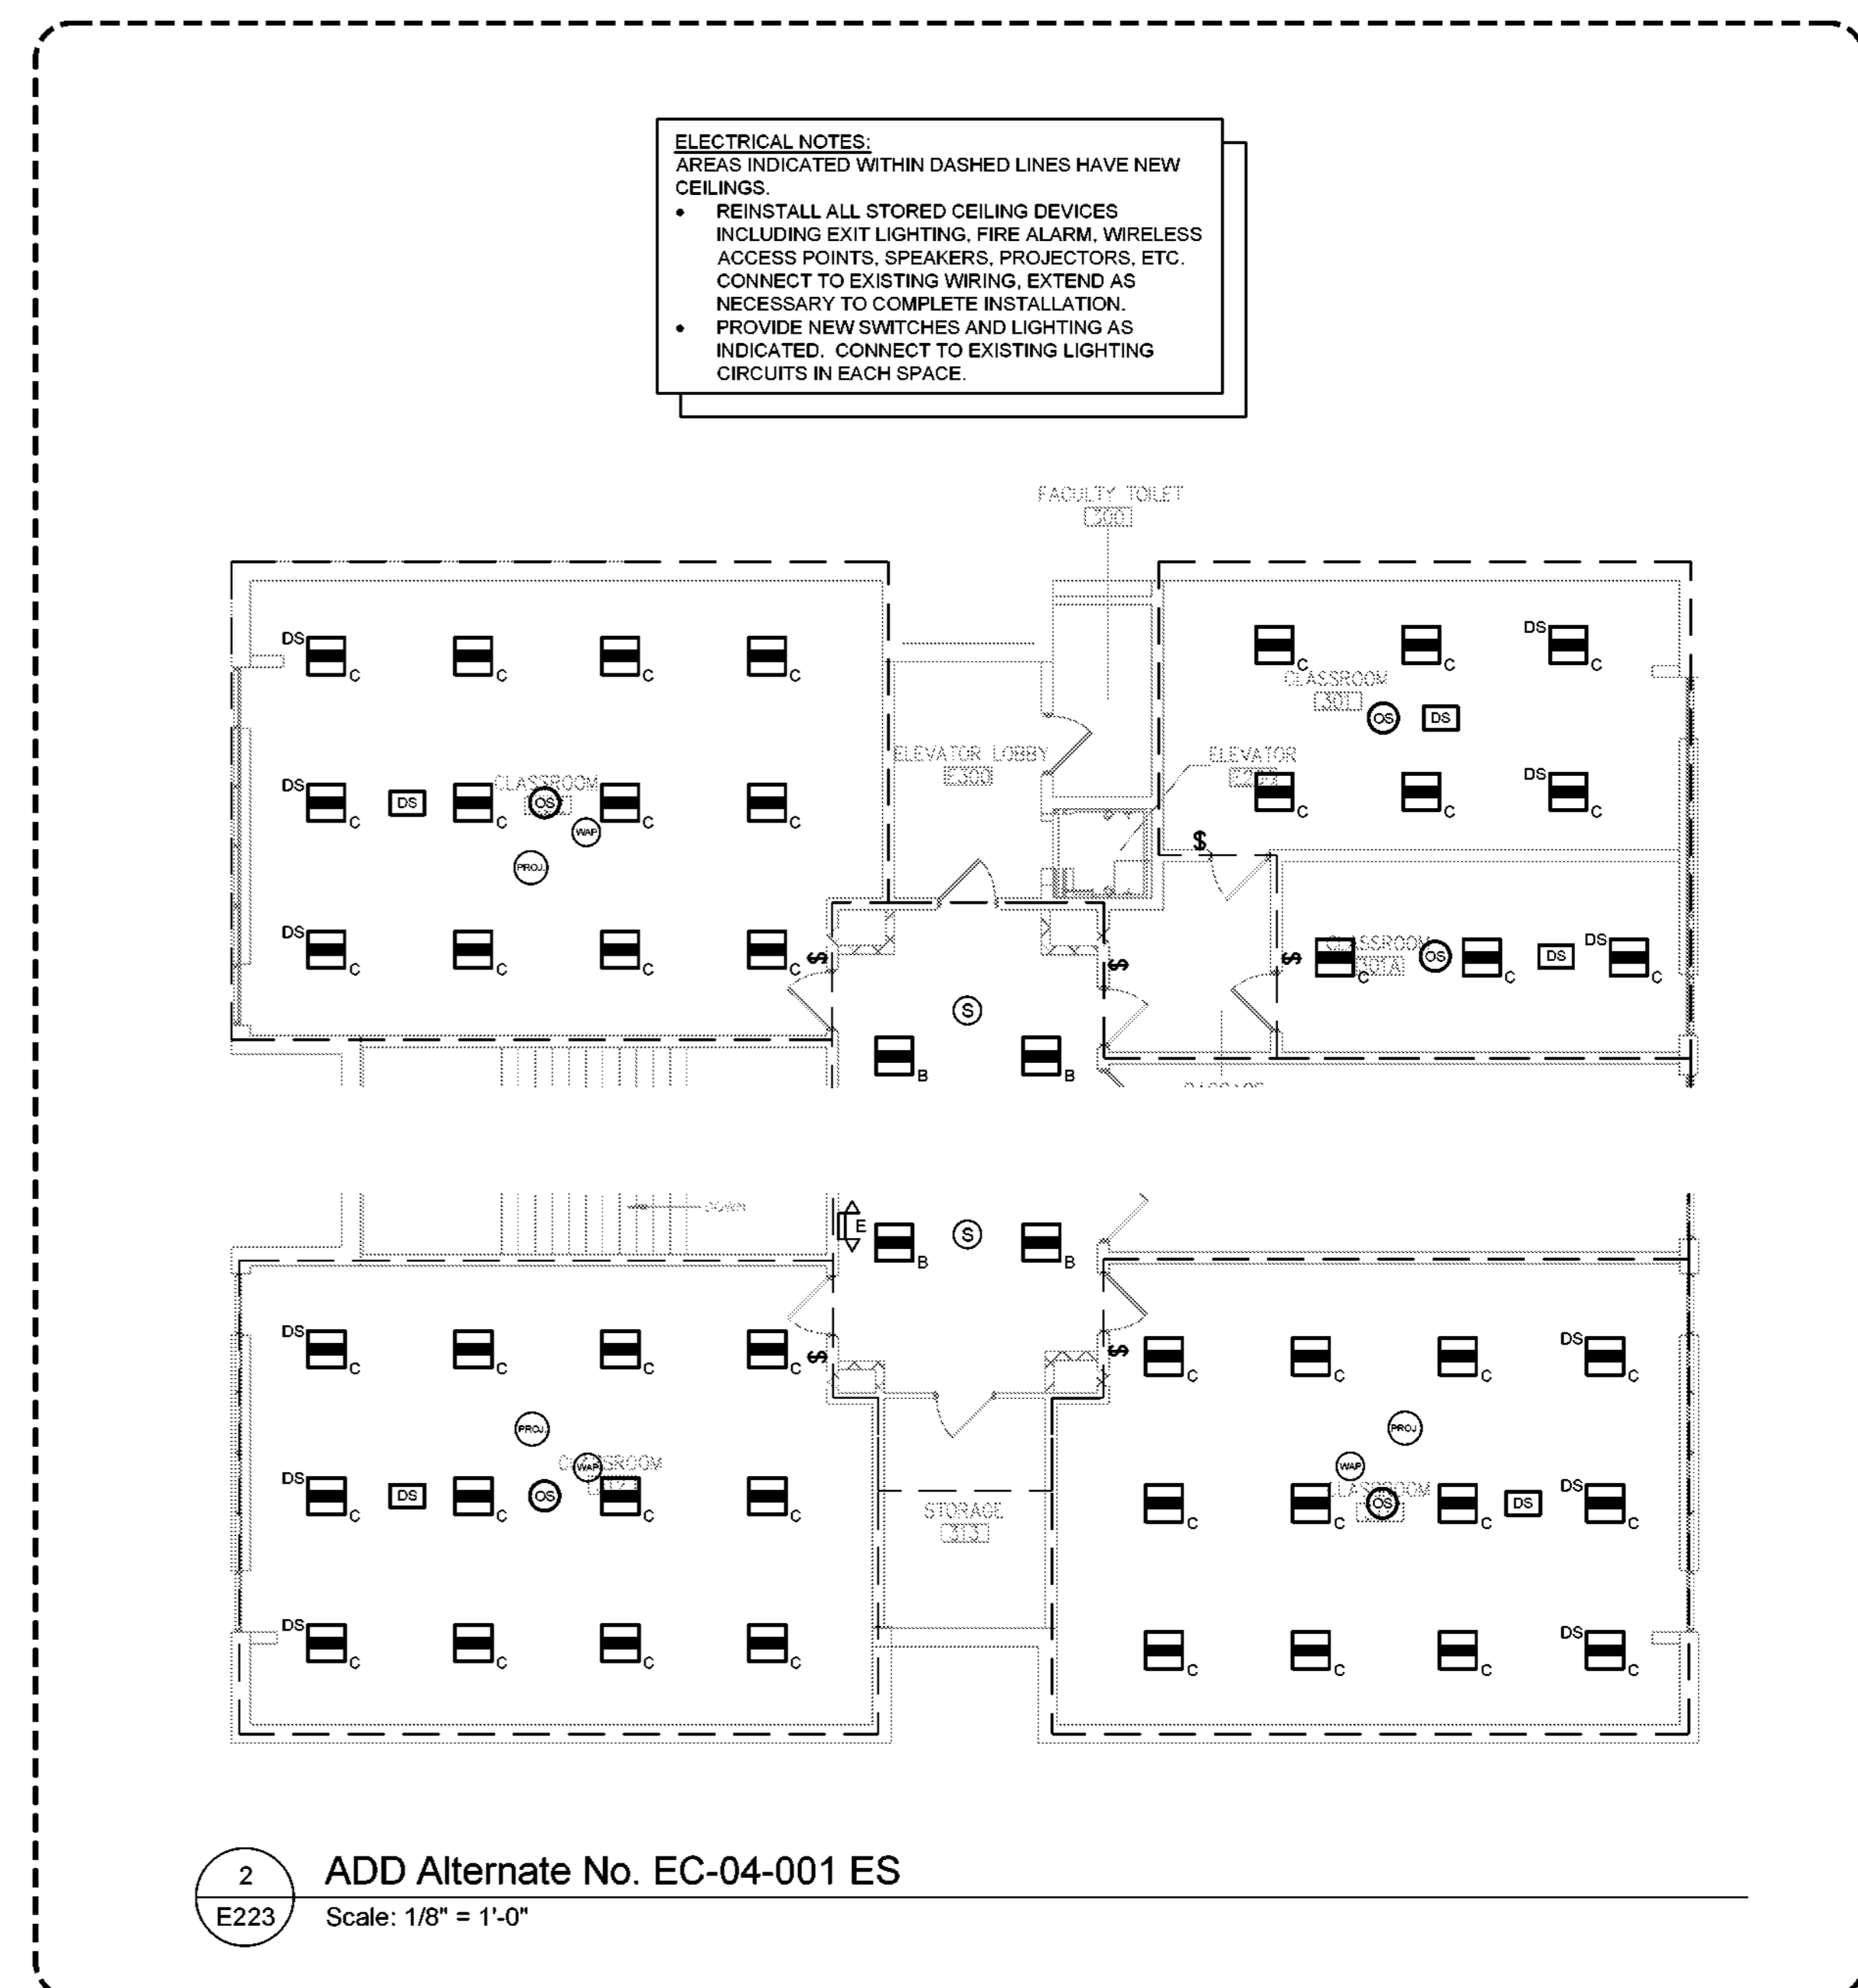


2 ADD Alternate No. EC-04-001 ES  
E223 Scale: 1/8" = 1'-0"

Scale: 1/8" = 1'-0"

**ADD ALTERNATE NO. EC-04-001-ES**

CEILINGS TO BE REPLACED IN CLASSROOM 301, 301A, 302, 311 &  
312 - PROVIDE TYPE C LIGHT FIXTURES AND ASSOCIATED  
CEILING WORK PER LAYOUTS ABOVE AND ELECTRICAL NOTES

## KEY PLAN

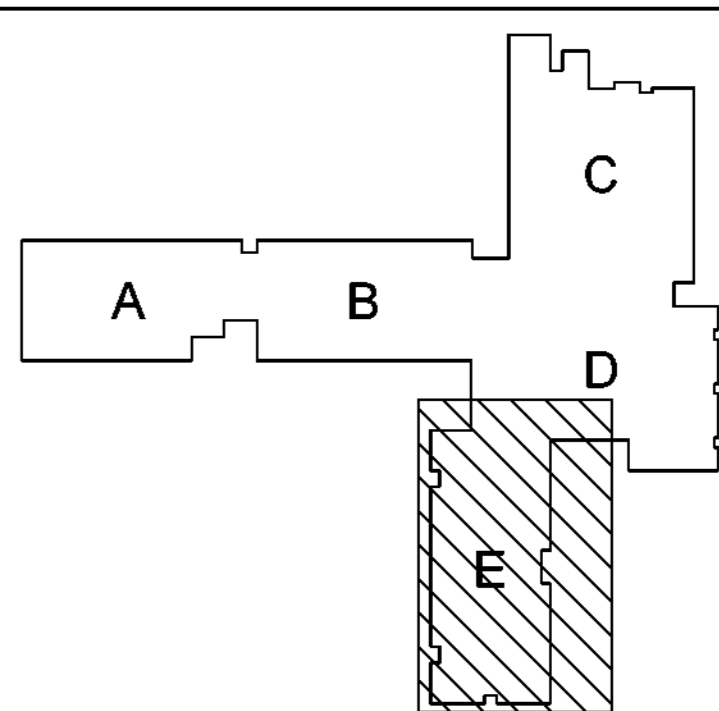

Copyright © All Rights Reserved