

Electrical General Notes

PROJECT INFORMATION:

- UNLESS SPECIFICALLY NOTED OTHERWISE, IT SHALL BE UNDERSTOOD THAT WHEN THE WORDS "OWNER" OR "CLIENT" ARE USED IN THESE DRAWINGS THEY ARE INTERCHANGEABLE AND ALL REFERENCE TO THE MAMARONECK UFSF.
- UNLESS SPECIFICALLY NOTED OTHERWISE, IT SHALL BE UNDERSTOOD THAT WHEN THE WORDS "ARCHITECT", "ENGINEER", OR "A/E" ARE USED IN THESE DRAWINGS, THEY ARE INTERCHANGEABLE AND ALL REFERENCE TO L&A ASSOCIATES, ENGINEERING, PLANNING, ARCHITECTURE SURVEYING ("L&A").
- UNLESS SPECIFICALLY NOTED OTHERWISE, IT SHALL BE UNDERSTOOD THAT WHEN THE WORD "CONTRACTOR" IS USED IN THE ELECTRICAL (E# ##) DRAWINGS AND/OR ELECTRICAL SPECIFICATION SECTIONS IT REFERS TO THE ELECTRICAL CONTRACTOR.
- WHERE ANY PART OF EQUIPMENT IS REFERRED TO IN THESE DRAWINGS IN THE SINGULAR NUMBER (E.G., "THE SWITCH", "THE RECEPTACLE"), THIS REFERENCE SHALL BE DEEMED TO APPLY TO AS MANY SUCH DEVICES AS ARE REQUIRED TO COMPLETE THE INSTALLATION AS SHOWN ON THE DRAWINGS.
- HEALTH, SAFETY, AND CRITICAL OPERATING EQUIPMENT SHALL NOT BE COMPROMISED WITHOUT OWNER'S AUTHORIZATION. SCHEDULE SHUTDOWN DURING OFF HOURS AND IMPLEMENT AND MAINTAIN A TEMPORARY OPERATIONAL PLAN.

CODE & STANDARDS COMPLIANCE:

- WHERE CODES ARE REFERENCED, THEY SHALL BE THE VERSION ENFORCED AS OF DECEMBER, 2022.
- CODE COMPLIANCE IS MANDATORY. NOTHING IN THESE DRAWINGS AND SPECIFICATIONS PERMITS WORK NOT CONFORMING TO THESE CODES, WHERE WORK IS SHOWN TO EXCEED MINIMUM CODE REQUIREMENTS, COMPLY WITH DRAWINGS AND SPECIFICATIONS. WHEN DIFFERENCES IN UTILITY SPECIFICATIONS OR STANDARDS, GOVERNMENTAL ORDINANCES OR CODES OCCUR, THE MORE STRINGENT REQUIREMENTS SHALL GOVERN THE INSTALLATION.
- THE ELECTRIC INSTALLATION SHALL BE IN ACCORDANCE WITH THE CURRENTLY ENFORCED EDITION OF THE NYSED MANUAL OF PLANNING STANDARDS, NATIONAL ELECTRICAL CODE (NEC), NATIONAL ELECTRICAL SAFETY CODE (NEC), AMERICAN ELECTRICIANS' HANDBOOK, INTERNATIONAL BUILDING CODE (IBC), AMERICANS WITH DISABILITIES ACT (ADA), NFPA 55 & 99 ASHRAE 90.1 AND NEC STANDARD OF INSTALLATION, WHEREVER THE DOCUMENTS THE WORD "CODE" IS STATED, THE MORE STRINGENT OF THE ABOVE REFERENCED CODES IS IMPLIED.
- ALL CONTRACTOR SUPPLIED MATERIALS/EQUIPMENT SHALL BE NEW AND UL LISTED OR APPROVED BY ANOTHER NATIONALLY RECOGNIZED TESTING LABORATORY (NRTL).
- THE CONTRACTOR SHALL PAY FOR AND OBTAIN ALL PERMITS AND INSPECTIONS REQUIRED BY THE DRAWINGS, BUILDING AND SAFETY CODES AND ORDINANCES, AND THE RULES AND REGULATIONS OF ANY LEGAL BODY HAVING JURISDICTION. PERMIT AND INSPECTIONS SHALL BE INCLUDED IN THE BASE BID AND SHALL NOT BE CAUSE FOR AN EXTRA.
- CONTRACTOR SHALL CONFORM TO ALL SAFETY RULES AND OTHER REGULATIONS, ETC. PERTAINING TO CONSTRUCTION WORK ON THE CLIENT'S PREMISES. CONTRACTOR SHALL REVIEW ALL APPLICABLE SAFETY RULES AND RULES AND REGULATIONS HAVE BEEN MET AND COORDINATE THIS WORK WITH RESPONSIBLE CLIENT'S PERSONNEL.
- ALL ELECTRICAL EQUIPMENT AND RACEWAYS PERMANENTLY ATTACHED TO STRUCTURES, INCLUDING SUPPORTING STRUCTURES AND ATTACHMENTS TO NON-BUILDING STRUCTURES, SHALL BE ANCHORED FOR SEISMIC LOADING TO RESIST A HORIZONTAL FORCE ACTION IN ANY DIRECTION. CONTRACTOR SHALL PROVIDE SEISMIC RESTRAINTS FOR ALL CONDUITS LARGER THAN 2 1/2" TRADE DIAMETER. PROVIDE SWAY BRACES FOR CONDUIT AND EQUIPMENT SUSPENDED FROM THE OVERHEAD. PROVIDE ANCHOR BOLTS FOR FLOOR AND WALL MOUNTED EQUIPMENT. THE INSTALLATION SHALL MEET THE REQUIREMENTS OF INTERNATIONAL BUILDING CODE (IBC) AS IT APPLIES TO ELECTRICAL EQUIPMENT FOR EARTHQUAKE LOADS.
- CONTRACTOR SHALL COMPLY WITH ALL CITY, STATE, AND FEDERAL ALL PENETRATIONS THROUGH FIRE/SMOKE PARTITIONS, FLOOR AND ROOFS, PATCH COMPROMISED PARTITIONS TO MATCH FIRE/SMOKE RESISTANCE RATING AS STATED ON CODE COMPLIANCE DRAWINGS.

GENERAL PROCEDURES:

- ALL EQUIPMENT SHALL BE AS INDICATED BY THE ENGINEER/ARCHITECT.
- THE COST INCURRED BY THE ACCEPTANCE OF SUBSTITUTIONS SHALL BE BORNE BY THE CONTRACTOR. PROOF FOR THE EQUALITY OF THE SUBSTITUTIONS SHALL BE BY THE CONTRACTOR AND DIFFERENCES SHALL BE ENUMERATED WITH THE SUBMITTAL. SUBMISSION WITHOUT THE DIFFERENCES NOTED CAN BE GROUNDS FOR REJECTION WITHOUT REVIEW.
- ELECTRICAL COMPONENTS, INCLUDING BUT NOT LIMITED TO CONDUCTOR SIZE, OVERCURRENT PROTECTION DEVICE AND DISCONNECT SWITCHES ARE BASED ON THE POWER REQUIREMENTS OF THE EQUIPMENT SHOWN ON THE CONTRACT DOCUMENTS. ALL COSTS (INCLUDING ADDITIONAL DESIGN FEES IF REQUIRED) ASSOCIATED WITH CHANGES TO THESE POWER REQUIREMENTS SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR MAKING THE CHANGE.
- OBTAIN SHOP DRAWINGS AND WIRING DIAGRAMS FOR THE PROPER INSTALLATION OF RELATED ELECTRICAL WORK.
- THE CONTRACTOR SHALL REMOVE AND REINSTALL CEILING SYSTEMS AS REQUIRED FOR THE INSTALLATION OF NEW ELECTRICAL WORK AND REPLACE IN KIND, ANY COMPONENTS DAMAGED BY PERSONNEL OR EQUIPMENT DURING PERFORMANCE OF THE WORK.
- ELECTRICAL CONTRACTOR SHALL BE RESPONSIBLE FOR THE REMOVAL OF DEBRIS GENERATED BY HIS WORK AND WORKERS AT THE END OF EACH WORKING DAY AND FOR GENERAL GOOD HOUSEKEEPING BY HIS WORKERS. ELECTRICAL CONTRACTOR SHALL PROVIDE REQUIRED REFUSE CONTAINERS. UNLESS OTHERWISE INDICATED ON THE MECHANICAL/FOOD SERVICE SCHEDULES/DRAWINGS, THE ELECTRICAL CONTRACTOR SHALL PROVIDE AND INSTALL ALL DISCONNECT SWITCHES FOR ALL MECHANICAL EQUIPMENT (I.E., ROOF TOP HVAC UNITS, EXHAUST FANS, VARIABLE AIR VOLUME DEVICES, ETC.)

SITE CONDITIONS/DRAWING COORDINATION:

- THESE DRAWINGS AND SPECIFICATIONS ILLUSTRATE THE WORK TO BE PERFORMED. THE ENGINEER IS NOT RESPONSIBLE FOR THE MEANS, METHODS, TECHNIQUES, SEQUENCES, AND PROCEDURES USED TO DO THE WORK, OR THE SAFETY ASPECTS OF CONSTRUCTIONS, AND NOTHING ON THESE DRAWINGS EXPRESSED OR IMPLIED CHANGES THIS CONDITION. PRIOR TO BIDDING AND/OR STARTING WORK THE CONTRACTOR SHALL VISIT THE PROJECT SITE TO DETERMINE THE CONDITIONS UNDER WHICH THE WORK IS TO BE PERFORMED AND SHALL BE RESPONSIBLE FOR KNOWING HOW THEY AFFECT THE WORK. SCHEDULE SITE VISIT WITH CLIENT'S REPRESENTATIVES. ADDITIONALLY, THE CONTRACTOR SHALL FIELD VERIFY ALL SITE DIMENSIONS AND ROOM LAYOUTS. SUBMISSION OF A BID TO PERFORM THIS WORK IS AN ACKNOWLEDGEMENT OF THESE RESPONSIBILITIES, AND THAT THEY HAVE BEEN FULLY CONSIDERED IN PLANNING OF THE WORK, AND THE BID PRICE. NO CLAIMS OR EXTRA CHARGES DUE TO THESE CONDITIONS WILL BE FORTHCOMING.
- THE CLIENT WILL OCCUPY THE SITE AND EXISTING BUILDING DURING THE ENTIRE CONSTRUCTION PERIOD. COOPERATE WITH THE CLIENT'S CONSTRUCTION OPERATIONS TO AVOID ANY CONFLICTS. PERFORM THE WORK SO AS NOT TO INTERFERE WITH THE CLIENT'S OPERATIONS. SCHEDULE ALL POWER OUTAGES, WITH THE CLIENT'S APPROVAL, FOR OVERTIME ON SUNDAYS AND HOLIDAYS AT NO ADDITIONAL COST TO THE CLIENT.
- EXISTING PROJECT CONDITIONS INDICATED ARE BASED ON FIELD OBSERVATIONS. EXISTING DESIGN/CONSTRUCTION DOCUMENTS AND EXISTING RECORD DOCUMENTS ARE INTENDED TO INDICATE THE SCOPE OF THE WORK AFFECTED BY THIS PROJECT.
- DRAWINGS SHALL NOT BE SCALED. DRAWINGS INDICATE THE GENERAL ARRANGEMENT OF SYSTEMS AND REQUIREMENTS OF THE WORK, ALTHOUGH SIZE AND LOCATION OF EQUIPMENT IS DRAWN TO SCALE WHEREVER POSSIBLE. CONTRACTOR SHALL MAKE USE OF ALL DATA IN ALL OF THE CONTRACT DOCUMENTS AND VERIFY INFORMATION AT THE PROJECT SITE.
- THE ELECTRICAL CONTRACTOR SHALL MAKE HIS OWN TAKEOFF ON ALL QUANTITIES. IT SHALL BE HIS RESPONSIBILITY, AT HIS COST, TO INCLUDE ALL EQUIPMENT AND MATERIAL IN ORDER TO COMPLY WITH THE INTENT OF THE DRAWINGS.
- THE CIRCUIT NUMBERS ARE FOR IDENTIFICATION ONLY. THE CONTRACTOR SHALL BE RESPONSIBLE FOR CORRECTLY PHASING THE CIRCUITS IN PANELS.
- EXISTING CIRCUIT DESIGNATIONS:
  - ALL REFERENCE TO EXISTING CIRCUIT DESIGNATIONS IS BASED ON PREVIOUS PROJECT DOCUMENTATION. THE CONTRACTOR SHALL CONSULT THE ENGINEER IN THE EVENT THAT ACTUAL CONDITIONS DO

- NOT COINCIDE WITH THE INDICATED RE-DISTRIBUTION OR OTHER USE OF EXISTING CIRCUITS AS HEREIN INDICATED.
  - THE TOTAL CONNECTED LOAD FOR ANY GENERAL PURPOSE (PROTECTED AT 20A) BRANCH CIRCUIT WHICH IS RE-DISTRIBUTED AS A PART OF THIS PROJECT SHALL NOT EXCEED 13A.
  - ANY VARIATION, AS MAY BE DIRECTED BY THE ENGINEER, FROM THE INDICATED CIRCUIT STRUCTURE SPECIFIED IN THIS DRAWING SET WILL REQUIRE BOTH VERIFICATION BY THE CONTRACTOR THAT THE TOTAL CONNECTED LOAD ON THE ASSOCIATED SUPPLY CONDUCTORS IS WITHIN THE ABOVE SPECIFIED LIMIT AND DOCUMENTATION IN THE PROJECT RECORD (AS-BUILT) DRAWINGS.
- THE ELECTRICAL INSTALLATION SHOWN IS REPRESENTED DIAGRAMMATICALLY AND INDICATES THE GENERAL ARRANGEMENT OF SYSTEMS, THE LOCATIONS AND ARRANGEMENTS OF EQUIPMENT, DEVICES, SWITCHBOARDS, PANELBOARDS, PARTITIONS, OPENINGS, ETC. ARE DESIGNED TO SHOW PREFERRED CONFIGURATIONS TO SUIT KNOWN CONDITIONS BUT ARE APPROXIMATE AND ARE SUBJECT TO MODIFICATIONS CAUSED BY STRUCTURAL CONDITIONS AND OTHER EXISTING OR PROPOSED EQUIPMENT. THE LOCATIONS ARE SUBJECT TO SUCH MODIFICATIONS AS MAY BE FOUND NECESSARY OR DESIRABLE AT THE TIME OF INSTALLATION IN ORDER TO ACCOMMODATE FIELD CONDITIONS AND COORDINATION REQUIREMENTS. CONTRACTOR SHALL FOLLOW THE INTENT OF THE DRAWINGS IN "LAYING OUT" THE WORK AND COORDINATE THE WORK WITH OTHER TRADES TO VERIFY SPACING CONDITIONS. CONTRACTOR SHALL DETERMINE ROUGH-IN LOCATIONS REQUIRED TO EFFECT SUCH COORDINATION. THE ELECTRICAL CONTRACTOR SHALL COORDINATE ALL WORK AND SHALL MAKE SUCH CHANGES WITHOUT EXTRA CHARGE.

- THE CONTRACT DRAWINGS DEPICT THE APPROXIMATE LOCATION OF ALL REQUIRED EQUIPMENT AND IF SHOWN, THE DIAGRAMMATIC ARRANGEMENT OF PIPING, RACEWAYS, CONDUITS, FEEDERS, CABLES, ETC. HEREIN AFTER REFERRED TO AS "CONDUIT." CONDUIT RUNS, IF SHOWN, HAVE BEEN DEPICTED WITH THE INTENT OF MOST CLEARLY INDICATING THE PROPOSED ROUTING. ACTUAL RUNS MAY DIFFER IF KEPT WITHIN THE REQUIREMENTS AND PROVISIONS OF THESE SPECIFICATIONS, AND PROVIDING THAT THAT ALL MODIFICATIONS HAVE BEEN SHOWN IN THE SHOP DRAWINGS. CONTRACTOR RESPONSIBLE TO DETERMINE CONDUIT RUNS AND "CLEAR" PIPING, DUCTWORK, ACCESS DOORS, AND OTHER OBSTRUCTIONS TO APPLICABLE. CONTRACTOR SHALL COORDINATE CONDUIT WITH WORK OF OTHER TRADES AND ALTER WHERE NECESSARY TO AVOID INTERFERENCE. SUBMIT FOR APPROVAL, PRIOR TO SCALED INSTALLATION DRAWINGS SHOWING THE LOCATION OF ALL NEW EQUIPMENT/DEVICES TO BE INSTALLED AND INDICATING CIRCUITRY. SHOP DRAWINGS SHALL INCLUDE ALL WIRING, PULL BOXES, JUNCTION BOXES, FITTINGS, WIRING DEVICES AND DIMENSIONED CLEARANCES FROM THE STRUCTURE AND EQUIPMENT. COORDINATE SHOP DRAWINGS WITH OTHER TRADES PRIOR TO SUBMISSION.
- ROUTING FOR FEEDERS, INSTRUMENTATION AND CONTROL CIRCUITS IS NOT SHOWN ON THE PLAN DRAWINGS. IF INDICATED ON THE FLOOR PLANS, THEY EXPRESS THE INTENT OF ROUTING. FINAL LOCATION AND ROUTING SHALL BE SUITED FOR THE CONSTRUCTION OF THE BUILDING AND ESTABLISHED BY THE CONTRACTOR BASED ON THE INSTALLATION CONDITIONS AND SHALL BE VERIFIED IN THE FIELD. ALL FEEDER INSTALLATION, CONDUIT TYPES AND INSTALLATION REQUIREMENTS SHALL BE IN ACCORDANCE WITH THE SPECIFICATIONS, ELECTRICAL RISER DIAGRAM AND APPROPRIATE PANEL SCHEDULES.

- ANY CUTTING, PATCHING, OR FINISH REPAIR WORK REQUIRED FOR THE ELECTRICAL INSTALLATION IS THE RESPONSIBILITY OF THE CONTRACTOR. WHERE MOUNTING HEIGHTS ARE NOT FIELD OR DIMENSIONED, INSTALL ELECTRICAL SERVICES AND OVERHEAD EQUIPMENT TO PROVIDE MAXIMUM HEADROOM POSSIBLE. CONNECT EQUIPMENT FOR EASE OF DISCONNECTING WITH MINIMUM INTERFERENCE WITH OTHER INSTALLATIONS.
- PROVIDE TEMPORARY POWER AND LIGHTING AS REQUIRED DURING THE ENTIRE DURATION OF DEMOLITION AND CONSTRUCTION UTILIZING THE EXISTING ELECTRICAL SYSTEM AS A SOURCE. THE ELECTRICAL CONTRACTOR SHALL PROVIDE TEMPORARY POWER AND LIGHTING UPON THE COMPLETION OF THE PROJECT.
- UNLESS OTHERWISE NOTED, REFER TO ARCHITECTURAL DRAWINGS FOR ELEVATIONS AND RELATIVE POSITIONS OF EQUIPMENT, WALL, CEILING AND FLOOR INFORMATION AND MINOR ARCHITECTURAL DIFFERENCES IN EACH ROOM.
- WHERE CONFLICTS EXIST, PROVIDE IN THE BID PROPOSAL THE MORE COSTLY ALTERNATIVE.

WORK/TRADE COORDINATION

- COORDINATE WORK WITH OTHER TRADES TO AVOID CONFLICT AND TO PROVIDE CORRECT ROUGH-IN AND CONNECTION FOR EQUIPMENT FURNISHED UNDER TRADES THAT ARE NOT LIMITED TO THE ELECTRICAL CONTRACTOR. CONTRACTORS OF OTHER TRADES OF THE REQUIRED ACCESS TO AND CLEARANCES AROUND ELECTRICAL EQUIPMENT TO MAINTAIN SERVICEABILITY AND CODE COMPLIANCE.
- THE ELECTRICAL CONTRACTOR SHALL VERIFY THE SIZE AND RATING OF ALL APPROVED MECHANICAL EQUIPMENT PRIOR TO THE INSTALLATION OF FEEDER AND BRANCH CIRCUIT CONDUCTORS AND OVERCURRENT PROTECTION DEVICES.
- AC AND REFRIGERATION EQUIPMENT NAMEPLATE RATING: SHORT CIRCUIT AND GROUND FAULT PROTECTION DEVICE RATING SHALL NOT EXCEED THE MANUFACTURER'S VALUES MARKED ON THE EQUIPMENT.
- SEQUENCE, COORDINATE AND INTEGRATE INSTALLATIONS OF ELECTRICAL MATERIALS AND EQUIPMENT FOR EFFICIENT FLOW OF WORK. GIVE PRIORITY TO THE REMOVAL OF OTHER ELECTRICAL EQUIPMENT. COORDINATE PRIOR TO CLOSING IN THE BUILDING. COORDINATE THE CUTTING AND PATCHING OF BUILDING COMPONENTS TO ACCOMMODATE INSTALLATION OF THE ELECTRICAL EQUIPMENT AND MATERIALS.
- PROVIDE COORDINATION DRAWINGS FOR ALL REQUIRED ACCESS PANEL LOCATIONS IN GYPSUM CEILING TO ARCHITECT/ENGINEER FOR COORDINATION.
- THE CONTRACTOR SHALL COORDINATE WORK WITH THE OTHER TRADES TO ENSURE THE MINIMUM SAFE WORKING CLEARANCES AROUND ELECTRICAL EQUIPMENT AND TO ENSURE ACCESS TO EQUIPMENT REQUIRING CALIBRATION OR MAINTENANCE (INCLUDING MOTORS, CONTROLS, INSTRUMENTS, PANELS, LIGHTS, VALVES, FILTERS, AND VAV BOXES). WORKING SPACE AND ACCESS SHALL BE SUFFICIENT FOR AN ADULT TO PERFORM MAINTENANCE SAFELY WITHOUT STRADDLING OR REMOVING OBSTRUCTIONS AND SHALL CONFORM TO NEC REQUIREMENTS (I.E., 110.26 & 110.34). WORK THAT ENCROACHES ON WORKING SPACE OR THAT IMPEDES MAINTENANCE SHALL BE RELOCATED AT THE CONTRACTOR'S EXPENSE.

INSTALLATION:

- GROUNDING SHALL BE INSTALLED IN ACCORDANCE WITH THE NEC IN ACCORDANCE WITH ELECTRODE, GROUNDING AND BONDING REQUIREMENTS FOR SERVICE, EQUIPMENT AND ENCLOSURES. INSTALL AN INSULATED EQUIPMENT GROUND CONDUCTOR IN EACH RACEWAY OR CONDUIT. SIZE EQUIPMENT GROUND CONDUCTOR IN ACCORDANCE WITH NEC TABLE 250.122. BOND RACEWAYS AND THE FRAMES AND ENCLOSURES OF MOTORS, BREAKERS, SWITCHES, AND OTHER ELECTRICAL EQUIPMENT TO THE BUILDING GROUNDING SYSTEM. PRECAUTION SHALL BE TAKEN TO ENSURE ADEQUATE GROUND CONTINUITY ALONG THE CONDUIT OR RACEWAY.
- PROVIDE A SEPARATE NEUTRAL CONDUCTOR FOR EACH CIRCUIT. INSTALL NEUTRAL CONDUCTORS AND GROUND CONDUCTORS INTO ALL SWITCH BOXES. MULTIPLE CIRCUITS SHALL NOT SHARE A COMMON NEUTRAL. NEUTRAL SHALL BE SIZED AS LARGE AS THE PHASE CONDUCTORS. NEUTRAL CONDUCTORS SHALL NOT BE REDUCED IN SIZE.
- ARRANGE CONNECTIONS FOR SINGLE PHASE CIRCUITS TO ACHIEVE THREE PHASE LOAD BALANCE WITHIN 20% OF THE AVERAGE PHASE LOAD CURRENT. UNGROUNDED CONDUCTORS USING A COMMON NEUTRAL MUST ORIGINATE FROM DIFFERENT PHASES.
- THE ELECTRICAL CONTRACTOR IS RESPONSIBLE FOR MAINTAINING PROPER PHASE ROTATION WITH ALL PENETRATIONS THROUGH THE BUILDING.
- PHASE ROTATION CHECK: ON MULTI-PHASE EQUIPMENT, PERFORM A PHASE ROTATION CHECK PRIOR TO ENERGIZING THE EQUIPMENT. USE KNOPP K-3 OR EQUIVALENT DEVICE WITH RED OR "A" LEAD CONNECTED TO PHASE A, WHITE OR "B" LEAD CONNECTED TO PHASE B, AND BLUE OR "C" LEAD CONNECTED TO PHASE C. NOTE THE PHASE ROTATION AND ANNOTATE TEST DOCUMENTATION WITH DEVICE USED, MANNER CONNED, ROTATION OBSERVED, DATE OF TEST, AND NAME OF CRAFTSMAN. DO NOT ENERGIZE EQUIPMENT UNLESS OBSERVED ROTATION MATCHES THE REQUIREMENTS OF THE EQUIPMENT.
- CONTRACTOR SHALL SUPPLY ALL LABOR, POWER CABLES, CONDUIT BOXES, FITTINGS, WIRING MATERIALS, HARDWARE, SUPPORTS, AND MISCELLANEOUS

- ITEMS FOR A COMPLETE ELECTRICAL INSTALLATION AND CONNECTION OF THE ELECTRICAL WORK REQUIRED, EXCEPT THAT THE PROVISION FOR OWNER SUPPLIED EQUIPMENT SHALL BE ONLY BE COMPLETED TO THE POINT INDICATED ELSEWHERE ON THE DRAWINGS.
- THE CONTRACTOR/INSTALLER SHALL USE A CALIBRATED TORQUE TOOL TO ACHIEVE THE INDICATED TORQUE VALUE WHEN THE TIGHTENING TORQUE INDICATED CIRCUIT STRUCTURE SPECIFIED IN THIS DRAWING SET. IN THE INSTALLATION INSTRUCTIONS, IN THE ABSENCE OF CONNECTOR OR THE EQUIPMENT MANUFACTURER'S RECOMMENDED TORQUE VALUES, THE TABLES IN INFORMATIVE ANNEX I MAY BE USED TO CORRECTLY TIGHTEN SCREW-TYPE CONNECTIONS FOR POWER AND LIGHTING CIRCUITS. INFORMATIVE ANNEX I REPRESENTS THE "RECOMMENDED TIGHTENING TORQUE TABLES FROM UL STANDARDS AND THE GENERAL ARRANGEMENT OF SYSTEMS."
- ALL CABLES, NOT WITHIN CONDUIT (EX., MC TYPE, FIRE ALARM, PA), ROUTED WITHIN THE CEILING CAVITY MUST BE SECURED USING BRIDLE RINGS, J-HOOKS, OR OTHER APPROPRIATE MEANS. THE CABLE MUST NOT LAY ON DROPPED CEILING PANELS, BE FASTENED TO EXISTING ELECTRICAL CONDUITS, STEAM PIPES, SPRINKLER PIPES, INSULATED PIPES, OR BE ROUTED IN SUCH A FASHION AS TO OBSTRUCT ACCESS HATCHES, DOORS, UTILITY ACCESS PANELS, MECHANICAL SERVICE WORK AREAS OR FITTINGS AND SHALL NOT BE ROUTED THROUGH FIRE DOORS, VENTILATING SLATS, OR GRATES.
  - UNLESS OTHERWISE PROVIDED, MC CABLES SHALL BE SECURED AT INTERVALS NOT EXCEEDING 6'. CABLES CONTAINING FOUR OR FEWER CONDUCTORS SIZED NO LARGER THAN 10 AWG SHALL BE SECURED WITHIN EVERY BOX, CABINET, FITTING, OR OTHER CABLE TERMINATION.
  - TYPE MC CABLE SHALL BE PERMITTED TO BE UNSUPPORTED WHERE THE CABLE: (A) IS FISHED BETWEEN ACCESS POINTS THROUGH CONCEALED SPACES IN FINISHED BUILDINGS OR STRUCTURES AND SUPPORTING IS IMPRACTICAL, OR (B) IS NOT MORE THAN 8' IN LENGTH FROM THE LAST POINT OF CABLE SUPPORT TO THE POINT OF CONNECTION TO LUMINAIRES OR OTHER ELECTRICAL EQUIPMENT AND THE CABLE AND POINT OF CONNECTION ARE WITHIN AN ACCESSIBLE CEILING. TYPE MC CABLE FITTINGS SHALL BE PERMITTED AS A MEANS OF CABLE SUPPORT.
- ALL CABLE TRAYS AND ELECTRICAL CONDUITS SHALL BE INDEPENDENTLY SUPPORTED AND BRACED INDEPENDENTLY OF THE CEILING.
- ALL NEW WIRING IS TO BE RUN CONCEALED WHEREVER POSSIBLE. WHEN NOT ROUTED CONCEALED IN THE CEILING/UNDER FLOOR CAVITIES CONDUCTORS SHALL BE IN A SURFACE MOUNTED METALLIC RACEWAY. IN PUBLIC SPACES, RACEWAY SHALL BE WIREMOLD OR EQUAL. IN UTILITY SPACES, RACEWAY SHALL BE METALLIC CONDUIT (REFER TO "APPLICATION OF RACEWAYS" FOR ADDITIONAL INFORMATION). ANY LOCATIONS THAT DO NOT HAVE ACCESSIBLE OR DROPPED CEILINGS WILL REQUIRE THE USE OF SURFACE MOUNTED METALLIC TRAYS OR OTHER TRADERS PRIOR TO SUBMISSION.
- LOCATE IN RUNS AS REQUIRED. NO EXPOSED CABLE MAY BE INSTALLED.
- SURFACE MOUNTED METALLIC RACEWAY SHALL MEET THE FOLLOWING CRITERIA AND CONFORM TO NEC ARTICLE 386:
  - INSTALL IN ACCORDANCE WITH MANUFACTURER'S INSTRUCTIONS FOR SYSTEM COMPONENTS AND APPROVED SHOP DRAWINGS. COORDINATE INSTALLATION WITH ADJACENT WORK TO ENSURE PROPER CLEARANCES AND TO PREVENT ELECTRICAL HAZARDS.
  - INSTALL IN ACCORDANCE WITH COMPLETE SYSTEM INSTALLATION SHEETS.
  - INSTALL ENCLOSURES TO BE MECHANICALLY CONTINUOUS AND CONNECTED TO ALL ELECTRICAL OUTLETS, BOXES, DEVICE MOUNTING BRACKETS, AND CABINETS, IN ACCORDANCE WITH MANUFACTURER'S INSTALLATION SHEETS.
  - INSTALL ENCLOSURES TO BE ELECTRICALLY CONTINUOUS AND BONDED IN ACCORDANCE WITH THE NATIONAL ELECTRIC CODE FOR PROPER GROUNDING.
  - MECHANICAL SECURITY: RACEWAY SYSTEMS SHALL BE MECHANICALLY CONTINUOUS AND CONNECTED TO ALL ELECTRICAL OUTLETS, BOXES, DEVICE MOUNTING BRACKETS, AND CABINETS, IN ACCORDANCE WITH MANUFACTURER'S INSTALLATION SHEETS.
  - ELECTRICAL SECURITY: METAL RACEWAY SHALL BE ELECTRICALLY CONTINUOUS AND BONDED IN ACCORDANCE WITH THE NATIONAL ELECTRIC CODE FOR PROPER GROUNDING.
  - RACEWAY SUPPORT: RACEWAY SHALL BE SUPPORTED BY 2-HOLE STRAPS AT INTERVALS NOT EXCEEDING 5 FEET OR IN ACCORDANCE WITH MANUFACTURER'S INSTALLATION SHEETS.
  - ACCESSORIES: PROVIDE ACCESSORIES AS REQUIRED FOR A COMPLETE INSTALLATION, INCLUDING INSULATED BUSHINGS AND INSERTS WHERE REQUIRED BY MANUFACTURER.
  - UNUSED OPENINGS: CLOSE UNUSED RACEWAY OPENINGS USING MANUFACTURER'S RECOMMENDED ACCESSORIES.
- WHERE PENETRATIONS EXIST THROUGH INTERIOR WALLS AND FLOOR SEPARATING AREAS TO MEET THE REQUIREMENTS OF NEC 352.44, EXPANSION FITTINGS SHALL BE INSTALLED ON ALL PVC RUNS GREATER THAN 6'.
- ALL OPENINGS AND PENETRATIONS SHALL BE SEALED UPON COMPLETION OF THE ELECTRICAL INSTALLATION TO PREVENT THE SPREAD OF SMOKE AND FIRE THROUGH OPENINGS. SEAL AROUND CONDUIT AND RACEWAY AND REPAIR ORIGINAL FIRE RATING; USE A UL CLASSIFIED FIRE SEALANT. SEAL PENETRATIONS THROUGH ROOF AND EXTERIOR WALLS TO MAKE WATERPROOF. REQUEST INSPECTION OF FIRE SEALS BY ELECTRICAL INSPECTOR FROM AUTHORITY HAVING JURISDICTION BEFORE AND AFTER PLACEMENT OF FIRE SEAL MATERIALS. ALL OPENINGS SHALL BE REPAIR MATCHED WITH THE OTHER TRADES TO LIMIT INTERFERENCE AND OBSTRUCTION.
- LIMIT THE USE OF ELECTRICAL METALLIC TUBING (EMT) TO WHERE IT WILL NOT BE SUBJECT TO PHYSICAL DAMAGE OR CORROSION. USE INTERMEDIATE METAL CONDUIT (IMC) OR RIGID GALVANIZED STEEL CONDUIT (RGS) WHERE RACEWAYS ARE EMBEDDED IN CONCRETE OR EXPOSED TO PHYSICAL DAMAGE. USE MINIMUM 3/4" CONDUIT EXCEPT AS FOLLOWS: 1/2" CONDUIT MAY BE USED FOR 20 AMP GENERAL LIGHT AND POWER CIRCUITS AND FOR CONTROL CIRCUITS; 3/8" FLEXIBLE METAL CONDUIT MAY BE USED TO CONNECT LIGHT FIXTURES IN SUSPENDED CEILINGS. USE LIQUID TIGHT FLEXIBLE METAL CONDUIT FOR FLEXIBLE CONNECTION TO EQUIPMENT IN MECHANICAL ROOMS OR OUTDOORS.
- WHERE RACEWAYS CONTAIN INSULATED CONDUCTORS 4 AWG AND LARGER THAT ENTER AN ENCLOSURE, THE CONDUCTORS MUST BE PROTECTED FROM ABRASION DURING AND AFTER INSTALLATION BY A FITTING THAT PROVIDES A SMOOTH, ROUNDED INSULATING SURFACE, SUCH AS AN INSULATING BUSHING AS PER NEC 300.4(G).
- INSTALL OUTDOOR EQUIPMENT TO BE WEATHERPROOF (NEMA 3R).
- ALL PENETRATIONS THROUGH EXTERIOR WALLS SHALL BE SEALED.
- INSIDE THE RACEWAY, THE FOLLOWING SHALL BE USED WHERE CONDUITS TO SEAL THE ANNULAR SPACE BETWEEN THE RACEWAY AND THE BUILDING PENETRATION. FURNISH AND INSTALL CONDUIT SEALING BUSHINGS AS MANUFACTURED BY OZ/GENDY TYPE CSMI OR CSMC OR APPROVED EQUAL FURNISH AND INSTALL CONDUIT SEALING BUSHINGS AS MANUFACTURED BY OZ/GENDY TYPE CSBG OR APPROVED EQUAL TO SEAL THE CONDUCTORS INSIDE THE RACEWAY. COORDINATE SUBMITTAL SUBMISSION WITH CONTRACTOR SIZE, QUANTITY AND INSULATION TYPE.
- WIRE INFORMATION:
  - ALL WIRING SHALL BE COPPER CONDUCTOR, 600 VOLTS IN EMT RACEWAY WITH APPROVED FITTINGS UNLESS OTHERWISE INDICATED. FEEDER AND BRANCH CIRCUIT WIRING SHALL BE MINIMUM #12 AWG UNLESS OTHERWISE INDICATED. FEEDER AND BRANCH CIRCUIT WIRING LARGER THAN #10 AWG SHALL BE STRANDED CONDUCTOR. LIGHT AND POWER CIRCUITS SHALL BE SOLID CONDUCTOR. CONTROL WIRING SHALL BE #18 AWG THWN. TYPE OF INSULATION AS FOLLOWS UNLESS NOTED OTHERWISE:
    - THHN/THWN INSULATION FOR #4 AWG AND SMALLER
    - THW OR THHN/THWN INSULATION FOR #2 AWG AND LARGER
    - THW USED FOR ALL PANEL FEEDER AND SERVICE CONDUCTORS
  - ALL PENETRATIONS THROUGH EXTERIOR WALLS SHALL BE SEALED. INSULATED IN CONDUITS EXPOSED TO THE WEATHER.
- USE THE FOLLOWING CONDUCTOR COLOR CODES:

208Y/120V 480Y/277V	PHASE A	BLACK	BROWN
	PHASE B	RED	ORANGE
	PHASE C	BLUE	YELLOW
	NEUTRAL	WHITE	GRAY
	EQUIP. GROUND	GREEN	GREEN

CIRCUIT BREAKERS:

- USE 600 VAC CIRCUIT BREAKERS IN 480V AND 480Y/277V SWITCHBOARDS, PANELBOARDS AND MOTOR CONTROL CENTERS.
  - PROVIDE CIRCUIT BREAKERS WITH UL LISTED INTERRUPTING RATING (RMS SYMMETRICAL AMPERES) GREATER THAN THE AVAILABLE FAULT CURRENT SHOWN ON THE ELECTRICAL ONE-LINE DIAGRAM. "SERIES RATED" EQUIPMENT SHALL NOT BE ACCEPTED.
  - USE CIRCUIT BREAKER PADLOCKING DEVICES FOR SERVICE AND MAINTENANCE PERSONNEL ON ALL OVER CURRENT PROTECTION DEVICES AT THE MAIN BUILDING PANEL (MDP OR EQUIVALENT). THE DEVICE MUST HAVE PROVISIONS FOR PLACEMENT OF A LOCK ON IT TO SECURE THE DEVICE IN THE OFF POSITION. THE LOCK-OUT DEVICE MUST BE PART OF THE DISCONNECT ASSEMBLY AND MUST REMAIN IN PLACE AFTER THE PADLOCK IS REMOVED. WHETHER IT IS A FUSE OR DISCONNECT SWITCH, A SINGLE CIRCUIT BREAKER, OR A CIRCUIT BREAKER IN A PANELBOARD, A DEVICE THAT IS ATTACHED TO THE CIRCUIT BREAKER HANDLE BY A SET SCREW IS NOT AN ACCEPTABLE MEANS TO SERVE AS A SAFE METHOD OF LOCKING THE DEVICE IN THE OFF POSITION.
  - ALL CIRCUIT BREAKERS SHALL BE MOLDED CASE THERMAL MAGNETIC AND RATED FOR AVAILABLE SHORT CIRCUIT CURRENT.
- RECEPTACLES:
- RECEPTACLES AND COMMUNICATIONS OUTLETS SHOWN ON DRAWINGS SHALL BE MOUNTED 8" APART ON CENTER HORIZONTALLY. CONTRACTOR SHALL COORDINATE EXACT LOCATION OF ALL BOXES IN TWO HOUR OR LESS RATED ASSEMBLIES SUCH THAT AREA OF BOX PER WALL AREA AND OUTLETS ON MINIMUM 12" O.C. HORIZONTAL SPACING COMPLY WITH STATE BUILDING CODE REGARDING FIRE RESISTANT CONSTRUCTION.
  - IN ALL AREAS SPECIFIED IN THE NEC, ALL 125-VOLT, 15- AND 20-AMPERE RECEPTACLES SHALL BE LISTED TAMPER-RESISTANT RECEPTACLES.
  - ALL OUTDOOR RECEPTACLES SHALL BE MOUNTED 42" ABOVE THE FINISHED GRADE, UNLESS NOTED OTHERWISE. THE OUTDOOR RECEPTACLES SHALL BE SEaled WITH A WEATHERPROOF ENCLOSURE. THE WEATHERPROOF ENCLOSURE SHALL HAVE A GASKETED HINGED OUTLET COVER/ENCLOSURE WHICH IS SUITABLE FOR WET LOCATIONS WHILE IN USE AND UL LISTED AS MANUFACTURED BY TAYMAC OR APPROVED EQUAL.

LABELING:

- ALL SWITCHBOARDS, PANELBOARDS, INDUSTRIAL CONTROL PANELS AND MOTOR CONTROL CENTERS THAT ARE IN OTHER THAN DWELLING OCCUPANCIES AND ARE LIKELY TO REQUIRE EXAMINATION, ADJUSTMENT, SERVICING OR MAINTENANCE WHILE ENERGIZED SHALL BE FIELD MARKED TO WARN QUALIFIED PERSONS OF POTENTIAL ELECTRIC ARC FLASH HAZARDS. THE MARKING SHALL BE LOCATED SO AS TO BE CLEARLY VISIBLE TO QUALIFIED PERSONS BEFORE EXAMINATION, ADJUSTMENT, SERVICING OR MAINTENANCE. THE MARKING SHALL BE PERMANENT, MARKED ON A DURABLE COMMERCIAL LABEL, CONFORMING TO NEC 110.16 AND ANSI Z535.4. ARC FLASH LABEL SHALL BE BRADY (BRADYID.COM) CATALOG NO. 102308 OR EQUAL.
- PROVIDE IDENTIFICATION TAGS FOR ALL NEW WIRING AND INSTALL AT EACH END AND IN ALL INTERMEDIATE PULL/JUNCTION BOXES, CABINETS, HOUSINGS, ETC. INDICATE ON TAGS, LEGIBLY MINIMUM 1/4" HIGH LETTERS, THE POINTS OF ORIGIN AND TERMINATION OF EACH CABLE OR CONDUIT RUN. LABEL ALL RECEPTACLES AND SWITCH COVERS WITH PANELBOARD AND CIRCUIT NUMBER, FOR INTERIOR EQUIPMENT, USE BROTHER P-TOUCH 3 LABEL MAKER WITH TC-10 LABEL CARTRIDGE OR EQUAL. FOR EXTERIOR EQUIPMENT, USE ALUMINUM DYMO HALF-INCH TAPE LABEL WITH EMBOSSED LETTERING. ABBREVIATE LETTERING TO PROVIDE NECESSARY INFORMATION WITH MINIMUM LABEL SIZE (I.E., PANELBOARD PP1, CIRCUIT 23 SHOULD READ PP1-23).
- LABEL ALL SWITCHGEAR, PANELBOARDS, AND SEPARATELY-MOUNTED EQUIPMENT WITH FEEDER SOURCE AND CIRCUIT NUMBER. FOR INTERIOR EQUIPMENT, PROVIDE WHITE MICARTA PLATE WITH QUARTER-INCH BLOCK LETTERING. FOR EXTERIOR EQUIPMENT, PROVIDE ANODIZED ALUMINUM PLATE WITH QUARTER-INCH EMBOSSED BLOCK LETTERING. ATTACH TO EQUIPMENT USING CONDUIT CEMENT IN A CLEAR SPACE ON THE UPPER PORTION OF THE EQUIPMENT COVER APPROXIMATELY 66" AFF. ABBREVIATE LETTERING OR ADJUST LETTER SIZE TO PROVIDE NECESSARY INFORMATION WITH MINIMUM LABEL SIZE. (I.E., 227/480V PANEL PP1 FROM MDP CKT 3 OR P-1 20 HP PUMP FROM PP1 CKT 3).
- ALL PANELS SHALL HAVE TYPED, COMPLETED DIRECTORIES INDICATING EQUIPMENT IDENTIFICATION AND CIRCUIT IDENTIFICATION. THE IDENTIFICATION SHALL BE LOCATED IN EACH PANEL. THE IDENTIFICATION SHALL BE THE MAIN BUILDING SIGNAGE) OF EQUIPMENT LOCATION, OR SPARE, OR SPACE. IDENTIFY THE PURPOSE OF INDIVIDUAL CIRCUIT BREAKERS, SAFETY SWITCHES AND MOTOR STARTERS BY MEANS OF NAMEPLATES AS INDICATED. UPDATE DIRECTORIES AS PANELS ARE ALTERED. CIRCUIT CHANGES SHALL BE REFLECTED ON "AS-BUILT" DRAWINGS.
- ALL CIRCUITS AND CIRCUIT MODIFICATIONS MUST BE LEGIBLY IDENTIFIED AS TO THEIR CLEAR, EVIDENT, AND SPECIFIC PURPOSE. THE IDENTIFICATION MUST INCLUDE SUFFICIENT DETAIL TO ALLOW EACH CIRCUIT TO BE DISTINGUISHED FROM ALL OTHERS, AND THE IDENTIFICATION MUST BE ON A CIRCUIT DIRECTORY LOCATED ON THE FACE OR INSIDE OF THE DOOR OF A PANELBOARD. CIRCUIT DIRECTORIES CONTAINING MULTIPLE ENTRIES WITH ONLY "LIGHTS" OR "OUTLETS" DO NOT PROVIDE THE SUFFICIENT DETAIL REQUIRED BY THE NEC.


LIGHTING:

- SUPPORT FOR LIGHT FIXTURES IN OR ON GRID-TYPE SUSPENDED CEILINGS: A SEISMIC FIXTURE CLAMP (SFC) SHALL BE INSTALLED AS A METAL CLIP TO ATTACH RECESSED FLUORESCENT LIGHT FIXTURES (LUMINAIRES) TO FRAMING MEMBERS. THE CLAMP SHALL BE INSTALLED IN EACH CORNER OF EACH PANEL CEILING. ONE CLAMP IS REQUIRED AT EACH OF THE FOUR CORNERS. IN MECHANICAL AREAS, THE CONTRACTOR SHALL VERIFY LOCATIONS AND MAKE ADJUSTMENTS NECESSARY TO CLEAR OBSTRUCTIONS AND REQUIRED TO SUIT FIELD CONDITIONS.
- "WIRING" TO BATTERY OPERATED EXIT OR EMERGENCY LUMINAIRES SHALL BE PER THE MANUFACTURER'S INSTRUCTIONS AND IN CONFORMANCE WITH ALL CITY, STATE AND FEDERAL REQUIREMENTS. THE CONTRACTOR SHALL PROVIDE EMERGENCY BATTERY TO THE LINE SIDE, AHEAD OF THE SWITCH OF THE AREA LIGHTING AND CLEARLY IDENTIFY THE CIRCUIT FEEDING THE UNIT AT THE DISTRIBUTION PANEL.
- PROVIDE NEUTRAL FOR ALL LIGHTING CIRCUITS.
- GROUND SWITCHES TOGETHER UNDER ONE FACEPLATE.
  - THE CONTRACTOR, WITH THE ASSISTANCE OF THE LIGHTING CONTROL SYSTEM MANUFACTURER OR REPRESENTATIVE, AND LIGHTING DESIGNER SHALL PROGRAM AND VERIFY THE SYSTEM PERFORMS PER THE MANUFACTURER'S INSTRUCTIONS AND THE LIGHTING DESIGNER'S INTENT, SEQUENCES OF OPERATIONS, PLANS, AND SPECIFICATIONS. THIS INCLUDES PROPERLY LOCATING THE DAYLIGHT SENSOR IN THE ROOM(S), SETTING THE DIMMING CURVES, SETTING OCCUPANCY SENSOR SHUT-OFF DELAYS, SETTING DIMMING LEVELS, AND ADDRESSING ALL OF THE COMPONENTS IN THE LIGHTING CONTROL SYSTEM.

INSPECTIONS/WARRANTY:

- THE CONTRACTOR SHALL COORDINATE ALL WORK AFTER INSPECTION AND APPROVAL BY PROPER AUTHORITIES. IF WORK IS CONCEALED WITHOUT INSPECTION AND APPROVAL, THE CONTRACTOR SHALL BE RESPONSIBLE FOR ALL WORK REQUIRED TO BOTH OPEN AND RESTORE THE CONCEALED AREAS IN ADDITION TO ANY REQUIRED MODIFICATIONS.
- THE CONTRACTOR SHALL MAKE A FINAL INSPECTION OF ALL ELECTRICAL EQUIPMENT TO ENSURE THAT THERE ARE NO LOOSE ELECTRICAL CONNECTIONS OR ELECTRICAL CIRCUITS SUBJECT TO ELECTRICAL BREAK DOWN DUE TO THE PRESENCE OF FOREIGN MATERIAL. THIS SHALL INCLUDE INSPECTION OF ALL CONNECTIONS MADE UNDER THIS CONTRACT.
- THE CONTRACTOR SHALL CONTRACT WITH AN ELECTRICAL UNDERWRITER TO PROVIDE THIRD-PARTY ELECTRICAL INSPECTION SERVICES (BOTH "ROUGH" AND "FINAL") FOR ISSUANCE OF A "CERTIFICATE OF COMPLETION." ALL FEES AND COSTS SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR.
- THE CONTRACTOR SHALL DELIVER CERTIFICATES OF ELECTRICAL AND OTHER INSPECTIONS OR COPIES THEREOF, TO THE CLIENT AT THE COMPLETION OF THE PROJECT WITH COPIES TO THE ENGINEER/ARCHITECT.
- THE CONTRACTOR SHALL GUARANTEE ALL WORK IN WRITING TO THE CLIENT AGAINST ANY AND ALL DEFECTS IN MATERIAL AND WORKMANSHIP FOR A PERIOD OF ONE YEAR. IF A DEFECT OR IS DISCOVERED IN THE SPECIFICATION, FROM DATE OF ACCEPTANCE AND PERFORM ALL CORRECTIVE WORK AT NO COST TO THE CLIENT.

Device Mounting Heights

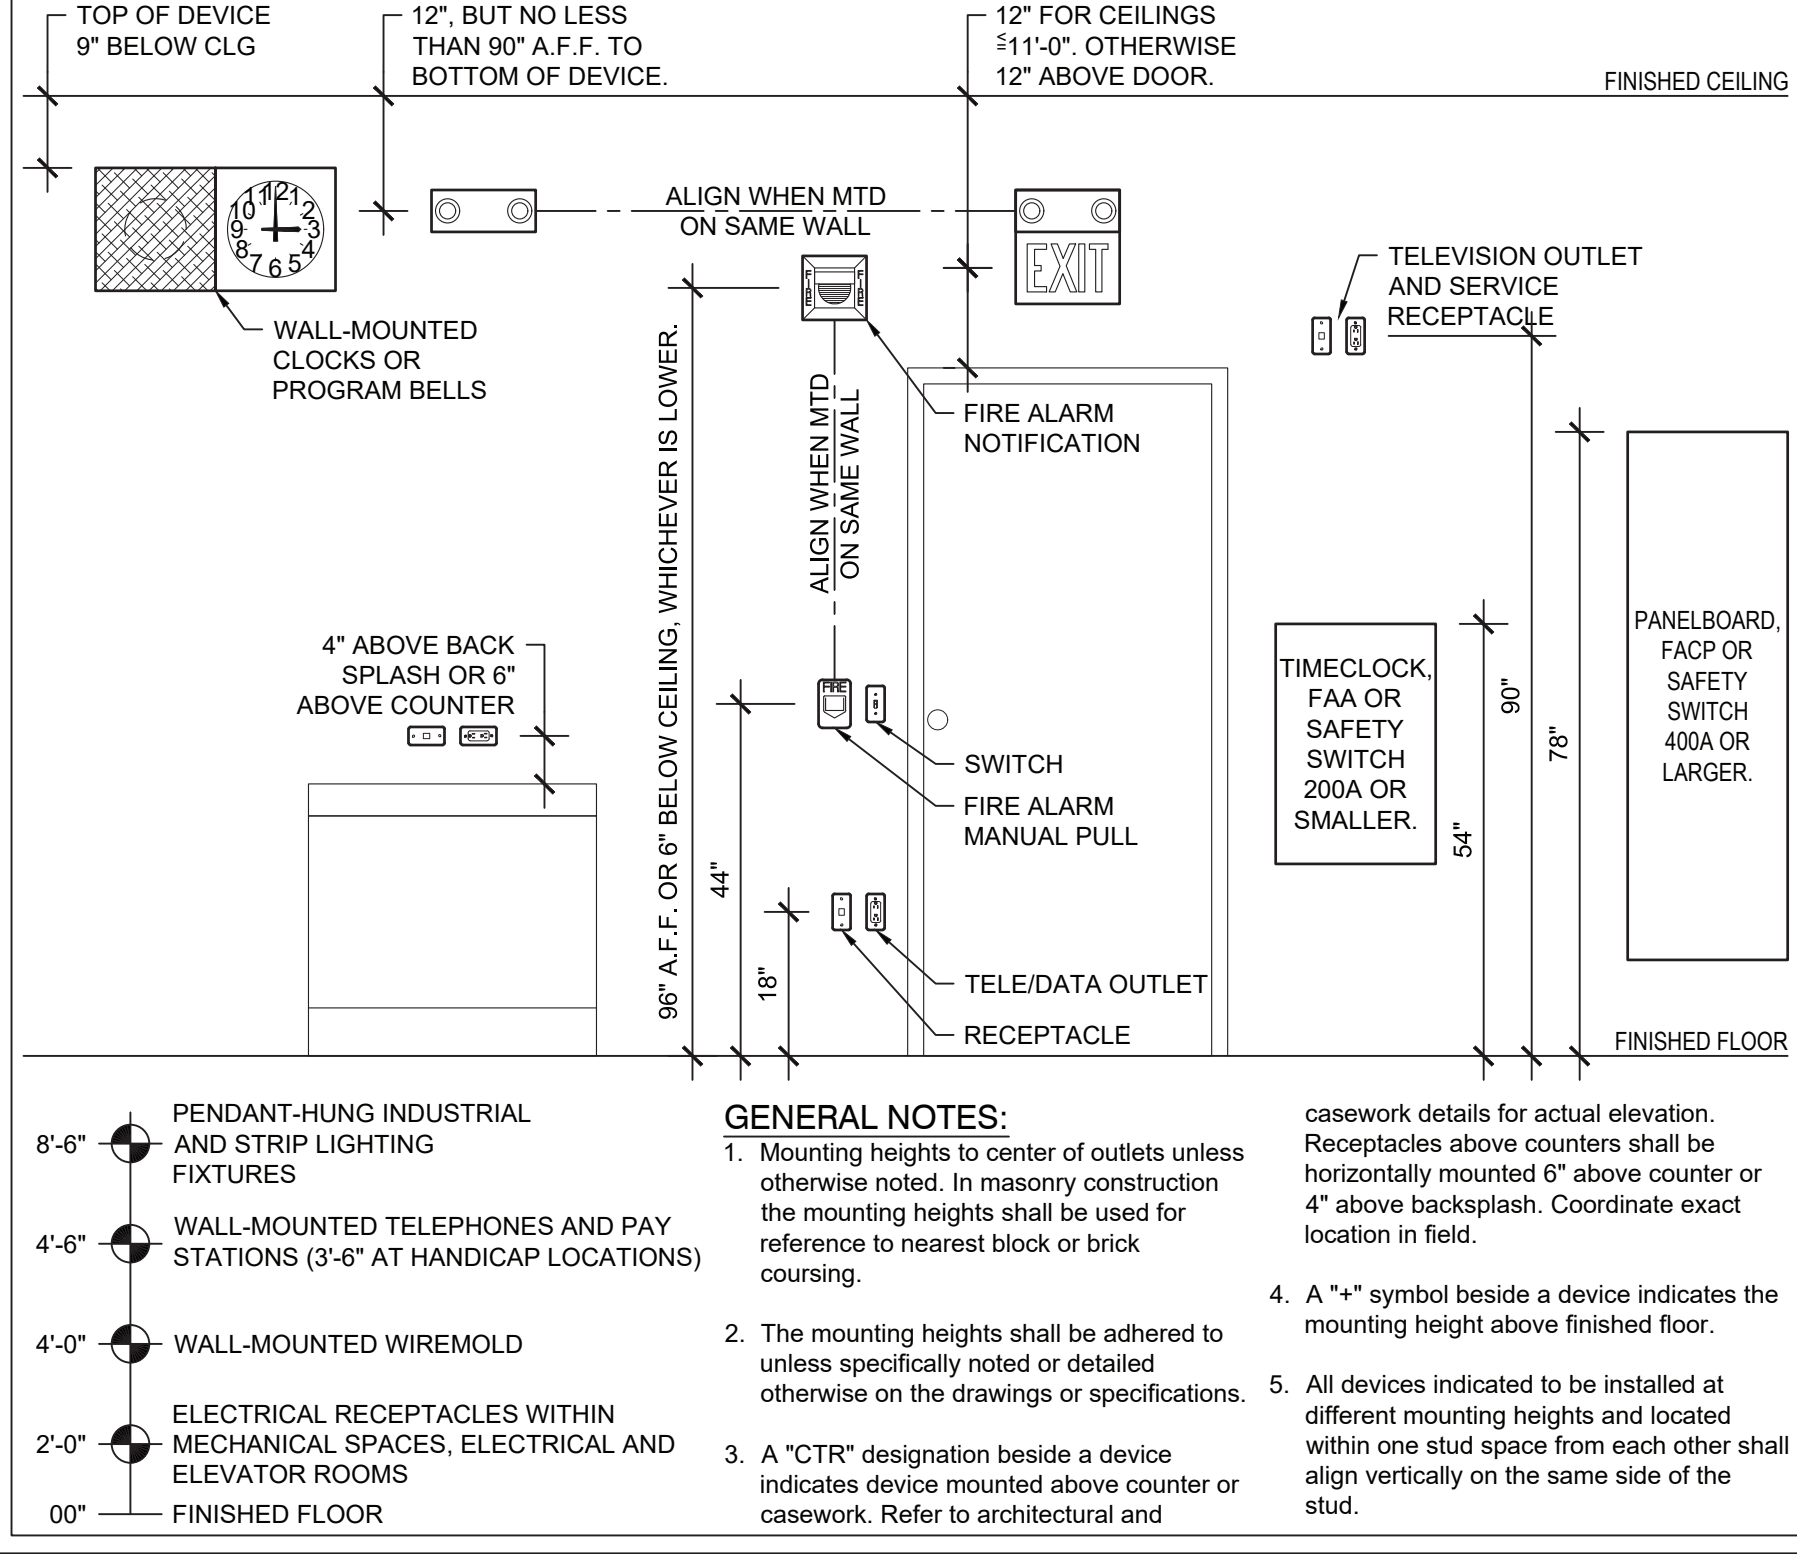


GENERAL NOTES:

- Mounting heights to center of outlets unless otherwise noted. In masonry construction the mounting heights shall be used for reference to nearest block or brick coursing.
- The mounting heights shall be adhered to unless specifically noted or detailed otherwise on the drawings or specifications.
- A "CTR" designation beside a device indicates device mounted above counter or casework. Refer to architectural and casework details for actual elevation. Receptacles above counters shall be horizontally mounted 6" above counter or 4" above backsplash. Coordinate exact location in field.
- A "\*" symbol beside a device indicates the mounting height above finished floor.
- All devices indicated to be installed at different mounting heights and located within one stud space from each other shall align vertically on the same side of the stud.

Application of Raceways

RACEWAY TYPE	APPLICATION
Rigid Steel Conduit	Where exposed to mechanical injury, where specifically required, indoors where exposed to moisture, where required by codes and for all circuits in excess of 600 volts.
I.M.C.	Where exposed to mechanical injury, where specifically required, indoors where exposed to moisture, where required by codes and for all circuits in excess of 600 volts.
E.M.T	Use in every instance except where another material is not specified.
Flexible Metal Clad Cables	Lighting and receptacle branch circuits concealed in hollow spaces of building. May not be used in corridors, places of assembly, or where prohibited by Code.
Type MC Flexible Steel	Use in dry areas for connections to lighting fixtures in hung ceilings, connections to equipment installed in removable panels of hung ceilings. At all transformer or equipment raceway connections where sound and vibration isolation is required.
Liquid-Tight Flexible Conduit	Use in areas subject to moisture where flexible steel is unacceptable, at connections to all motors, and all raised floor areas.
Non-Metallic Conduit	1. Schedule 40 - Where raceways are in slab in below grade levels, for raceway duct banks. 2. Schedule 80 - For underground raceways outside of building which are not encased in concrete. Also for secondary conductors of cold cathode lighting systems.
Wireways and Aux Gutters	Where indicated on the Drawings and as otherwise specifically required.

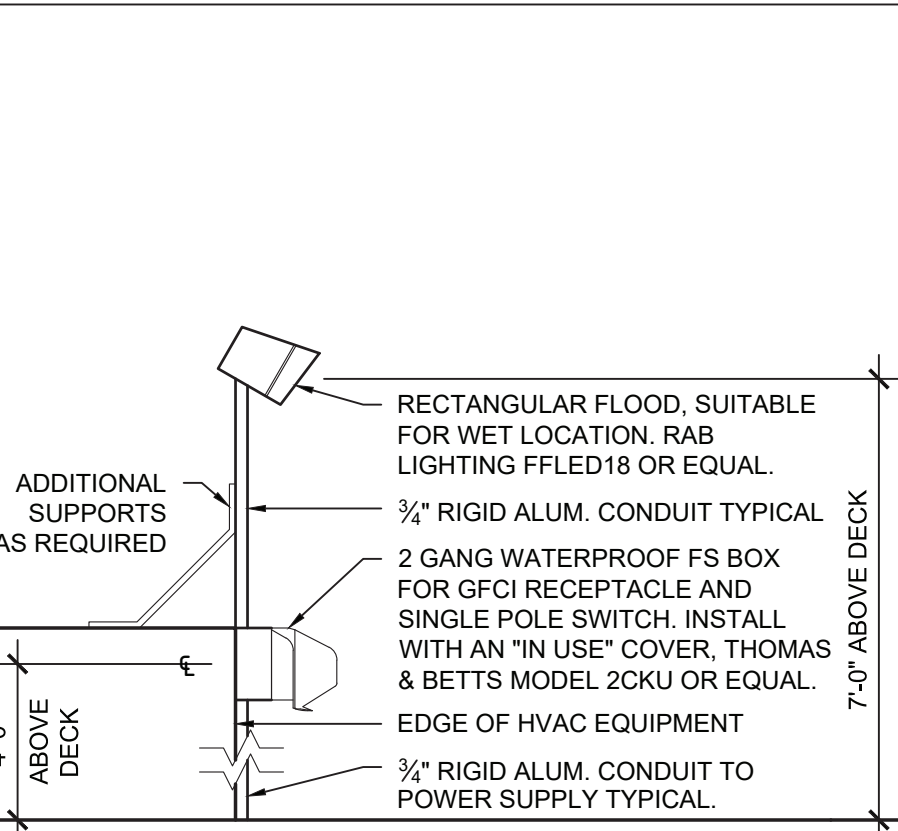

HVAC Convenience Receptacle & Light Detail

1 E0.01 N.T.S.

Electrical Grounding Requirements

THE CONTRACTOR SHALL PROVIDE A GROUNDING CONDUCTOR FOR ALL BRANCH FEEDERS AND CIRCUITS IN ACCORDANCE WITH THE FOLLOWING CHART					
OCPD in Ahead of Equip., Conduit, etc. (Amps)	Size (AWG or kcmil)	OCPD in Ahead of Equip., Conduit, etc. (Amps)	Size (AWG or kcmil)	OCPD in Ahead of Equip., Conduit, etc. (Amps)	Size (AWG or kcmil)
15	14	300	4	1600	4/0
20	12	400	3	2000	250
30	10	500	2	2500	350
40	10	600	1	3000	400
60	10	800	1/0	4000	500
100	8	1000	2/0	5000	700
200	6	1200	3/0	6000	800

Note: Where necessary to comply with NEC 250.4(A)(5) or (B)(4), the equipment grounding conductor shall be sized larger than given in this table.

Where ungrounded conductors are increased in size, equipment grounding conductors, where installed, shall be increased in size proportionately according to the circular mil area of the ungrounded conductors.

\*See installation restrictions in NEC 250.120

Date 12/20/22  
Checked BH  
Drawn MH

**MICHAEL J. McGOVERN, R.A.**  
REGISTERED ARCHITECT  
License No. 022297-1

Revisions:

08/02/23  
ISSUE FOR RE-BID

UNAUTHORIZED ALTERATIONS OR ADDITIONS TO THIS DOCUMENT IS A VIOLATION OF SECTION 2308 OF THE NEW YORK STATE EDUCATION LAW. THESE DOCUMENTS REMAIN THE EXCLUSIVE PROPERTY OF THE ENGINEER, AND MAY NOT BE USED FOR ANY PURPOSE WHATSOEVER WITHOUT THE WRITTEN CONSENT OF THE ENGINEER.

Engineering, Planning, Architecture, Surveying LLP  
L&A ASSOCIATES  
252 Main Street, Goshen, New York 10924 | t. 845-615-0350 | f. 845-615-0351


ELECTRICAL COVER SHEET  
NEW KITCHEN DESIGN  
MAMARONECK AVENUE SCHOOL  
850 MAMARONECK AVENUE  
MAMARONECK, NEW YORK 10543

Job No. 4,1092.85  
File No. 109285E001

NYSED PROJECT # 66-07-01-03-0-004033

E0.01



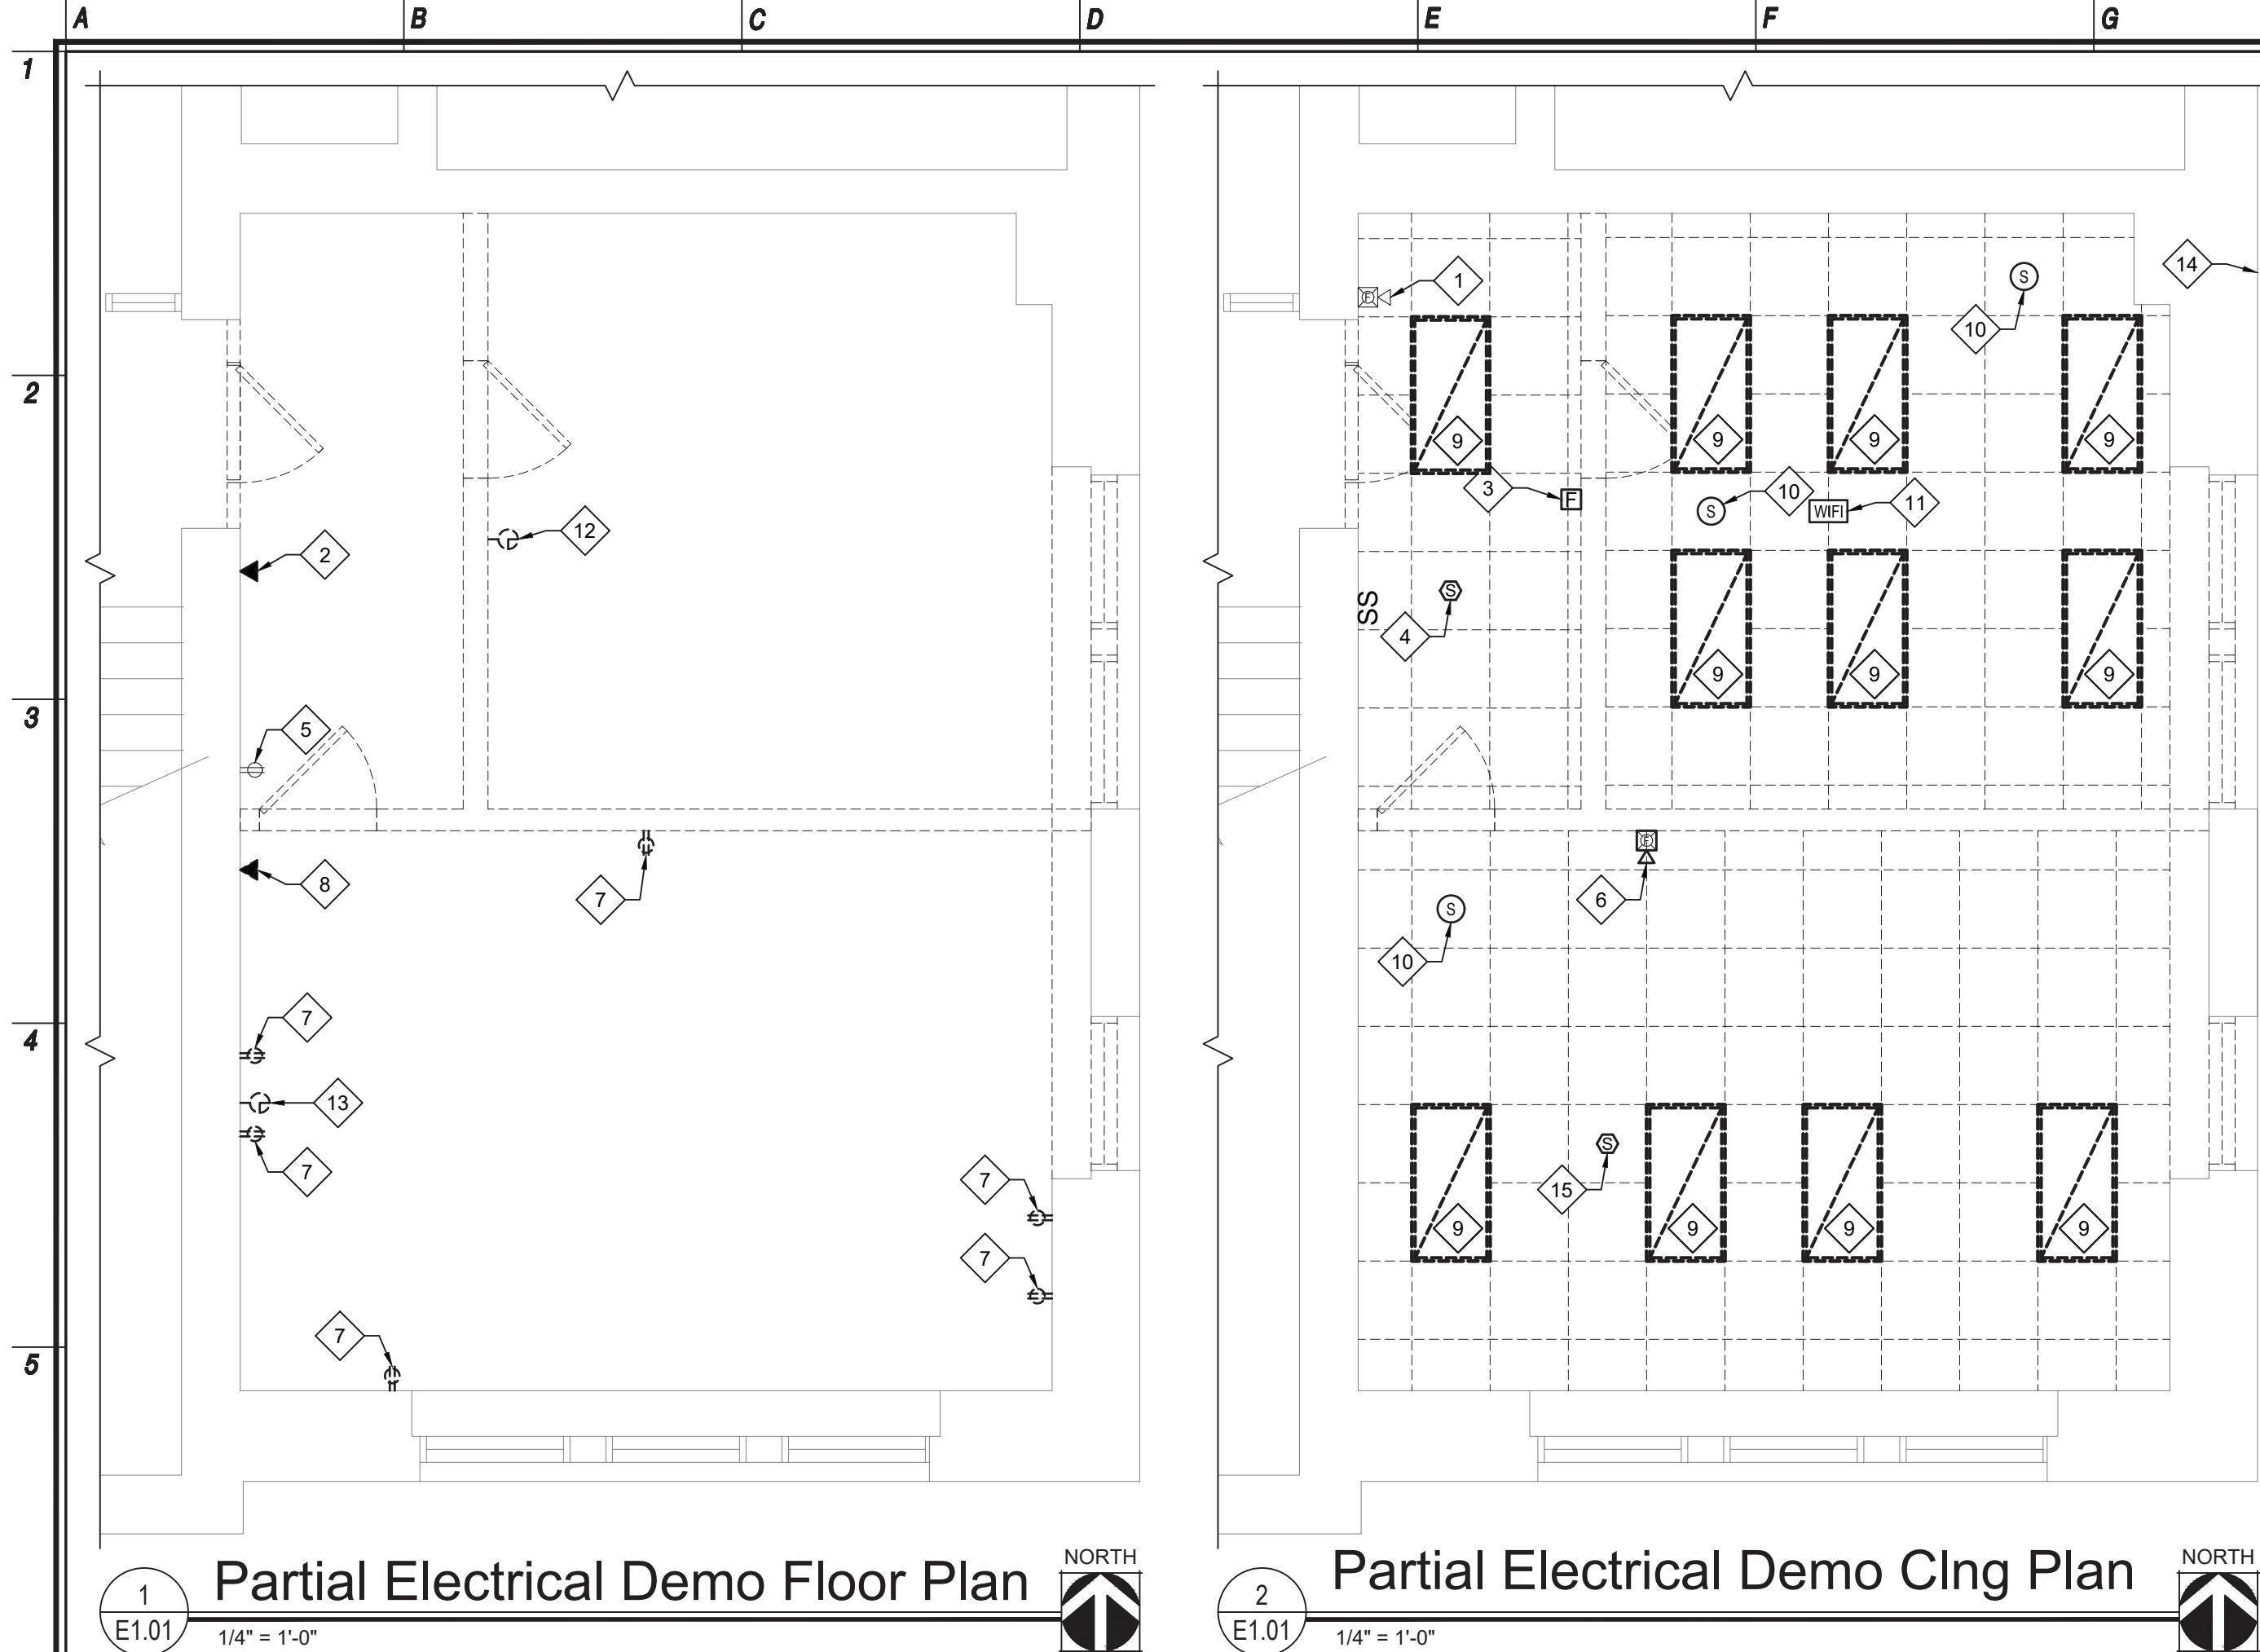

Demo. Elec. Key Notes	
#	SYMBOL INDICATES DEMOLITION KEY NOTE
1. EXISTING HORN/STROBE TO REMAIN. PROTECT DURING CONSTRUCTION.	REMOVE CONDUCTORS, WIREMOLD, AND CONDUITS BACK TO SOURCE.
2. EXISTING TELEPHONE TO BE RELOCATED. EXTEND WIRING TO NEW LOCATION. REFER TO DRAWING E2.01 FOR ADDITIONAL INFORMATION.	10. EXISTING CEILING MOUNTED SPEAKER TO BE RELOCATED. EXTEND WIRING TO NEW LOCATION. REFER TO DRAWING E2.01 FOR ADDITIONAL INFORMATION.
3. EXISTING MANUAL PULL STATION TO BE RELOCATED. EXTEND WIRING TO NEW LOCATION. REFER TO DRAWING E2.01 FOR ADDITIONAL INFORMATION.	11. EXISTING WIRELESS ACCESS POINT TO BE RELOCATED. EXTEND WIRING TO NEW LOCATION. REFER TO DRAWING E2.01 FOR ADDITIONAL INFORMATION.
4. EXISTING SMOKE DETECTOR TO BE RELOCATED. EXTEND WIRING TO NEW LOCATION. REFER TO DRAWING E2.01 FOR ADDITIONAL INFORMATION.	12. EXISTING CLOCK TO BE REMOVED. REMOVE CONDUCTORS, WIREMOLD, AND CONDUITS BACK TO SOURCE. TURN CLOCK OVER TO OWNER.
5. EXISTING RECEPTACLE. EXTEND BOX AND CONDUCTORS TO NEW WALL SURFACE. REPLACE EXISTING RECEPTACLE WITH A GFCI RECEPTACLE. REFER TO DRAWING E2.01 FOR ADDITIONAL INFORMATION.	13. EXISTING CLOCK. RELOCATE TO NEW WALL SURFACE. EXTEND CONDUCTORS AND BACK BOX AS REQUIRED. REFER TO DRAWING E2.01 FOR ADDITIONAL INFORMATION.
6. EXISTING HORN/STROBE TO BE RELOCATED. EXTEND WIRING TO NEW LOCATION. REFER TO DRAWING E2.01 FOR ADDITIONAL INFORMATION.	14. EXISTING SECURITY CAMERA (2nd FLOOR) TO BE RELOCATED. EXTEND APPROX. 25' HORIZONTALLY.
7. EXISTING RECEPTACLE TO BE REMOVED. REMOVE CONDUCTORS, WIREMOLD, AND CONDUITS BACK TO SOURCE.	15. EXISTING SMOKE DETECTOR TO BE RELOCATED AND REPLACED WITH A FIXED TEMPERATURE HEAT DETECTOR. NEW DETECTOR SHALL BE UL LISTED FOR USE WITH THE EXISTING FACP & SLC LOOP. EXTEND WIRING TO NEW LOCATION. REFER TO DRAWING E2.01 FOR ADDITIONAL INFORMATION.
8. EXISTING DATA/PHONE JACK TO BE REMOVED. REMOVE CONDUCTORS, WIREMOLD, AND CONDUITS BACK TO SOURCE.	
9. EXISTING LIGHT FIXTURE & SWITCHING TO BE REMOVED.	

## Electrical General Demolition Notes

### GENERAL PROJECT INFO:

- THE DEMOLITION DRAWINGS ARE DIAGRAMMATIC AND INDICATE THE GENERAL INTENT AND SCOPE. PLANS DO NOT ATTEMPT TO SHOW ALL ELECTRICAL DEMOLITION ITEMS. UNLESS OTHERWISE NOTED, THE DEVICES SHOWN ARE FOR INFORMATION PURPOSES. THE CONTRACTOR SHALL FIELD VERIFY ALL DEMOLITION ITEMS AND THE EXTENT OF DEMOLITION WORK. CONDITIONS UNDER WHICH DEMOLITION IS TO BE ACCOMPLISHED, ALONG WITH THE KIND AND AMOUNT OF MATERIALS BEING REMOVED AND PROVIDE FOR THE REMOVAL OF ALL DEVICES ACCORDINGLY PRIOR TO BID.
- THE CONTRACTOR SHALL INCLUDE ALL LABOR AND MATERIALS IN THE BASE BID, INCLUDING ALL TEMPORARY CONNECTIONS, CONDUIT, AND WIRE TO ACCOMMODATE CONSTRUCTION AND PROVIDE CONTINUOUS SERVICE TO DEVICES. SYSTEMS THAT ARE TO REMAIN TEMPORARY OR PERMANENT AND REQUIRE THE SHUTDOWN OF THE BUILDING POWER SHALL BE PERFORMED DURING OVERTIME AND SHALL BE INCLUDED IN THE BASE BID.
- THE CONTRACTOR IS RESPONSIBLE FOR THE SEQUENCE OF ALL WORK AND SHALL INCLUDE IN THE BASE BID ALL LABOR AND MATERIALS REQUIRED FOR THE EXTENSIONS, RE-ROUTING AND RELOCATION OF EXISTING SYSTEM COMPONENTS, EQUIPMENT, WIRING, CONDUITS, AND CABLE TO MAINTAIN THE OPERATION OF ALL SYSTEMS THROUGHOUT THE BUILDING DURING DEMOLITION AND CONSTRUCTION PHASES.
- THE CONTRACTOR SHALL REPORT TO THE CLIENT ANY AND/OR ALL CONDITIONS THAT MAY INTERFERE WITH OR OTHERWISE AFFECT OR PREVENT THE PROPER EXECUTION AND COMPLETION OF THE WORK OF THIS CONTRACT.
- THE CONTRACTOR SHALL EXECUTE ALL WORK WITHIN THE REGULATIONS OF THE BUILDING FOR DEMOLITION AND REMOVAL OF DEBRIS. OVERTIME WORK REQUIRED WILL BE AT NO EXTRA COST TO THE CLIENT.
- ALL EQUIPMENT SHALL BE DISCONNECTED AND REMOVED BACK TO ITS POWER SOURCE OF ORIGINATION UNLESS OTHERWISE NOTED ("U.O.N.") BY EXISTING TO REMAIN ("E"). ALL DISCONNECTED AND REMOVED ITEMS THAT ARE NOT BEING REUSED SHALL BE RETURNED TO THE OWNER OR DISPOSED OFF SITE IN AN APPROVED METHOD.
- THE CONTRACTOR SHALL ALWAYS PROTECT THE PROPERTY OF THE CLIENT AND THE BUILDING OWNER, INCLUDING BUT NOT LIMITED TO WINDOWS, FINISHES, PUBLIC TOILETS, ELEVATORS, DOORS, BUCKS, ELECTRICAL AND AIR CONDITIONING EQUIPMENT, CONNECTOR ENCLOSURES, ETC.
- UNLESS NOTED OTHERWISE, ALL THE EXISTING ELECTRICAL EQUIPMENT CURRENTLY LOCATED IN THE AREAS OF DEMOLITION, WHETHER SPECIFICALLY INDICATED ON THIS DRAWING OR NOT, SHALL BE DISCONNECTED AND REMOVED FROM SERVICE. THE OWNER HAS THE FIRST RIGHT OF REFUSAL ON ALL REMOVED ITEMS. ALL ITEMS NOT WANTED BY THE OWNER SHALL BE PROPERLY DISPOSED OF OFFSITE BY THE CONTRACTOR IN ACCORDANCE WITH THE LAW. CARE SHALL BE TAKEN TO MAINTAIN CIRCUIT CONTINUITY TO ALL EXISTING ELECTRICAL DEVICES TO REMAIN. REFER TO ARCHITECTURAL DRAWINGS FOR EXACT AREAS OF DEMOLITION.
- RELOCATE OR REMOVE ALL ELECTRICAL DEVICES IN ACCORDANCE WITH THE APPLICABLE CODES.
- DO NOT DISABLE OR DISRUPT BUILDING FIRE OR LIFE SAFETY SYSTEMS WITHOUT WRITTEN PERMISSION FROM THE OWNER. IN ALL CASES, PERMISSION SHALL HAVE BEEN GRANTED NOT LESS THAN TEN (10) WORKING DAYS PRIOR TO THE INTENDED INTERRUPTION.
- BEFORE STARTING WORK, THE ELECTRICAL CONTRACTOR SHALL CHECK ALL EXISTING DEVICES, LIGHT FIXTURES, EQUIPMENT, ETC. THAT ARE NOTED OR REQUIRED TO BE REUSED TO SATISFY HIMSELF THAT THEY ARE OPERATING PROPERLY. SHOULD ANY OF THE ITEMS NOT BE OPERATING PROPERLY, THE CONTRACTOR SHALL REPORT SAME TO THE ENGINEER AND AWAIT HIS DIRECTIONS. CONTRACTORS THAT DO NOT COMPLY WITH THE ABOVE WILL BE RESPONSIBLE FOR PROVIDING OPERATIONAL ITEMS AT THEIR EXPENSE.
- THE CONTRACTOR SHALL FIELD INVESTIGATE THE EXISTING ELECTRICAL & LOW VOLTAGE SYSTEMS INSTALLATIONS. ALL

EXISTING INSTALLATIONS IN THE RENOVATION AREAS THAT ARE TO REMAIN BUT ARE NOT CURRENTLY IN COMPLIANCE WITH CURRENT CODES SHALL BE CORRECTED, INCLUDING BUT NOT LIMITED TO THE FOLLOWING: UN-SUPPORTED WIRE, CONDUIT AND JUNCTION BOXES LAYING ON TOP OF CEILING TILES, WIRE, CONDUIT AND/OR JUNCTION BOXES SUPPORTED ONLY BY TIE-WIRE. RAISE AND SUPPORT CONDUIT WITH STRAP PER SPECS. RAISE AND SUPPORT WIRE WITH BRIDLE RINGS, J-HOOKS, OR OTHER APPROPRIATE MEANS. PROVIDE NEW CONDUIT/WIRE AS REQUIRED. FIXTURES IMPROPERLY SUPPORTED OR INADEQUATELY SUPPORTED BY DEVICE BOXES - PROVIDE PROPER SUPPORT PER N.E.C.

### WORK/TRADE COORDINATION:


- THE ELECTRICAL CONTRACTOR SHALL COORDINATE THE MECHANICAL EQUIPMENT DEMOLITION WITH THE MECHANICAL CONTRACTOR AND MECHANICAL DEMOLITION PLANS AND GENERAL CONSTRUCTION DEMOLITION WITH THE GENERAL CONTRACTOR AND ARCHITECTURAL DEMOLITION PLANS FOR ALL EQUIPMENT TO BE DEMOLISHED AND SCHEDULE TIME FOR ELECTRICAL DEMOLITION.
- THE CONTRACTOR SHALL REMOVE ALL ELECTRICAL EQUIPMENT LEFT AFTER WALL DEMOLITION, INCLUDING CONDUIT, SWITCH BOXES, PLATES, BRIDGES, OR ANY OTHER TELEPHONE OR ELECTRIC WIRING AND EQUIPMENT. DISCONNECT ALL WIRING AT PANELS AND REMOVE OLD WIRING FROM THE PLENUM.
- TEMPORARILY RELOCATE ELECTRICAL EQUIPMENT AS REQUIRED TO ACCOMMODATE THE CONSTRUCTION SCHEDULE. ALL AREAS NOT UNDER CONSTRUCTION MUST BE KEPT OPERATIONAL DURING CONSTRUCTION. TO ACCOMPLISH THIS, PROVIDE THE NECESSARY TEMPORARY ELECTRICAL SERVICES. REMOVE TEMPORARY DEVICES UPON COMPLETION OF THE PROJECT.
- AS PART OF THE BASE BID, THE ELECTRICAL CONTRACTOR SHALL PROVIDE TEMPORARY ELECTRIC POWER REQUIRED FOR CONSTRUCTION ACTIVITIES OF ALL PROJECT DIVISIONS. ALL TEMPORARY BRANCH CIRCUITS SHALL BE SUPPLIED BY CIRCUITS PROTECTED BY GROUND FAULT CIRCUIT BREAKERS. ALL TEMPORARY BRANCH CIRCUITS SHALL BE IN ACCORDANCE WITH NEC ARTICLE 590.
- THE AE WILL REVIEW COMPLAINTS CONCERNING POWER DISTRIBUTION OR DEVICES AVAILABLE IN A SPECIFIC AREA OR AREAS OF THE PROJECT. IF DIRECTED BY THE AE, THE CONTRACTOR SHALL PROVIDE ADDITIONAL POWER DISTRIBUTION OR CONNECTION DEVICES REQUIRED UNDER THIS SECTION AT NO ADDITIONAL COST.
- AS PART OF THE BASE BID, THE ELECTRICAL CONTRACTOR SHALL PROVIDE TEMPORARY LIGHTING WITH LOCAL SWITCH FOR GENERAL ILLUMINATION AND TASK ILLUMINATION FOR THE GENERAL CONTRACTOR, OTHER PRIME CONTRACTORS, AND FOR ALL SUB-CONTRACTORS FOR THE DURATION OF THE CONSTRUCTION. LIGHTING LEVELS PROVIDED ARE TO BE IN COMPLIANCE WITH APPLICABLE WORKPLACE STANDARDS. ALL TEMPORARY LIGHTING SHALL BE SUPPLIED BY CIRCUITS PROTECTED BY GROUND FAULT CIRCUIT BREAKERS. ALL TEMPORARY LIGHTING SHALL BE IN ACCORDANCE WITH NEC ARTICLE 590.
- THE AE WILL REVIEW COMPLAINTS CONCERNING LIGHTING LEVELS AND/OR LIGHTING QUALITY IN A SPECIFIC AREA OR AREAS OF THE PROJECT. IF DIRECTED BY THE AE, THE CONTRACTOR SHALL PROVIDE ADDITIONAL LUMINARIES AND/OR ADDITIONAL DISTRIBUTION WIRING REQUIRED AT NO ADDITIONAL COST.
- AT THE CONCLUSION OF THE CONSTRUCTION ACTIVITIES REMOVE ALL WIRING, BOTH EXPOSED AND CONCEALED, USED FOR TEMPORARY LIGHTING AND POWER DISTRIBUTION.
- DEMOLITION REQUIREMENTS:
- RACEWAYS ASSOCIATED WITH ELECTRICAL BEING DEMOLISHED, WHICH ARE CONCEALED IN EXISTING REMAINING WALLS MAY BE ABANDONED IN PLACE. REMOVE WIRING FROM THE CONDUIT.
- RACEWAYS ASSOCIATED WITH ELECTRICAL BEING DEMOLISHED WHICH ARE EXPOSED SHALL BE REMOVED.
- WHERE REMOVAL OF EQUIPMENT OR WIRING IS INDICATED, IT

- SHALL INCLUDE ALL ASSOCIATED WIRING BACK TO THE LAST ACTIVE REMAINING OUTLET, DEVICE, FIXTURE, OR PANEL.
- NO REMOVED EQUIPMENT OR MATERIAL SHALL BE REUSED AS PART OF NEW WORK, U.O.N.
- EXISTING REMAINING CONCEALED RACEWAYS MAY BE REUSED FOR NEW WORK PROVIDED. THEY MEET ALL REQUIREMENTS OF THE SPECIFICATION FOR NEW WORK.
- WIRE WITH BRIDLE RINGS, J-HOOKS, OR OTHER APPROPRIATE MEANS. PROVIDE NEW CONDUIT/WIRE AS REQUIRED. FIXTURES IMPROPERLY SUPPORTED OR INADEQUATELY SUPPORTED BY DEVICE BOXES - PROVIDE PROPER SUPPORT PER N.E.C.
- THE ELECTRICAL CONTRACTOR SHALL ENSURE THAT ALL REMAINING ELECTRICAL DEVICES, OUTLETS, LIGHT FIXTURES, ETC. HAVE NOT BEEN DISCONNECTED OR MADE INOPERATIVE DURING DEMOLITION. THE ELECTRICAL CONTRACTOR SHALL RESTORE ALL INTERRUPTED OR DISCONNECTED CIRCUITS TO OPERATION.
- REMOVE ABANDONED ELECTRICAL EQUIPMENT, DEVICES AND WIRING (I.E. DISTRIBUTION EQUIPMENT, RECEPTACLES, DATA PORTS, RACEWAY SYSTEMS) BACK TO THE SOURCE PANELBOARD, SWITCHBOARD, SWITCHGEAR, COMMUNICATIONS CLOSET, OR CABINET. ABANDONED WIRING AND RACEWAYS CAN RESULT FROM ACTIONS THAT INCLUDE THE FOLLOWING:
  - EQUIPMENT IS REMOVED OR RELOCATED.
  - FIXTURES ARE REMOVED OR RELOCATED.
  - THERE IS NO DEMONSTRABLE NEAR TERM FUTURE USE FOR THE EXISTING CIRCUIT OR RACEWAY SYSTEM.
- UNUSED ELECTRICAL EQUIPMENT AND MATERIAL SHOULD ONLY BE LEFT IN PLACE IF ONE OR MORE OF THE FOLLOWING CONDITIONS EXIST:
  - THE REMOVAL REQUIRES THE DEMOLITION OF OTHER STRUCTURES OR EQUIPMENT THAT IS STILL IN USE. AN EXAMPLE IS CONDUIT EMBEDDED IN WALLS OR DUCTBANKS.
  - THE COST OF REMOVAL IS EXCESSIVE DUE TO HAZARDS, CONSTRUCTION METHODS, OR RESTRICTED ACCESS. THE ENGINEER SHALL MAKE A FINAL DETERMINATION FOR THIS CONDITION.
  - IF EITHER OF THE ABOVE TWO CASES EXIST, REMOVE THE CONDUITS, INCLUDING THOSE ABOVE ACCESSIBLE CEILINGS, TO THE POINT THAT BUILDING CONSTRUCTION, EARTH, OR PAVING COVERS THEM. CUT CONDUIT BENEATH OR FLUSH WITH BUILDING CONSTRUCTION OR PAVING. PLUG, CAP, OR SEAL THE REMAINING UNUSED CONDUITS. INSTALL BLANK COVERS FOR ABANDONED BOXES AND ENCLOSURES NOT REMOVED.
- INVENTORY EACH PANELBOARD WHERE CIRCUITS ARE INDICATED TO BE REUSED. SEQUENTIALLY CONSOLIDATE EXISTING CIRCUITS WITHIN EACH PANELBOARD WITH REGARD TO AREA SERVED. MAXIMIZE CAPACITY FOR SERVICE TO THE PROJECT AREA BY INCLUDING EXISTING SPARES WITH THE GROUP OF CIRCUITS BEING REMOVED. DISCONNECTED AS A RESULT OF THIS SELECTIVE DEMOLITION, PREPARE A CURRENT DIRECTORY, POST DEMOLITION, FOR EACH PANELBOARD AS THE BASE UPON WHICH THE FINAL DIRECTORIES WILL BE COMPILED.
- EXTENSION/CONTINUITY:
- REMOVAL SHALL INCLUDE WIRING, RACEWAY, BOXES, SWITCHES, LIGHT FIXTURES, ETC. AS INDICATED ON THE PLANS AND AS REQUIRED BY THESE DEMOLITION NOTES.
- EXTEND EXISTING EQUIPMENT CONNECTIONS USING MATERIALS AND METHODS COMPATIBLE WITH THE EXISTING ELECTRICAL INSTALLATION AND IDENTIFIED IN THE ELECTRICAL SPECIFICATIONS.
- WHEN RELOCATION OR REMOVAL OF AN ELECTRICAL DEVICE INTERRUPTS THE CONTINUITY OF A DOWNSTREAM CIRCUIT OR DEVICE TO REMAIN, REROUTE/MODIFY THE CIRCUIT AS REQUIRED TO MAINTAIN CIRCUIT CONTINUITY. PROVIDE NEW JUNCTION BOXES, PULLBOXES, RACEWAYS, WIRING, ETC., AS REQUIRED.
- WHERE AN EXISTING DEVICE IS REMOVED BUT THE RACEWAY AND BOX REMAINS FOR CIRCUIT CONTINUITY, PROVIDE AN APPROPRIATE BLANK COVER PLATE OF MATERIAL AND FINISH TO

- MATCH THE COVER PLATES OF THE DEVICES IN THAT ROOM.
- IF THE CONTINUITY OF THE NEUTRAL CONDUCTOR OF A MULTIWIRE CIRCUIT IS INTERRUPTED (OPEN), THE RESULTANT OVER OR UNDER VOLTAGE CAN CAUSE A FIRE AND/OR DESTRUCTION OF ELECTRICAL EQUIPMENT. CONTRACTOR SHALL TAKE NECESSARY PRECAUTIONS TO PRECLUDE THE INTERRUPTION OF NEUTRAL CONDUCTOR ON A MULTIWIRE CIRCUIT.
- NON-DEMOLITION AREAS: DEMOLITION WORKS SHALL NOT AFFECT AREAS NOT INCLUDED IN DEMOLITION. CONTRACTOR SHALL BE RESPONSIBLE FOR THE CONTINUITY OF ALL SERVICES IN NON-DEMOLITION AREAS. ALL SERVICES SHALL BE MAINTAINED AT ALL TIMES. MAINTAIN SERVICE BY EXTENDING, RE-ROUTING AND/OR RECONNECTING ANY CIRCUITS AFFECTED BY DEMOLITION. PROVIDE ADDITIONAL CONDUIT/WIRING AS REQUIRED TO MAINTAIN SERVICE. CIRCUITS IN NON-DEMOLITION AREAS THAT ARE CONNECTED TO DEMOLISHED PANELS AND/OR CIRCUITS SHALL BE RE-CIRCUITED TO THE EXISTING PANELS. PROVIDE TEMPORARY POWER AS REQUIRED DURING CHANGE-OVER TO MAINTAIN CONTINUOUS SERVICE. PROVIDE TEMPORARY POWER FOR ALL RELOCATED CIRCUITS AS REQUIRED TO MAINTAIN CONTINUOUS SERVICE.
- WHERE EXISTING OUTLETS ARE SHOWN TO REMAIN OR BE RELOCATED TO A NEW WALL SURFACE, PERFORM THE FOLLOWING:
  - PROVIDE ADDITIONAL CONDUIT, WIRING, ETC., NECESSARY.
  - PROVIDE NEW WIRING DEVICE AND FACEPLATE.

### HAZARDOUS MATERIAL DISPOSAL:

- DISCONNECT AND REMOVE ALL BALLASTS FROM FLUORESCENT LIGHT FIXTURES THAT DO NOT HAVE A LABELS STATING "BALLAST DOES NOT CONTAIN PCB'S" OR SIMILAR LABEL (BALLAST MAY CONTAIN PCB'S). PLACE PCB BALLASTS IN D.O.T. APPROVED CONTAINERS. PROPERLY DISPOSE OF CONTAINERS WITH A FEDERALLY APPROVED DISPOSAL CONTRACTOR. DISPOSAL SHALL INVOLVE SEGREGATION OF COMPONENTS FOR RECYCLING AND INCINERATION OF PCB CONTENTS. ALL DISPOSAL DOCUMENTATION SHALL BE PROVIDED TO THE OWNER UPON COMPLETION OF THE PROJECT. CONTRACTOR SHALL MAINTAIN AN OWNER APPROVED LOG SHEET FOR EACH RUN.
- REMOVE ALL MERCURY-CONTAINING LAMPS. DO NOT BREAK OR CRUSH. RETAIN SERVICES OF A STATE APPROVED LAMP RECYCLING FACILITY ABLE TO ACCEPT WASTE D009. COORDINATE PACKAGING REQUIRED AND PACKAGE, SECURE, AND DELIVER LAMPS AS REQUIRED BY THE SELECTED RECYCLING FACILITY TO INSURE MINIMUM LAMP BREAKAGE. MINIMUM OF 95% OF LAMP MATERIAL MUST BE SHIPPED INTACT. CONTRACTOR MUST COMPLY WITH ALL REPORTING AND PAPERWORK REQUIREMENTS OF STATE LAWS REGARDING THE HANDLING, TRANSPORTATION, AND DISPOSAL OF HAZARDOUS WASTE INCLUDING BUT NOT LIMITED TO FILING THE REQUIRED PAPERWORK AND MANIFEST WITH THE STATE AND OWNERS AS REQUIRED BY LAW. ALL DISPOSAL DOCUMENTATION SHALL BE PROVIDED TO THE OWNER UPON COMPLETION OF THE PROJECT.

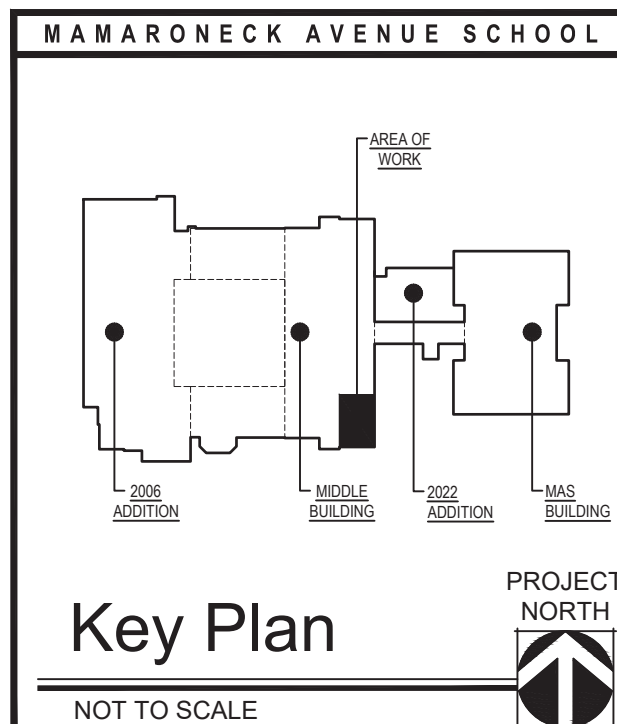

Date12/20/22

CheckedBH

DrawnMH

MICHAEL J. MCGOVERN, R.A.

REGISTERED ARCHITECT

License No. 022257-1

Revisions:

#

08/02/23

ISSUE FOR RE-BID

UNAUTHORIZED ALTERATIONS OR ADDITIONS TO THIS DOCUMENT IS A VIOLATION OF SECTION 2209 OF THE NEW YORK STATE EDUCATION LAW. THESE DOCUMENTS REMAIN THE EXCLUSIVE PROPERTY OF THE ENGINEER, AND MAY NOT BE USED FOR ANY PURPOSE WHATSOEVER WITHOUT THE WRITTEN CONSENT OF THE ENGINEER.

Engineering, Planning, Architecture, Surveying LLP

ASSOCIATES

252 Main Street, Goshen, New York 10924 | L 845-615-0350 | F 845-615-0351

DEMOLITION ELECTRICAL PLANS

NEW KITCHEN DESIGN

MAMARONECK AVENUE SCHOOL

850 MAMARONECK AVENUE

MAMARONECK, NEW YORK 10543

Job No. 4.1092.85

File No. 109285E101

E1.01