

**84 CHALET ROAD
KIAMESHA LAKE, NY 12751**


120 HUYSHOPE AVENUE
SUITE 400
HARTFORD, CT 06106
860.247.9226

CONSULTANTS:
MEP & FP ENGINEER
M/E ENGINEERING
60 LAKEFRONT BOULEVARD, SUITE 320
BUFFALO, NY 14202
716.845.5092


OWNERS CONSULTANT
AKRF ENGINEERING
34 SOUTH BROADWAY, SUITE
WHITE PLAINS, NY 10601
914-949-7336

ISSUE	09/30/21
JOB	H18064.14
DRAWN	DSL
SCALE	NTS

REVISIONS:




E-500

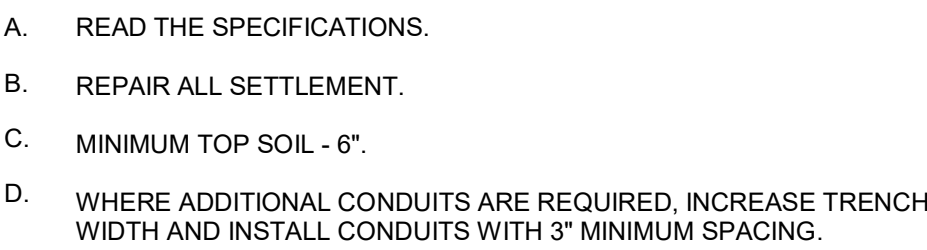


A. WHERE CONDUIT STUBS UP UNDER FLOOR MOUNTED EQUIPMENT SUCH AS SWITCHGEAR, PROVIDE PVC ELBOWS IN LIEU OF RIGID SHOWN.

B. AT EACH CONDUIT STUB-UP, AFFIX ENGRAVED PLASTIC NAMEPLATE INDICATING CONDUIT NO. OR CIRCUIT IDENTIFICATION. ATTACH WITH NYLON CABLE TIE.

3 NEW SITE DUCT SECTION (2 CONDUITS)

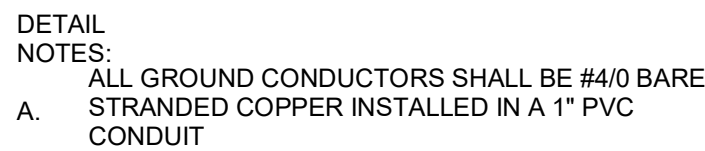

NTS

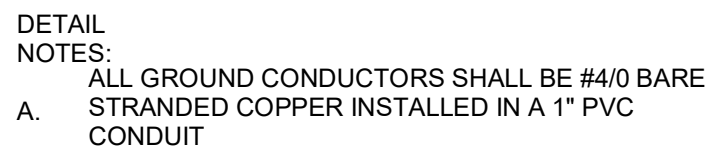

NTS