

520 SOUTH MAIN STREET, SUITE 2531 AKRON, OH 44311 330.572.2100 FAX: 330.572.2101

NOT FOR

CONSTRUCTION

HOWAY TO THE RESIDENCE OF THE PERSON OF THE

PLAN KEYNOTES (#)

SITE PLAN

1"=20'

1. PROPOSED CONCRETE CURBED WALK, SEE DETAIL ON SHEET C-501.2 AND THE FOLLOWING REQUIREMENTS: LONGITUDINAL SLOPE: 4.5% MAX.

CROSS SLOPE: 1.8% MAX. 2. PROPOSED PAINTED 4" WIDE SOLID WHITE STRIPE, SEE PAVEMENT MARKINGS AND NOTES ON SHEET C-501.2.

3. PROPOSED PAINTED TRANSVERSE STRIPING, SEE DETAIL ON SHEET C-501.2.

4. PROPOSED PAINTED 4" WIDE SOLID BLUE STRIPE, SEE PAVEMENT MARKINGS AND NOTES ON SHEET C-501.2. 5. PROPOSED ADA PARKING SIGN IN CRASH RATED BOLLARD (SEE PLAN FOR VAN ACCESSIBLE SPACE. PROVIDE

APPROPRIATE SIGNAGE PER DETAIL), SEE DETAIL ON SHEET C-501.2. 6. PROPOSED PAINTED ADA PAVEMENT SYMBOL PER ADA SPECIFICATIONS AND DETAIL ON SHEET C-501.2.

7. PROPOSED PARALLEL ADA RAMP PER ADA SPECIFICATIONS AND DETAIL ON THIS SHEET AND THE FOLLOWING REQUIREMENTS: LONGITUDINAL SLOPE: 8.0% MAX.

CROSS SLOPE: 1.8% MAX. 8. PROPOSED LANDING PER THE FOLLOWING REQUIREMENTS: SLOPE IN ANY DIRECTION: 1.8% MAX. LENGTH: 5.0' MIN. WIDTH: MATCH RAMP WIDTH LANDINGS SHALL BE PROVIDED AT ALL TOP AND BOTTOMS OF PROPOSED RAMPS. LEGEND (SEE SHEET C-001.2 FOR GENERAL LEGEND)

PROPOSED STANDARD DUTY ASPHALT

PAVEMENT. SEE SHEET C-501.2.

PROPOSED CURBED CONCRETE WALK. SEE SHEET C-501.2. PROPOSED 3" ASPHALT PAVEMENT OVERLAY,

> SEE SHEET C-501.2. CONTRACTOR SHALL POWER WASH ALL SIDEWALKS FREE OF DEBRIS, DIRT AND STAINS. ONCE DRIED, CONTRACTOR SHALL CRACK FILL AND SEAL ALL JOINTS PER NYSDOT SPECIFICATION.

CONSTRUCTION KEYNOTE PROPOSED PARKING SPACE NUMBER


PAVEMENT AS DETAILED ELSEWHERE ----

SECTION A

SLOPE PER DETAIL TO 1"R —

PAINT CURB YELLOW PER PAVEMENT MARKINGS NOTES DETAIL, SEE SHEET C-501.2 -PAINT CURB TAPERS YELLOW PER PAVEMENT MARKINGS NOTES DETAIL, SEE SHEET C-501.2.

BENCHMARKS: UPDATE ELEVATION TIE-IN OR BASIS OF BEARING.

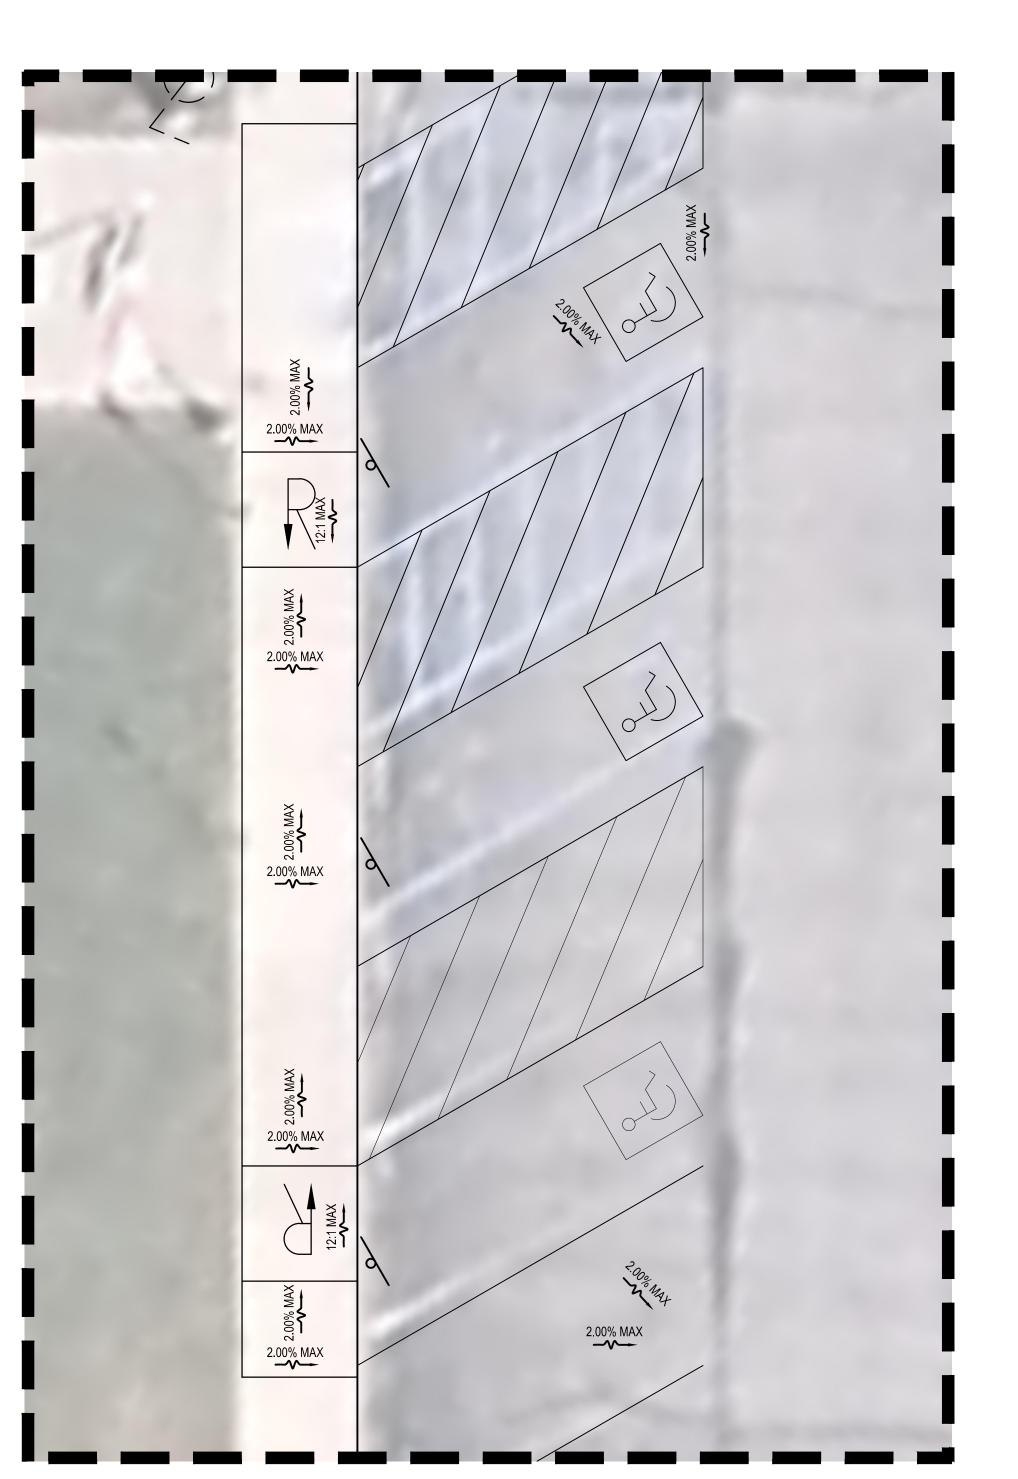

GRADING ENLARGEMENT #1

PROPOSED DRAINAGE SLOPE & DIRECTION



FRONT EDGE OF RAMP 2"R -MAX 50:1 LCURB TO BE POURED INTEGRAL WITH WALK 4" THICK FIBER REINFORCED CONC. WALK. SEE CONCRETE NOTES ON SHEET C-001.2 — MINIMUM 4" COMPACTED AGGREGATE BASE

6" CONCRETE CURB AS DETAILED ELSEWHERE, SEAL JOINT ————