


A1 POWER PLAN - AREA 'B'
1" = 10'-0"

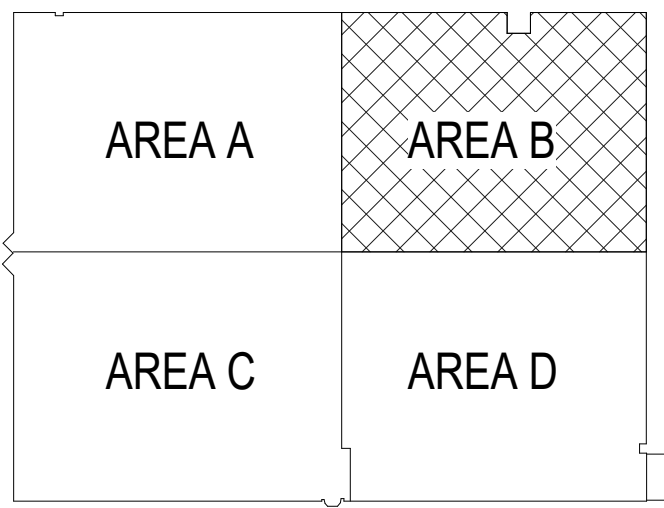

KEYPLAN

GENERAL NOTES

- A. REFER TO SHEET E-001.1 FOR ELECTRICAL SYMBOL LEGEND AND PANELBOARD SCHEDULES.
- B. REFER TO E-001.1 FOR ELECTRICAL DETAILS.
- C. COORDINATE CIRCUIT, DISCONNECT, AND STARTER SIZE(S) AND TERMINATION LOCATION(S) PRIOR TO ROUGH-IN.
- D. HATCHING INDICATES AREAS WITH NO WORK.
- E. NOT ALL EXISTING DEVICES ARE SHOWN ON PLAN.
- F. REFER TO MECHANICAL SHEETS FOR ADDITIONAL DEMOLITION SCOPE.

KEY NOTES

1. REFER TO SHEET E-201.1 FOR DETAIL INFORMATION, QUANTITY, AND LOCATION FOR DROP CORDS TO BE PROVIDED IN WORKROOM.
2. REFER TO SHEET E-201.1 FOR DETAIL INFORMATION, QUANTITY, AND LOCATION FOR DATA OUTLETS TO BE PROVIDED IN WORKROOM.
3. EXISTING WATER COOLER TO BE REMOVED AND REPLACED WITH NEW. REPLACE EXISTING GFCI RECEPTACLE WITH A REGULAR DUPLEX RECEPTACLE, AND PROVIDE A 50A GFCI BREAKER FOR THE CIRCUIT SERVING THE WATER COOLER.
4. EXISTING EXHAUST FAN TO BE REMOVED AND REPLACED WITH NEW (FRACTIONAL HP, 120V, 1Ø). DISCONNECT FROM AND RECONNECT TO EXISTING CIRCUIT. EXTEND EXISTING CONDUIT AND WIRING AS REQUIRED.
5. REMOVE EXISTING RECEPTACLES WITHIN VENDING AREA AND PROVIDE NEW AS SHOWN. WIRE WITH (2#12, 110/120 IN 34°C TO SPARE 20A/1P BREAKERS IN THE NEAREST 208/120V PANELBOARD WITH AVAILABLE CAPACITY. CIRCUIT NUMBERS AS INDICATED. PROVIDE GFCI BREAKERS FOR VENDING MACHINE CIRCUITS IF VENDING MACHINES ARE NOT INTEGRALLY GFCI-PROTECTED.

NOT FOR
CONSTRUCTION

| | |
|-----------------|------------|
| PROJECT MANAGER | DESIGNER |
| JR | AS |
| DATE | 2022359.04 |

USPS - MID-HUDSON, NY
99 GOVERNOR DRIVE
NEWBURGH, NY 12550

