

**PME ENGINEER:
GREENMAN-PEDERSEN, INC.
400 Rella Boulevard
Montebello, NY 10901**

UNIT PRICES

© COPYRIGHT, MICHAEL SHULALE ARCHITECT'S LLP, ALL RIGHTS RESERVED.

Drawing	Title
---------	-------

COVER SHEET

Drawing No.

A-000

2020 EXISTING BUILDING CODE OF NEW YORK STATE			
BUILDING CODE SUMMARY			
Site	North Rockland Central School District	Date:	12/14/2023
Project Name:	North Rockland High School Extension Boiler Replacement	Location	Rockland County
Project Number:	44023	Architect of Record	MSA
Project Address:	65 Chapel Street, Garnerville, NY 10923		
APPLICABLE ORDINANCES, CODES & STANDARD			
2020	Existing Building Code of New York State		
2020	Building Code of New York State		
EXISTING BUILDING CODE: CHAPTER 1 SCOPE AND ADMINISTRATION			
SECTION 101	GENERAL		
101.2 Scope	The provisions of this code shall apply to the repair, alteration, change of occupancy, addition to and relocation of existing buildings.		
101.4 Applicability	This code shall apply to the repair, alteration, change of occupancy, addition and relocation of existing buildings, regardless of occupancy, subject to the criteria of Sections 101.4.1 and 101.4.2.		
101.4.2 Buildings Previously Occupied	The legal occupancy of any building existing on the date of adoption of this code shall be permitted to continue without change, except as is specifically covered in this code, the Fire Code of New York State, or the Property Maintenance Code of New York State, or as is deemed necessary by the building official for the general safety and welfare of the occupants and the public.		
EXISTING BUILDING CODE: CHAPTER 2 DEFINITIONS			
SECTION 202	GENERAL DEFINITIONS		
EQUIPMENT OR FIXTURE	Any plumbing, heating, electrical, ventilating, air conditioning, refrigerating, and fire protection equipment, and elevators, dumbwaiters, escalators, boilers, pressure vessels and other mechanical facilities or installations that are related to building services. Equipment or fixture shall not include manufacturing, production, or process equipment, but shall include connections from building service to process equipment.		
EXISTING BUILDING CODE: CHAPTER 3 PROVISIONS FOR ALL COMPLIANCE METHODS			
SECTION 301	ADMINISTRATION		
301.3.2 Work Area Compliance Method	Alterations, additions and changes of occupancy complying with the applicable requirements of Chapters 6 through 12 of this code shall be considered in compliance with the provisions of this code.		
EXISTING BUILDING CODE: CHAPTER 6 CLASSIFICATION OF WORK			
SECTION 601	GENERAL		
601.2 Work Area	The work area, as defined in Chapter 2, shall be identified on the construction documents.		
SECTION 602	ALTERATION - LEVEL 1		
602.1 Scope	Level 1 alterations include the removal and replacement or the covering of existing materials, elements, equipment, or fixtures using new materials, elements, equipment, or fixtures that serve the same purpose.		
602.2 Application	Level 1 alterations shall comply with the provisions of Chapter 7.		
EXISTING BUILDING CODE: CHAPTER 7 ALTERATIONS - LEVEL 1			
SECTION 702	BUILDING ELEMENTS AND MATERIALS		
702.6 Methods and Materials	New work shall comply with the materials and methods requirements in the Building Code of New York State, Energy Conservation Construction Code of New York State, Mechanical Code of New York State, and Plumbing Code of New York State, as applicable, that specify material standards, detail of installation and connection, joints, penetrations, and continuity of any element, component, or system in the building.		
SECTION 703	FIRE PROTECTION		
703.1 General	Alterations shall be done in a manner that maintains the level of fire protection provided		

EXISTING BUILDING CODE

2020 ENERGY CONSERVATION CODE OF NEW YORK STATE

BUILDING CODE SUMMARY				
Site	North Rockland Central School District		Date:	4/29/2024
Project Name:	North Rockland High School Extension Boiler Replacement		Location	Rockland County
Project Number:	44023		Architect of Record	MSA
Project Address:	65 Chapel Street, Garnerville, NY 10923			
APPLICABLE ORDINANCES, CODES & STANDARD				
2020	Existing Building Code of New York State			
2020	Building Code of New York State			
2020	Energy Conservation Code of New York State			
ENERGY CONSERVATION CODE: CHAPTER 4 COMMERCIAL ENERGY EFFICIENCY				
SECTION C402	Building Envelope Requirements			
Table C402.1.3	Building Envelope Requirements - Opaque Assemblies			
	Climate Zone 5A	Walls	Average R-Value	
	Mass	Above Grade	R-11.4ci	
	Climate Zone 5A	Roofs	Average R-Value	
	Wood Framed or Other	Insul entirely above roof deck	R-30ci	
SECTION C403	Building Mechanical Systems			
C403.1 General	Mechanical systems and equipment serving the building heating, cooling, ventilating or refrigerating needs shall comply with this section.			
C403.1.1 Calculation of Heating and Cooling Loads (Mandatory)	Design loads associated with heating, ventilating and air conditioning of the building shall be determined in accordance with ANSI/ASHRAE/ACCA Standard 183 or by an approved equivalent computational procedure using the design parameters specified in Chapter 3. Heating and cooling loads shall be adjusted to account for load reductions that are achieved where energy recovery systems are utilized in the HVAC system in accordance with the ASHRAE HVAC Systems and Equipment Handbook by an approved equivalent computational procedure.			
ENERGY CONSERVATION CODE: CHAPTER 5 EXISTING BUILDING				
SECTION C503	ALTERATIONS			
C503.1 General	Alterations to any building or structure shall comply with the requirements of the code for new construction. Alterations shall be such that the existing building or structure is no less conforming to the provisions of this code than the existing building or structure was prior to the alteration. Alterations to an existing building, building system or portion thereof shall conform to the provisions of this code as those provisions relate to new construction without requiring the unaltered portions of the existing building or building system to comply with this code. Alterations shall not create an unsafe or hazardous condition or overload existing building systems.			
C503.4 Heating and cooling Systems	New heating, cooling and duct systems that are part of the alteration shall comply with Sections C403.			

ENERGY CODE

MANUAL OF PLANNING STANDARDS 2022			
MANUAL OF PLANNING STANDARDS SUMMARY			
Owner:	North Rockland Central School District	Date:	4/29/2024
Project Name:	North Rockland High School Extension Boiler Replacement	Location	Rockland County
Project Number:	44023	Architect of Record	MSA
Project Address:	65 Chapel Street, Garnerville, NY 10923		
APPLICABLE ORDINANCES, CODES & STANDARD			
2020	Existing Building Code of New York State		
2020	Building Code of New York State		
2020	Energy Conservation Code of New York State		
2020	Fire Code of New York State		
PART III: ENVIRONMENT			
S304	ACOUSTICAL ENVIRONMENT		
S304-2 - Mechanical/Electrical/Plumbing Noise Control	<p>a. Achieving the proper level of ambient noise in an academic space is critical. If the level is too high, communication between teachers and students will be partially or fully masked. If too low, the slightest noises (pencils dropping, rustling of papers, etc.) will appear to be intensified in their level of disturbance. The intent of this section is to recommend the design of mechanical / electrical / plumbing systems to meet the sound standards of ANSI/ASA S12.60- latest version in classrooms and Large Group Instruction spaces used by any grade level. Sound levels do not apply to mechanical / electrical / plumbing systems used solely for emergency purposes such as fire alarm notification devices or emergency generators.</p> <p>b. Table S304-1 is a table of ambient noise criteria for mechanical equipment based on the single number room criteria "RC" curves. The values and ranges represent general limits of acceptability for typical building occupancies. Designs should not exceed upper values stated in Table for instructional spaces. Lower values may be more appropriate and should be based on a careful analysis of economics, space usage and user needs.</p> <p>c. Locations of mechanical and electrical equipment should be carefully chosen to not have an adverse impact on the ambient noise level in the adjacent spaces. To avoid excessive vibration of the building structure by mechanical air-handling units, chillers, compressors, transformers, etc., locate equipment rooms on grade whenever possible. Exterior equipment should be installed in locations such that the sound generated by the equipment will not intrude on instructional spaces at levels that exceed interior HVAC sound levels.</p> <p>d. When locating electrical receptacles for switches and outlets, no back-to-back boxes should be installed in sound-critical rooms. Offset boxes at least two stud cavities from each other.</p>		
PART VI: HEATING, VENTILATION AND AIR CONDITIONING REQUIREMENTS			
S602	THERMAL ENVIRONMENT		
S602-6 - Mechanical Cooling (Air Conditioning)	<p>a. During the normal school year there are many days when mechanical cooling provided by refrigeration equipment would be desirable, and to an even greater extent, when there is extensive summer use of rooms.</p> <p>b. Mechanical cooling for interior spaces with no exterior operable windows: Interior spaces of pupil occupancy, which are approved because of educational program, shall be provided with equipment for mechanical cooling when a temperature of 78°F cannot be maintained in the spaces.</p>		
S603	CONTROLS		
S603 - Controls	<p>a. New HVAC controls should be DDC (direct digital control) with electric actuators. DDC hardware and software should be specified open protocol and web-based communication. Temperature sensors/controls should be provided for every student occupied space. Groups of small spaces (such as offices) with similar building exposures may share sensors. SED recommends temperature sensors for kindergarten through second grades be located closer to the floor to more accurately provide for the comfort of younger students.</p> <p>b. Building automation control workstations and temperature Control Panels should be located so as to be under the supervision of the building supervisor, either in the custodian's office, mechanical equipment room, or in a central area. Subpanels of lower control hierarchy should be located near equipment and spaces served for ease of maintenance and troubleshooting. Control indicator panels for rooftop units should be situated within the building so as to be readily accessible to facility staff.</p> <p>c. Provide a sequence of operation for all HVAC&R equipment that is clearly written to be applicable to the spaces served and that maintains the code required ventilation and occupant comfort. Program to take advantage of natural free cooling whenever outdoor temperatures are favorable.</p> <p>d. Consider employing variable frequency drives on pump and fan motors for energy efficiency under part load conditions.</p> <p>e. Air flow monitoring stations. Please see Section S306.</p> <p>f. Provide motorized, low leakage, insulated dampers at all HVAC&R intakes, relief and exhaust air openings.</p>		

MANUAL OF PLANNING STANDARDS

[illegible]

Section # & Req ID	Mechanical Rough-In Inspection	Complies?	Comments/Assumptions
C403.4.4 [ME68] ³	Hydronic systems greater than 300,000 Btu/h designed for variable fluid flow. See section language for full details.	<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input checked="" type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	Exception: Dedicated equipment circulation pumps were configured in primary/secondary design to provide the minimum flow requirements of the equipment manufacturer for proper operation of equipment. Location on plans/spec: M-002
C403.3.4 [ME107] ³	System shutdown requirement met through multiple single-input boilers, one or more modulating boilers, or a combination of single-input and modulating boilers. Boiler input between 1.0 MBtu/h and 5 MBtu/h has 3:1 shutdown ratio, boiler input between 5.0 MBtu/h and 10 MBtu/h has 4:1 shutdown ratio, boiler input > 10.0 MBtu/h has 5:1 shutdown ratio.	<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input checked="" type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	Requirement will be met. Location on plans/spec: M-002 See the Mechanical Systems list for values.
C403.4.1 4 [ME63] ³	Heating for vestibules and air curtains with integral heating include automatic controls that shut off the heating system when outdoor air temperatures > 45F. Vestibule heating and cooling systems controlled by a thermostat in the vestibule with heating setpoint ≤= 60F and cooling setpoint ≥= 80F.	<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input checked="" type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	
C408.2.3 [ME53] ³	Air outlets and zone terminal devices have means for air balancing.	<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input checked="" type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	Exception: Requirement does not apply.
C403.5. C403.5.1. C403.5.2. [ME123] ³	Refrigerated display cases, walk-in coolers or walk-in freezers served by remote compressors and remote condensers not located in a condensing unit, have fan-powered condensers that comply with Sections C403.5.1. and refrigeration compressor systems that comply with C403.5.2..	<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input checked="" type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	Exception: Requirement does not apply.

Additional Comments/Assumptions:

Report date: 05/30/24
 Page 4 of 6

Section & Req ID	Final Inspection	Complies?	Comments/Assumptions
C303.3, C403.2.5, 3 (F18)†	Furnished O&M manuals for HVAC systems within 90 days of system acceptance.	<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	Requirement will be met.
C403.2.2 (F127)†	HVAC systems and equipment capacity does not exceed calculated loads.	<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	Requirement will be met. Location on plans/spec: M-002
C403.4.1, 2 (F138)†	Thermostatic controls have a 5 °F deadband.	<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	Requirement will be met. Location on plans/spec: M-002
C403.2.4, 1.3 (F120)†	Temperature controls have setpoint overlap restrictions.	<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	Requirement will be met. Location on plans/spec: M-002
C403.2.4, 2 (F139)†	Each zone equipped with setback controls using automatic time clock or programmable control system.	<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	Requirement will be met. Location on plans/spec: M-002
C403.2.4, 2.1, C403.2.4, 2.2 (F140)†	Automatic Controls: Setback to 55°F (heat) and 85°F (cool); 7-day clock, 2-hour occupant override, 10-hour backup.	<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	Requirement will be met. Location on plans/spec: M-002
C408.2.1 (F128)†	Commissioning plan developed by registered design professional or approved agency.	<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	Requirement will be met. Location on plans/spec: M-001
C408.2.3, 1 (F131)†	HVAC equipment has been tested to ensure proper operation.	<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	Requirement will be met. Location on plans/spec: M-001
C408.2.3, 2 (F110)†	HVAC control systems have been tested to ensure proper operation, calibration and adjustment of controls.	<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	Requirement will be met. Location on plans/spec: M-001
C408.2.4 (F129)†	Preliminary commissioning report completed and certified by registered design professional or approved agency.	<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	Requirement will be met. Location on plans/spec: M-001
C408.2.5, 1 (F17)†	Furnished HVAC as-built drawings submitted within 90 days of system acceptance.	<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	Requirement will be met.
C408.2.5, 3 (F143)†	An air and/or hydronic system balancing report is provided for HVAC systems.	<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	Requirement will be met. Location on plans/spec: M-002

1 High Impact (Tier 1)
2 Medium Impact (Tier 2)
3 Low Impact (Tier 3)

Project Title: NRHS Extension Boiler Replacement
 Data filename:

Report date: 05/30/24
 Page 5 of 6

Section # & ReqID	Final Inspection	Complies?	Comments/Assumptions
C408.2.5.4 [F130]	Final commissioning report due to building owner within 90 days of receipt of certificate of occupancy.	<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	Requirement will be met. Location on plans/spec: M-001
Additional Comments/Assumptions:			

1

High Impact (Tier 1)

2

Medium Impact (Tier 2)

3

Low Impact (Tier 3)

Project Title:

NRHS Extension Boiler Replacement

Report date: 05/30/24

Data filename:

Page 6 of 6


Drawing Title
**ENERGY CODE
COMPLIANCE**

Drawing No.
EN-001

ASBESTOS ABATEMENT NOTES

PRE-ABATEMENT WORK NOTES:

1. THESE DRAWINGS HAVE BEEN PREPARED UTILIZING THE OWNERS' ORIGINAL CONSTRUCTION DOCUMENTS IN ORDER TO ILLUSTRATE THE EXISTING CONDITIONS OF THE SITE AND STRUCTURES THEREIN. THE CONTRACTOR SHALL BE RESPONSIBLE FOR ACTUAL VERIFICATION OF ALL EXISTING CONDITIONS IN THE FIELD.
2. THE CONTRACTOR SHALL DETERMINE EXACT FINAL LOCATIONS OF PERSONNEL AND WASTE DECONTAMINATION ENCLOSURES, PICK UP AREA FOR REFUSE AND ASBESTOS DEBRIS. THESE LOCATIONS SHALL BE REVIEWED AND PROPERLY APPROVED BY THE DISTRICT PRIOR TO COMMENCEMENT OF WORK. THIS CONTRACTOR SHALL ESTABLISH, LABEL AND MAINTAIN PROPER EXITS AND WAYS OF EGRESS WITHIN EACH WORK AREA FOR NORMAL AND EMERGENCY USE BY WORKERS DURING ALL ABATEMENT ACTIVITIES.
3. THE CONTRACTOR, PRIOR TO BIDDING SHALL BE RESPONSIBLE TO BECOME COMPLETELY FAMILIAR WITH ALL ASPECTS OF THE PROJECT, INCLUDING, BUT NOT LIMITED TO, ALL DEMOLITION AND CONSTRUCTION WORK AS SHOWN IN THE COMPLETE SET OF DRAWINGS AND IN THE PROJECT MANUAL / SPECIFICATIONS AND ASBESTOS SURVEY REPORTS IN ORDER THAT THE FULL SCOPE OF WORK WHICH MAY ENCOUNTER ASBESTOS CONTAINING MATERIALS IS UNDERSTOOD AND ACCOUNTED FOR, BY THE CONTRACTOR IN (UNDERTAKING)THIS PROJECT. A COPY OF THE ASBESTOS SURVEY REPORT CAN BE REQUESTED FROM THE OWNERS' ENVIRONMENTAL CONSULTANT.
4. PRIOR TO ABATEMENT ALL CONTRACTORS WILL SURVEY EXISTING CONDITIONS IN THE ABATEMENT AND GENERAL WORK AREAS. ITEMS / MATERIALS, ETC., DAMAGED OR NON-FUNCTIONAL SHALL BE LISTED, NOTED, PHOTOGRAPHED AND REVIEWED WITH THE PROJECT INSPECTOR. ALL OTHER ITEMS / MATERIALS SHALL BE REVIEWED WITH THE PROJECT INSPECTOR. ALL OTHER ITEMS / MATERIALS SHALL BE ASSUMED TO BE IN GOOD CONDITION AND WORKING ORDER. IT SHALL BE THE RESPONSIBILITY OF THE ABATEMENT CONTRACTOR TO MAINTAIN ALL MATERIALS, ITEMS, EQUIPMENT, SYSTEMS, ETC. IN THEIR ORIGINAL CONDITION AND RETURN TO OWNER/GENERAL CONTRACTOR, ETC., IN SAME CONDITION AT THE END OF THIS CONTRACT.

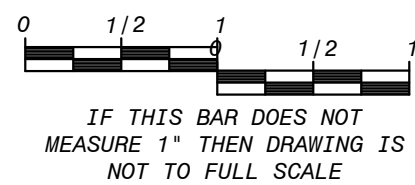


ASBESTOS REMOVAL GENERAL NOTES:

1. ASBESTOS ABATEMENT INDICATED ON THESE DRAWINGS SHALL BE PERFORMED BY A NYS DEPARTMENT OF LABOR LICENSED ASBESTOS ABATEMENT CONTRACTOR, WHO SHALL VERIFY ALL EXISTING CONDITIONS, DIMENSIONS AND QUANTITIES PRIOR TO BID.
2. THE CONTRACTOR SHALL PERFORM ALL CONTRACT WORK IN ACCORDANCE WITH CONTRACT SPECIFICATIONS, NEW YORK STATE DEPARTMENT OF LABOR (NYSDDL) INDUSTRIAL HEALTH CODE RULE 56, OSHA, NESHAPS, AHERA, NYSDEC AND ALL OTHER APPLICABLE CODES.
3. THE CONTRACTOR SHALL MAINTAIN THE SITE AS NEAT AS POSSIBLE AND ORDERLY DURING (THE COURSE OF)THE WORK. ALL LOOSE DEBRIS WHICH MAY (BECOME WINDBORNE) BLOW OFF THE SITE, SHALL BE COLLECTED AND DISPOSED OF PROPERLY BY THE CONTRACTOR ON A DAILY BASIS AS PART OF THE PROJECT WORK.
4. THE CONTRACTOR SHALL PROVIDE BARRIERS AROUND THE WORK AREAS IN ORDER TO ENSURE SAFE PASSAGE BY ANY PERSON. THESE BARRIERS SHALL ALSO SERVE TO KEEP ALL UNAUTHORIZED PERSONS OUT OF THE PROJECT AREA FOR THE DURATION OF THE WORK.
5. VARIANCES: CONTRACTOR SHALL PAY FOR AND OBTAIN ANY NECESSARY SITE SPECIFIC VARIANCES.
6. THE CONTRACTOR SHALL MAINTAIN SECURITY IN THE BUILDING AND THE WORK AREAS AT ALL TIMES.
7. PROJECT STAGING, STORAGE, SCHEDULING AND ACCESS SHALL BE COORDINATED WITH AND APPROVED BY THE ARCHITECT, CONSTRUCTION MANAGER AND OWNER PRIOR TO PROCEEDING WITH WORK.
8. SHOULD IT BECOME NECESSARY, THE CONTRACTOR SHALL COORDINATE SHUT DOWN AND LOCK OUT / TAG OUT OF THE ELECTRICAL POWER FROM THE OWNERS' POWER, WITH OWNERS' REPRESENTATIVE, PRIOR TO THE COMMENCEMENT OF WORK.
9. ALL TEMPORARY POWER TO THE WORK AREA SHALL BE BROUGHT IN FROM OUTSIDE THE WORK AREA THROUGH A GROUND-FAULT CIRCUIT INTERRUPTER AT THE SOURCE.
10. CONTRACTOR SHALL COORDINATE CONNECTION OF WATER SERVICE FOR DECONTAMINATION PURPOSES WITH OWNERS' REPRESENTATIVE. WATER FOR DECONTAMINATION UNITS IS AVAILABLE FROM THE OWNER.
11. THE OWNER OR OWNERS' REPRESENTATIVE IS RESPONSIBLE TO CONTRACT FOR NYSDOL PROJECTS MONITORING / AIR SAMPLING TECHNICIAN SERVICES AS REQUIRED.
12. CONTRACTOR TO PROVIDE A COPY OF SAFETY DATA SHEETS (SDS'S) FOR ANY CHEMICAL AGENTS TO BE USED DURING THE ASBESTOS ABATEMENT TO THE PROJECT MONITOR AND THE OWNER'S REPRESENTATIVE.
13. CONTRACTOR SHALL REQUEST AND RECEIVE PROJECT MONITOR AND OWNERS' REPRESENTATIVES APPROVAL OF ALL WORK BEFORE ANY ABATEMENT IS UNDERTAKEN.
14. UNDER NO CIRCUMSTANCES SHALL CONTAMINATED WASTE WATER BE DISCHARGED THROUGH A SYSTEM WITHOUT FILTERING. THE MAXIMUM FILTER SIZE OPENING SHALL BE CAPABLE OF RETAINING A 5.0 MICRON PARTICLE SIZE COLLECTION CAPABILITY.
15. DRAWINGS ATTEMPT TO INDICATE THE GENERAL SCOPE OF EXISTING CONDITIONS AND ITEMS AFFECTED BY THE ABATEMENT WORK. CONTRACTOR SHALL EXAMINE THE WORK AREA PRIOR TO FORMULATING HIS BID SHALL INCLUDE FIELD VARIATIONS FROM THOSE SHOWN WITHIN THE GENERAL INTENT OF THE WORK.
16. THE CONTRACTOR SHALL REMOVE AND DISPOSE OF ALL ASBESTOS CONTAINING MATERIALS CONTAINED WITHIN AND GENERATED FROM THE ABATEMENT PROJECT AND ASSOCIATED WITH ALL PROJECT WORK, IN COMPLIANCE WITH ALL APPLICABLE LAWS, RULES REGULATIONS AND ALL REQUIREMENTS OF ALL AUTHORITIES HAVING JURISDICTION.
17. THE CONTRACTOR SHALL REMOVE AND DISPOSE OF ALL ASBESTOS CONTAINING MATERIALS CONTAINED WITHIN AND GENERATED FROM THE PROJECT AND ASSOCIATED WITH ALL PROJECT WORK, IN THE MOST EFFICIENT AND COST EFFECTIVE METHOD POSSIBLE, WHICH ALSO COMPLIES WITH THE REQUIREMENTS LISTED ABOVE.

POST ABATEMENT WORK NOTES:

1. PROVIDE ALL APPLICABLE CODE RULE 56 PROCEDURES, CLEAN UP AND ADDITIONAL TESTING AS REQUIRED.
2. AFTER FINAL CLEARANCE HAS BEEN ATTAINED (SUBSTANTIAL COMPLETION) THE ABATEMENT CONTRACTOR, TOGETHER WITH THE PROJECT INSPECTOR AND OWNER'S REPRESENTATIVE WILL SURVEY FINAL CONDITIONS IN THE ABATEMENT AND GENERAL WORK AREAS. ITEMS / MATERIALS, ETC., DAMAGED OR NON-FUNCTIONAL SHALL BE LISTED, NOTED, PHOTOGRAPHED AND REVIEWED WITH THE PROJECT INSPECTOR. ALL OTHER ITEMS / MATERIALS SHALL BE REVIEWED WITH THE PROJECT INSPECTOR. ALL OTHER ITEMS / MATERIALS NOT NOTED, SHALL BE ASSUMED TO BE IN GOOD CONDITION AND WORKING ORDER. IT SHALL BE THE RESPONSIBILITY OF THE ABATEMENT CONTRACTOR TO MAINTAIN ALL MATERIALS, ITEMS, EQUIPMENT, SYSTEMS, ETC. IN THEIR ORIGINAL CONDITION AND RETURN TO OWNER/GENERAL CONTRACTOR, ETC., IN SAME CONDITION AT THE END OF THIS CONTRACT. ANY NEW DAMAGE OR MISSING EQUIPMENT SHALL BE NOTED AND THE COST OFFSET FROM THE CONTRACT.
3. REMOVE ALL TEMPORARY ENCLOSURES, BARRIERS, ETC. REINSTALL ITEMS/WORK PREVIOUSLY REMOVED. ALL TAPE AND ADHESIVE RESIDUALS TO BE REMOVED. TEST AND REPAIR.
4. THE CONTRACTOR SHALL TAKE ALL NECESSARY PRECAUTIONS TO ENSURE AGAINST DAMAGE TO THE EXISTING WORK TO REMAIN IN PLACE. ANY DAMAGE TO SUCH WORK SHALL BE REPAIRED OR REPLACED TO THE SATISFACTION OF THE ARCHITECT AND OWNER AT NO ADDITIONAL COST TO THE CONTRACT.
5. AT COMPLETION OF THE ABATEMENT WORK, A CONDITION SURVEY SHALL BE DONE BY ALL CONTRACTORS AND PROJECT INSPECTOR (SEE NOTE 2.) ANY VARIATION (I.E. DAMAGE BY THE CONTRACTOR) SHALL BE REPAIRED / RESTORED BY THE ABATEMENT CONTRACTOR.
6. THE CONTRACTOR SHALL, UPON COMPLETION OF THE REMOVAL, PROVIDE WRITTEN DOCUMENTATION (INCLUDING ALL APPROPRIATE THIRD PARTY TESTING RESULTS) THAT THE PROJECT WORK AREAS ARE COMPLETELY FREE OF ALL ASBESTOS CONTAINING MATERIALS (CONTEMPLATED FOR REMOVAL UNDER THIS PROJECT, OR PHASE) AT FINAL CLEARANCE.
7. THE CONTRACTOR SHALL PROVIDE RECORDS OF ALL ASBESTOS CONTAINING MATERIALS REMOVED FROM THE SITE, INCLUDING THE COMPOSITION AND VOLUMES OF DISPOSED MATERIALS AND THE FINAL DISPOSAL SITE(S).


**PLAN NORTH**

Drawing	Title
---------	-------

ABATEMENT NOTES

Drawing No.

AA-000

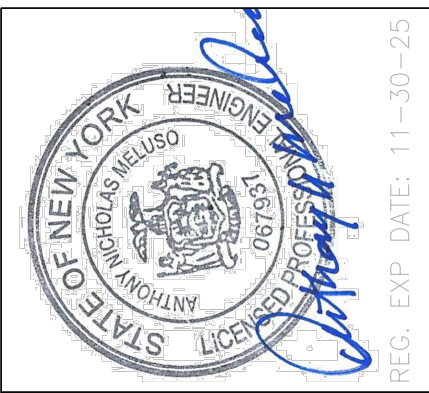


Drawn by	AM
Checked by	RL
Project No.	44023
Scale	AS NOTED
Date	05-31-24

**Quality Environmental
Solutions &
Technologies, Inc.**
1298 NYS Route 9
Wappingers Falls, NY
12590
Tel: (845) 298-6031

NORTH ROCKLAND HIGH
SCHOOL EXTENSION BOILER
REPLACEMENT

HIGH SCHOOL SED# 50-02-01-06-0-007-016

5 Chapel Street
Hartford, CT 06103

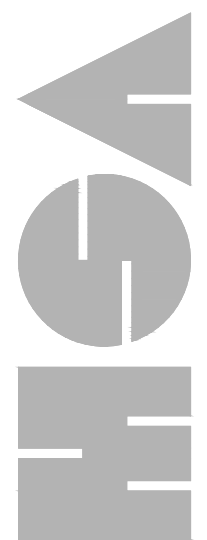


MICHAEL SHILALE ARCHITECTS, L.L.P.
140 Park Avenue New City, NY 10956 Tel 845-708-9200
www.shilale.com




CAST IRON SECTIONAL
BOILER TO BE REMOVED

SMITH BOILER
TO BE REMOVED

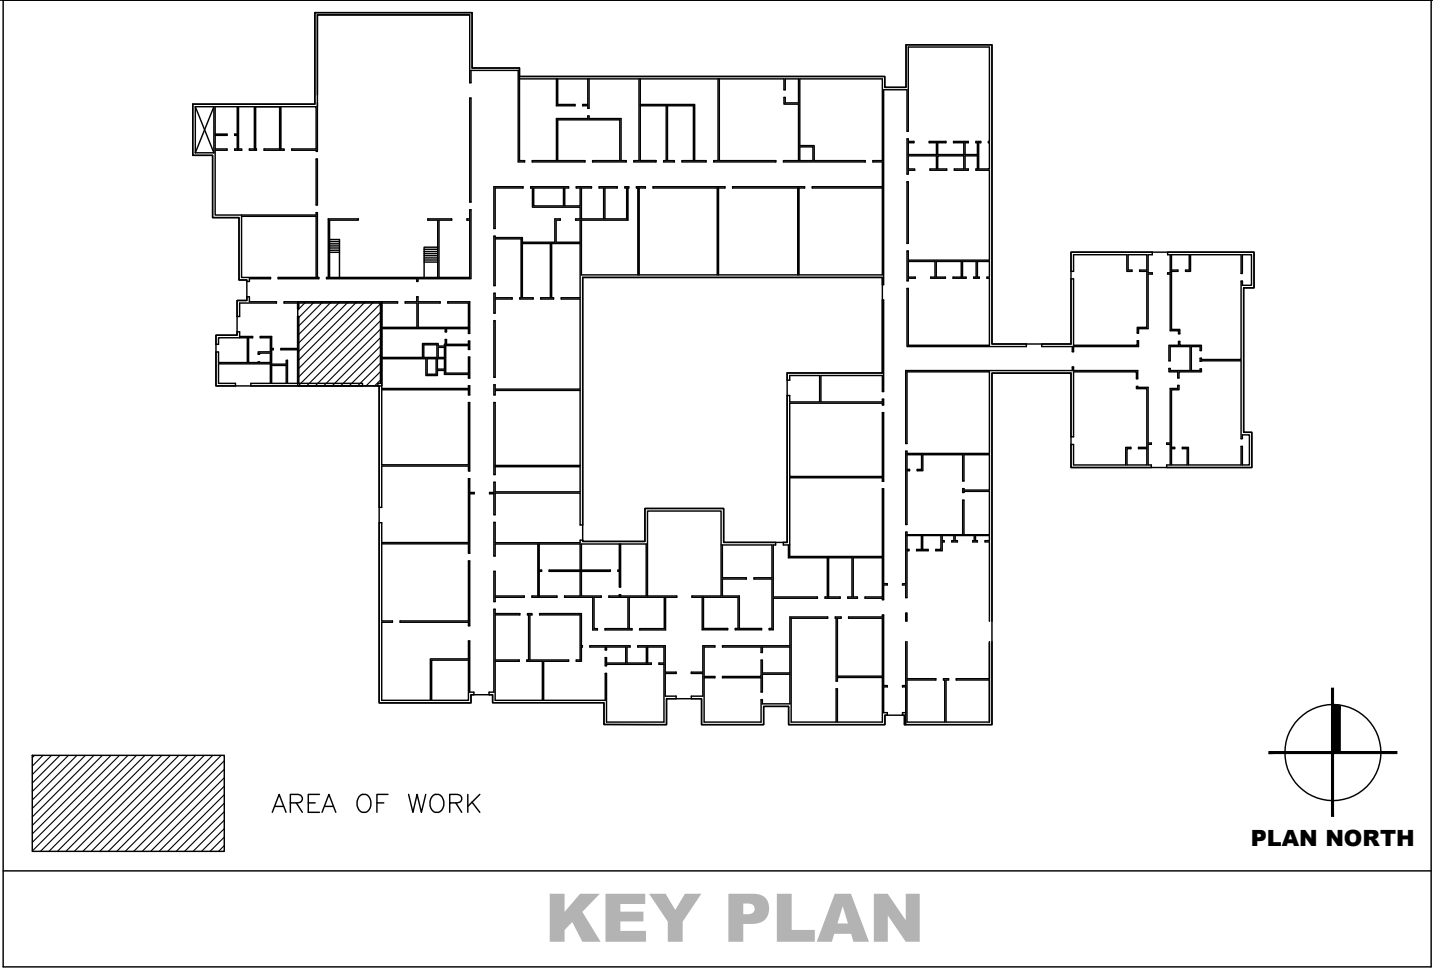

KEY PLAN

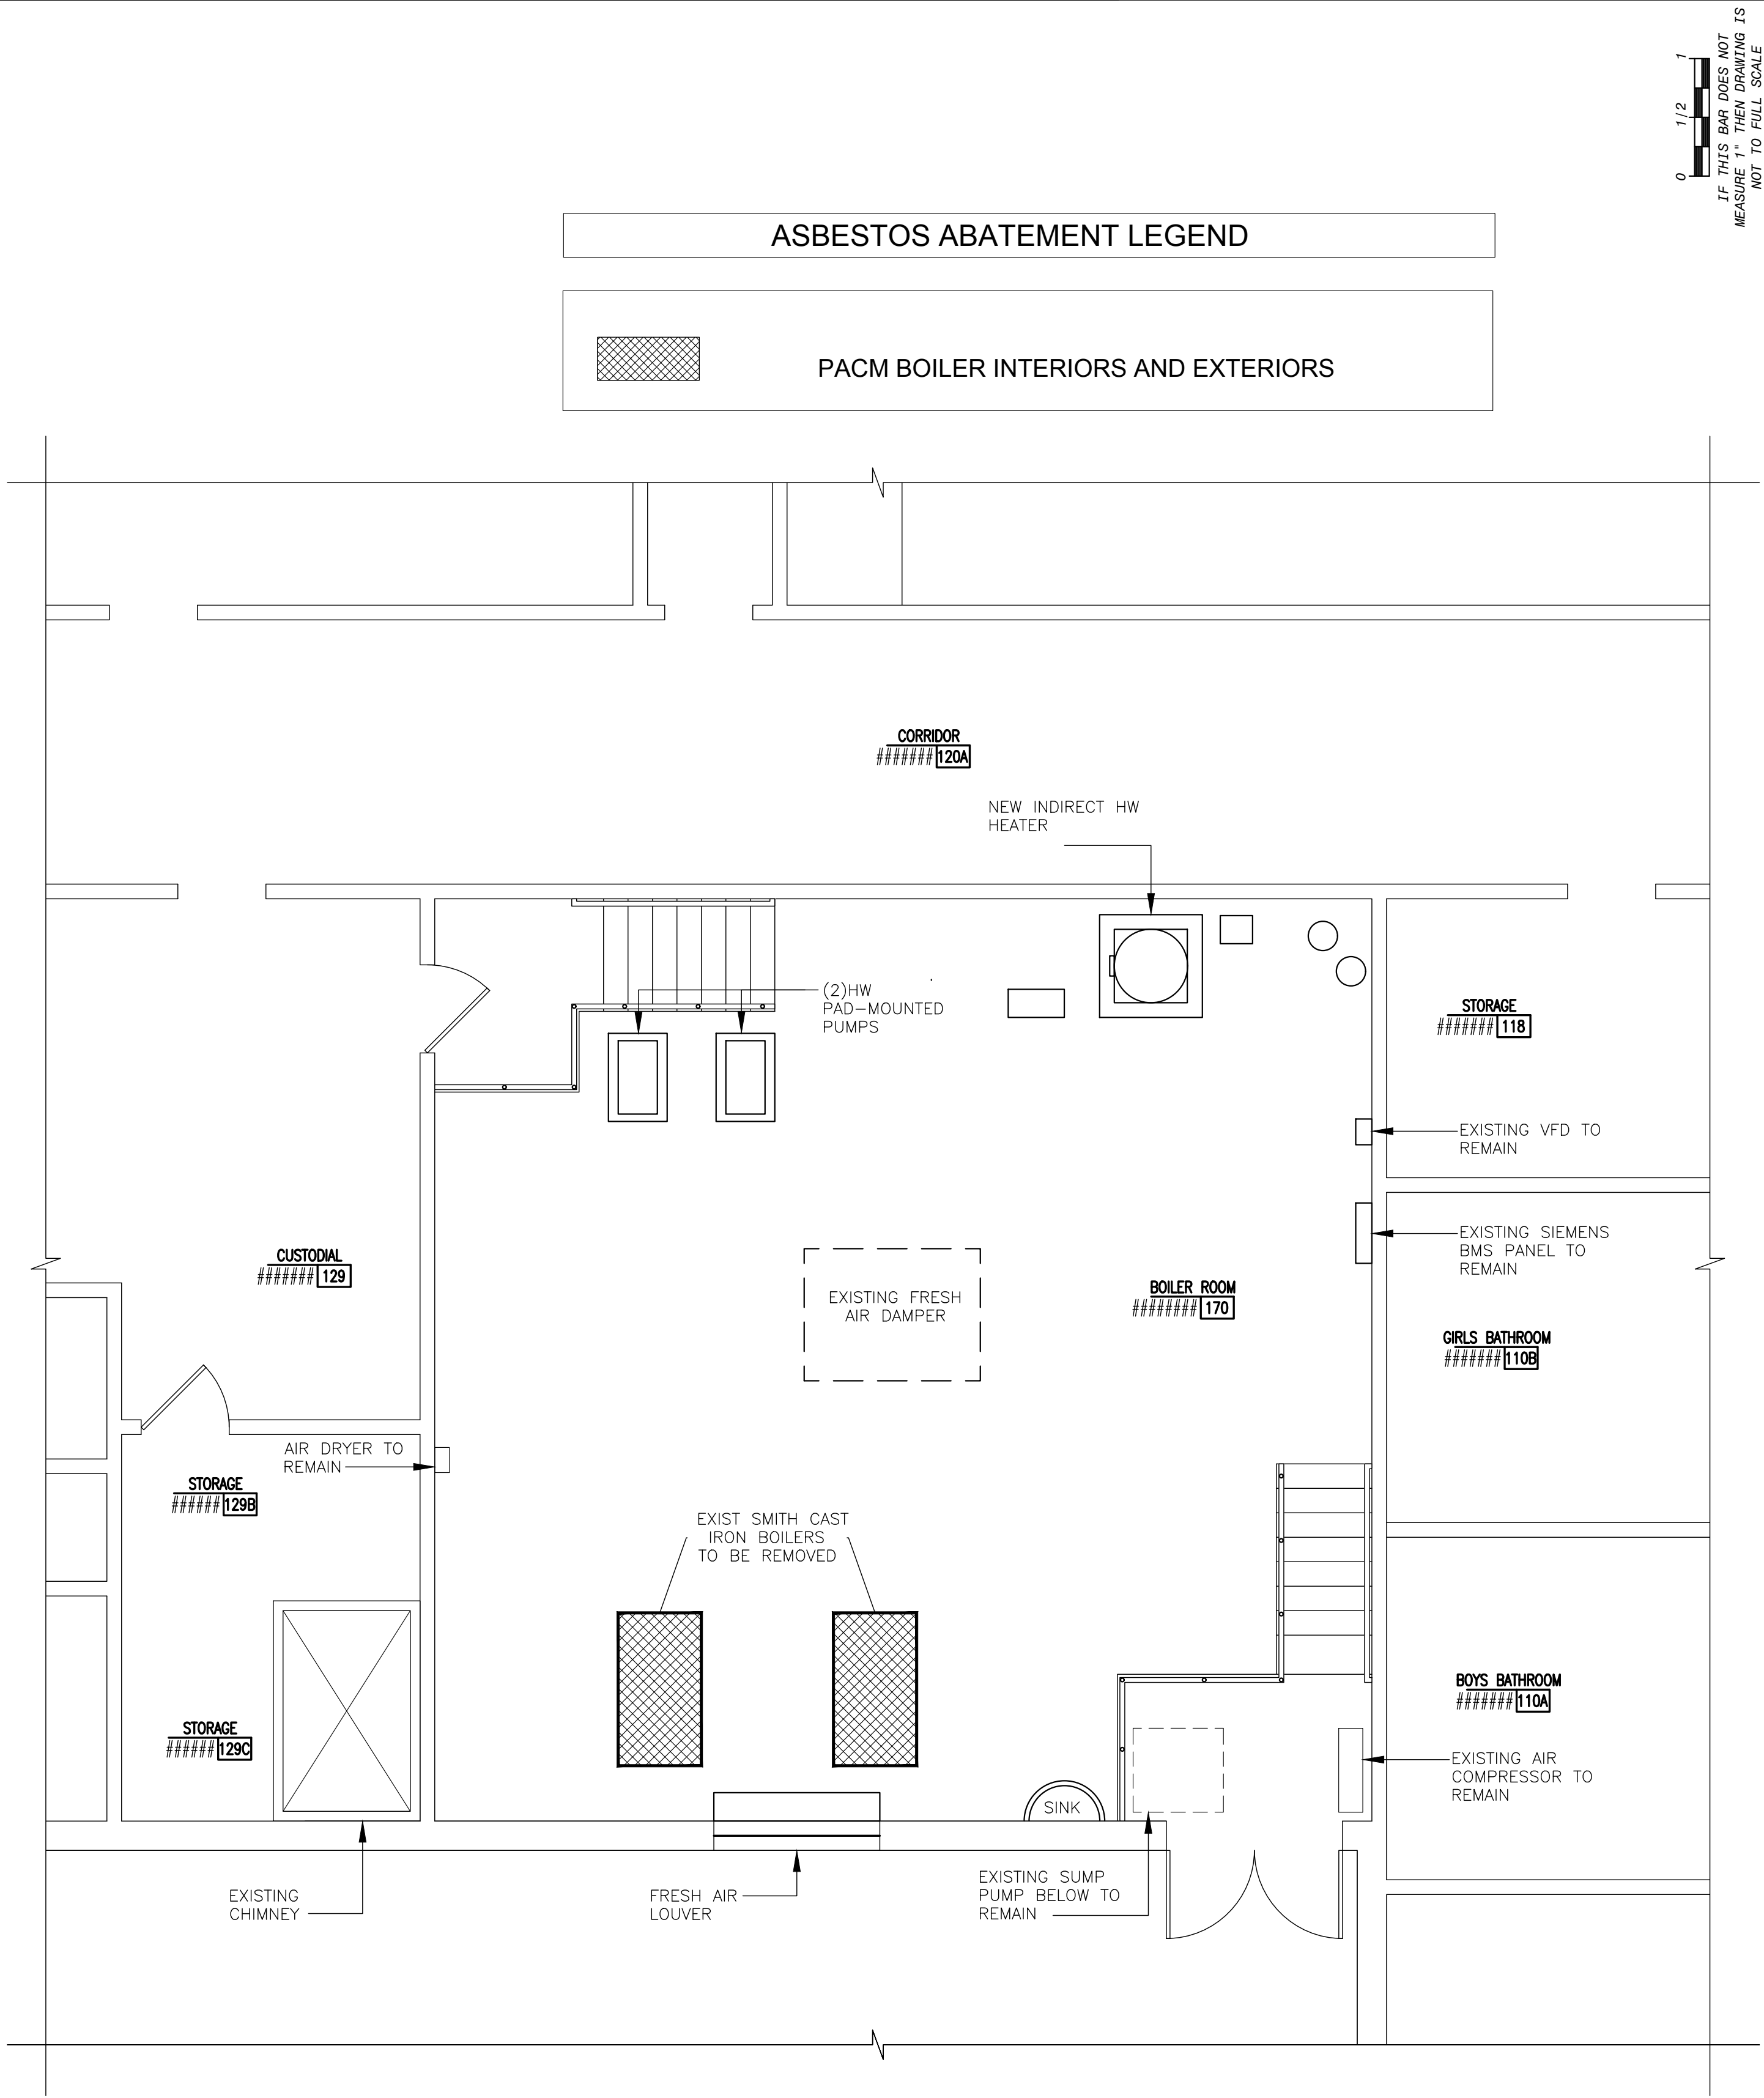

ASBESTOS ABATEMENT LEGEND


PACM BOILER INTERIORS AND EXTERIORS

1 NRHSE BOILER ROOM ACM ABATEMENT PLAN
SCALE: NTS

0 1/2 1
IF THIS BAR DOES NOT
MEASURE 1" THEN DRAWING IS
NOT TO FULL SCALE

PLAN NORTH

No.	Date	Revisions
1	05-31-24	BIDDING DOCUMENTS

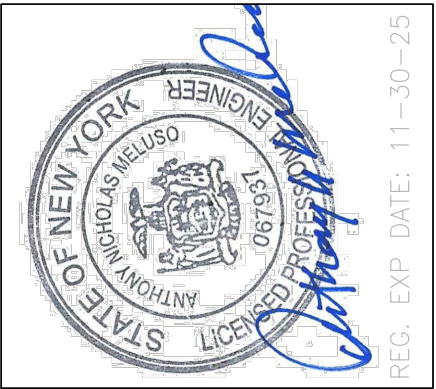





Drawn by	AM
Checked by	RL
Project No.	44023
Scale	AS NOTED
Date	05-31-24

Quality Environmental Solutions & Technologies, Inc. 1238 NYS Route 9 Wappingers Falls, NY 12590 Tel: (845) 238-6031
--

NORTH ROCKLAND HIGH SCHOOL EXTENSION BOILER REPLACEMENT HIGH SCHOOL SED# 50-02-01-06-0-007-016 45 Chapel Street Garnerville, NY 10823 COUNTY OF ROCKLAND
--




Drawing Title PROPOSED BOILER ROOM ACM PLAN	Drawing No. AA-100
---	------------------------------

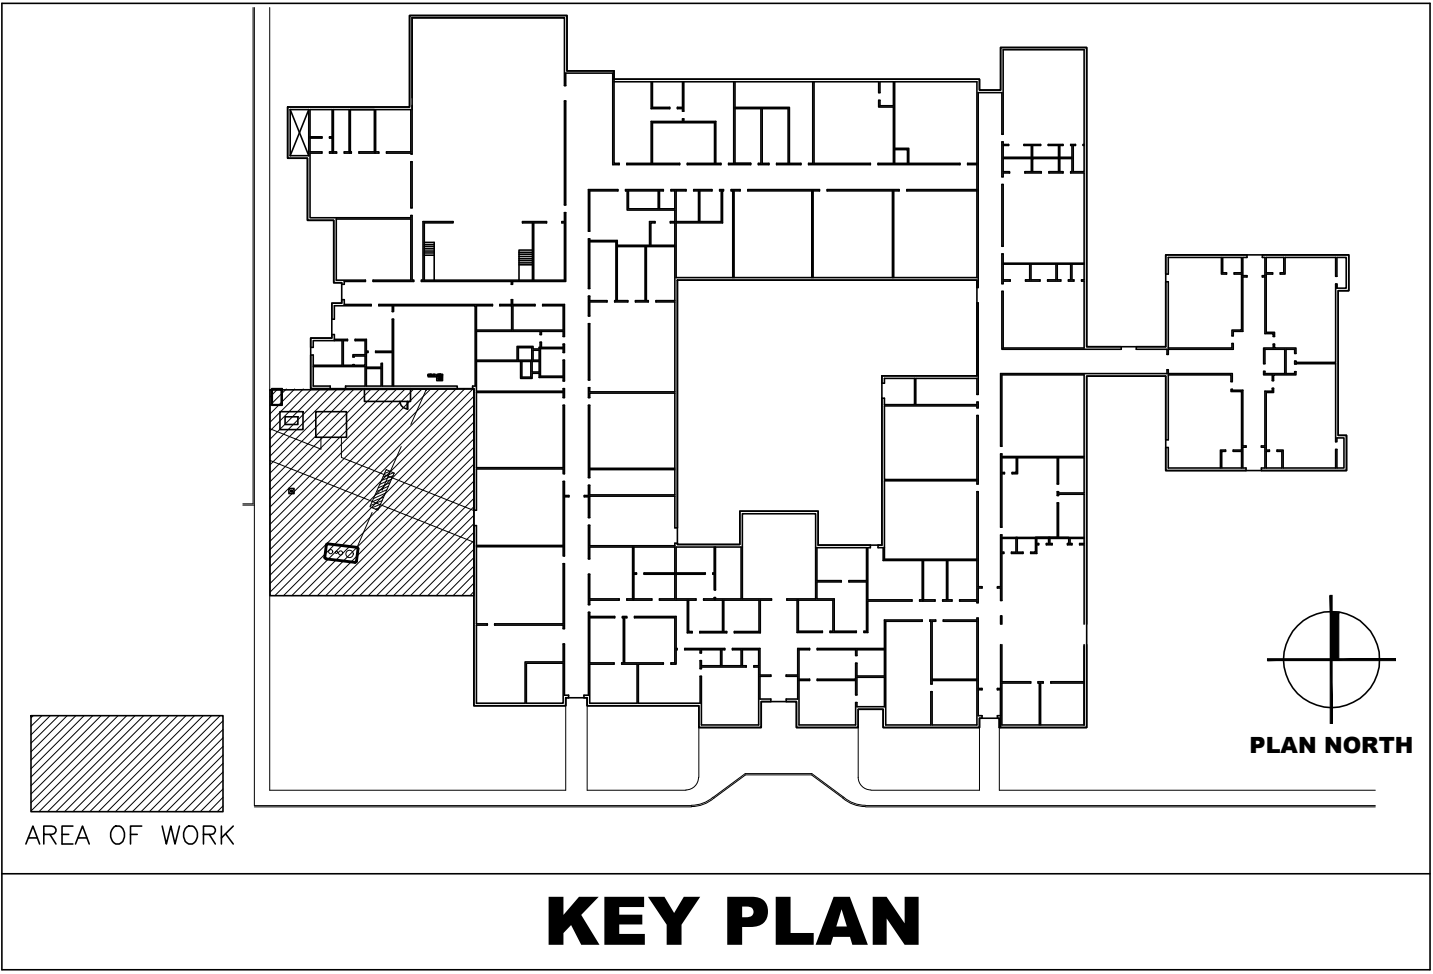

- GENERAL NOTES**
- SEE AND COORDINATE WITH ASBESTOS PLANS.
 - CONTRACTOR IS RESPONSIBLE TO PROVIDE TESTING DATA ON ALL FILL BROUGHT ONTO THE SITE.


- SITE KEY NOTES**
- C1** AS PER BASE BID: REMOVE EXISTING OIL TANK AND BACKFILL. PROVIDE CLEAN FILL, COMPACT IN LIFTS, ADD 4" TOPSOIL. RAKE SEED, AND HAY ALL DISTURBED AREAS
 - C2** AS PER ALTERNATE NO. 2: DECOMMISSION EXISTING OIL TANK TO REMAIN IN PLACE AND FILL IN LIEU OF REMOVAL.
 - C3** INSTALL NEW FENCE GATE.
 - C4** REMOVE EXISTING OIL TANK VENT. PATCH MASONRY TO MATCH (SUBMIT BRICK EXAMPLES).
 - C5** UNDERGROUND OIL LINE TO BE REMOVED.
 - C6** EXISTING OIL LINE UNDER WALKWAY TO BE ABANDONED IN PLACE.

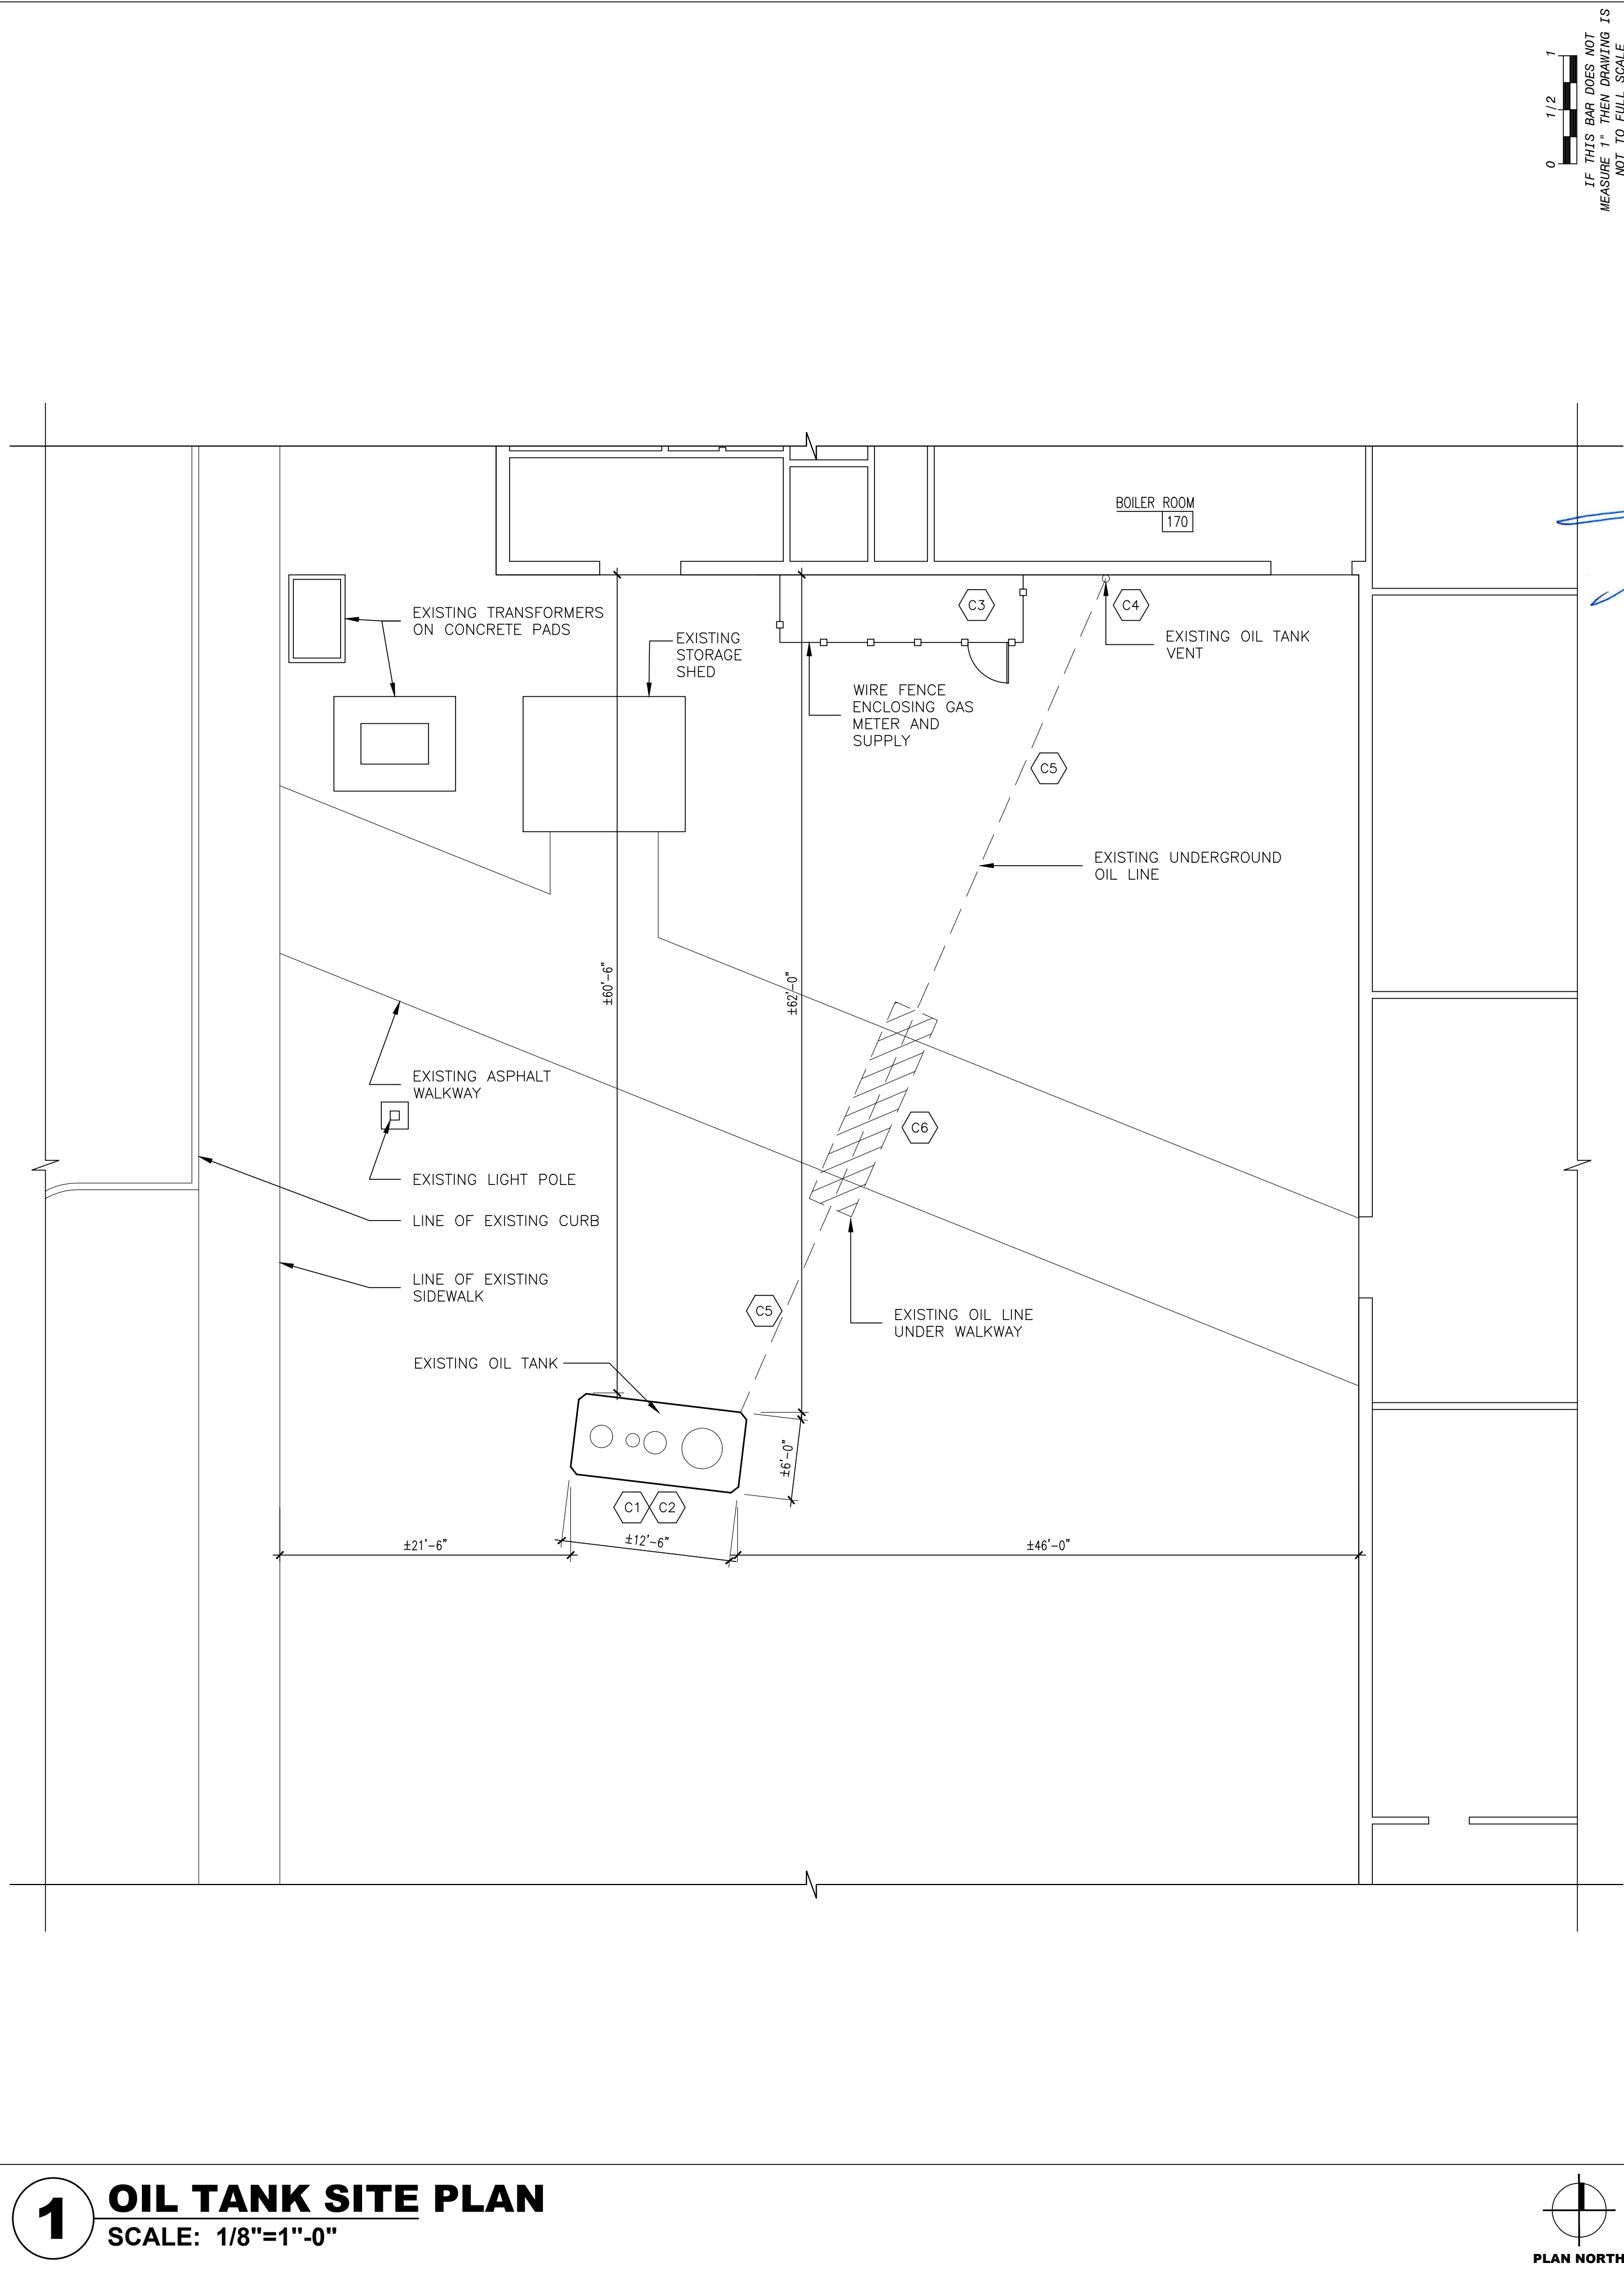

0 1/2 1
IF THIS BAR DOES NOT
MEASURE 1" THEN DRAWING IS
NOT TO FULL SCALE



No.	Date	Revisions
1	05-31-24	BIDDING DOCUMENTS

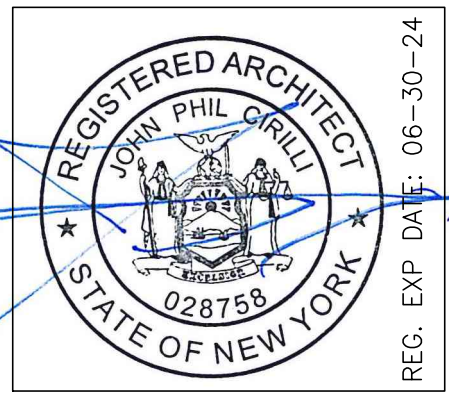

Drawn by	MAL
Checked by	MS/JC
Project No.	44023
Scale	AS NOTED
Date	05-31-24

Mechanical & Electrical Engineer:	Structural Engineer:
---	-------------------------



**NORTH ROCKLAND HIGH
SCHOOL EXTENSION BOILER
REPLACEMENT**

SED# 50-02-01-06-0-007-016
65 CHAPEL STREET
GARNERVILLE, NY 10923
COUNTY OF ROCKLAND

MSA
MICHAEL SHILALE ARCHITECTS, L.L.P.
140 Park Avenue New York, NY 10056 Tel 945-706-9200
msa@msa.com

SITE PLAN
Drawing No. **C-101**

© COPYRIGHT, MICHAEL SHILALE ARCHITECTS LLP. ALL RIGHTS RESERVED. Drawing Title



NOTES:

1. FILTER FABRIC SHALL HAVE AN EOS OF 40-85.
2. WOODEN FRAME SHALL BE CONSTRUCTED OF 2" X 4" CONSTRUCTION GRADE LUMBER.
3. WIRE MESH ACROSS THROAT SHALL BE A CONTINUOUS PIECE 30 INCH MINIMUM WIDTH WITH A LENGTH 4 FEET LONGER THAN THE THROAT. IT SHALL BE SHAPED AND SECURELY NAILED TO A 2" X 4" WEIR.
4. THE WEIR SHALL BE SECURELY NAILED TO 2" X 4" SPACERS 9 INCHES LONG SPACED NO MORE THAN 6 FEET APART.
5. THE ASSEMBLY SHALL BE PLACED AGAINST THE INLET AND SECURED BY 2" X 4" ANCHORS 2 FEET LONG EXTENDING ACROSS THE TOP OF THE INLET AND HELD IN PLACE BY SAND BAGS OR ALTERNATE WEIGHTS.

6


INLET PROTECTION DETAIL
SCALE: N.T.S.

CONSTRUCTION SPECIFICATIONS

1. FILTER FABRIC SHALL HAVE AN EOS OF 40-85. BURLAP MAY BE USED FOR SHORT TERM APPLICATIONS.
2. CUT FABRIC FROM A CONTINUOUS ROLL TO ELIMINATE JOINTS. IF JOINTS ARE NEEDED THEY WILL BE OVERLAPPED TO THE NEXT STAKE.
3. STAKE MATERIALS WILL BE STANDARD 2"x4" WOOD OR EQUIVALENT, METAL WITH A MINIMUM LENGTH OF 3 FEET.
4. SPACE STAKES EVENLY AROUND INLET 3 FEET APART AND DRIVE A MINIMUM 18 INCHES DEEP. SPANS GREATER THAN 3 FEET MAY BE BRIDGED WITH THE USE OF WIRE MESH BEHIND THE FILTER FABRIC FOR SUPPORT.
5. FABRIC SHALL BE EMBEDDED 1 FOOT MINIMUM BELOW GROUND AND BACKFILLED. IT SHALL BE SECURELY FASTENED TO THE STAKES AND FRAME.
6. A 2"x4" WOOD FRAME SHALL BE COMPLETED AROUND THE CREST OF THE FABRIC FOR OVER FLOW STABILITY.
7. MAXIMUM DRAINAGE AREA 1 ACRE

5

INLET PROTECTION DETAIL
SCALE: N.T.S.



NOTES:

1. IF THIS BALE DOES NOT MEASURE 1" THEN DRAWING IS NOT TO FULL SCALE

3

HAY BALE DETAIL
SCALE: N.T.S.

2

TREE PROTECTION DETAIL
SCALE: N.T.S.

NOTES:

1. WOVEN WIRE FENCE TO BE FASTENED SECURELY TO FENCE POSTS WITH WIRE TIES OR STAPLES. POSTS SHALL BE STEEL EITHER "I" OR "U" TYPE OR HARDWOOD.
2. FILTER CLOTH TO BE TO BE FASTENED SECURELY TO WOVEN WIRE FENCE WITH TIES SPACED EVERY 24" AT TOP AND MID SECTION. FENCE SHALL BE WOVEN WIRE, 12 1/2 GAUGE, 6" MAXIMUM MESH OPENING.
3. WHEN TWO SECTIONS OF FILTER CLOTH ADJOIN EACH OTHER THEY SHALL BE OVER-LAPPED BY SIX INCHES AND FOLDED. FILTER CLOTH SHALL BE EITHER FILTER X, MIRAFI 100X, STABILINKA T140N, OR APPROVED EQUIVALENT.
4. PREFABRICATED UNITS SHALL BE GEOFAB, ENVIROFENCE, OR APPROVED EQUIVALENT.
5. MAINTENANCE SHALL BE PERFORMED AS NEEDED AND MATERIAL REMOVED WHEN "BULGES" DEVELOP IN THE SILT FENCE.

1

SILT FENCE DETAIL
SCALE: N.T.S.

0 1/2 1

IF THIS BAR DOES NOT MEASURE 1" THEN DRAWING IS NOT TO FULL SCALE

Drawn by	JR/CP/RH
Checked by	MS/JC
Project No.	44023
Scale	AS NOTED
Date	09-18-23

No.	Date	Revisions
1	05-31-24	BIDDING DOCUMENTS

IT IS A VIOLATION OF THE LAW FOR ANY PERSON, UNLESS ACTING UNDER THE DIRECTION OF A LICENSED ARCHITECT, TO ALTER AN ITEM IN ANY WAY.

Mechanical & Electrical Engineer:	Structural Engineer:
-----------------------------------	----------------------

NORTH ROCKLAND HIGH SCHOOL EXTENSION BOILER REPLACEMENT





SED# 50-02-01-06-0-007-016

45 CHURCH STREET, GARNETTVILLE, NY 10823

COUNTY OF ROCKLAND

SITE DETAILS

Drawing No. **C-501**

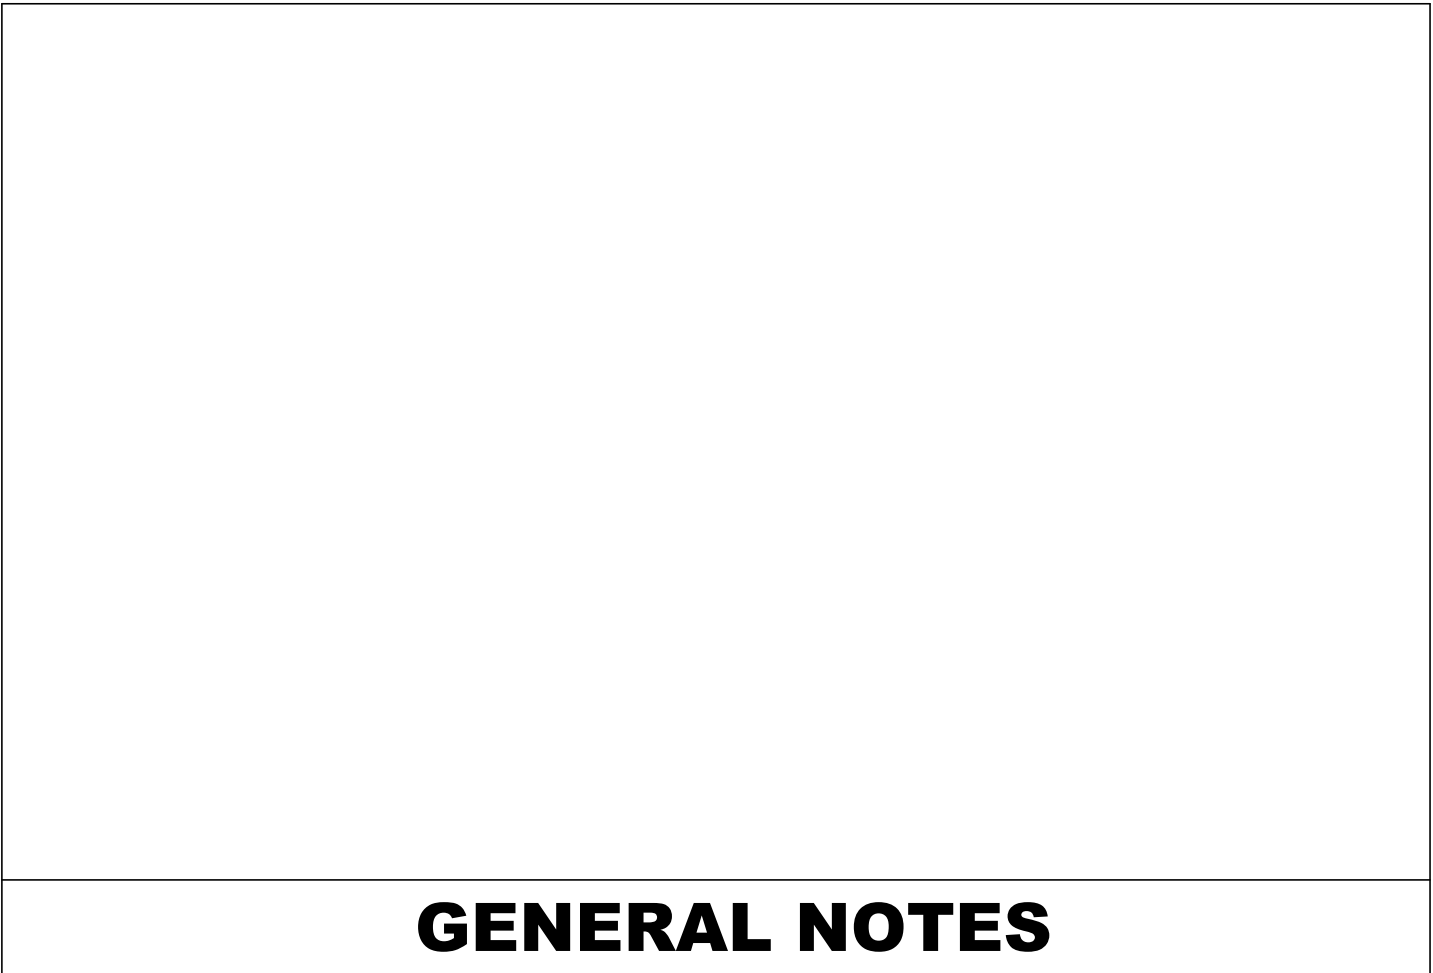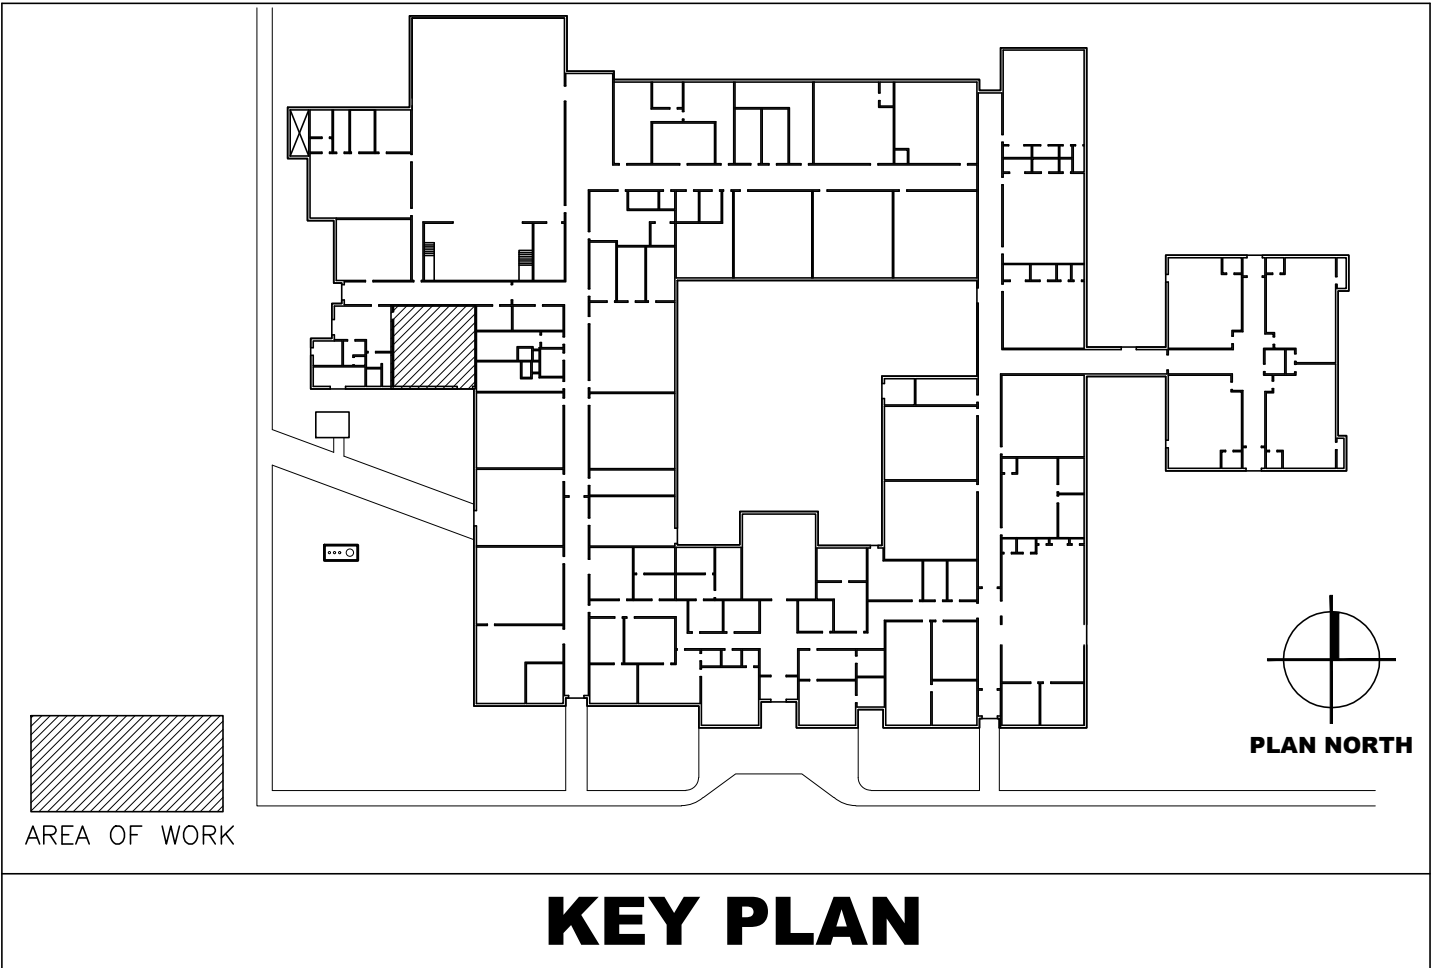

GENERAL NOTES

A1 PROVIDE NEW HIGH EFFICIENCY CONDENSING BOILER ON EXISTING HOUSEKEEPING PAD. SEE SCHEDULE OF BOILERS ON M-002.

A2 BASE BID: EXISTING PAD-MOUNTED HOT WATER PUMPS TO REMAIN. ALT. NO. 1: REMOVE AND REPLACE 2 NEW HOT WATER PAD-MOUNTED PUMPS AND INSTALL ON EXISTING HOUSEKEEPING PADS.

A3 PROVIDE NEW INDIRECT HOT WATER HEATER. SEE MECHANICAL DRAWINGS.

A4 PROVIDE NEW HOUSEKEEPING PAD.

A5 PROVIDE NEW TRANSITION HOOD FOR COMBUSTION AIR INTAKE VENT. SEE MECHANICAL DRAWINGS.

A6 PROVIDE NEW EXHAUST FLUE. SEE MECHANICAL DRAWINGS.


A7 HOT WATER CIRCULATING PUMPS TO BE REINSTALLED. SEE MECHANICAL DRAWINGS.

A8 FLASH PATCH EXISTING CONCRETE FLOOR WITH ARDEX AT LOCATION OF REMOVED HOUSEKEEPING PAD.

A9 PATCH MASONRY WALL AT ALL REMOVED PENETRATIONS. (2HR RATED MASONRY). SUBMIT UL DESIGN.

A10 INSTALL DOOR CLOSER ON EXISTING DOOR.

CONSTRUCTION KEY NOTES

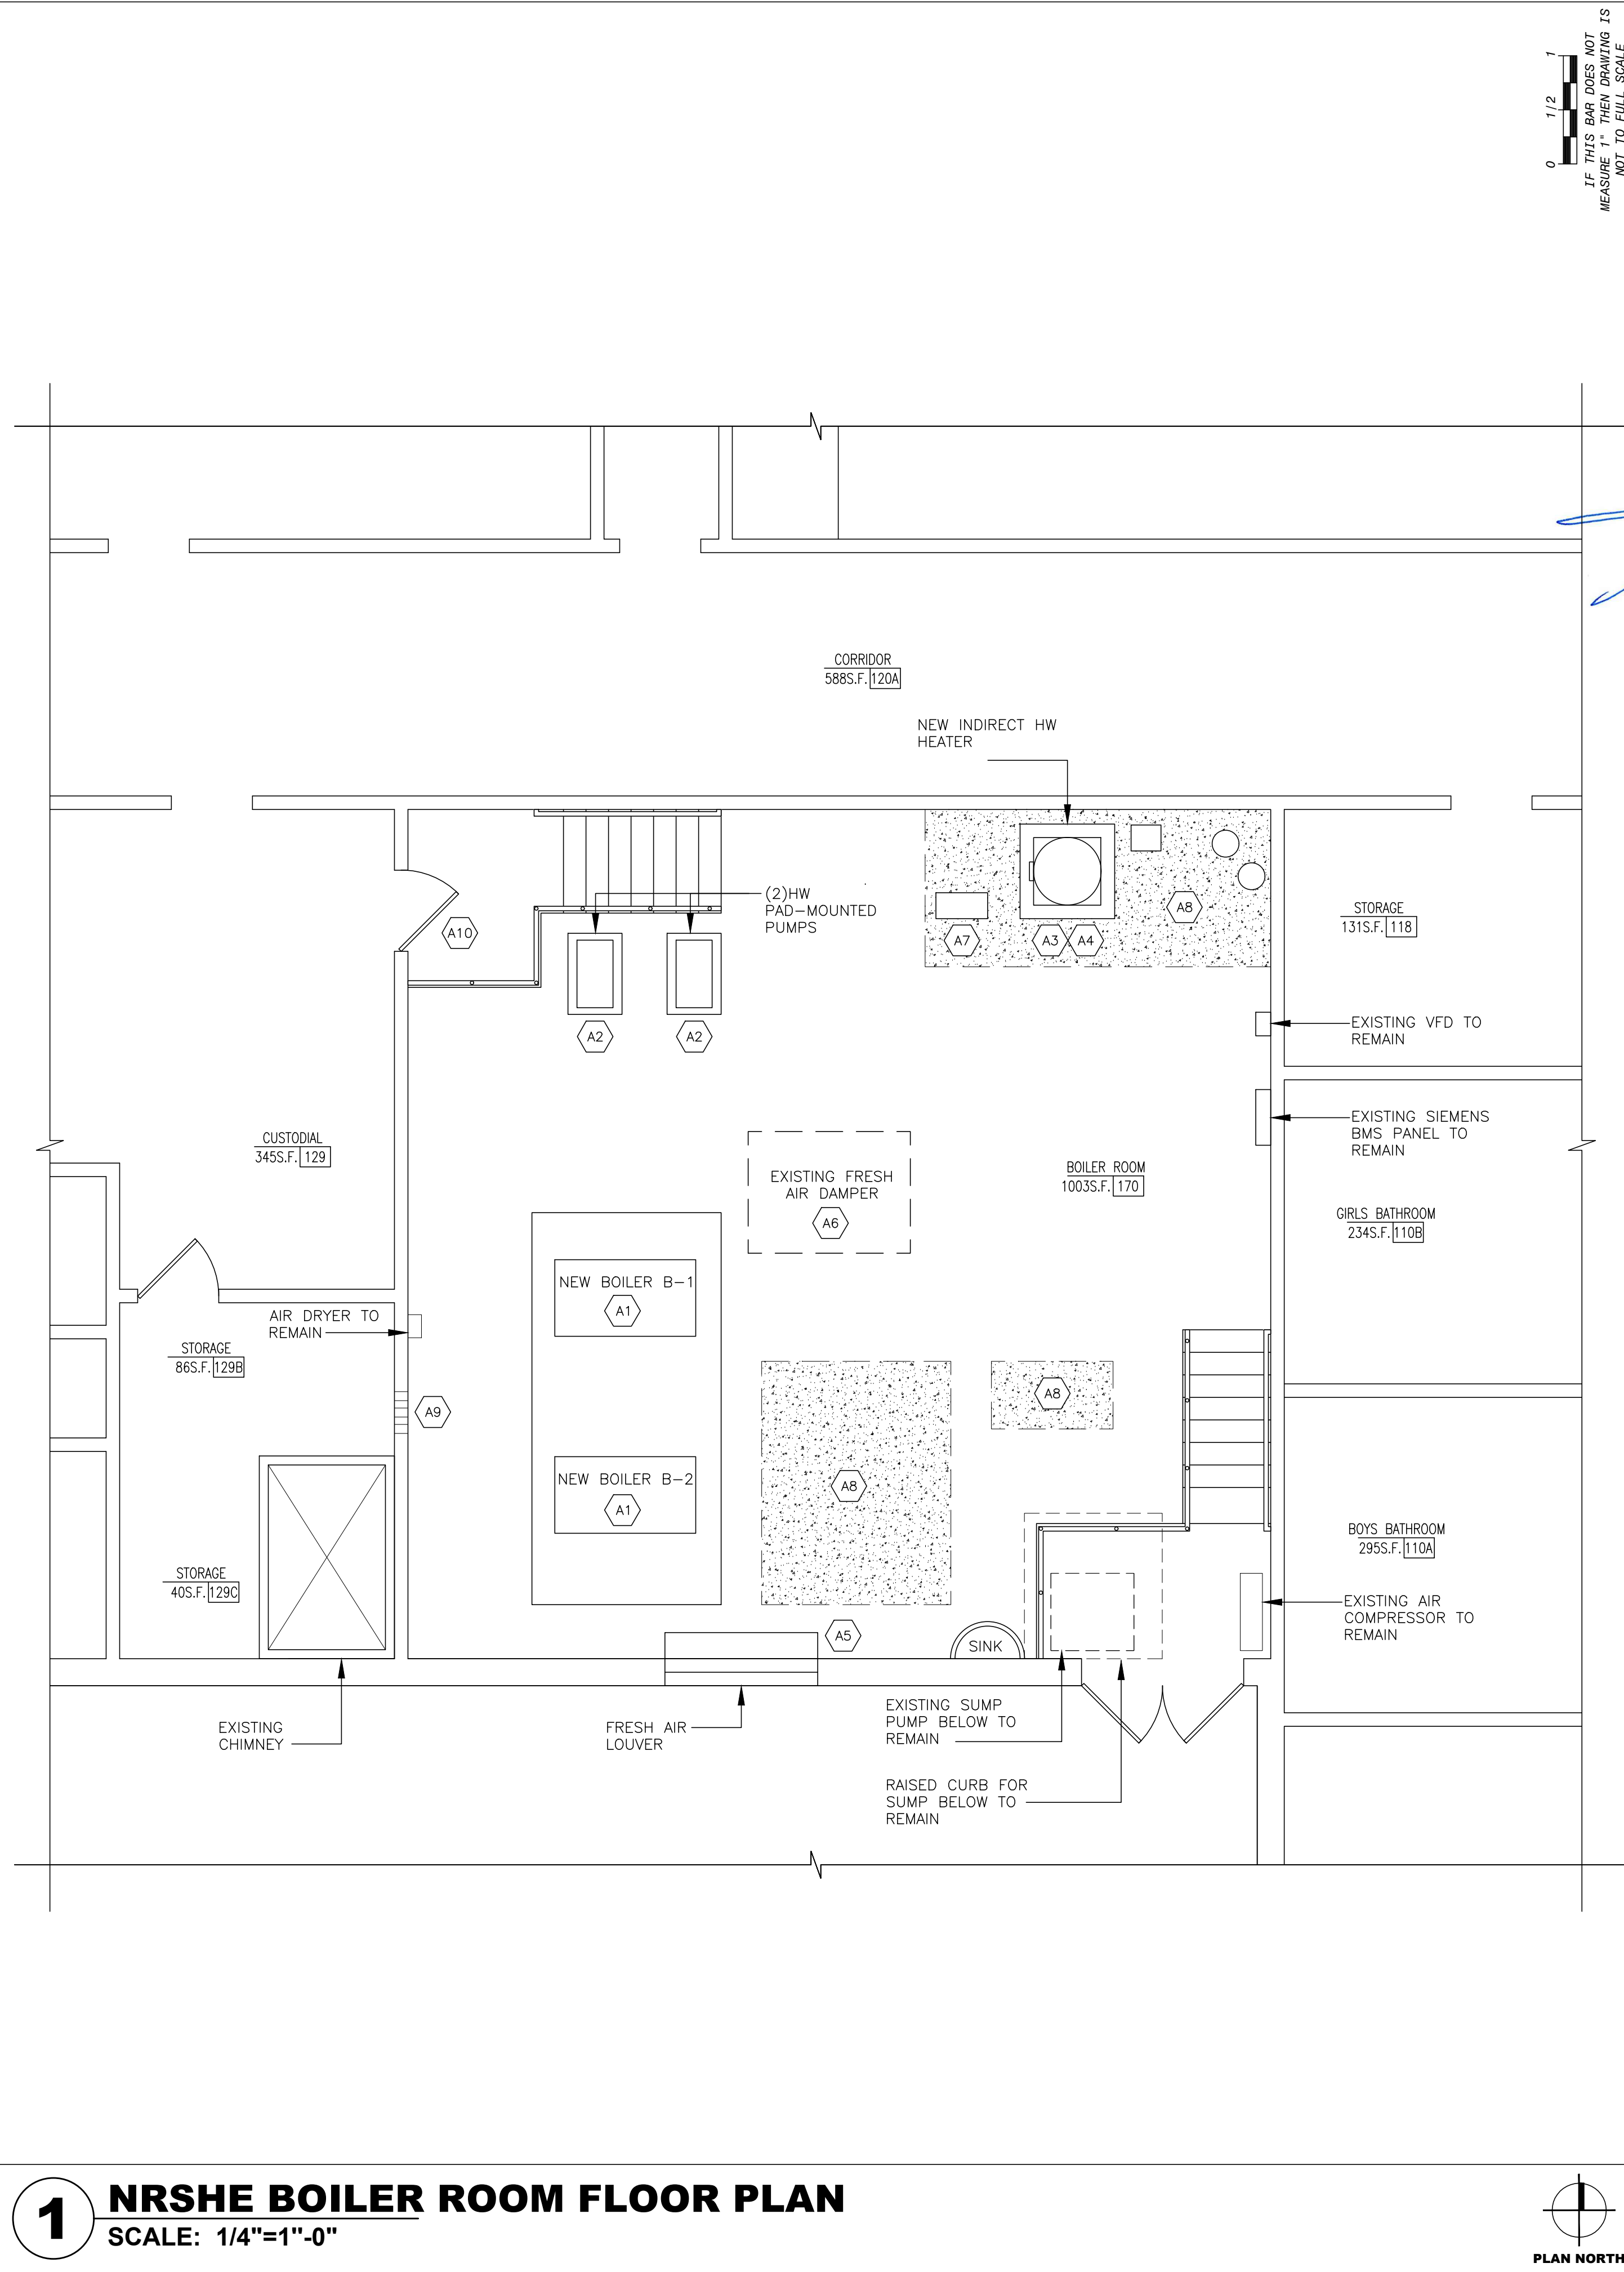

1

NRSHE BOILER ROOM FLOOR PLAN
SCALE: 1/4"=1'-0"

0 1/2 1
IF THIS BAR DOES NOT
MEASURE 1" THEN DRAWING IS
NOT TO FULL SCALE



© COPYRIGHT, MICHAEL SHILALE ARCHITECTS LLP. ALL RIGHTS RESERVED.

Drawing Title

**PROPOSED
BOILER ROOM
PLAN**

140 Park Avenue New York, NY 10022 Tel 945/063900
mshilale.com

MSA

MICHAEL SHILALE ARCHITECTS, L.L.P.

65 CHAMPLAIN STREET
CAMDENVILLE, NY 12823

SEDP# 50-02-01-06-0-007-016

COUNTY OF ROCKLAND

MECHANICAL & ELECTRICAL ENGINEER

STRUCTURAL ENGINEER

Drawn by DE

Checked by MS/JC

Project No. 44023

Scale AS NOTED

Date 05-08-24

1

05-31-24 BIDDING DOCUMENTS

No.

Date

Revisions

REGISTERED ARCHITECT
JOHN PHILIP ORLIT
028758
STATE OF NEW YORK

REG. EXP. DATE: 06-30-24

IT IS A VIOLATION OF THE LAW FOR ANY PERSON, UNLESS ACTING UNDER THE DIRECTION OF A LICENSED ARCHITECT, TO ALTER AN ITEM IN ANY WAY.


Drawn by DE

Checked by MS/JC


Project No. 44023

Scale AS NOTED


Date 05-08-24

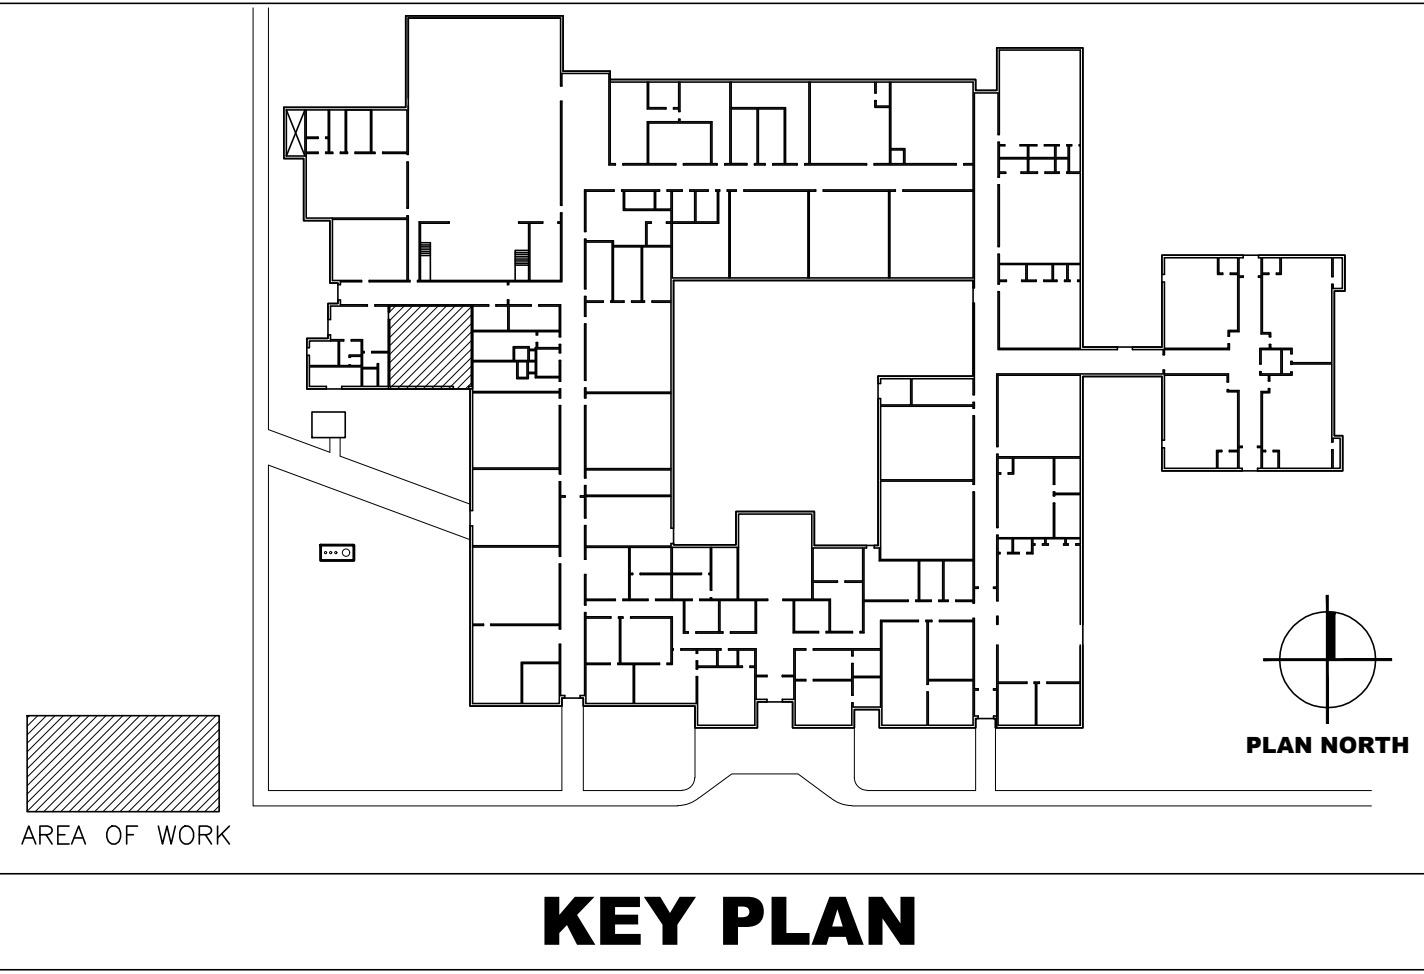


KEY PLAN

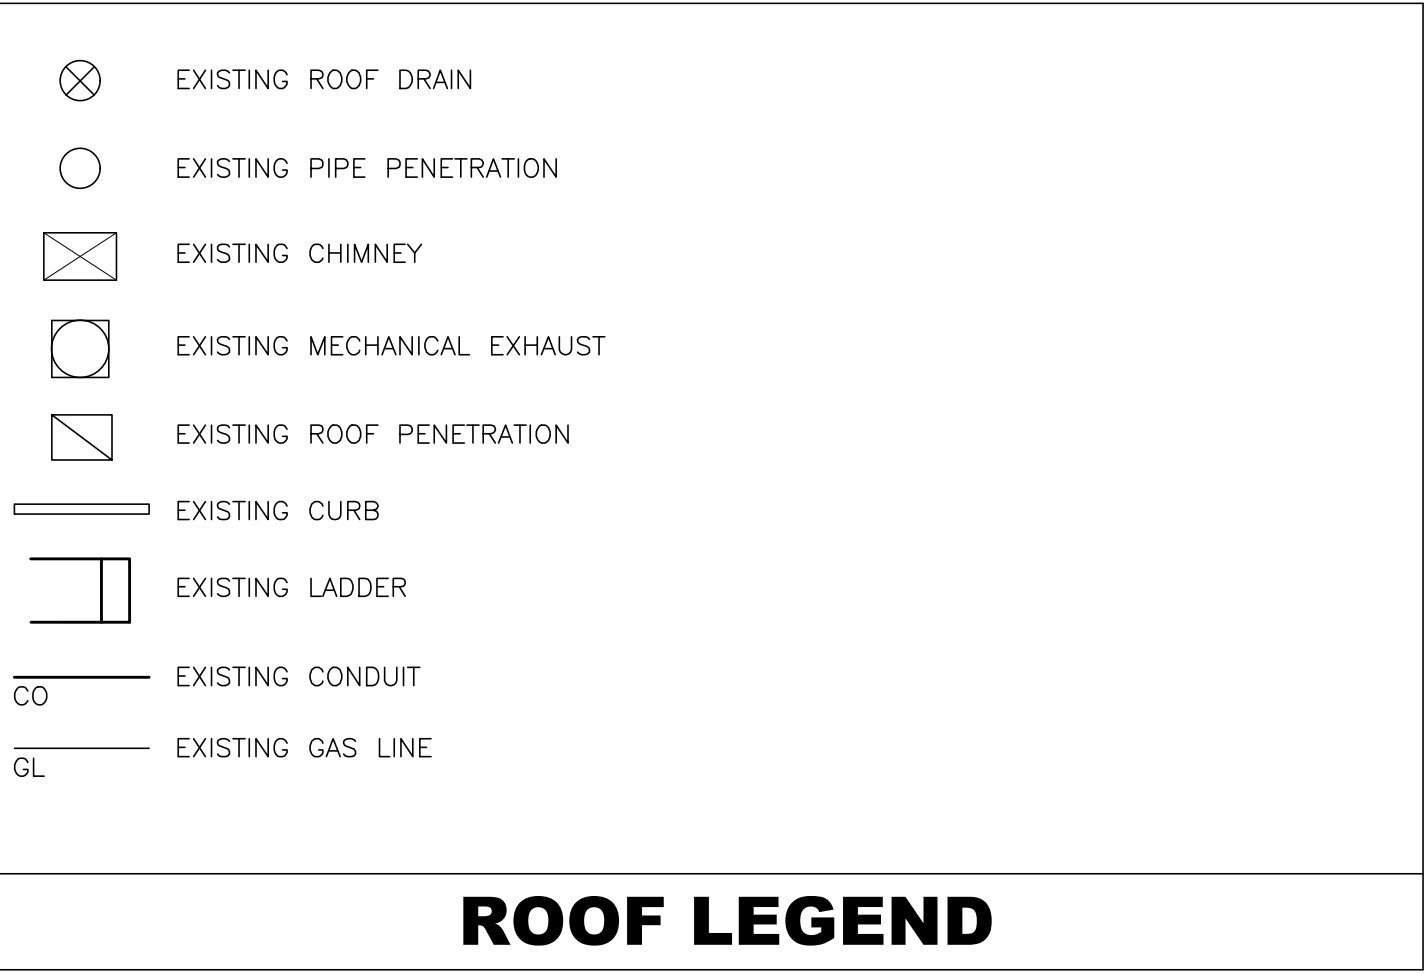


ROOF LEGEND

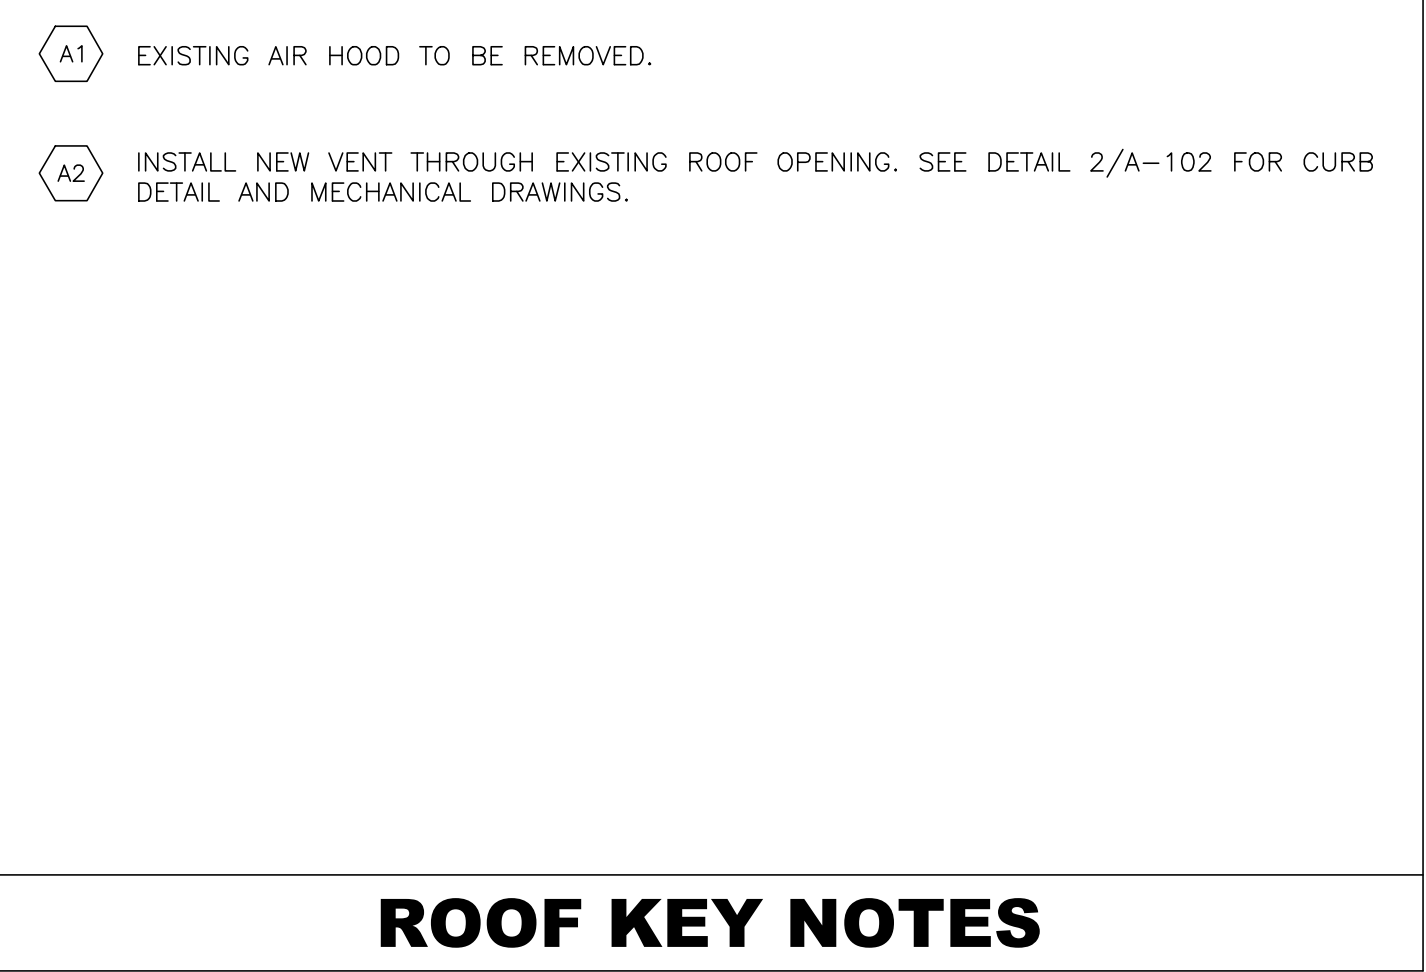

ROOF KEY NOTES

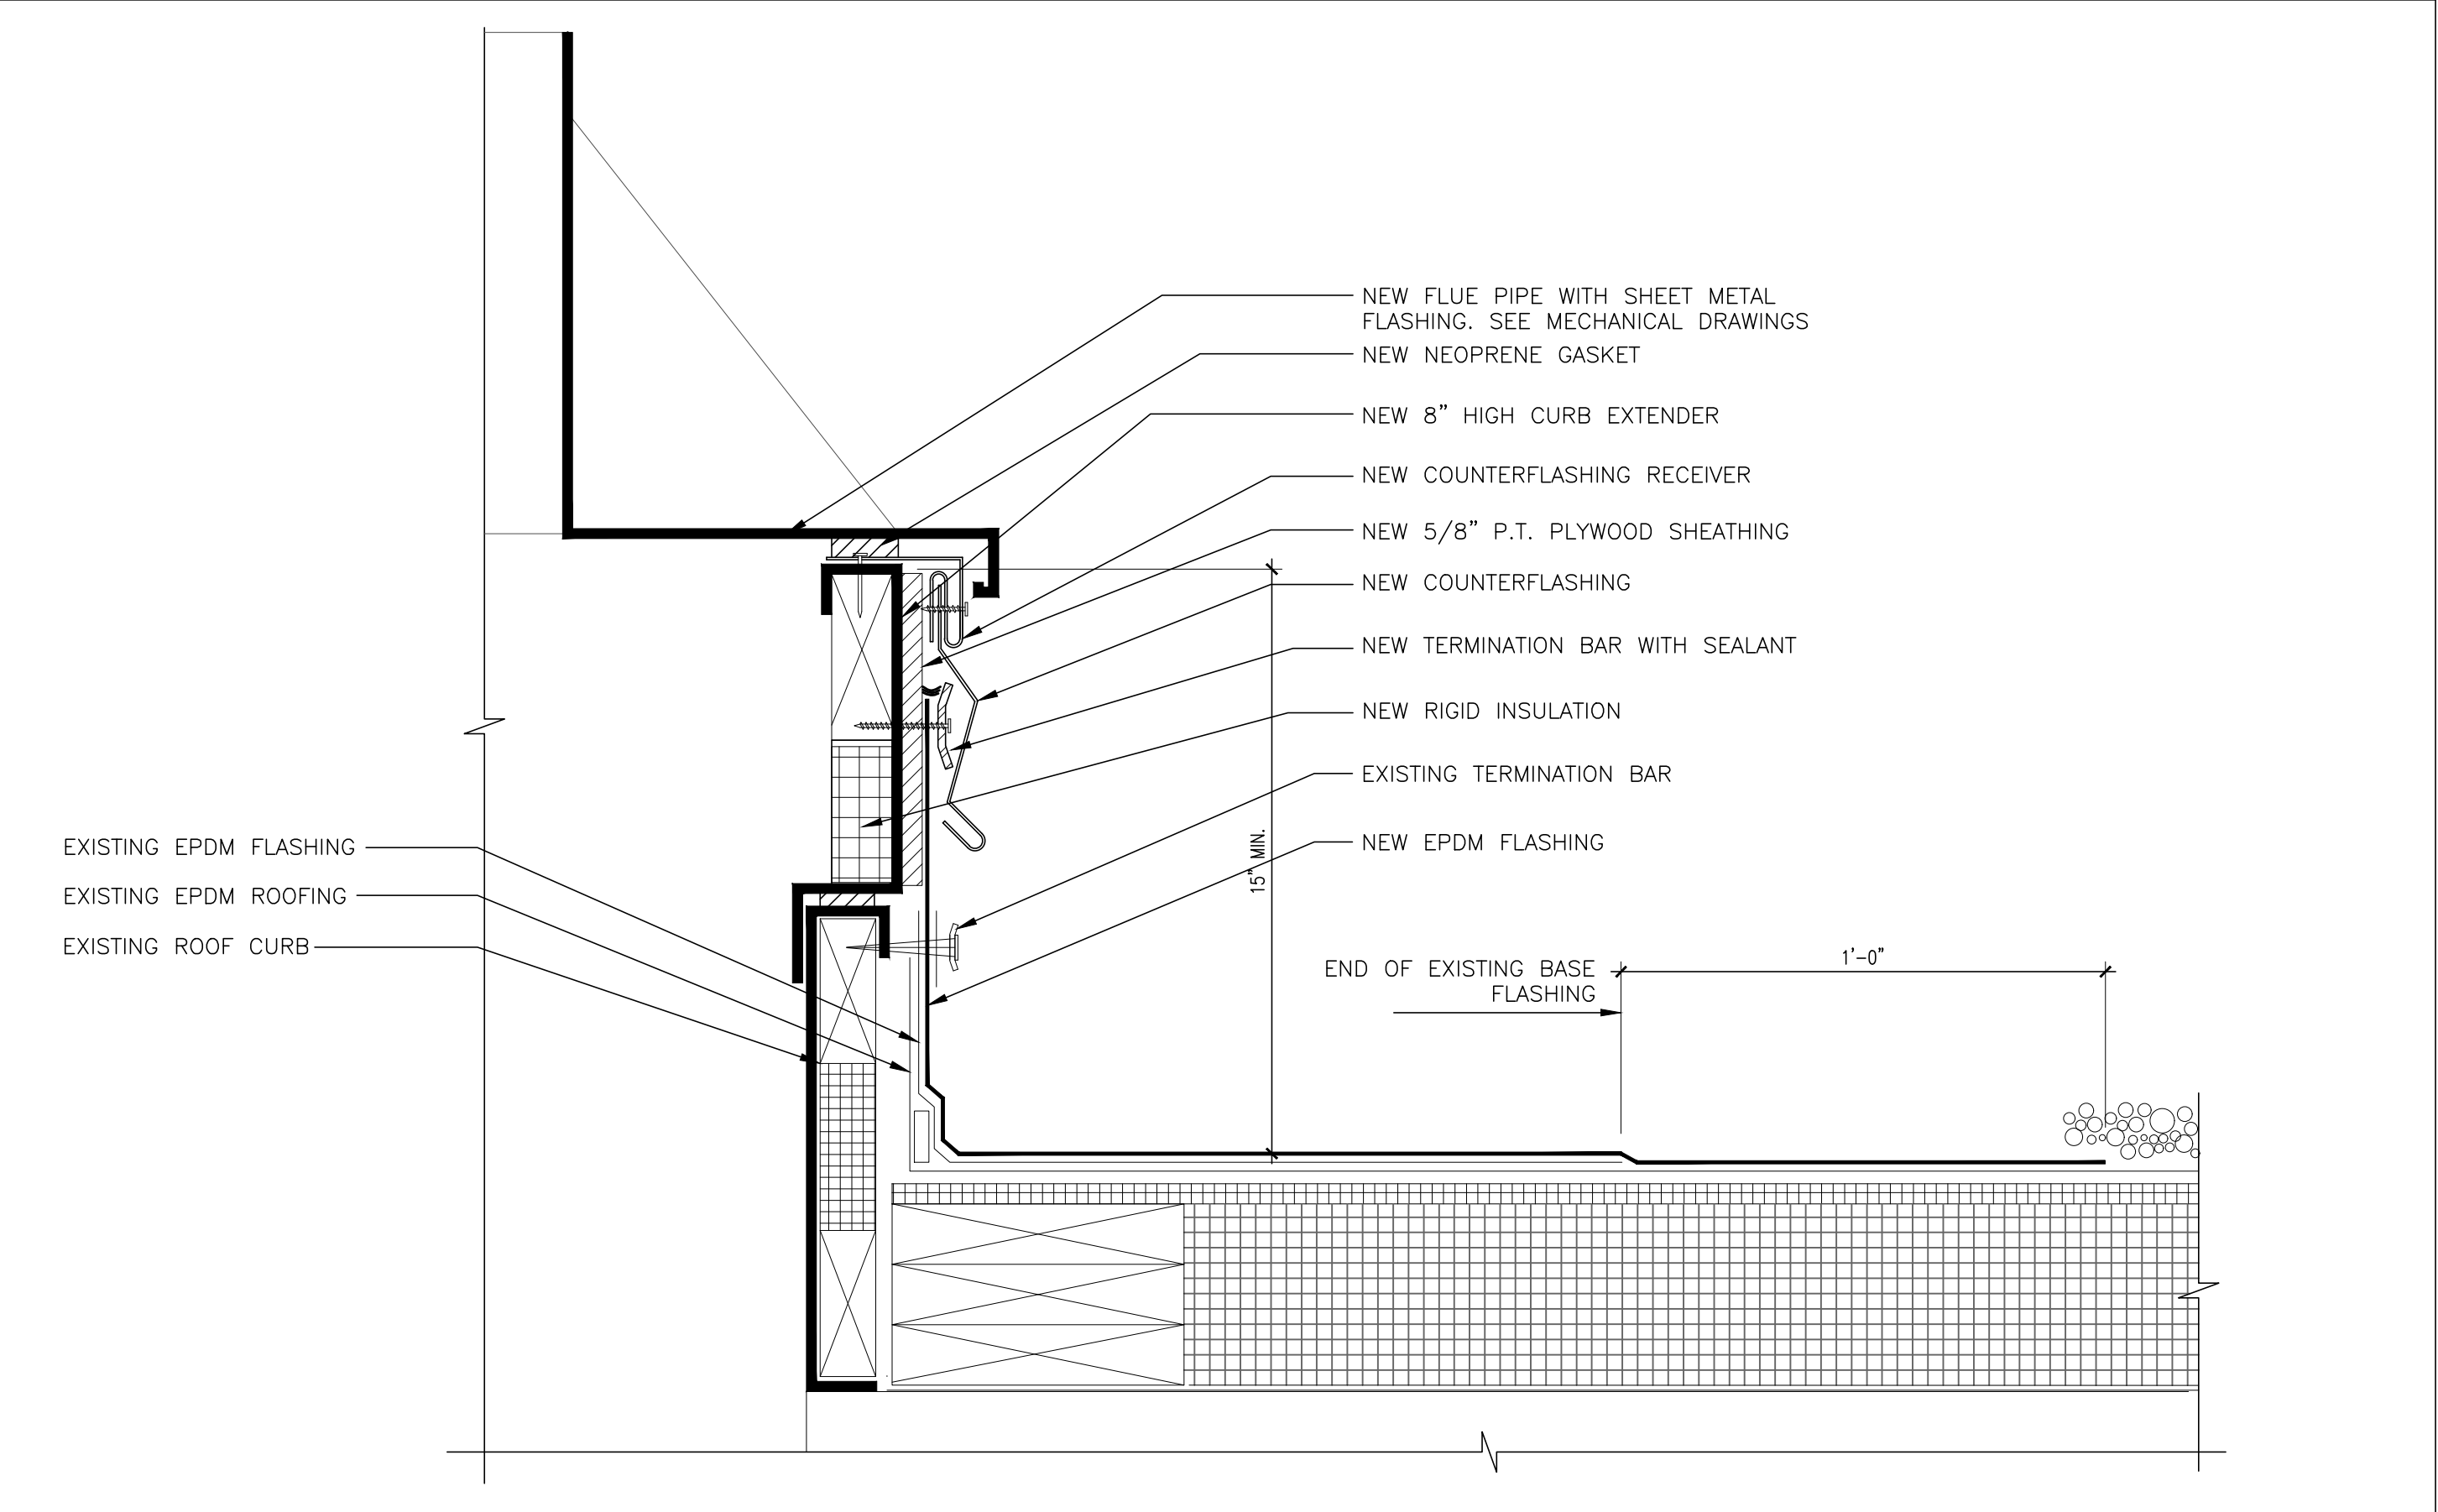


2 TYPICAL CURB ADAPTER DETAIL EPDM
SCALE: 3"=1'-0"

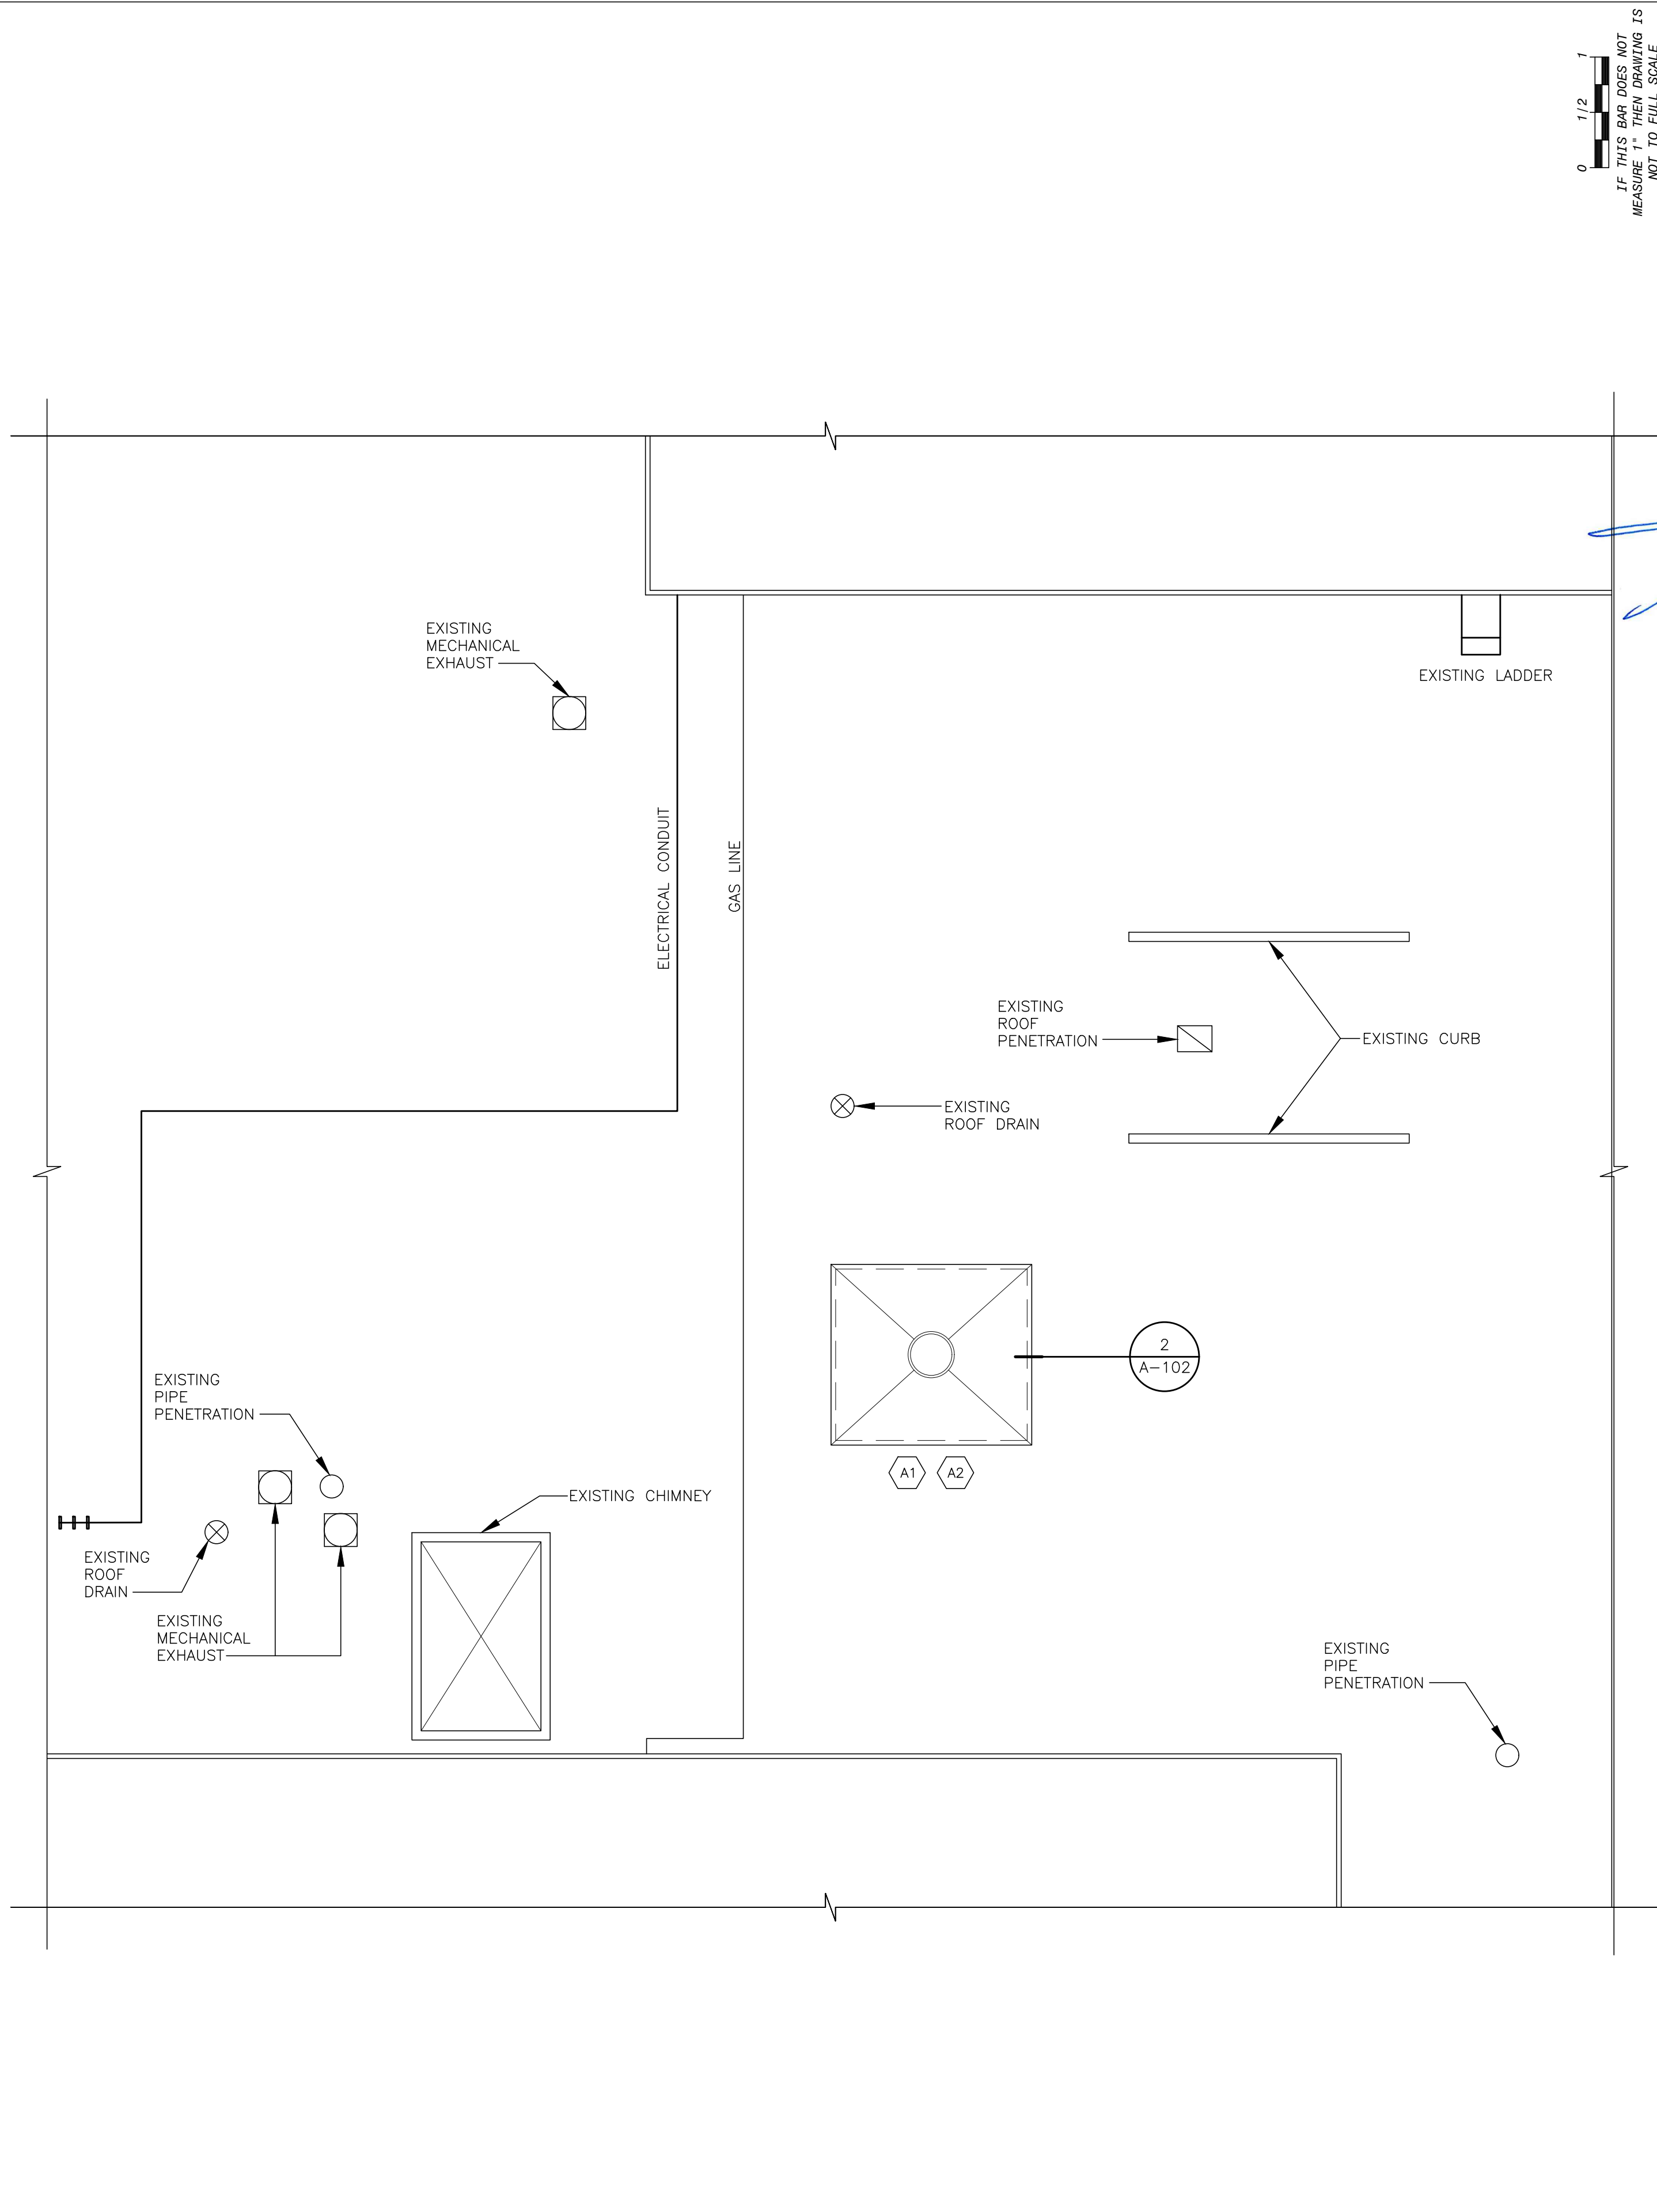

1 NRSHE BOILER ROOM ROOF PLAN
SCALE: 1/4"=1'-0"



Revisions	
No.	Date
1	05-31-24

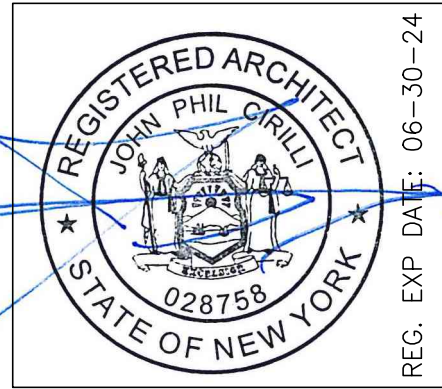

Drawn by	DE
Checked by	MS/JC
Project No.	44023
Scale	AS NOTED
Date	05-08-24

Mechanical & Electrical Engineer:	Structural Engineer:
-----------------------------------	----------------------

NORTH ROCKLAND HIGH SCHOOL EXTENSION BOILER REPLACEMENT

SED# 50-02-01-06-0-007-016

65 CHAPLE STREET, GARNETTville, NY 10923

COUNTY OF ROCKLAND

MSA

MICHAEL SHILALE ARCHITECTS, L.L.P.

140 Park Avenue New York, NY 10056 Tel 945-705-9200
info@msa.com

BOILER ROOM ROOF PLAN

A-102

1. SPECIAL PRECAUTIONS SHALL BE TAKEN BY THE CONTRACTOR SO THAT EQUIPMENT ON THE APPLICATION AND ITS INSTALLATION WILL NOT AFFECT THE FOLLOWING:
 - EGRESS TO AND FROM THE BUILDING FIRE SAFETY OR CREATE A FIRE HAZARD
 - STRUCTURAL SAFETY OF THE BUILDING.
 - ACCUMULATION OF DUST AND DEBRIS. THE CONTRACTOR SHALL LEAVE THE SITE BROOM CLEAN EACH DAY.
2. ASBESTOS MUST FIRST BE INVESTIGATED AND VERIFIED IN FIELD BEFORE ANY DEMOLITION OR CONSTRUCTION WORK TO BE PERFORMED. ASBESTOS FREE MUST BE CERTIFIED FOR ALL HVAC EQUIPMENT, DUCTWORK, AND ALL PIPING INSULATION.
3. CONSTRUCTION WORK SHALL BE CONFINED TO WORK AREAS NOTED ON THE DRAWINGS AND SHALL INVOLVE TEMPORARY INTERRUPTION OF HEATING, WATER AND ELECTRIC SERVICES TO THE BUILDING SYSTEMS ONLY AS SCHEDULED WITH NEW YORK CITY.
4. FIRE SAFETY: ALL BUILDING MATERIALS STORED IN CONSTRUCTION AREA, AND/OR IN ANY AREA OF THE BUILDING ARE TO BE SECURED IN A LOCKED AREA. ACCESS TO SUCH AREAS TO BE CONTROLLED BY THE FACILITY AND/OR GENERAL CONTRACTOR.
5. CONTRACTOR SHALL PROVIDE BARRICADES AROUND WORK AREAS AS REQUIRED TO PREVENT UNAUTHORIZED PERSONS FROM ENTERING THEREIN.
6. THE CONTRACTOR SHALL SUBMIT SAFETY PLAN FOR CONSTRUCTION MANAGER'S APPROVAL.
7. CONFINED SPACES: ALL WORK WITHIN CONFINED SPACES SHALL BE CONDUCTED IN ACCORDANCE WITH OSHA REGULATIONS.

THE WORK OF THIS PROJECT INCLUDES BOILER REPLACEMENT AT NORTH ROCKLAND HIGH SCHOOL EXTENSION. PROVIDE MATERIALS AND SERVICES AS FOLLOWS. THE FOLLOWING IS NOT INTENDED TO BE A COMPLETE DESCRIPTION OF THE WORK; PERFORM THE WORK AS HEREINAFTER DESCRIBED IN THESE CONTRACT DOCUMENTS.

- ## CALCULATIONS

COMBUSTION AIR INTAKE REQUIREMENTS FOR THE BOILERS

1. DESIGN COMPLIES WITH THE MANUFACTURER'S INSTRUCTIONS AS PER NYS
FGC 304.1

A.	CLIMATE (BASED ON NEAREST AVAILABLE DATA: ASHRAE 2012 HANDBOOK CLIMATIC DESIGN INFORMATION, WESTCHESTER CO, NY):
1.	1. 41.07°N, 73.71°W
2.	2. ELEVATION: 397 FT
3.	3. CLIMATE ZONE 5A
B.	OUTSIDE DESIGN CONDITIONS (BASED ON NEAREST AVAILABLE DATA: ASHRAE 2012 HANDBOOK CLIMATIC DESIGN INFORMATION, WESTCHESTER CO, NY):
1.	1. HEATING DB (99.6%): 8.7°F DB
2.	2. COOLING DB/MCWB (1%): 86.4°F DB, 71.9°F WB
C.	INSIDE DESIGN CONDITIONS (PER NYSED MANUAL OF PLANNING STANDARDS §802-6.8, AND 2015 ASHRAE HANDBOOK CH 7 TABLE 6):
1.	1. HEATING INDOOR SETPOINT: 72°F
2.	2. COOLING INDOOR SETPOINT: 78°F, 60% RH

1. SEE SPECIFICATION SECTION 230993 AND DRAWING M401.

- DEMOLITION/RELOCATIONS: CONTRACTOR SHALL BE RESPONSIBLE FOR DEMOLITION AND RELOCATIONS OF SERVICES, EQUIPMENT AND MATERIAL RELATING TO HIS/HER RESPECTIVE TRADE. INCLUDE IN BID THE COST TO PROVIDE DEMOLITION OF ALL ELECTRICAL EQUIPMENT AND SYSTEMS ASSOCIATED WITH THE RENOVATION WORK. ALL DEMOLITION WORK SHALL COORDINATE WITH OWNER.
2. WHERE EXISTING WALLS, FLOORS OR CEILINGS ARE REMOVED OR PENETRATED, AND WHERE EXISTING END WALLS OF THE BUILDING ARE POINTS OF CONNECTION OF ADDITIONS, ALL SERVICES, PIPING, CONDUIT, CONTROL AND/OR SWITCH DEVICES, LIGHTS, OR OTHER HVAC, PLUMBING, FIRE PROTECTION OR ELECTRICAL EQUIPMENT SHALL BE REMOVED (AND/OR RELOCATED WHERE THEY MUST REMAIN IN SERVICE, OR SERVE, AREAS BEYOND THE IMMEDIATE WORK) CONTRACTOR SHALL FIELD VERIFY CONDITIONS AT THE SITE.
3. PRIOR TO DEMOLITION CONTRACTOR SHALL REVIEW WITH OWNER A MATERIALS TO BE REMOVED. SHOULD THE OWNER OPT TO KEEP ANY MATERIALS THE CONTRACTOR SHALL REMOVE AND DELIVER THE PARTS TO THE OWNER ON THE SITE WHERE SO DIRECTED. OTHERWISE ALL DEMOLISHED OR REMOVED MATERIALS SHALL BECOME THE PROPERTY OF THE CONTRACTOR AND SHALL BE REMOVED FROM THE SITE AND BE DISPOSED OF IN A LEGAL MANNER.
4. DEMOLITION SHALL INCLUDE REMOVAL OF ALL PARTS AND PIECES IN THEIR ENTIRETY BACK TO POINTS INDICATED OR IF NOT INDICATED, BACK TO THEIR POINT OF SOURCE. REMOVE CONDUCTORS FROM REMAINING CONDUITS WHERE IT IS INDICATED. WHERE CONDUCTORS REMAINED IN CONDUITS-DISCONNECT, ISOLATE AND CAPPED THEM TO ENSURE SAFETY AND PROTECTION. WHERE CONDITIONS PROHIBIT TOTAL REMOVAL OF THE WORK, THE REMAINING PORTION SHALL BE CUT FLUSH WITH THE SURROUNDING SURFACE AND BE CAPPED, PLUGGED OR SEALED AND THE SURROUNDING SURFACE SHALL BE MAINTAINED IN AN APPROVED MANNER.
5. MAINTAIN EXISTING UTILITIES INDICATED OR REQUIRED TO REMAIN, KEEP IN SERVICE, AND PROTECT AGAINST DAMAGE DURING DEMOLITION OPERATIONS. DO NOT INTERRUPT EXISTING UTILITIES SERVING OCCUPIED OR USED FACILITIES, EXCEPT WHEN SCHEDULED WITH THE OWNER.
6. DO NOT REMOVE EXISTING STRUCTURAL WORK. DO NOT REMOVE OPERATIONAL ELEMENTS AND SAFETY-RELATED COMPONENTS IN A MANNER RESULTING IN A REDUCTION OF CAPACITIES TO PERFORM IN THE MANNER INTENDED OR RESULTING IN DECREASED OPERATIONAL LIFE, INCREASED MAINTENANCE, OR DECREASED SAFETY.
7. REMOVALS, DISCONNECTIONS, AND RELOCATIONS SHALL BE PERFORMED BY WORKMEN SKILLED IN THE TRADE INVOLVED AND SHALL BE EMPLOYED BY A CONTRACTOR LICENSED IN THE TRADE INVOLVED. ALL WORK SHALL BE DONE IN ACCORDANCE WITH ACCEPTED TRADE PRACTICES.
8. PROVIDE ADEQUATE TEMPORARY SUPPORT FOR WORK TO REMAIN, TO PREVENT FAILURE. DO NOT ENDANGER OTHER WORK.
9. PROTECTION: PROVIDE ADEQUATE PROTECTION WHERE REQUIRED FOR THE PRESENT BUILDING AND ITS CONTENTS. TEMPORARY DUSTPROOF BARRIERS AND BARRICADES SHALL BE ERECTED WHERE REQUIRED FOR PROTECTION OF PERSONNEL, PROTECTION FROM DUST AND DIRT, FOR SECURITY, FIRE AND WEATHER PROTECTIVE REASONS. CONTRACTOR SHALL TAKE EVERY PRECAUTION AGAINST FIRE BY EMPLOYING FIRE DEPARTMENT TYPE HOSES AND PORTABLE FIRE EXTINGUISHERS AS REQUIRED BY OSHA AND/OR THE OWNER'S INSURANCE UNDERWRITER.
10. USE TEMPORARY ENCLOSURES OR OTHER SUITABLE METHODS TO LIMIT DUST AND DIRT RISING AND SCATTERING TO LOWEST PRACTICAL LEVEL. COMPLY WITH GOVERNING REGULATIONS PERTAINING TO ENVIRONMENTAL PROTECTION.
11. ALL EXISTING EQUIPMENT REQUIRED TO BE REUSED SHALL BE CLEANED, RECONDITIONED, CALIBRATED AND ADJUSTED. IN ALL INSTANCES WHERE CONTRACTOR FINDS THAT EXISTING EQUIPMENT IS DEFECTIVE TO THE POINT WHERE IT CANNOT BE PROPERLY RESTORED AND WILL NOT OPERATE PROPERLY, HE SHALL REPORT THE SPECIFIC INSTRUMENTS OR EQUIPMENT TO THE OWNER/ENGINEER FOR DIRECTIONS.
12. TEMPORARY SHUTDOWNS OF SERVICE OF EXISTING ELECTRICAL, HEATING, AIR CONDITIONING, AND VENTILATION SYSTEMS SHALL BE PERFORMED WITH A MINIMUM OF DISRUPTION OF SERVICE, HELD TO AN ABSOLUTE MINIMUM DURATION OF TIME, AND ONLY AFTER HAVING NOTIFIED THE BUILDING OPERATIONS MANAGEMENT AT LEAST TWO WEEKS IN ADVANCE AND HAVING RECEIVED THEIR PERMISSION IN WRITING, AT LEAST TWO WEEKS PRIOR TO THE SCHEDULED SHUTDOWN. COMMUNICATIONS SHALL BE RELAYED THROUGH THE CONSTRUCTION MANAGER.
13. ELECTRICAL CONTRACTOR SHALL RING OUT AND IDENTIFY ALL CIRCUITS REMAINING IN CONTRACT AREA, AFTER DEMOLITION. REMOVE ALL CIRCUITS BACK TO POINT OF SOURCE. MARK PANEL CIRCUITS NO LONGER IN USE "SPARE".

THE WORK SHALL COMPLY WITH THE 2020 BUILDING CODE OF NYS. IN ADDITIONS, THE WORK SHALL COMPLY WITH ALL OTHER RELEVANT CODES, RULES AND ORDINANCES OF THIS STATE OF NEW YORK, ALL LOCAL, STATE AND FEDERAL AGENCIES HAVING JURISDICTION.

CONTRACTOR SHALL PAY ALL FEES AND TAXES, OBTAIN ALL PERMITS AND APPROVALS, FILE THE REQUIRED DOCUMENTS AND CAUSE ALL INSPECTIONS.

CONTRACTOR SHALL PROVIDE ALL WORK, EQUIPMENT, LABOR AND MATERIAL REQUIRED FOR A COMPLETE AND TROUBLE FREE INSTALLATION

ALL DUCTWORK ELBOWS WILL BE EITHER LONG RADIUS OR SQUARE WITH TURNING VANES.

CONTRACTOR SHALL SUBMIT SHOP DRAWINGS FOR ALL EQUIPMENT, PIPING, CONTROLS, DUCTWORK, REGISTERS, SUPPORTS, DAMPERS, AND ACCESSORIES PRIOR TO FABRICATION AND INSTALLATION. SUBMIT ALL REPORTS FOR REVIEW SUCH AS TESTING, ADJUSTING, AND BALANCING, AND COMMISSIONING.

CONTRACTOR SHALL VERIFY ALL EXISTING FIELD CONDITIONS AND NOTIFY OWNER OF ANY DISCREPANCIES BEFORE COMMENCING WORK.

PROVIDE AN AIR BALANCE REPORT FOR THE EQUIPMENT SHOWN ON THE DRAWINGS.

ALL EQUIPMENT AND MATERIALS SHALL BE INSTALLED IN A NEAT AND WORKMANLIKE MANNER TO THE SATISFACTION OF THE OWNER.

EXCEPT AS NOTED, ALL MATERIAL AND EQUIPMENT SHALL BE NEW AND IN GOOD CONDITION, WHERE APPLICABLE BY CODE AND/OR THESE SPECIFICATIONS, EQUIPMENT AND MATERIALS SHALL BE LABELED BY THE REQUISITE GOVERNING AGENCY.

SURVEY THE INSTALLATION SITE PRIOR TO BID. DETERMINE THE CONSTRAINTS OF THE EXISTING AVAILABLE SPACE PERTAINING TO EQUIPMENT SIZE AND CONFIGURATION AND EXAMINE THE CONDITIONS FOR WHICH THE EQUIPMENT WILL BE INSTALLED. VERIFY ALL MEASUREMENTS AT THE SITE. THE CONTRACTOR SHALL BE RESPONSIBLE FOR DIMENSIONAL COMPATIBILITY OF THE DUCTWORK AND EQUIPMENT WITH THE SPACE.

SHIP AND DELIVER EQUIPMENT KNOCKED DOWN AS NECESSARY TO FIT THROUGH EXISTING BUILDING OPENINGS. VERIFY IN FIELD THE CONSTRAINTS OF THE EXISTING BUILDING PRIOR TO FABRICATION OF EQUIPMENTS. INCLUDE IN THE BID ALL COSTS ASSOCIATED WITH RIGGING AND DELIVERY OF EQUIPMENT AS REQUIRED BY THE EXISTING BUILDING CONDITIONS.

SCHEDULE AND NOTIFY THE OWNER AND BUILDING MANAGEMENT IN ADVANCE PRIOR TO SHUTDOWN OF ANY SERVICES.

UPON COMPLETION OF THE PROJECT, PROVIDE AS-BUILT DRAWINGS TO THE OWNER. FOR QUANTITY OF COPIES, REFER TO GENERAL SPECIFICATIONS OR AS DIRECTED BY ARCHITECT.

IT IS THE INTENT OF THESE CONTRACT DOCUMENTS TO CALL FOR AN INSTALLATION THAT IS COMPLETE IN EVERY RESPECT. IF AN ITEM OF WORK IS SHOWN ON THE DRAWINGS, IT SHALL BE CONSIDERED SUFFICIENT FOR INCLUSION IN THE CONTRACT. THE CONTRACTOR SHALL FURNISH AND INSTALL ALL MATERIAL AND EQUIPMENT USUALLY FURNISHED OR NEEDED TO MAKE A COMPLETE INSTALLATION, WHETHER SPECIFICALLY MENTIONED OR NOT.

RENDER FULL COOPERATION TO OTHER TRADES AND COORDINATE THE WORK WITH OTHER TRADES. THIS CONTRACTOR SHALL ASSIST IN WORKING OUT SPACE CONDITIONS.

PERFORM ALL CUTTING AND PATCHING NECESSARY FOR THE PROPER INSTALLATION OF THIS WORK. REPAIR ANY DAMAGE DONE BY THIS WORK AND REPAIR ANY DAMAGE CAUSED.

ON ACCEPTANCE OF CONTRACT, CONTRACTOR AGREES TO GUARANTEE THE WORK AND EQUIPMENT FOR A PERIOD OF NOT LESS THAN ONE (1) YEAR FROM DATE OF INITIAL OPERATION. MANUFACTURED EQUIPMENT SHALL CARRY FULL PERIOD OF MANUFACTURER'S GUARANTEE, AND SHALL NOT BE LESS THAN ONE (1) YEAR. COMPRESSORS SHALL CARRY AN EXTENDED WARRANTY OF FIVE YEARS.

1. ALL WORK SHALL BE PERFORMED IN STRICT ACCORDANCE WITH THE REQUIREMENTS OF THE 2020 NYS BUILDING CODE, 2020 NYS MECHANICAL CODE, AND 2020 NYS ENERGY CONSERVATION CODE, AND ALL GOVERNING LOCAL CODES, LAWS, AND REGULATIONS.
2. PROVIDE A COMPLETE OPERABLE SYSTEM IN A WORKMANLIKE MANNER. OUTLINE DESCRIPTION AND EQUIPMENT; DO NOT LIMIT CONTRACTOR'S LIABILITY FOR THE INSTALLATION OF A COMPLETE OPERABLE SYSTEM
3. THE CONTRACTOR SHALL FIELD VERIFY AND BE RESPONSIBLE FOR ALL DIMENSIONS AND CONDITIONS ON THE JOB AND NOTIFY THE OWNER OF ANY VARIATIONS FROM THE DIMENSIONS AND CONDITIONS SHOWN IN THESE DOCUMENTS. ALL DIMENSIONS AND EQUIPMENT ARE SHOWN DIAGRAMMATICALLY, COORDINATE WITH ACTUAL FIELD CONDITION.
4. BEFORE COMMENCING WORK, THE CONTRACTOR SHALL FILE ALL REQUIRED CERTIFICATES OF INSURANCE WITH THE BUILDING DEPARTMENT. OBTAIN ALL REQUIRED PERMITS AND PAY ALL FEES REQUIRED.
5. COORDINATION OF ALL WORK UNDER THIS CONTRACT SHALL BE MAINTAINED TO ENSURE THE QUALITY AND TIMELY COMPLETION OF THE WORK/PROJECT.
6. THE CONTRACTOR SHALL PERFORM ALL CUTTING AND PATCHING REQUIRED TO COMPLETE THE WORK OR TO MAKE ITS PARTS FIT TOGETHER PROPERLY WITHOUT COMPROMISING THE QUALITY OF THE WORK. RESTORE WALLS AND CEILINGS TO MATCH EXISTING.
7. THE CONTRACTOR SHALL BE RESPONSIBLE FOR ADEQUATELY BRACING AND PROTECTING ALL WORK DURING CONSTRUCTION AGAINST DAMAGE, BREAKAGE, COLLAPSE, DISTORTIONS, AND OFF ALIGNMENTS ACCORDING TO CODES AND STANDARDS OF GOOD PRACTICE.
8. THE TERM "FINISH FLOOR" SHALL MEAN THE NORMAL FINISHED SURFACE OF THE FLOOR LEVEL. ALL ELEVATIONS GIVEN FOR EXISTING BUILDINGS ARE TO FINISHED FLOOR. THE CONTRACTOR SHALL FIELD VERIFY ALL ELEVATIONS FOR EXISTING STRUCTURES PRIOR TO THE COMMENCEMENT OF WORK.
9. THE CONTRACTOR SHALL PATCH AND REPAIR ALL FLOORS, WALLS CEILINGS, ETC. DAMAGED OR EXPOSED DUE TO WORK OR REMOVALS AND FINISH TO MATCH ADJOINING SURFACES.
10. ALL NEWLY INSTALLED, PATCHED WORK AND ALL AFFECTED AREAS SHALL BE PAINTED, ALL PAINTING WORK SHALL BE PERFORMED TO COVER THE ENTIRE HORIZONTAL OR VERTICAL SURFACE TO THE CLOSEST CORNER IN ALL FOUR DIRECTIONS. COLOR TO MATCH EXISTING CONDITIONS.
11. WORK NOT SHOWN OR SPECIFIED, BUT NECESSARY FOR PROPER AND ACCEPTABLE CONSTRUCTION, INSTALLATION OR OPERATION OF ANY PART OF THE WORK AS DETERMINED BY THE OWNER, SHALL BE INCLUDED IN THE WORK THE SAME AS IF HEREIN SPECIFIED OR INDICATED.
12. DURING CONSTRUCTION, TEMPORARY BAFFLES TO SEAL OPENINGS TO PREVENT DUST AND DIRT FROM FILTERING INTO OCCUPIED AREAS ARE TO BE PROVIDED BY CONTRACTOR.
13. ALL WORK SHALL BE INSTALLED SO THAT ALL PARTS REQUIRED ARE READILY ACCESSIBLE FOR INSPECTION, OPERATION, MAINTENANCE AND REPAIR.
14. CONTRACTOR SHALL MAINTAIN FREE AND UNOBSTRUCTED ACCESS FROM ALL FLOORS AND ADJACENT SPACES INTO THE EXISTING FIRE STAIRS TO OUTSIDE OF THE BUILDING AT ALL TIMES.
15. CONTRACTOR SHALL MAINTAIN FREE FROM DEBRIS AND ACCUMULATED REFUSE, AND SHALL HAVE SOLE RESPONSIBILITY FOR PROTECTING ALL DANGEROUS AREAS FROM ENTRY BY UNAUTHORIZED PARTIES. SITE WILL BE LEFT BROOM CLEAN AT THE END OF EACH WORKING DAY.
16. PROVIDE BARRICADES AROUND WORK AREAS AS REQUIRED TO PREVENT BUILDING OCCUPANTS AND OTHER UNAUTHORIZED PERSONS FROM ENTERING THEREIN.
17. CONTRACTOR IS TO NOTIFY IMMEDIATELY THE OWNER OF ANY HAZARDOUS MATERIALS ENCOUNTERED IN ENCLOSED SPACES. ANY SUCH MATERIALS SHALL BE PROMPTLY TESTED AND REMOVED BY A QUALIFIED CONSULTANT AS PER D.O.B. STANDARDS & THE LAW.
18. CONTRACTOR SHALL RELOCATE AND PATCH ANY EXISTING ITEMS INTERFERING WITH THE INSTALLATION OF NEW WORK WHETHER SHOWN OR NOT ON THE DRAWINGS AT NO COST TO OWNER.
19. THERE WILL BE NO CHANGE IN USE, EGRESS OR OCCUPANCY BECAUSE OF THE WORK OF THIS CONTRACT.
20. THE MECHANICAL CONTRACTOR SHALL PROVIDE POWER SUPPLIES, ELECTRICAL WIRING AND CONDUIT FOR POWER AND CONTROL TO PNEUMATIC DAMPER AND VALVE OPERATORS, THERMOSTATS, AUTOMATIC CONTROL INSTRUMENTATION. COORDINATE WITH THE ELECTRICAL CONTRACTOR TO PROVIDE A COMPLETE AND FUNCTIONAL SYSTEM.
21. FOR POWERED EQUIPMENT INTENDED FOR DEMOLITION, COORDINATE WITH THE ELECTRICAL TRADE TO ENSURE THAT POWER SUPPLIES AND DISCONNECT SWITCHES ASSOCIATED WITH THE EQUIPMENT ARE SHUT-OFF AND DISCONNECTED.
22. TEMPORARY SHUTDOWNS OF SERVICE OF EXISTING ELECTRICAL, STEAM, HEATING, AIR CONDITIONING AND VENTILATION SYSTEMS SHALL BE PERFORMED WITH A MINIMUM OF DISRUPTION OF SERVICE, HELD TO AN ABSOLUTE MINIMUM DURATION OF TIME, AND ONLY AFTER HAVING NOTIFIED THE BUILDING OPERATIONS MANAGEMENT AT LEAST TWO WEEKS IN ADVANCE AND HAVING RECEIVED THEIR PERMISSION IN WRITING, AT LEAST TWO WEEKS PRIOR TO THE SCHEDULED SHUTDOWN. COMMUNICATIONS SHALL BE RELAYED THROUGH THE CONSTRUCTION MANAGER.
23. PROVIDE EQUIPMENT MAINTENANCE MANUALS AND REQUIRED EQUIPMENT LABELS FOR ALL MECHANICAL, ELECTRICAL AND SERVICE HOT WATER HEATING EQUIPMENT. TO THE OWNER WITHIN 90 DAYS AFTER SYSTEM ACCEPTANCE.
24. WHERE MANUFACTURERS NAMES AND PRODUCT NUMBERS ARE INDICATED ON THE DRAWINGS IT SHALL BE CONSIDERED TO MEAN THE ESTABLISHING OF QUALITY AND PERFORMANCE STANDARDS OF SUCH ITEMS. ALL OTHER PRODUCTS MUST BE SUBMITTED TO THE ENGINEER FOR APPROVAL BEFORE THEY SHALL BE DEEMED EQUAL.
25. ALL WORK ON THESE DRAWINGS SHALL BE CONSIDERED NEW WORK WHETHER STATED OR NOT EXCEPT WHERE SPECIFICALLY NOTED AS "EXISTING TO REMAIN".
26. DETAILS NOT SHOWN OR SPECIFIED, BUT NECESSARY FOR PROPER AND ACCEPTABLE CONSTRUCTION, INSTALLATION OR OPERATION OF ANY PART OF THE WORK AS DETERMINED BY THE ENGINEER, SHALL BE INCLUDED IN THE WORK THE SAME AS IF HEREIN SPECIFIED OR INDICATED.
27. THE WORD "PROVIDE" USED ON DRAWINGS AND SPECIFICATIONS ASSOCIATED WITH THIS PROJECT MEANS "FURNISH AND INSTALL". WHEN ONLY ONE PART OF ACTION IS REQUIRED, EITHER "FURNISH" OR "INSTALL" WILL BE USED ACCORDINGLY (TYP., U.O.W.N.).
28. ALL DISCONNECT SWITCHES, STARTERS, AND VARIABLE FREQUENCY DRIVES SHALL BE FURNISHED BY MECHANICAL CONTRACTOR AND INSTALLED BY ELECTRICAL CONTRACTOR.
29. DESIGN LOADS ASSOCIATED WITH HEATING, VENTILATING, AND AIR CONDITIONING HAVE BEEN DETERMINED IN ACCORDANCE WITH ANSI/ASHRAE/ACCA STANDARD 183.

[illegible]

Drawn by	WM
Checked by	PC
Project No.	44023
Scale	AS SHOWN
Date	05/31/2024

Mechanical & Electrical Engineer:	GREENMAN PEDERSEN, INC 2 EXECUTIVE BOULEVARD, SUITE 202, SUFFERN, NY 10901
Structural Engineer:	

**NORTH ROCKLAND HIGH
SCHOOL EXTENSION BOILER
REPLACEMENT**

HIGH SCHOOL, EXT. SFD# 50-02-01-06-0-018-037

**66 Chapel Street,
Garnerville, NY 10923**

COUNTY OF ROCKLAND


HSA

MICHAEL SHIALLE ARCHITECTS, L.L.P.
140 Park Avenue New City, NY 10959 Tel 845-709-9200
www.hsalle.com

Drawing Title
MECHANICAL
GENERAL NOTES


Drawing No.
M-001

© COPYRIGHT, MICHAEL SHILALE ARCHITECTS, ALL RIGHTS RESERVED.

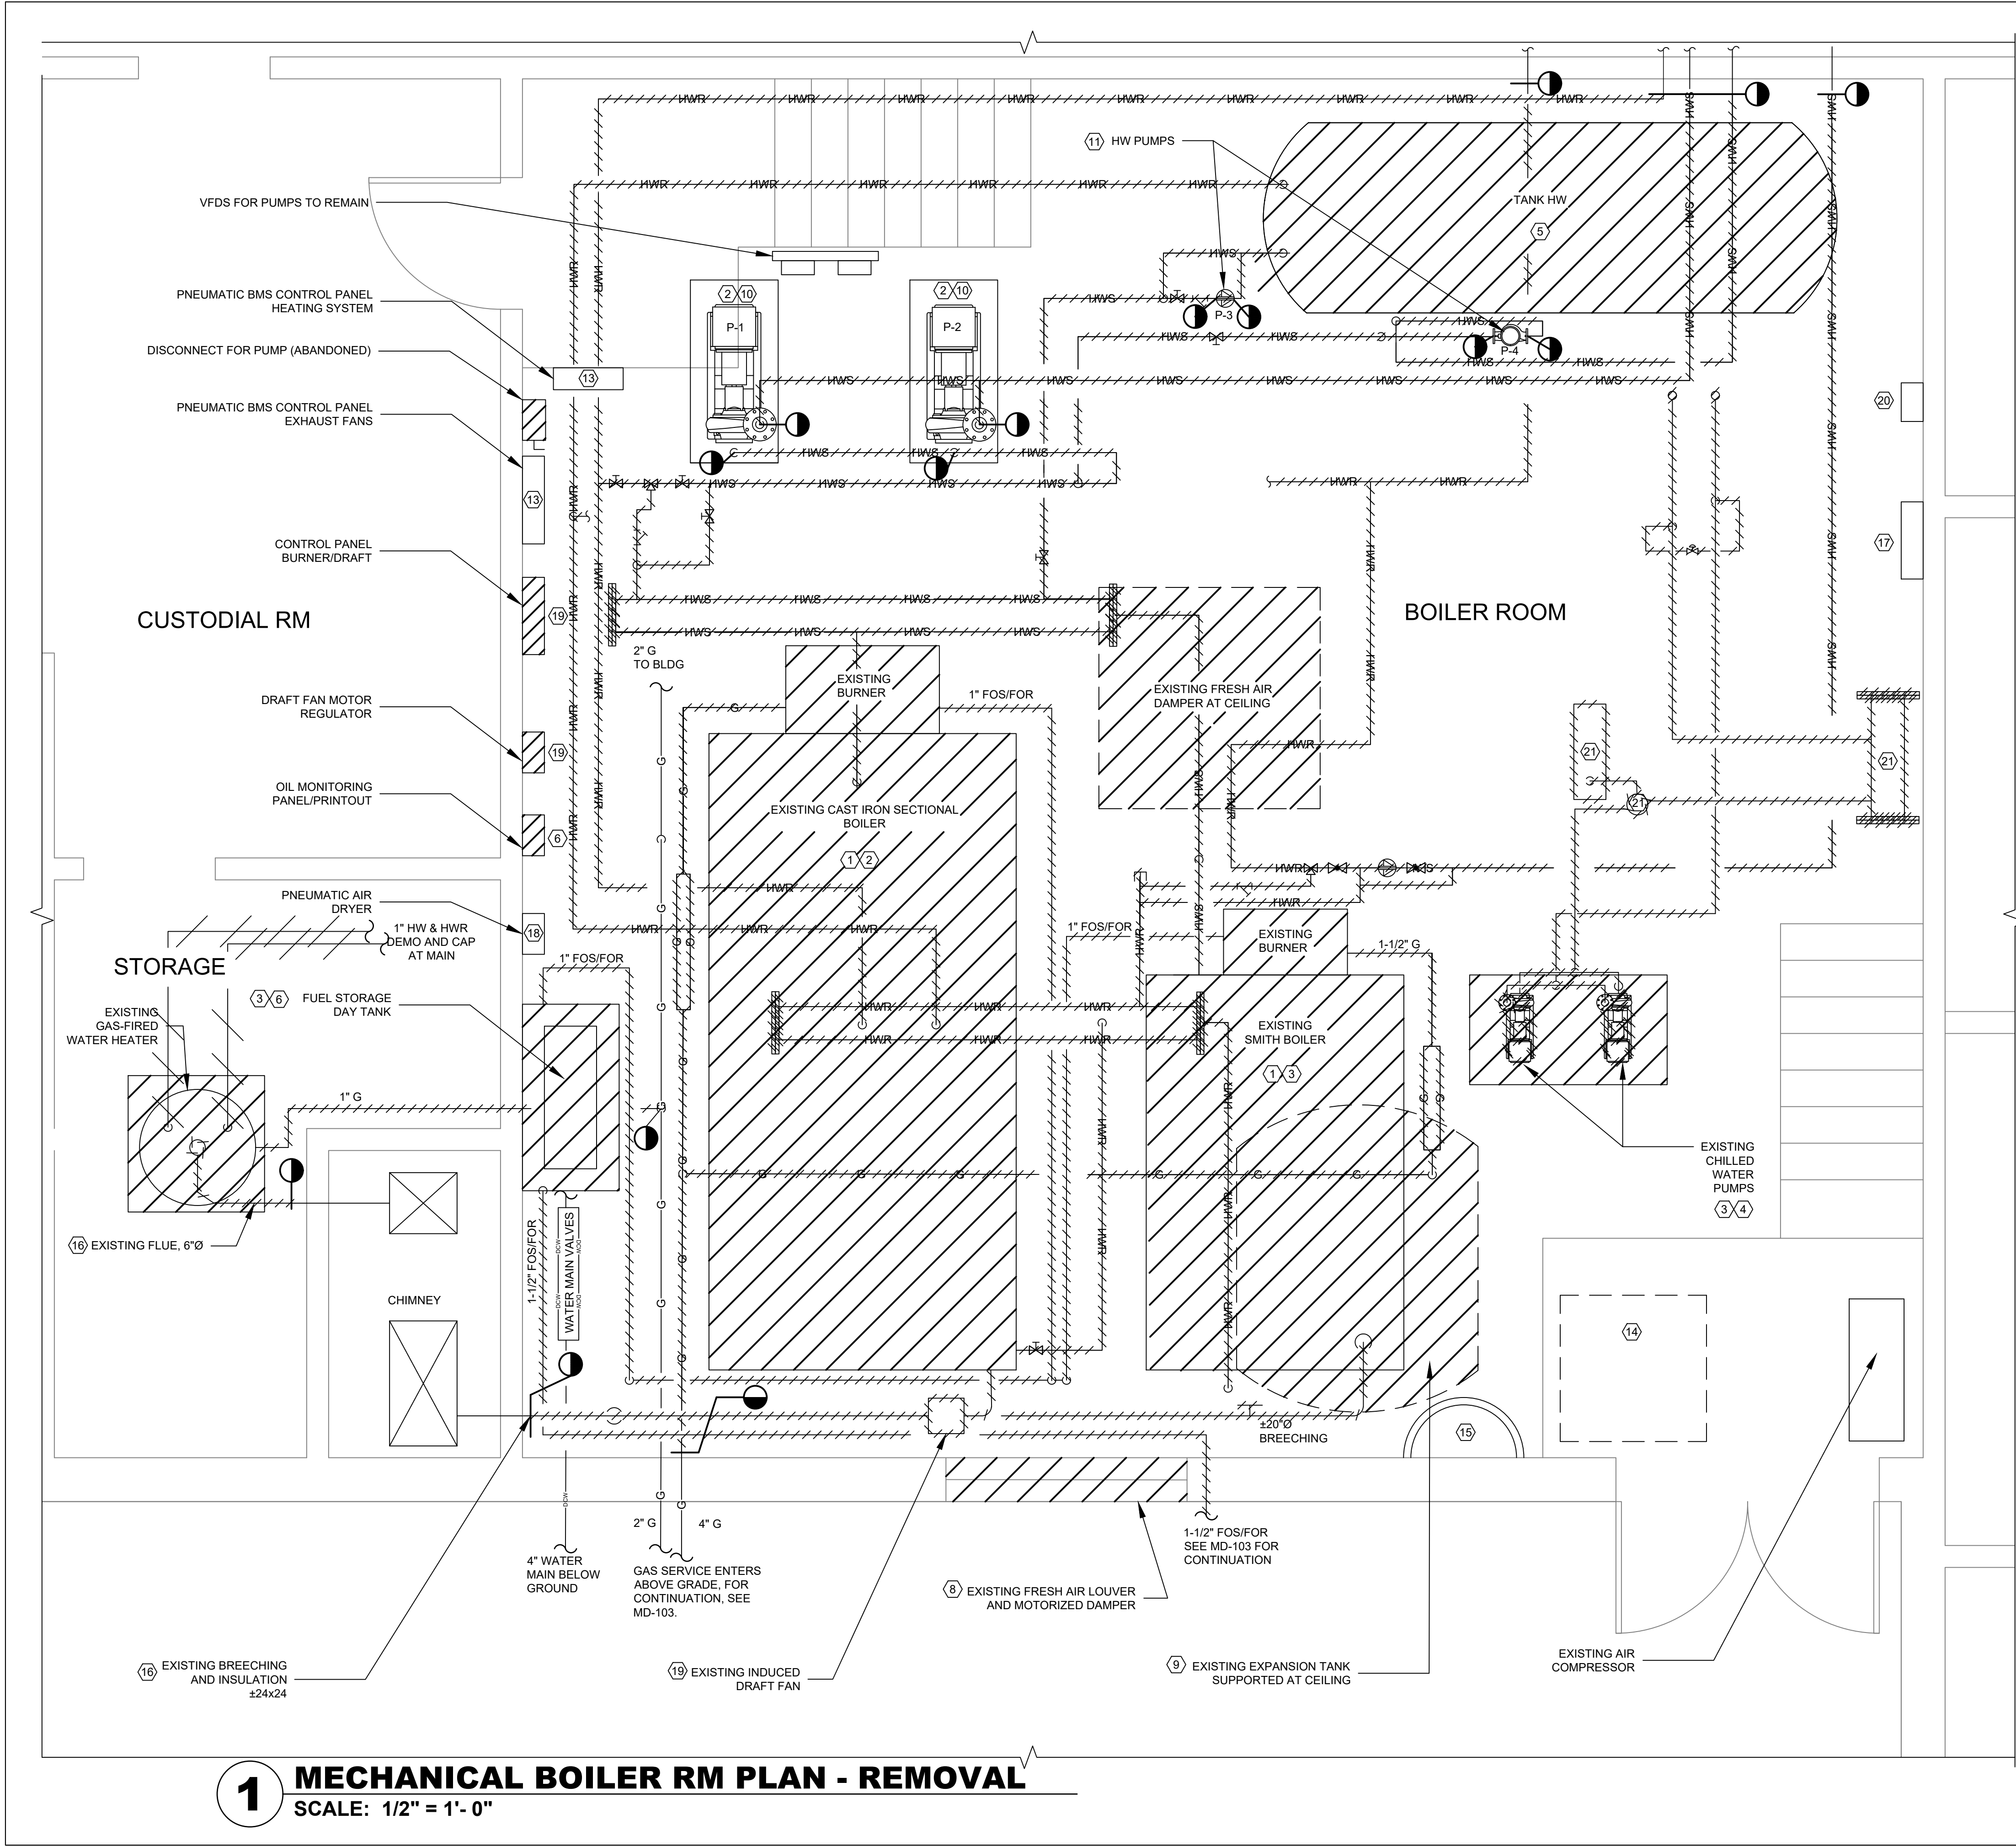

KEYED NOTES

- 1 DISCONNECT, REMOVE AND DISPOSE OF EXISTING HOT WATER BOILER, BURNER AND ASSOCIATED PIPING.
- 2 EXISTING HOUSEKEEPING PAD TO REMAIN.
- 3 REMOVE EXISTING HOUSEKEEPING PAD, REFER TO ARCHITECTURAL PLANS.
- 4 DISCONNECT, REMOVE AND DISPOSE OF ABANDONED CHILLED WATER PUMPS, ASSOCIATED INSULATED PIPING AND SUPPORTS.
- 5 DISCONNECT, REMOVE AND DISPOSE OF DOMESTIC HOT WATER TANK AND ASSOCIATED SUPPORTS.
- 6 DISCONNECT, REMOVE AND DISPOSE OF EXISTING OIL STORAGE DAY TANK, ASSOCIATED PIPING AND FUEL MONITORING SYSTEM.
- 7 DISCONNECT, REMOVE AND DISPOSE OF EXISTING UNDERGROUND FUEL OIL STORAGE TANK, ASSOCIATED WITH PIPING AND FUEL MONITORING SYSTEM.
- 8 DISCONNECT, REMOVE AND DISPOSE OF EXISTING FRESH AIR DAMPER AT CEILING AND WALL. EXISTING LOUVER AT WALL TO REMAIN.
- 9 DISCONNECT, REMOVE AND DISPOSE OF EXISTING CEILING SUSPENSION EXPANSION TANK, ASSOCIATED SUPPORTS AND PIPING.
- 10 EXISTING PAD-MOUNTED HOT WATER PUMPS ARE TO REMAIN.
- 11 DISCONNECT EXISTING HOT WATER CIRCULATING PUMP. EXISTING PUMP TO BE RE-UTILIZED. CONTRACTOR RESPONSIBLE TO PROTECT PUMP FOR REINSTALLATION.
- 12 DISCONNECT, REMOVE AND DISPOSE OF EXISTING HOT WATER STORAGE TANK AND ASSOCIATED SUPPORTS.
- 13 EXISTING PNEUMATIC BMS CONTROL PANEL TO REMAIN.
- 14 EXISTING SUMP PUMP AT FLOOR TO REMAIN.
- 15 EXISTING WALL MOUNTED SINK TO REMAIN.
- 16 DISCONNECT, REMOVE AND DISPOSE OF EXISTING BREECHING AND INSULATION, CAP AND SEAL AT CHIMNEY.
- 17 EXISTING SIEMENS BMS PANEL TO REMAIN.
- 18 EXISTING AIR DRYER FOR PNEUMATIC SYSTEM TO REMAIN.
- 19 DISCONNECT, REMOVE AND DISPOSE EXISTING DRAFT SYSTEM CONTROLS.
- 20 VFD FOR DOMESTIC HOT WATER PUMP TO REMAIN.
- 21 DISCONNECT, REMOVE AND DISPOSE OF EXISTING AIR SEPARATOR, EXPANSION TANK AND HEADER FOR CHILLED WATER SYSTEM. REMOVE ALL ASSOCIATED SUPPORTS.

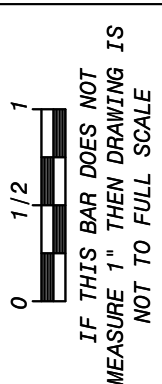

Revisions	
No.	Date
1	05/31/24
BIDDING DOCUMENTS	




Drawn by	WM
Checked by	PC
Project No.	44023
Scale	AS SHOWN
Date	05/31/2024

GREENMAN PEDERSEN, INC. MECHANICAL & ELECTRICAL ENGINEERS 300 WEST 10TH STREET SUITE 200 ROCKLAND, NY 10986	Mechanical & Electrical Engineer: Structural Engineer:
--	---


NORTH ROCKLAND HIGH SCHOOL EXTENSION BOILER REPLACEMENT
HIGH SCHOOL EXT SIDA# 50-02-01-06-0-016-037
65 Chapel Street Greenwich, NY 10603 COUNTY OF ROCKLAND



MECHANICAL BOILER ROOM PLAN - REMOVAL
Drawing No. MD-101

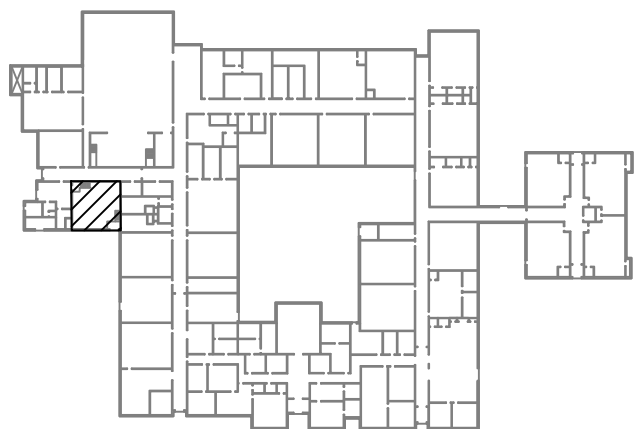

1 **ROOF PLAN REMOVAL**
SCALE: 1/4" = 1'-0"

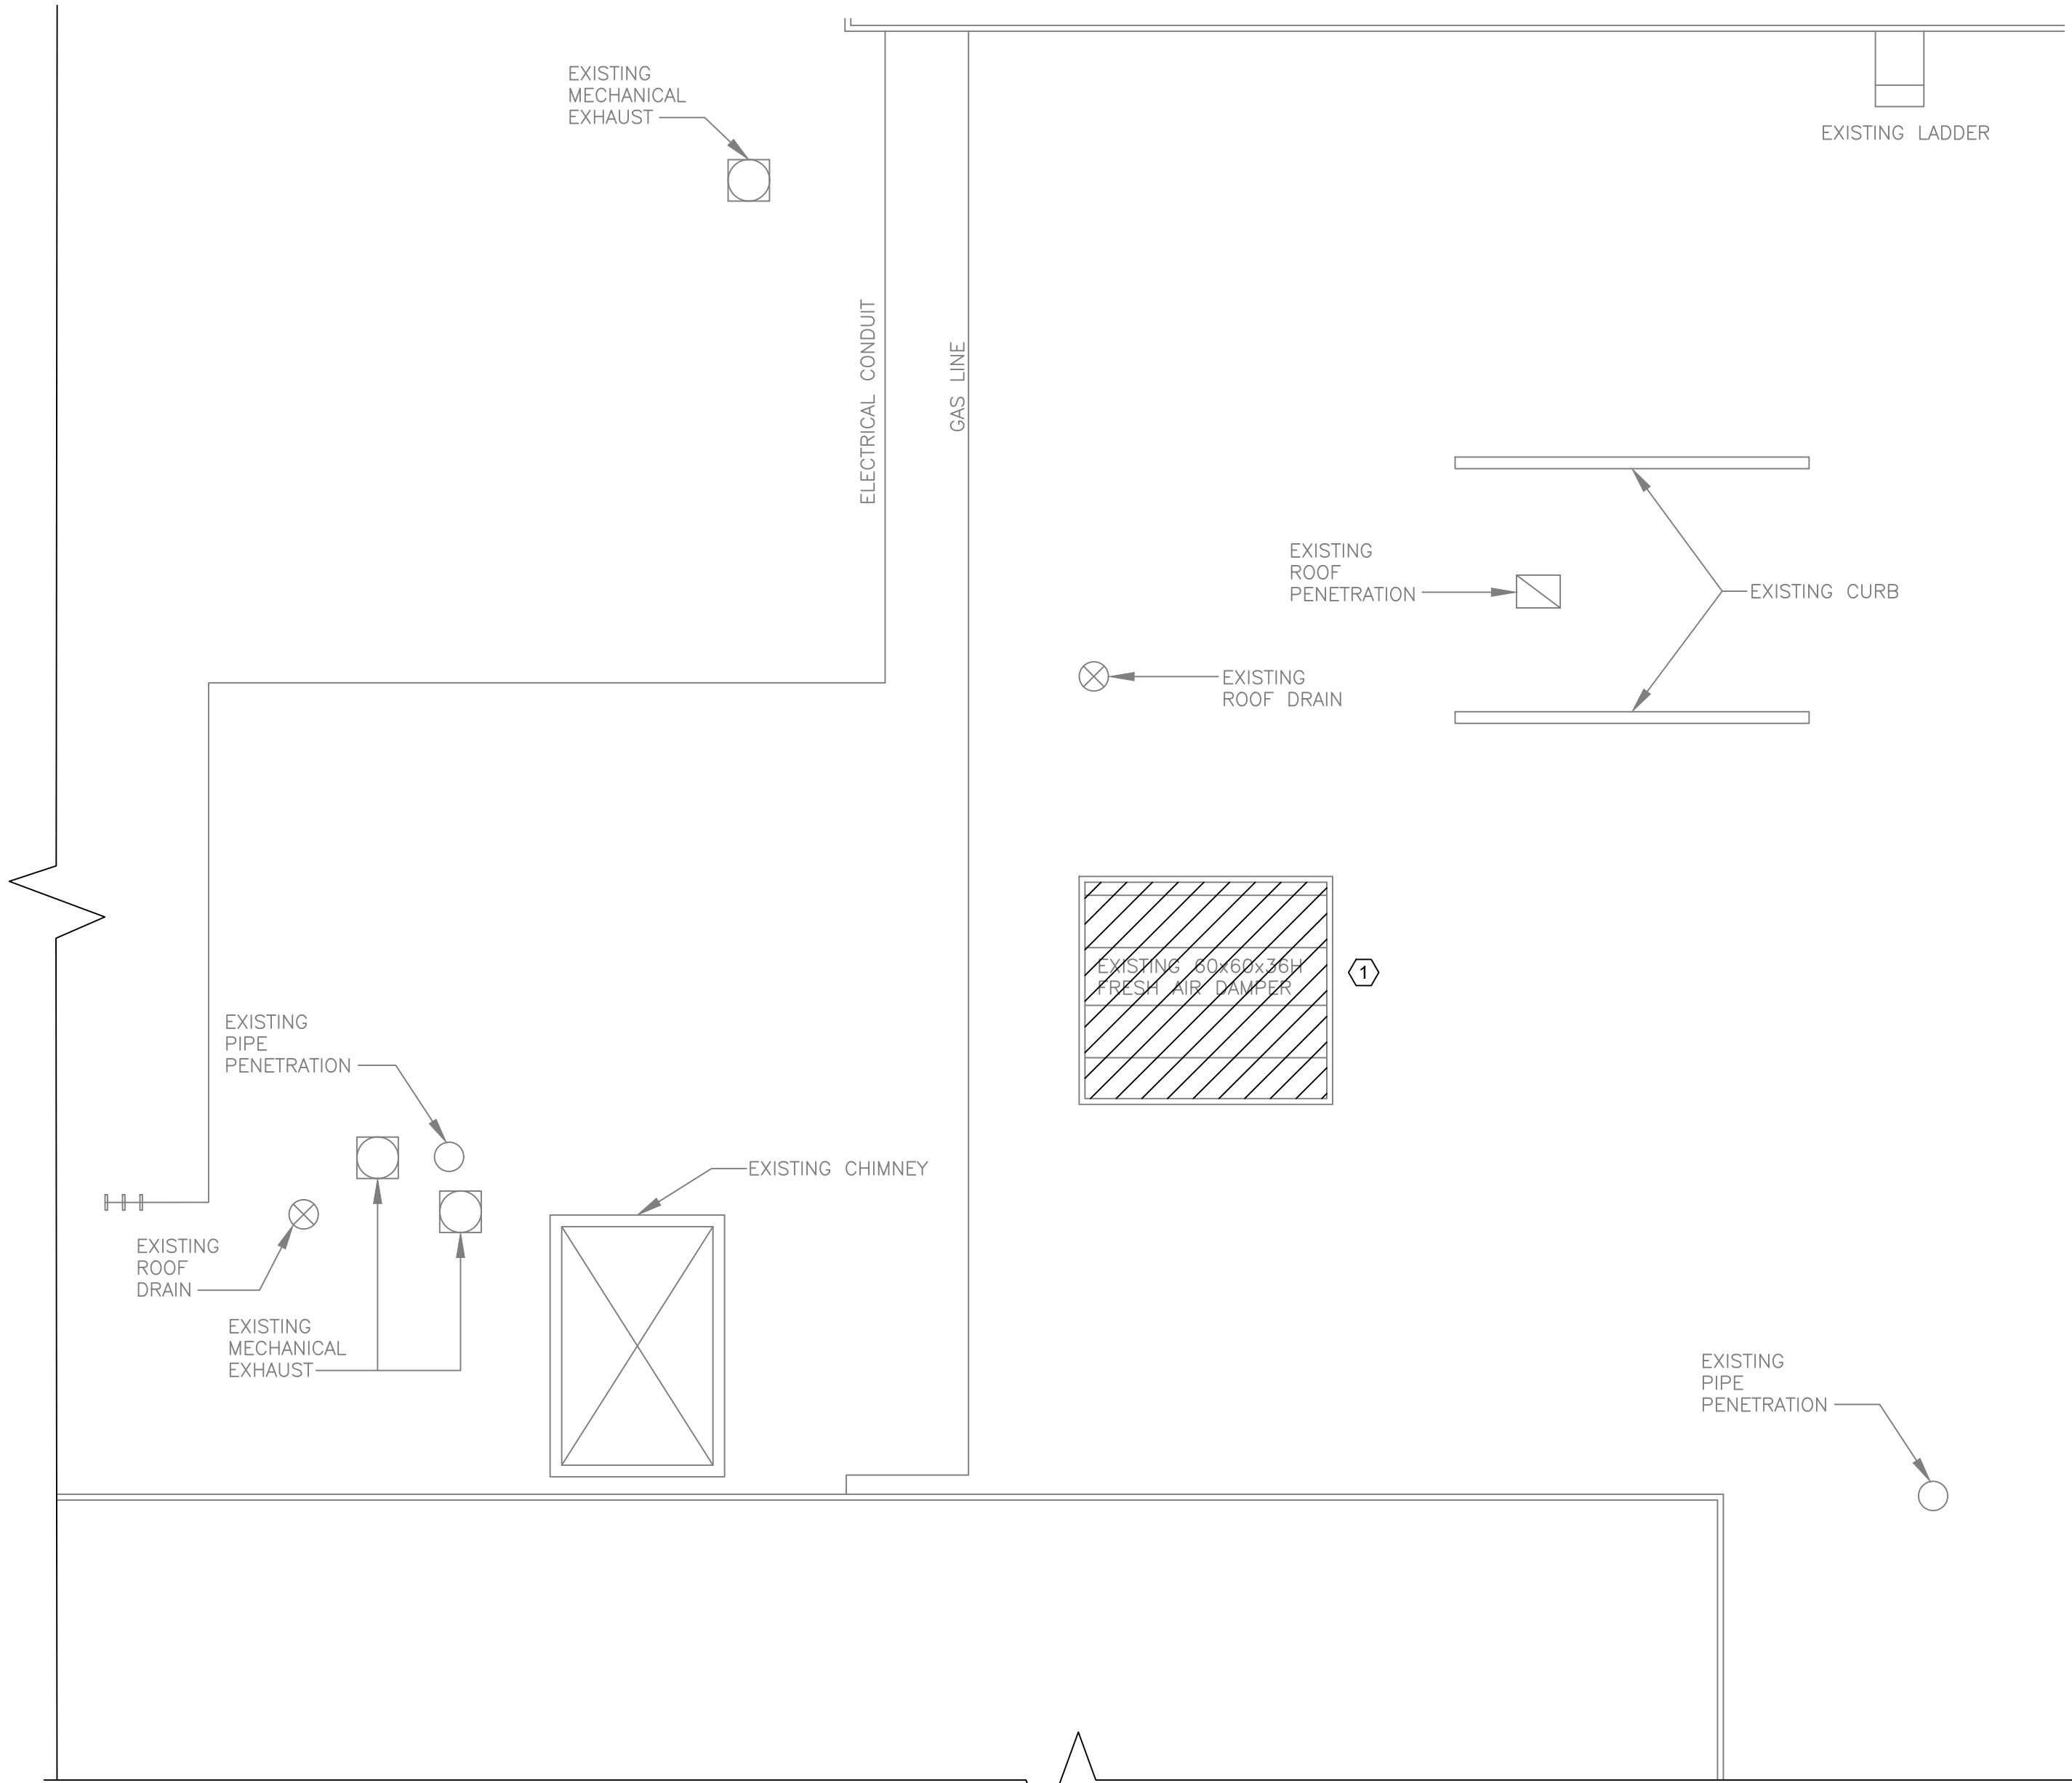

KEYED NOTES

- ① DISCONNECT AND REMOVE AIR HOOD. EXISTING CURB TO REMAIN. COORDINATE REMOVALS WITH ARCHITECT.



0 1/2 1
IF THIS BAR DOES NOT MEASURE 1" THEN DRAWING IS NOT TO FULL SCALE

Drawing Title
**MECHANICAL ROOF
PLAN REMOVAL**

Drawing No.

MD-102



MICHAEL SHILALE ARCHITECTS, LLP
140 Park Avenue New City, NY 10956 Tel 845-708-9200
www.shilale.com

**NORTH ROCKLAND HIGH
SCHOOL EXTENSION BOILER
REPLACEMENT**

HIGH SCHOOL EXT SEDA 50-02-01-06-0-016-037

65 Chapel Street
Glenville, NY 10883

COUNTY OF ROCKLAND

**GREENMAN
PEDERSEN, INC**
3 ROUTE 202, SUITE 202, SUFFERN, NY 10901

Mechanical
& Electrical
Engineer:

Structural
Engineer:

Drawn by WM
Checked by PC
Project No. 44023
Scale AS SHOWN
Date 05/31/2024




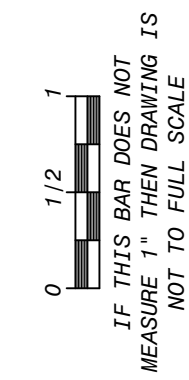
REG. EXP. DATE: 10-31-26

No.	Date	Revisions
1	05/31/24	BIDDING DOCUMENTS




- ① DISCONNECT AND REMOVE UNDERGROUND FUEL OIL TANK AND ASSOCIATED FILL/VENT PIPING, MANHOLES, ETC. CONTRACTOR TO COORDINATE REMOVAL WITH FACILITIES AND ASSOCIATED UTILITY PROVIDER. SEE GENERAL NOTES ON THIS DRAWING FOR MORE INFO.
- ② DISCONNECT AND REMOVE BURIED FUEL OIL SUPPLY AND RETURN PIPING FROM UNDERGROUND FUEL STORAGE TANK TO BOILER ROOM DAY TANK. COORDINATE REMOVAL WITH FACILITIES. SEE GENERAL NOTES ON THIS DRAWING FOR MORE INFO.
- ③ EXISTING UTILITY GAS METER AND PIPING TO REMAIN.

1. PRIOR TO REMOVAL OF FUEL OIL TANK AND FUEL OIL PIPING, CONTRACTOR TO EMPTY TANK FROM ITS CONTENTS AND PROPERLY DISPOSE PER EPA REGULATIONS.
2. CONTRACTOR TO PERFORM TEST OF THE EXCAVATED SOIL FOR ANY CONTAMINATES. UPON COMPLETION OF THE REMOVAL WORK, CONTRACTOR TO BACKFILL EXCAVATED AREA WITH CLEAN FILL.
3. COORDINATE ALL EXCAVATION AND FILL REQUIREMENTS WITH ARCHITECT AND GENERAL CONTRACTOR.



REG. EXP DATE: 10-31-26

[illegible]

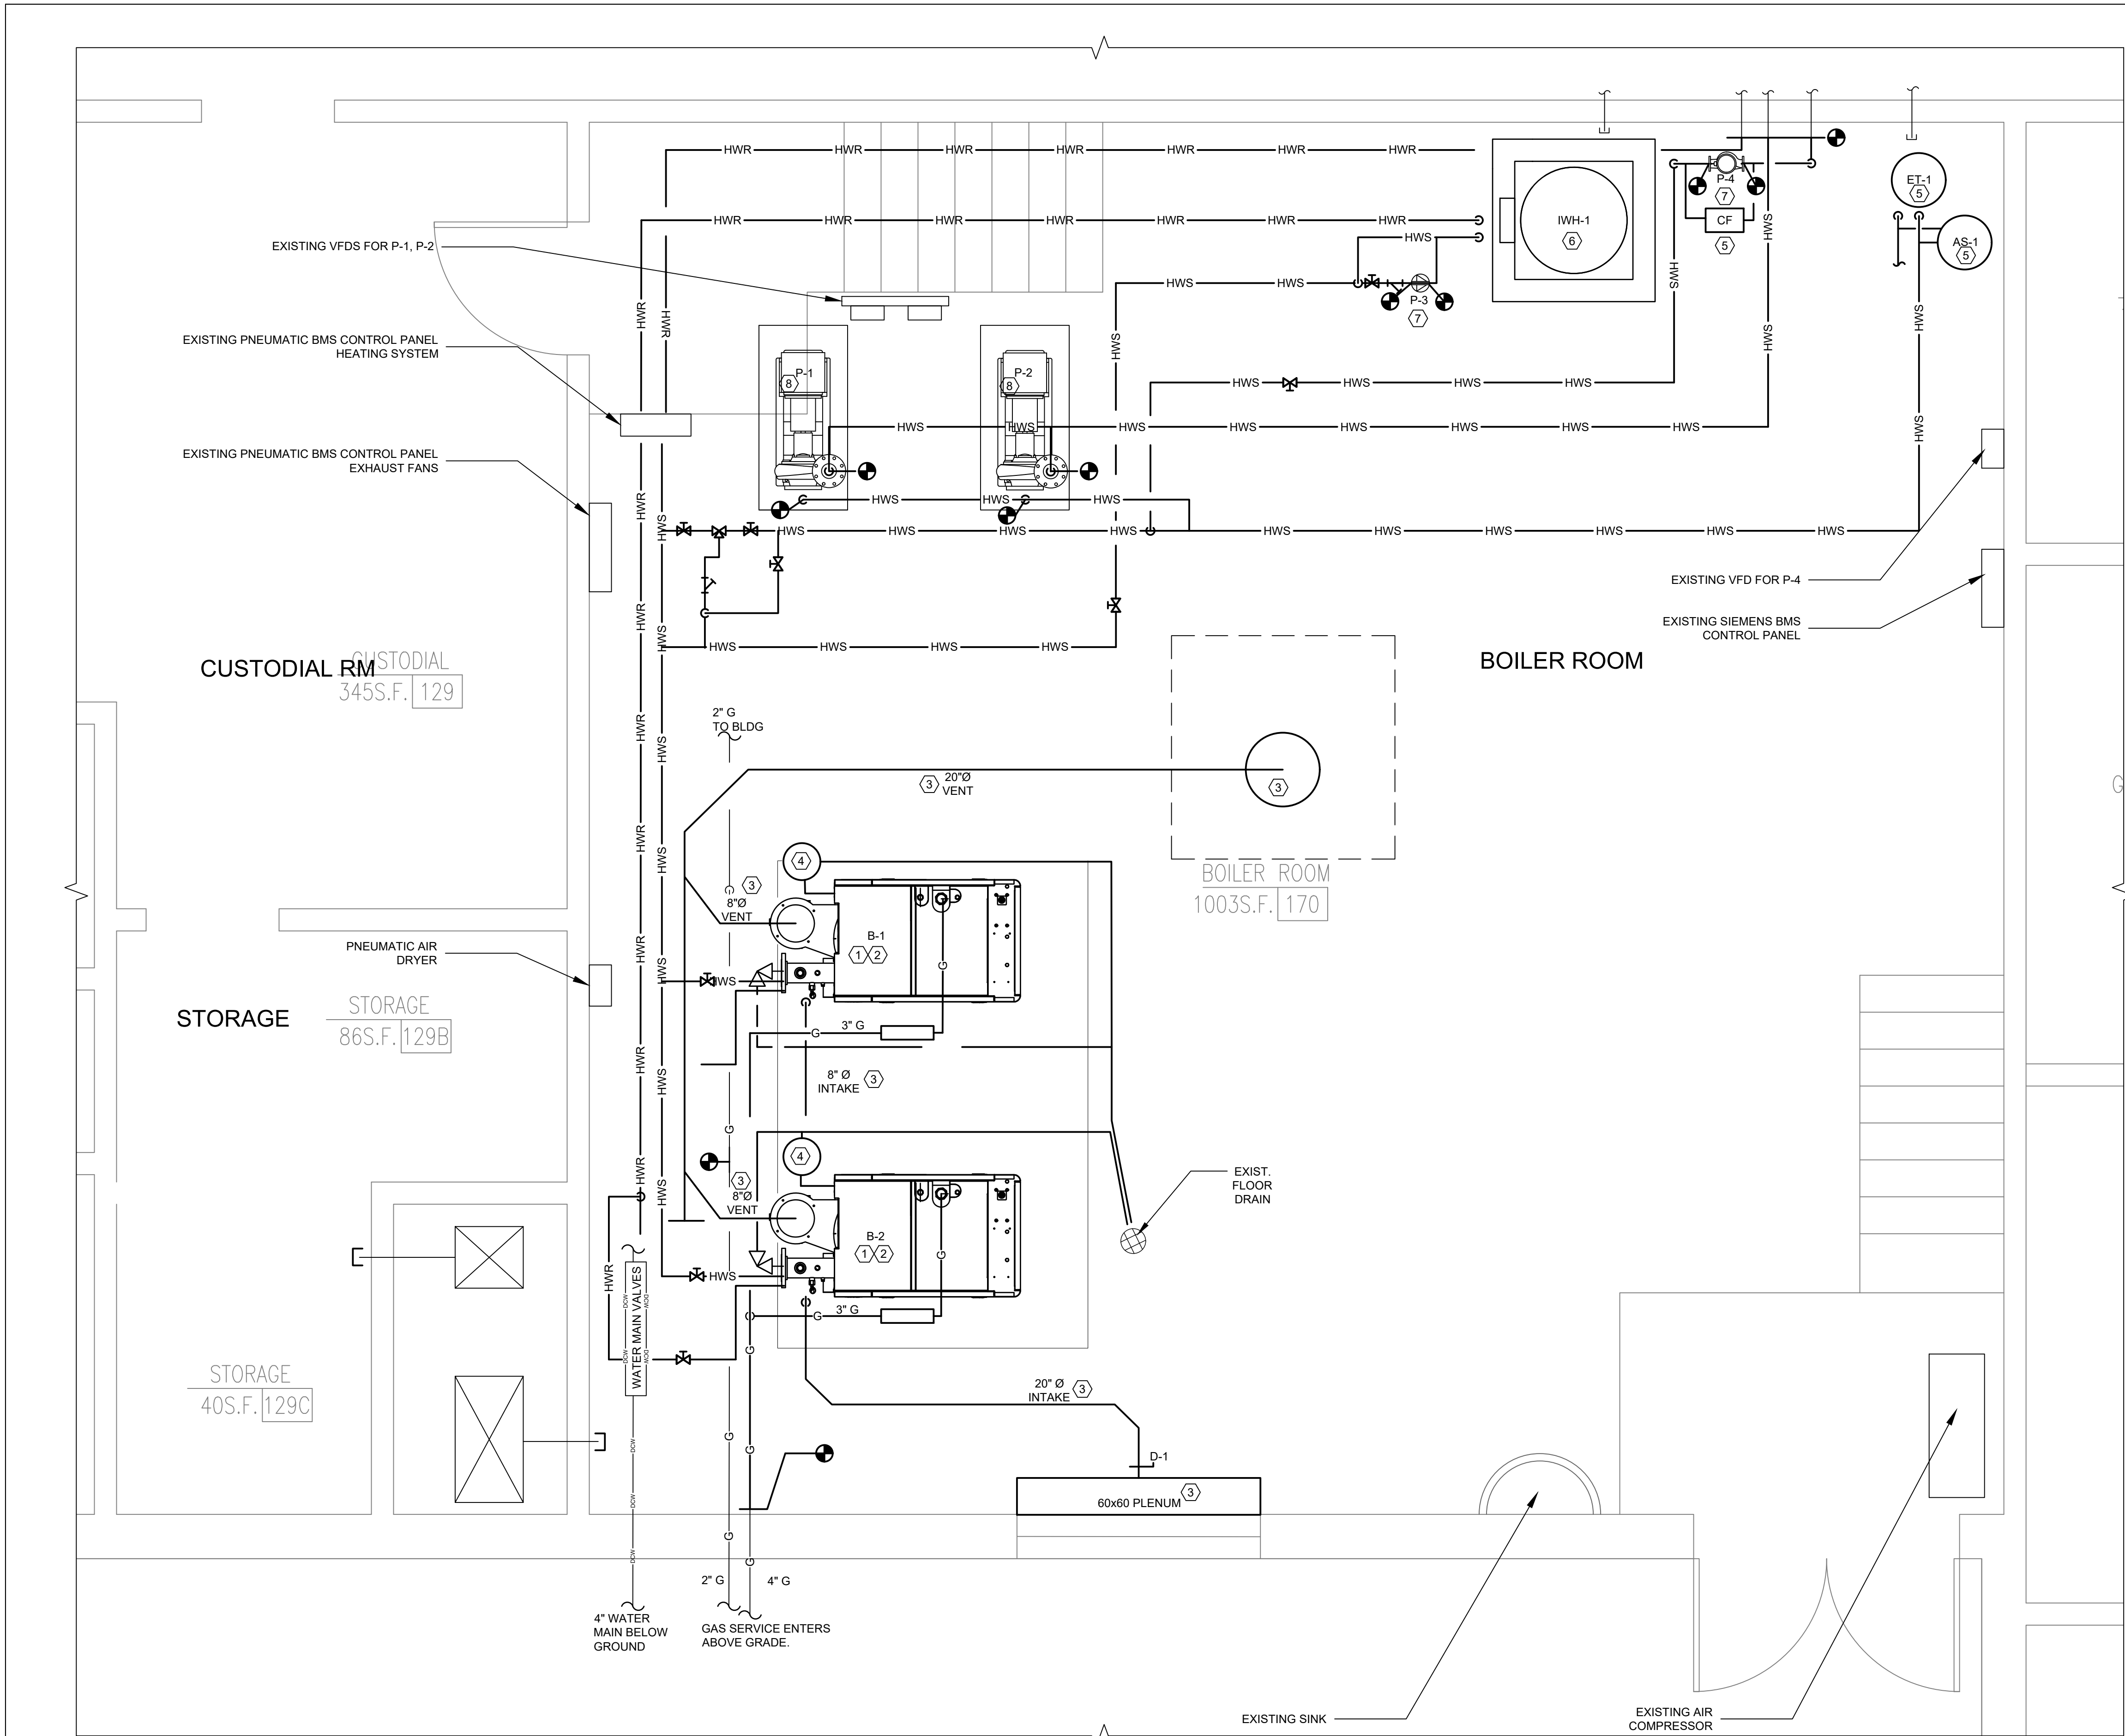


1 MECHANICAL BOILER ROOM PLAN - NEW WORK
SCALE: 1/2" = 1'-0"

KEYED NOTES:

- 1 PROVIDE HOT WATER CONDENSING BOILER. SEE EQUIPMENT SCHEDULE ON DRAWING M002 AND MECHANICAL DETAILS. PROVIDE NEW DGC CONTROLS AND INTERCONNECT TO EXISTING SIEMENS BMS SYSTEM. SEE DRAWING M401 AND SPECIFICATIONS.
- 2 PROVIDE PIPING AND REQUIRED INSULATION AND SUPPORTS FOR BOILER. MAKE ALL REQUIRED CONNECTIONS AS PER MANUFACTURER'S INSTRUCTIONS AND AS PER MECHANICAL DETAILS. FOR PIPE INSULATION, SEE SPECIFICATIONS AND SCHEDULE ON DRAWING M002.
- 3 FURNISH AND INSTALL EXHAUST FLUE AND COMBUSTION AIR INTAKE VENT AND SUPPORTS. SEE DETAILS ON M503 AND FOLLOW MANUFACTURER'S INSTALLATION INSTRUCTIONS.
- 4 FURNISH AND INSTALL CONDENSATE NEUTRALIZER FOR THE CONDENSING BOILERS. SEE DETAIL ON M503.
- 5 FURNISH AND INSTALL ALL ASSOCIATED BOILER APPURTENANCES: AIR SEPARATOR, EXPANSION TANK, CHEMICAL SHOT FEEDER, ETC. SEE EQUIPMENT SCHEDULE ON M002. REFER TO MECHANICAL DETAILS FOR ADDITIONAL INFORMATION.
- 6 FURNISH AND INSTALL INDIRECT HOT WATER HEATER. SEE EQUIPMENT SCHEDULE ON M002. PROVIDE NEW PIPING, INSULATION AND SUPPORTS AND MAKE CONNECTION TO EXISTING MIXING VALVE AT DOMESTIC HOT WATER SYSTEM.
- 7 REINSTALL EXISTING PUMPS, P-3 AND P-4. PROVIDE NEW SUPPORTS. MAKE ALL CONNECTIONS TO EXISTING PIPING.
- 8 BASE BID: EXISTING PUMPS TO REMAIN. ALTERNATE #1: FURNISH AND INSTALL PUMPS, P-1, P-2. SEE WATER PUMP SCHEDULE ON DRAWING M-002 AND MECHANICAL DETAILS.

GENERAL NOTES:

1. SEE PIPING DIAGRAM AND DETAILS FOR ALL VALVING, FITTINGS AND SIZES.

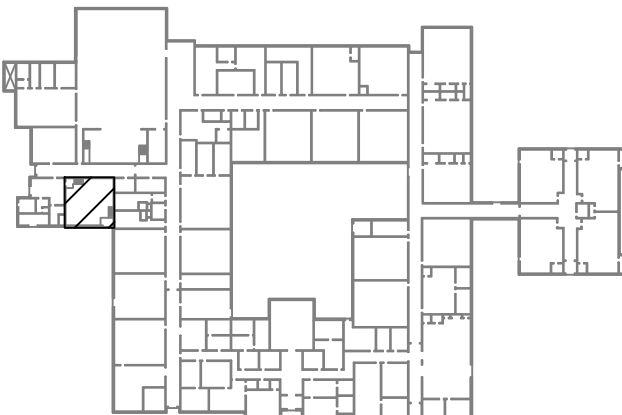

KEY PLAN

Revisions	
No.	Date
1	05/31/24
BIDDING DOCUMENTS	



Drawn by	WM
Checked by	PC
Project No.	44023
Scale	AS SHOWN
Date	05/31/2024


GREENMAN PEDERSEN, INC. 300 WEST 10TH STREET, SUITE 202, SUFFOLK, NY 10081	
Mechanical & Electrical Engineer:	Structural Engineer:

NORTH ROCKLAND HIGH SCHOOL EXTENSION BOILER REPLACEMENT	
HIGH SCHOOL EXT SBD# 50-02-01-06-0-016-037	
65 Chapel Street, Garrisonville, NY 10623	
COUNTY OF ROCKLAND	



Drawing Title MECHANICAL BOILER ROOM PLAN - INSTALL	Drawing No. M-101
---	-----------------------------

1 PARTIAL ROOF PLAN - NEW WORK
SCALE: 1/4" = 1'-0"

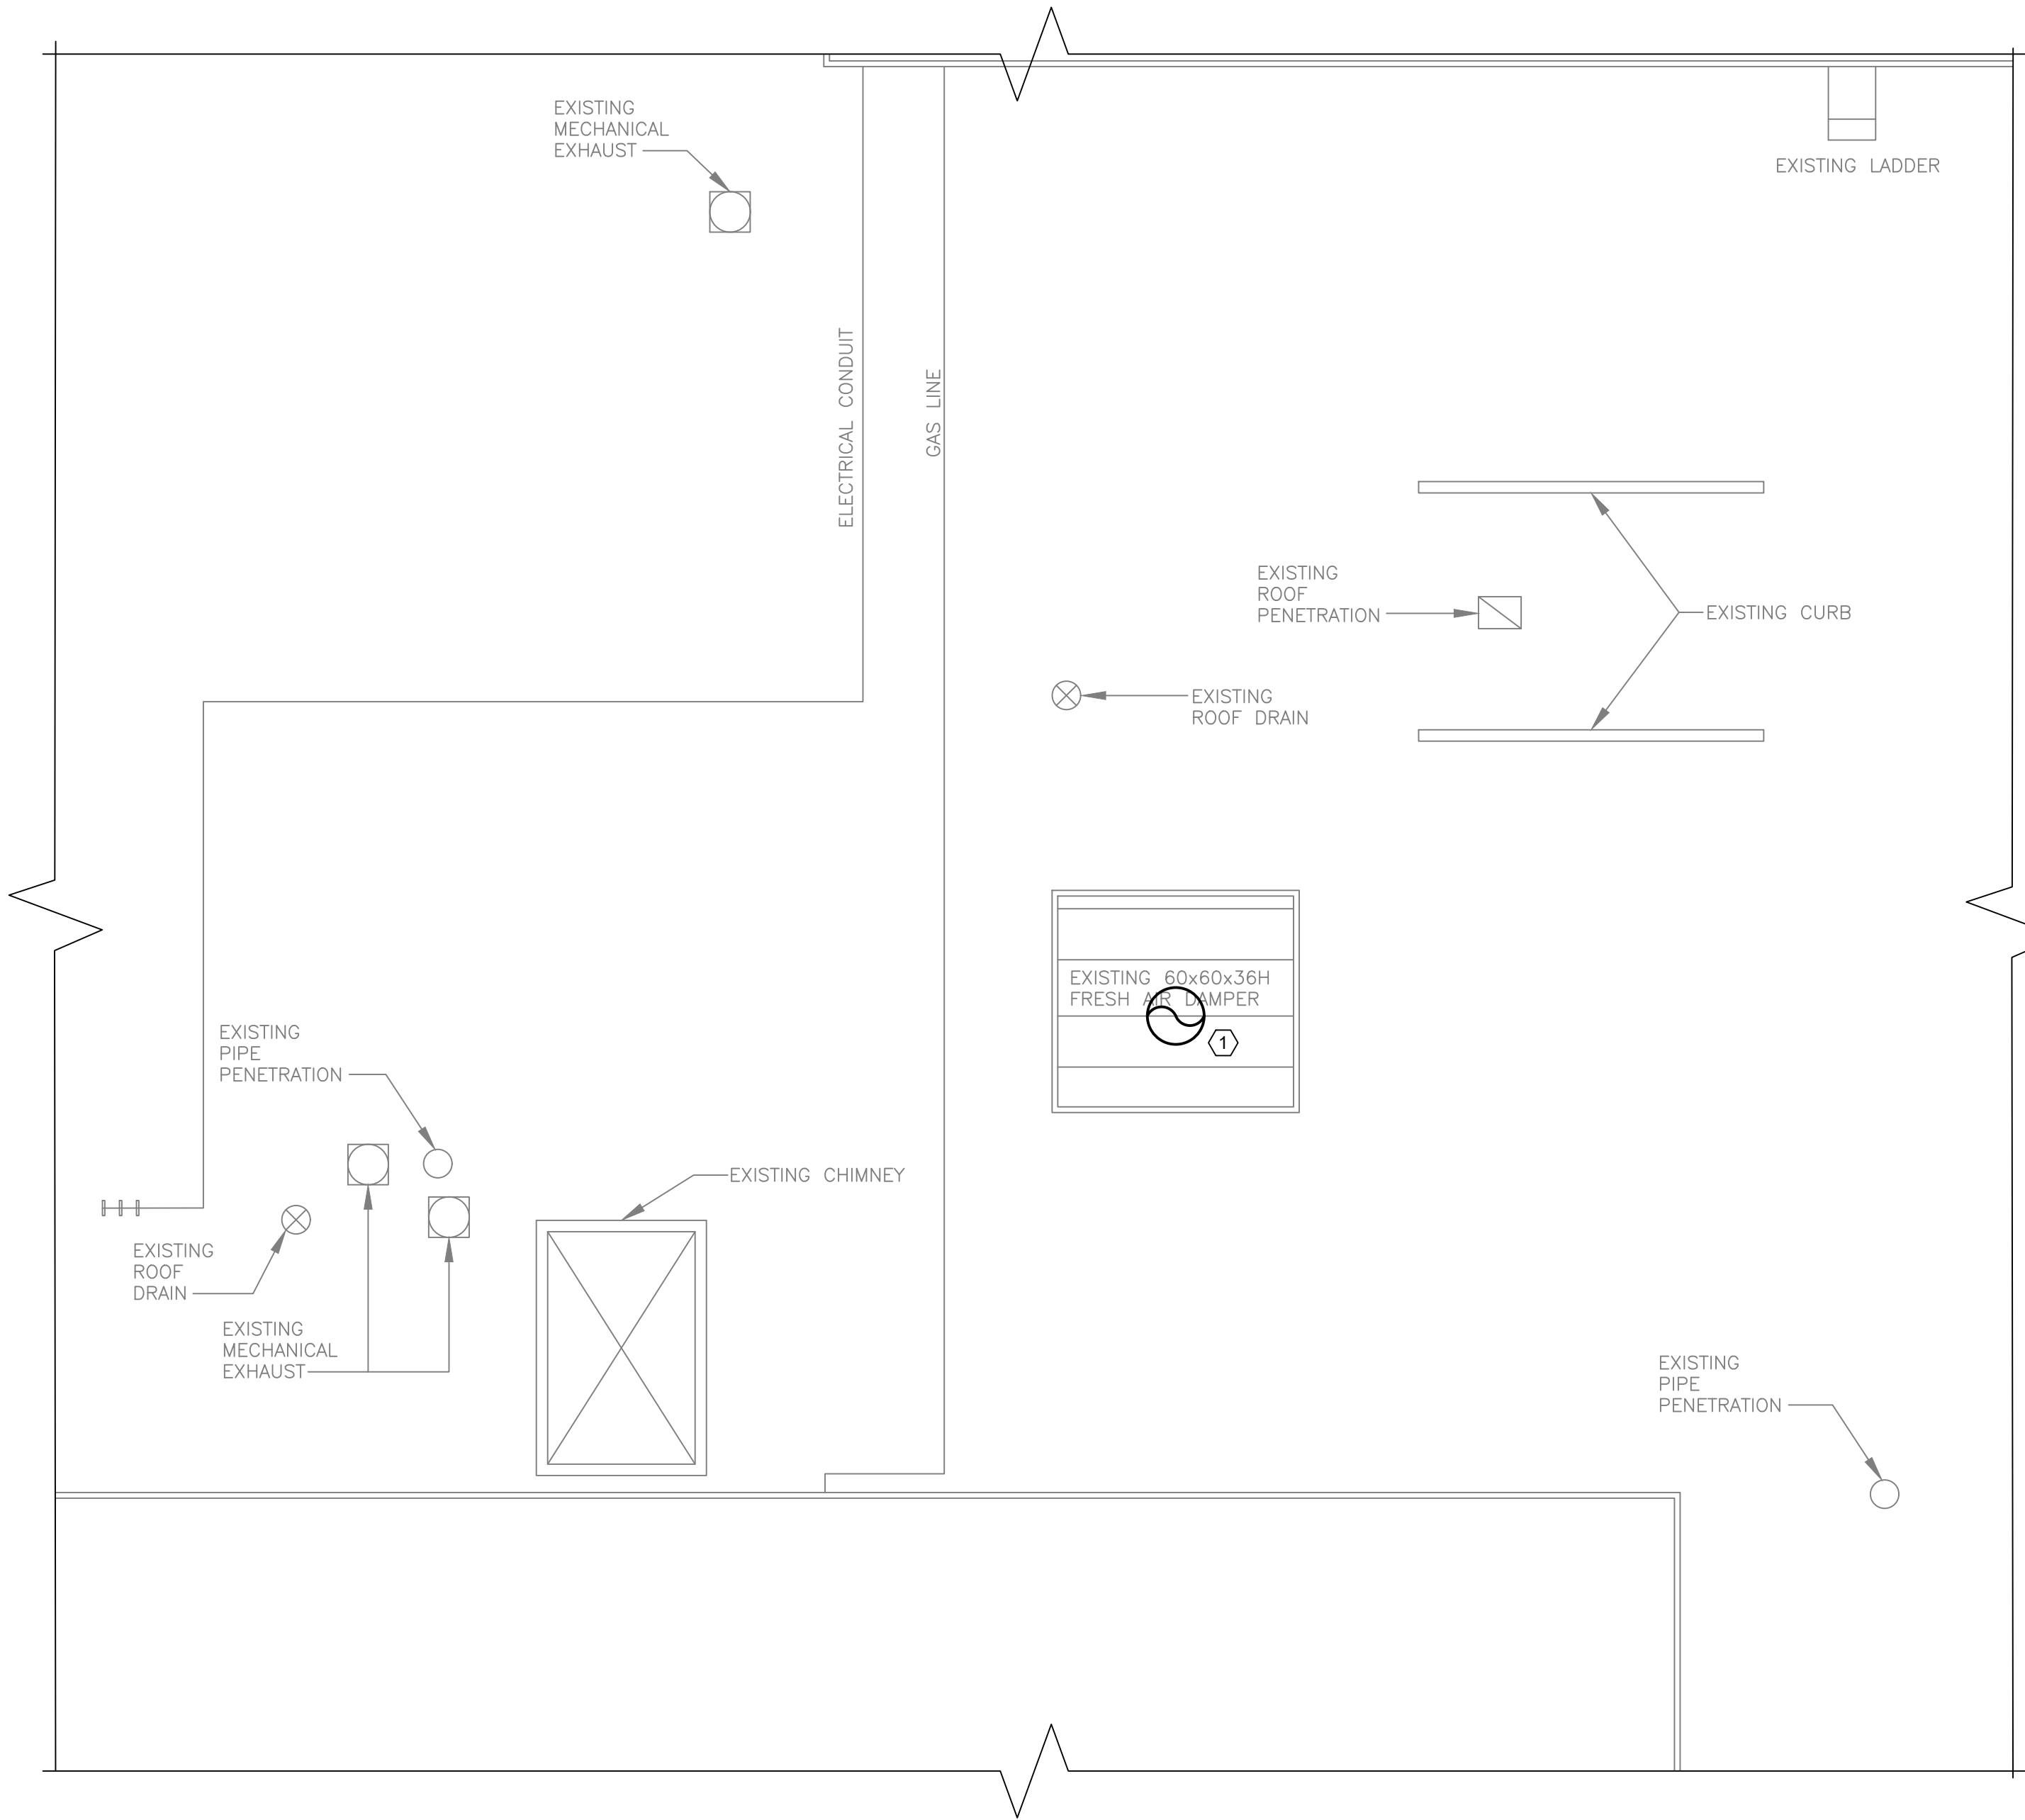

KEYED NOTES

- 1 FURNISH AND INSTALL NEW VENT THROUGH EXISTING ROOF OPENING. SEE DETAIL 1/M503 AND REFER TO MANUFACTURER'S INSTALLATION MANUALS. CONTRACTOR TO PROPERLY SEAL PENETRATION. COORDINATE WITH GC AND REFER TO ARCHITECTURAL PLANS FOR ADDITIONAL DETAILS.



KEY PLAN



0 1/2 1
IF THIS BAR DOES NOT
MEASURE 1" THEN DRAWING IS
NOT TO FULL SCALE

© COPYRIGHT, MICHAEL SHILALE ARCHITECTS, ALL RIGHTS RESERVED.

Drawing Title
**MECHANICAL ROOF
PLAN - INSTALL**

Drawing No.

M-102



**NORTH ROCKLAND HIGH
SCHOOL EXTENSION BOILER
REPLACEMENT**

HIGH SCHOOL EXT SEDA 50-02-01-06-0-016-037

65 Chapel Street
Glenville, NY 10023

COUNTY OF ROCKLAND

**GREENMAN
PEDERSEN, INC**
3 ROUTE 924, SUITE 202
SUITE 202, SUPTEN, NY 10961

Mechanical
& Electrical
Engineer:

Structural
Engineer:

Drawn by WM
Checked by PC
Project No. 44023
Scale AS SHOWN
Date 05/31/2024



REG. EXP. DATE: 10-31-26

No.	Date	Revisions
1	05/31/24	BIDDING DOCUMENTS

REFER TO SPECIFICATION SECTION 230993 FOR SEQUENCE OF OPERATION AND CONTROL OF MECHANICAL EQUIPMENT LISTED AND SHOWN ON DRAWING M003. REFER TO MECHANICAL EQUIPMENT SPECIFICATIONS FOR ADDITIONAL INFORMATION.

1. THE OCCUPANCY MODE (UNOCCUPIED OR OCCUPIED) SHALL BE DETERMINED THROUGH A USER-DEFINABLE TIME SCHEDULE. SUMMERTIME MODE SHALL INCLUDE TIMES DURING WHICH HEATING IS NOT REQUIRED. WINTERTIME MODE SHALL INCLUDE TIMES DURING WHICH HEATING IS REQUIRED.
2. BOILER B-1 SHALL BE THE PRIMARY LEAD BOILER. BOILER B-2 SHALL BE THE LAG BOILER, SEE LEAD-LAG PROGRAMMING CONTROLS BELOW.
3. BOILER B-2 SHALL RUN WHEN MAINTENANCE IS REQUIRED ON BOILER B-1.
4. NEW BREAK GLASS STATION AT EACH BOILER ROOM DOORWAY SHALL SHUT DOWN BOTH BOILER PRIMARY CONTROL CIRCUITS AND CLOSE MAIN FUEL VALVES.

HEATING MODE SHALL BE INITIATED WHEN OUTSIDE TEMPERATURE FALLS BELOW 55°F, (ADJUSTABLE). THE HOT WATER BOILER SHALL BE ENGAGED AND MAINTAIN AT LEAST MINIMUM HOT WATER TEMPERATURE REQUIRED BY THE BOILER.

1. BOILER B-1: B-1 SHALL MODULATE TO MAINTAIN HOT WATER SUPPLY TEMPERATURE SETPOINT OF 180°F (ADJ.).
 - a. PUMP P-1/2: P-1/2 SHALL BE ENERGIZED AND SHALL OPERATE AT A CONSTANT SPEED WHENEVER B-1 IS ENERGIZED (HARDWIRED TO BOILER CONTROLLER). B-1 SHALL NOT OPERATE UNLESS P-1/2 IS RUNNING. P-1/2 FLOW RATE SHALL BE IN ACCORDANCE WITH BOILER MANUFACTURER'S PUMPING REQUIREMENTS.
 - b. B-1 BURNERS SHALL FULLY MODULATE AS FACTORY BURNER SET PROGRAMMING.
 - c. LOW RETURN TEMPERATURE: WHENEVER THE HOT WATER RETURN TEMPERATURE FALLS BELOW 140°F (ADJ.) AND B-1 IS ENERGIZED, AN ALARM SHALL GENERATE.
2. BOILER B-2: B-2 SHALL MODULATE TO MAINTAIN HOT WATER SUPPLY TEMPERATURE SETPOINT OF 180°F (ADJ.).
 - a. PUMP P-1/2: P-1/2 SHALL BE ENERGIZED AND SHALL OPERATE AT A CONSTANT SPEED WHENEVER B-1 IS ENERGIZED (HARDWIRED TO BOILER CONTROLLER). B-1 SHALL NOT OPERATE UNLESS P-1/2 IS RUNNING. P-1/2 FLOW RATE SHALL BE IN ACCORDANCE WITH BOILER MANUFACTURER'S PUMPING REQUIREMENTS.
 - b. B-2 BURNERS SHALL FULLY MODULATE AS FACTORY BURNER SET PROGRAMMING.
 - c. LOW RETURN TEMPERATURE: WHENEVER THE HOT WATER RETURN TEMPERATURE FALLS BELOW 140°F (ADJ.) AND B-2 IS ENERGIZED, AN ALARM SHALL GENERATE.
3. SECONDARY PUMPS:
 - a. PUMPS P-3/4: P-3/4 SHALL OPERATE AT VARIABLE SPEED TO MAINTAIN ZONE HOT WATER SUPPLY TEMPERATURE AT A SETPOINT (BASED ON OUTSIDE AIR TEMPERATURE RESET)
 - b. THE DDC SYSTEM USES CURRENT SWITCHES TO CONFIRM THE LEAD PUMP IS IN THE DESIRED STATE (I.E. ON OR OFF) AND GENERATES AN ALARM IF STATUS DEVIATES FROM DDC START/STOP CONTROL. IF THE LEAD PUMP GOES INTO ALARM, THE LAG PUMP STARTS.
4. OUTSIDE AIR TEMPERATURE RESET:
 - a. NATURAL GAS MODE (BOILERS B-1, B-2): BOILERS SHALL MODULATE TO MAINTAIN HOT WATER SETPOINT ACCORDING TO THE MANUFACTURER'S SUGGESTED PROTOCOL. HOT WATER SUPPLY TEMPERATURE MAY BE RESET TO 140 DEG F (ADJ.)
 - b. OUTSIDE AIR RESET MODE SHALL BE CANCELED IF THE PRIMARY HOT WATER RETURN TEMPERATURE DROPS TO 140 DEG F. (ADJ.) WHENEVER BOILERS ARE ENERGIZED. THERE IS NO HOT WATER RETURN LOW LIMIT FOR B-2.
5. LEAD LAG PROGRAMMING CONTROL:

A LEAD-LAG PROGRAMMING CONTROL SHALL SEQUENCE AUTOMATICALLY THE FIRING OF MULTIPLE BOILERS WITH CHANGING LOAD CONDITIONS. THE FIRST (LEAD) BOILER STARTS-UP AND REACHES ITS BURNER DELIVERY (HIGH FIRE) RATE. IF THE FIRST BOILER IS UNABLE TO MEET THE REQUIRED WATER TEMPERATURE, THE SECOND (LAG) BOILER SHALL AUTOMATICALLY FIRE. BOILERS SHALL OPERATE IN UNISON, MODULATING TO MEET THE DEMAND. IF THE DEMAND IS LESS THAN THE CAPACITY PROVIDED BY BOTH BOILERS FIRING AT LOW FIRE, THE LAG BOILER SHALL AUTOMATICALLY SHUT DOWN. THE LEAD BOILER SHALL SHUT DOWN WHEN THE DEMAND HAS BEEN EXCEEDED. SELECTION OF THE LEAD BOILER SHALL BE MADE EITHER MANUALLY BY MEANS OF A SELECTOR DIAL ON THE CONTROL CABINET OR AUTOMATICALLY AS A FUNCTION OF RUN TIME.
6. BURNER OPERATING CONTROLS:

TO MAINTAIN SAFE OPERATING CONDITIONS, THE FOLLOWING BURNER SAFETY CONTROLS LIMIT BURNER OPERATION.

 - a. HIGH TEMPERATURE LIMIT: AUTOMATIC AND MANUAL RESET STOPS BURNER IF OPERATING CONDITIONS RISE ABOVE MAXIMUM BOILER DESIGN TEMPERATURE. LIMIT SWITCH TO BE MANUALLY RESET ON THE CONTROL INTERFACE.
 - b. LOW-WATER CUTOFF SWITCH: ELECTRONIC PROBE SHALL PREVENT BURNER OPERATION ON LOW WATER. CUTOFF SWITCH SHALL BE MANUALLY RESET ON THE CONTROL INTERFACE.
 - c. BLOCKED INLET SAFETY SWITCH: MANUAL-RESET PRESSURE SWITCH FIELD MOUNTED ON BOILER COMBUSTION-AIR INLET.
 - d. HIGH AND LOW GAS PRESSURE SWITCHES: PRESSURE SWITCHES SHALL PREVENT BURNER OPERATION ON LOW OR HIGH GAS PRESSURE. PRESSURE SWITCHES TO BE MANUALLY RESET ON THE CONTROL INTERFACE.
 - e. BLOCKED DRAIN SWITCH: BLOCKED DRAIN SWITCH SHALL PREVENT BURNER OPERATION WHEN TRIPPED. SWITCH TO BE MANUALLY RESET ON THE CONTROL INTERFACE.
 - f. LOW AIR PRESSURE SWITCH: PRESSURE SWITCHES SHALL PREVENT BURNER OPERATION ON LOW AIR PRESSURE. SWITCH TO BE MANUALLY RESET ON THE CONTROL INTERFACE.
 - g. AUDIBLE ALARM: FACTORY MOUNTED ON CONTROL PANEL WITH SILENCE SWITCH; SHALL SOUND ALARM FOR ANY LOCKOUT CONDITIONS.
 - h. EACH BURNER SHALL BE PROVIDED WITH A FLAME FAILURE (COMBUSTION SAFETY) PROGRAMMING CONTROL WHICH SHALL DE-ENERGIZE ALL ELECTRICALLY OPERATED FUEL VALVES AND BURNER EQUIPMENT WITHIN FOUR SECONDS, AND ACTIVATE A VISUAL ALARM MOUNTED ON THE CONTROL PANEL AFTER AN OPERATING FLAME FAILURE HAS OCCURRED. AUTOMATIC START UP AND SHUTDOWN PROGRAMMING SHALL BE A PART OF THIS SAFETY EQUIPMENT.
 - i. CARBON MONOXIDE SHUT DOWN: BURNER EQUIPMENT SHALL BE SHUT DOWN BY THE STAND ALONE CO SYSTEM ON DETECTION OF HIGH CARBON MONOXIDE LEVELS.
 - j. LOW FIRE HOLD ADJUST: A LOW FIRE HOLD MINIMUM TEMPERATURE ADJUST SHALL LIMIT BURNER MODULATION TO PREVENT BOILER FROM MODULATING TO LOW FIRE UNTIL WATER TEMPERATURE REACHES 180°F.

D. SUMMERTIME MODE: BOILERS B-1 AND B-2 SHALL BE SET TO MAINTAIN DOMESTIC HOT WATER HEATING REQUIREMENTS. THE SUMMER SWING VALVE SWITCH SHALL BE SET TO OFF. PRIMARY LOOP PUMPS SHALL BE OFF. SECONDARY LOOP PUMPS SHALL BE ON.

D. SUMMERTIME MODE: BOILERS B-1 AND B-2 SHALL BE SET TO MAINTAIN DOMESTIC HOT WATER HEATING REQUIREMENTS. THE SUMMER SWING VALVE SWITCH SHALL BE SET TO OFF. PRIMARY LOOP PUMPS SHALL BE OFF. SECONDARY LOOP PUMPS SHALL BE ON.

TT	TEMPERATURE TRANSMITTER
PT	PRESSURE TRANSMITTER
CS	CURRENT TRANSMITTER
HS	HAND SWITCH (HAND-OFF-AUTO SWITCH)
ZC	VALVE OR DAMPER POSITION CONTROLLER
ES	DAMPER END SWITCH

 MOTOR STARTER

(DPS) DIFFERENTIAL PRESSURE SENSOR


(SPD) SPEED COMMAND

(AIA) ANALOG INPUT


(COMM) COMMUNICATION

ADJ ADJUSTABLE

EVA	ELECTRIC VALVE ACTUATOR
-----	-------------------------



1. PROVIDE MATERIALS REQUIRED TO EXECUTE THE WORK SHOWN OF THIS CONTRACT AND TO SATISFY THE SEQUENCE OF OPERATIONS WHICH SHALL INCLUDE, BUT NOT BE LIMITED TO: LOW VOLTAGE WIRING, CONDUIT, MATERIALS, PROGRAMMING, SOFTWARE, HARDWARE, AND APPURTENANCES.
2. PROVIDE LOW VOLTAGE WIRING IN EMT CONDUIT THROUGHOUT. PAINT TO MATCH EXISTING FINISHES.
3. SCHEDULE THE WORK WITH THE OWNER AND NOTIFY THE OWNER AT LEAST 48 HOURS IN ADVANCE OF PERFORMING ANY SHUTDOWNS.
4. PERFORM CUTTING AND PATCHING AS REQUIRED TO ACCESS THE EXISTING VENT DAMPERS OR TO OTHERWISE EXECUTE THE WORK. RESTORE FINISHES TO MATCH EXISTING TO THE SATISFACTION OF THE OWNER.

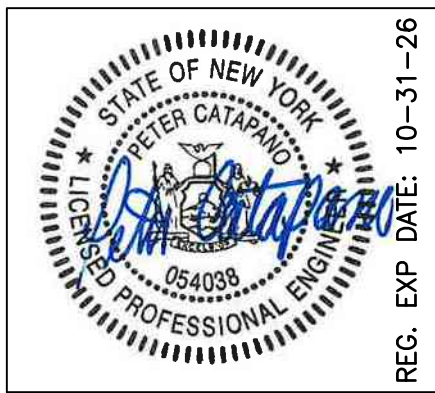[illegible]

Drawn by	WM
Checked by	PC
Project No.	44023
Scale	AS SHOWN
Date	05/31/2024

Mechanical & Electrical Engineer:	GREENMAN PEDERSEN, INC 2 EXECUTIVE BOULEVARD, SUITE 202, SUFFERN, NY 10901
Structural Engineer:	

**NORTH ROCKLAND HIGH
SCHOOL EXTENSION BOILER
REPLACEMENT**



MICHAEL SHILALE ARCHITECTS, L.L.P.
140 Park Avenue New City, NY 10956 Tel 845-708-9200
www.shilale.com


Drawing Title

MECHANICAL
CONTROL DIAGRAM

Drawing No.


M-401

© COPYRIGHT, MICHAEL SHILALE ARCHITECTS, ALL RIGHTS RESERVED.

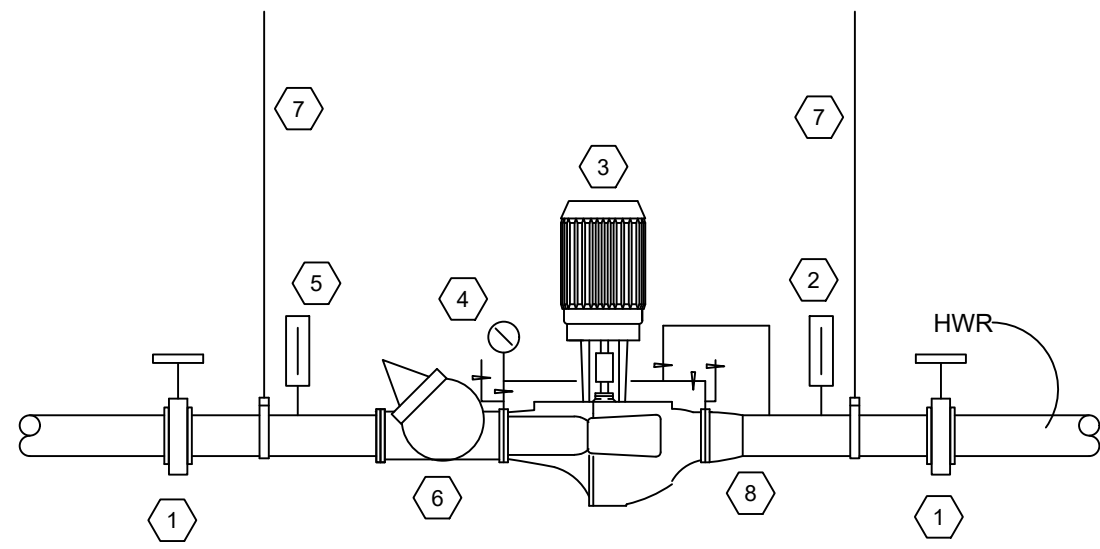


1 INLINE PUMP DETAIL
SCALE: NTS


- 1 BUTTERFLY VALVE
- 2 THERMOMETER
- 3 VERTICAL INLINE PUMP
- 4 PRESSURE GAUGE
- 5 THERMOMETER
- 6 PUMP TRIPLE DUTY VALVE
- 7 PIPE HANGER
- 8 PIPE REDUCER (AS NEEDED)

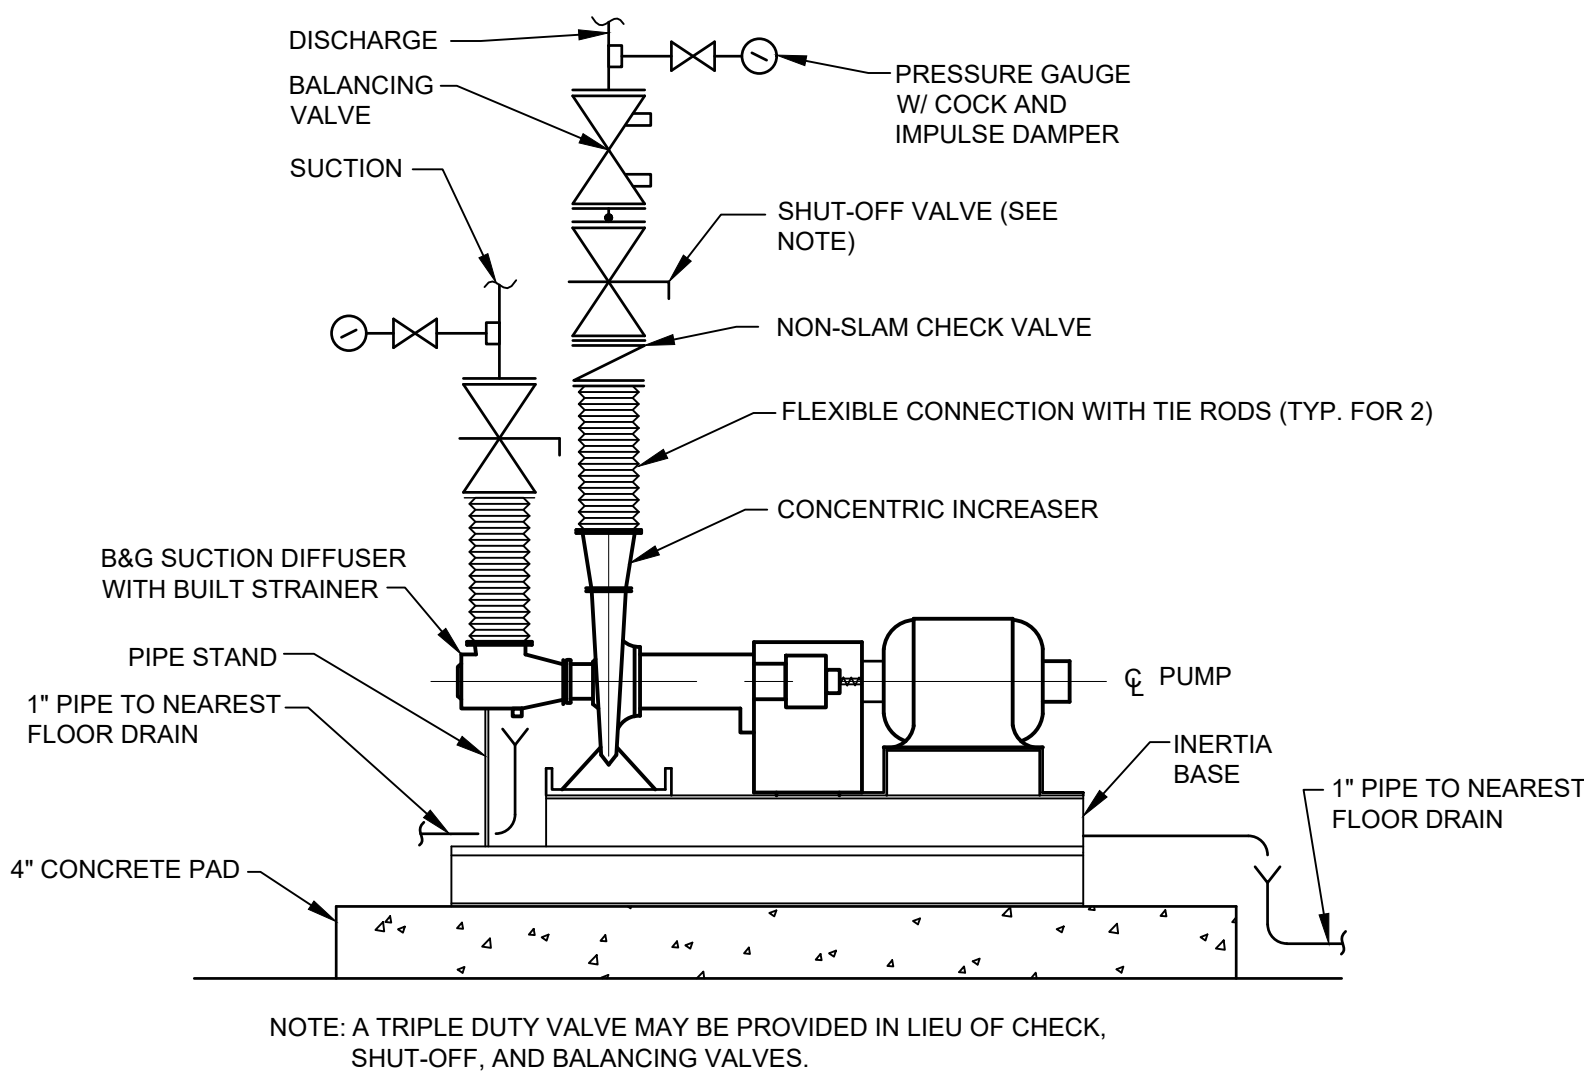

2 HOT WATER PUMP DETAIL
SCALE: NONE
(P-1, P-2)
ALTERNATE #1

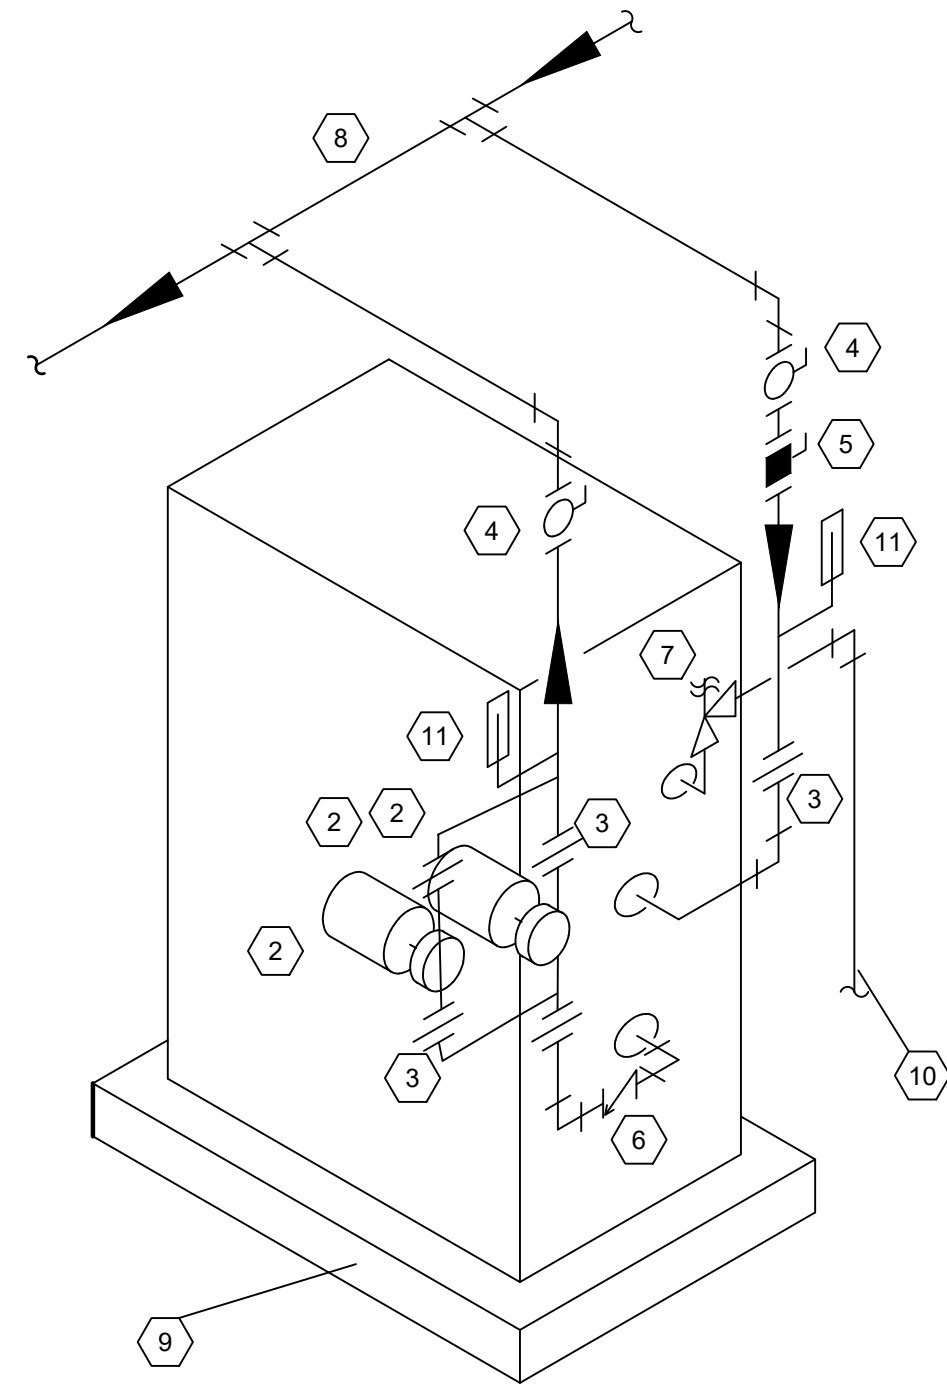

3 BOILER PIPING DETAIL
SCALE: NONE

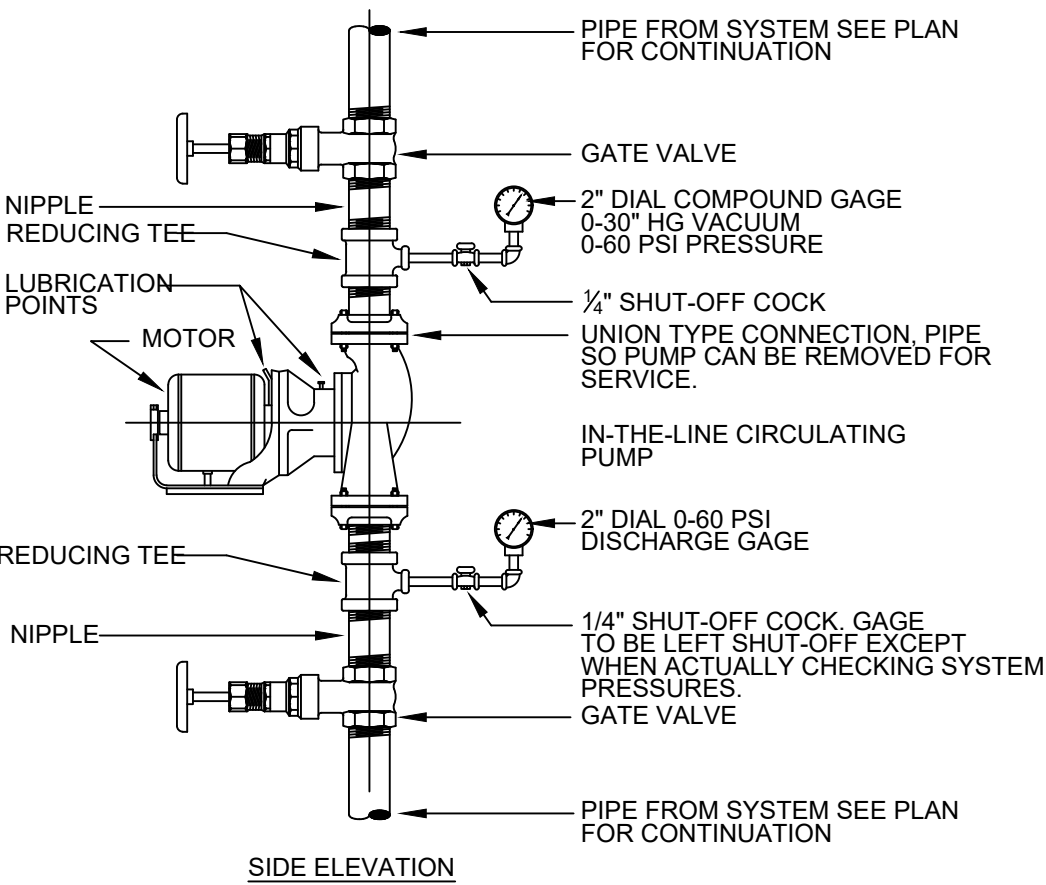

4 INLINE CIRCULATION PUMP AT BOILER DETAIL
SCALE: NTS


INSTALLATION NOTES

1. THE PUMP SHALL BE INSTALLED DEAD LEVEL, AND SHALL NOT TOUCH OR REST ON ANY PART OF THE BUILDING STRUCTURE.
2. THE ELECTRICAL CONNECTION TO THE PUMP SHALL BE MADE THROUGH THE USE OF FLEXIBLE CONDUIT (GREENFIELD) AT LEAST 18" LONG.
3. THE PUMP SHALL BE INSTALLED SO THAT THE PUMP CAN BE COMPLETELY REMOVED WITHOUT THE DISMANTLING OR REMOVAL OF ANY PIPING OR VALVES.
4. THE MOTOR AND COUPLING SHALL BE CHECKED AND PROPERLY ALIGNED IN STRICT ACCORDANCE WITH THE MANUFACTURER'S INSTRUCTIONS.
5. THE ADJACENT PIPING SHALL BE CAREFULLY FITTED AND ERECTED SO THAT THE PUMP CAN BE INSTALLED OR REMOVED FROM THE PIPE WITHOUT FORCING OR SPRINGING.
6. AFTER THE SYSTEM HAS BEEN COMPLETED AND THE PUMP STARTED THE PUMP AND SYSTEM SHALL BE CHECKED FOR VIBRATION AND EXCESSIVE NOISE AND IMMEDIATELY CORRECTED.

LUBRICATION NOTES

1. AFTER COMPLETION OF THE SYSTEM AND BEFORE START-UP, THE PUMP SHALL BE LUBRICATED IN STRICT ACCORDANCE WITH THE MANUFACTURER'S INSTRUCTIONS.
2. A METAL INSTRUCTION PLATE SHALL BE ATTACHED TO THE PUMP IN A LOCATION WHERE IT IS CLEARLY VISIBLE. THESE INSTRUCTIONS SHALL INDICATE THE RECOMMENDED LUBRICANT, THE POINTS OF LUBRICATION, AND THE RECOMMENDED FREQUENCY OF LUBRICATION.

LEGEND	
	STRAINER
	STOP VALVE
	CHECK VALVE
	RELIEF VALVE
	DRAIN VALVE
	UNION
	PUMP
	TEMPERATURE GAUGE
	AIR SEPARATOR
	3 WAY CONTROL VALVE

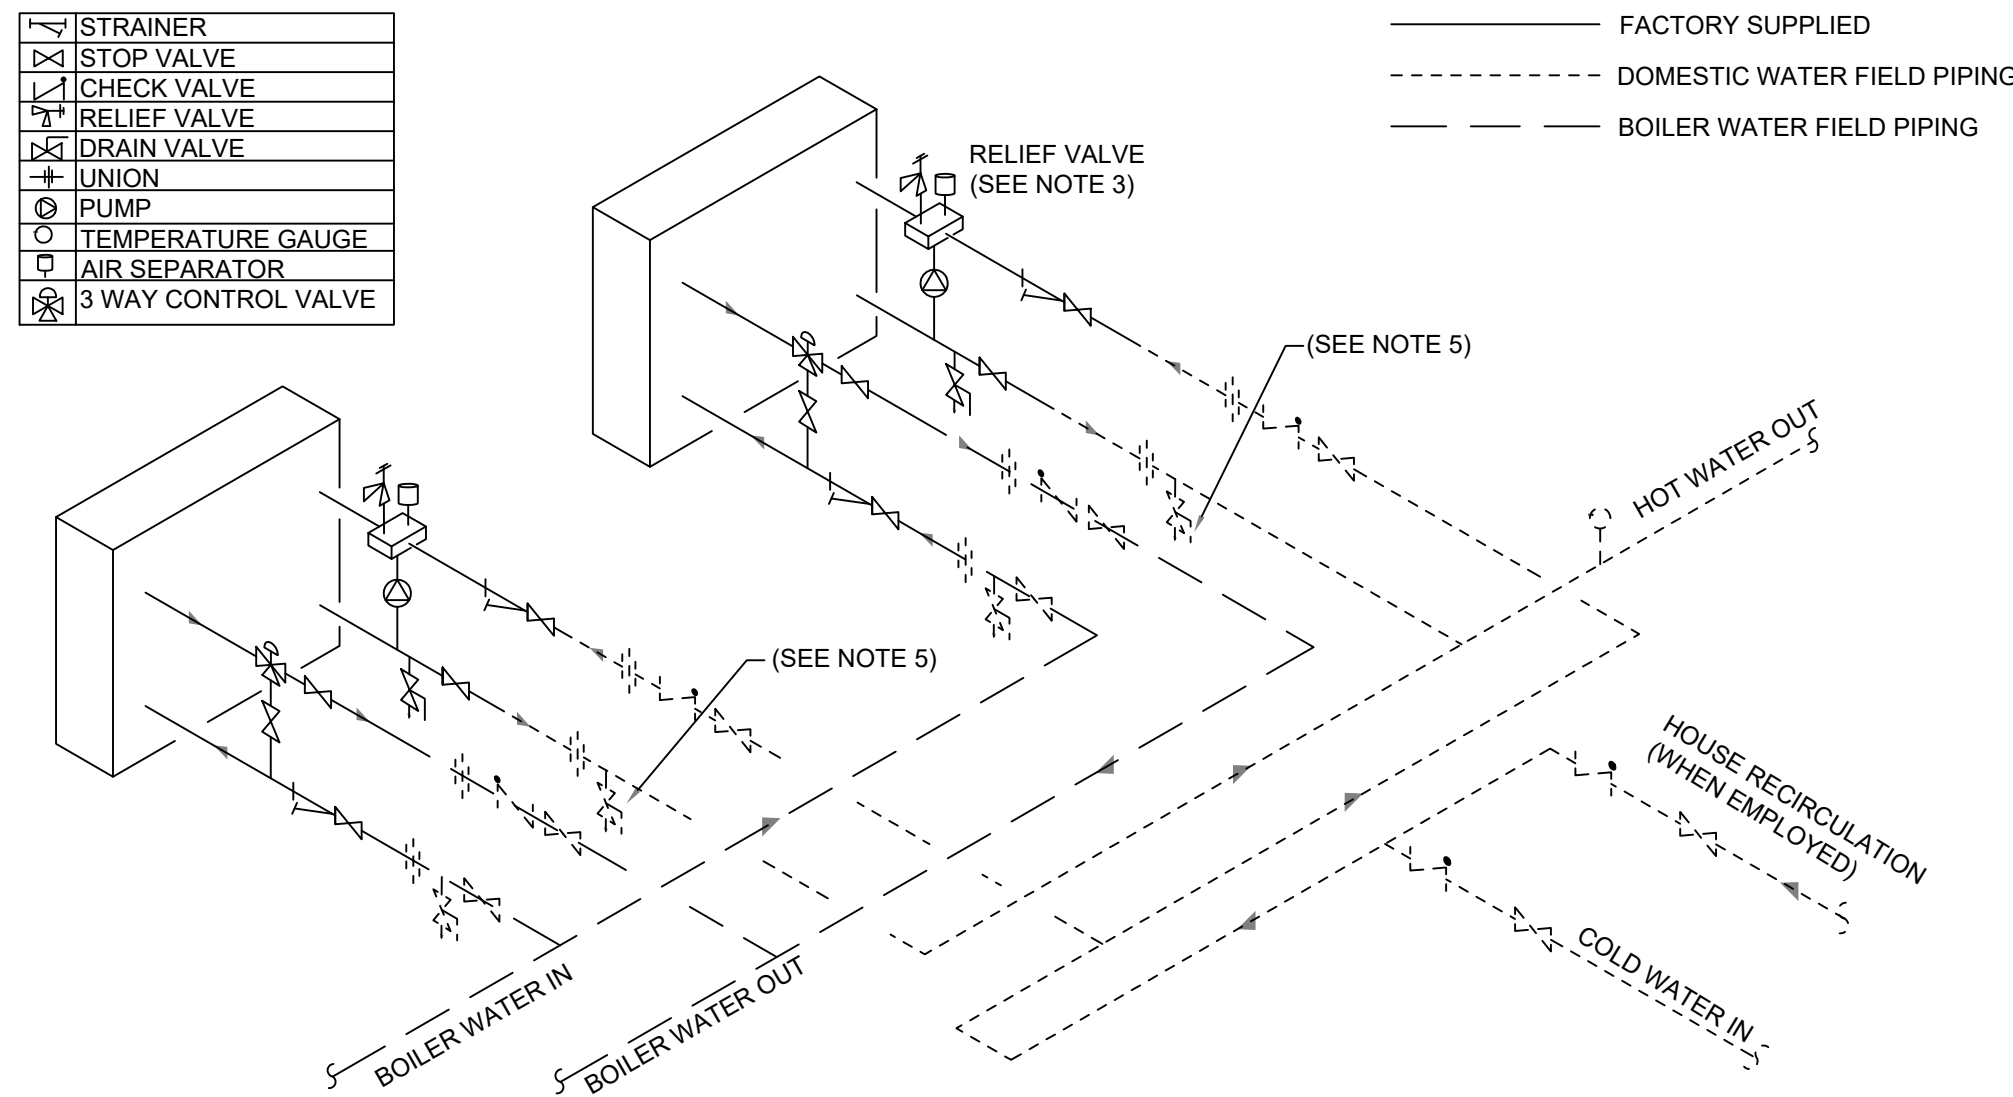

5 DOMESTIC HW HEAT EXCHANGER PIPING DETAIL
SCALE: NTS

NOTES:

1. FOR ACTUAL SIZES AND LOCATIONS OF PIPING AND OTHER CONNECTIONS TO THE HEATER, SEE DIMENSIONAL DRAWING.
2. REDUCERS, ON THE WATER INLET SIDE, SHOULD BE LOCATED ADJACENT TO THE HEATER. EXPANSION FITTINGS, ON THE WATER INLET SIDE, SHOULD BE LOCATED AS FAR AS POSSIBLE FROM THE HEATER.
3. DRAIN VALVE SHOULD BE PIPED DIRECTLY TO A FLOOR DRAIN. RELIEF VALVE SHOULD BE PIPED VERTICALLY TO A HEIGHT 19" ABOVE THE FLOOR.
4. HEATERS SHOULD BE PIPED REVERSE RETURN OR BALANCING DEVICES ON THE OUTLETS SHOULD BE EMPLOYED.
5. INSTALL A HOSE CONNECTION AT THE HOT WATER OUTLET.
6. CONTRACTOR RESPONSIBLE TO REVIEW MANUFACTURER'S INSTALLATION INSTRUCTIONS FOR ALL PIPING INSTALLATION GUIDELINES.

0 1/2 1
IF THIS BAR DOES NOT
MEASURE 1" THEN DRAWING IS
NOT TO FULL SCALE

Revisions	
No.	Date
1	05/31/24 BIDDING DOCUMENTS



Drawn by	WM
Checked by	PC
Project No.	44023
Scale	AS SHOWN
Date	05/31/2024


GREENMAN PEDERSEN, INC. 300 WEST 10TH STREET SUITE 202, SUFFERN, NY 10901	
Mechanical & Electrical Engineer:	Structural Engineer:

NORTH ROCKLAND HIGH SCHOOL EXTENSION BOILER REPLACEMENT	HIGH SCHOOL EXT SIDA# 50-02-01-06-0-010-037	COUNTY OF ROCKLAND
65 Chapel Street Greenburgh, NY 10623		




Drawing Title MECHANICAL DETAILS - 1	Drawing No. M-501
---	-----------------------------

© COPYRIGHT, MICHAEL SHILALE ARCHITECTS, ALL RIGHTS RESERVED.

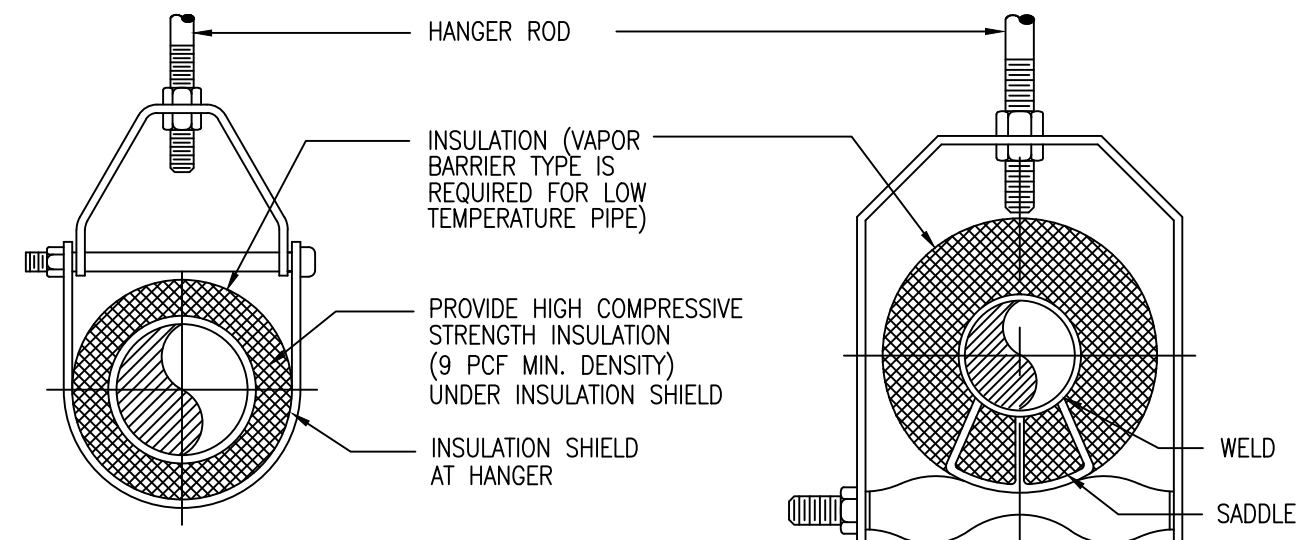


ADJUSTABLE CLEVIS HANGER
TYPE 1 - SEE SPECIFICATIONS

ADJUSTABLE CLEVIS HANGER
TYPE 43 - SEE SPECIFICATIONS

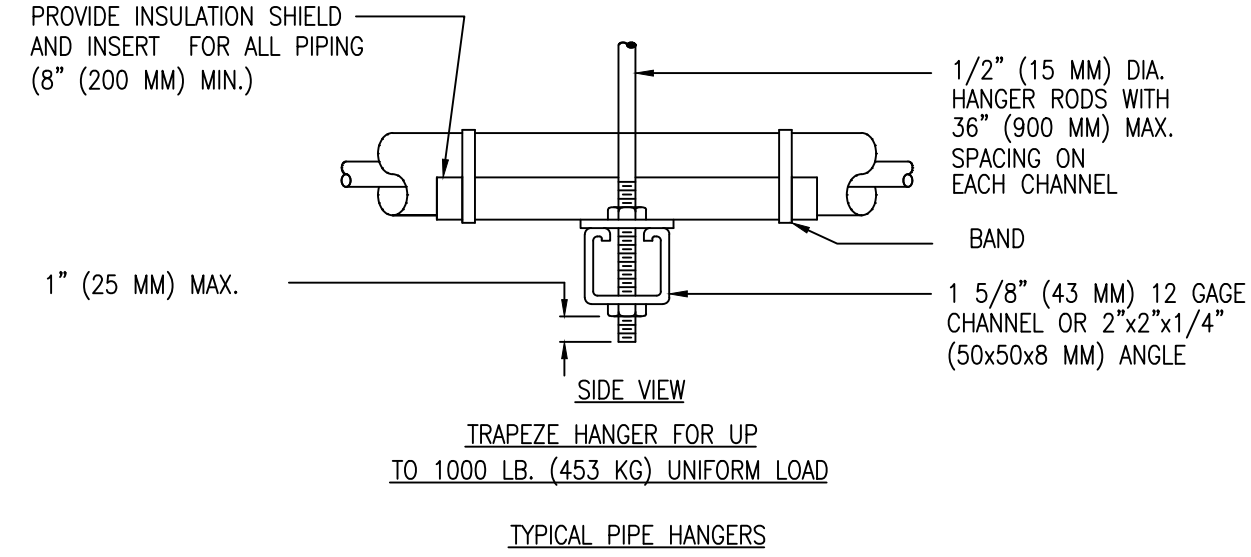

1 PIPE HANGER DETAIL


SCALE: NTS

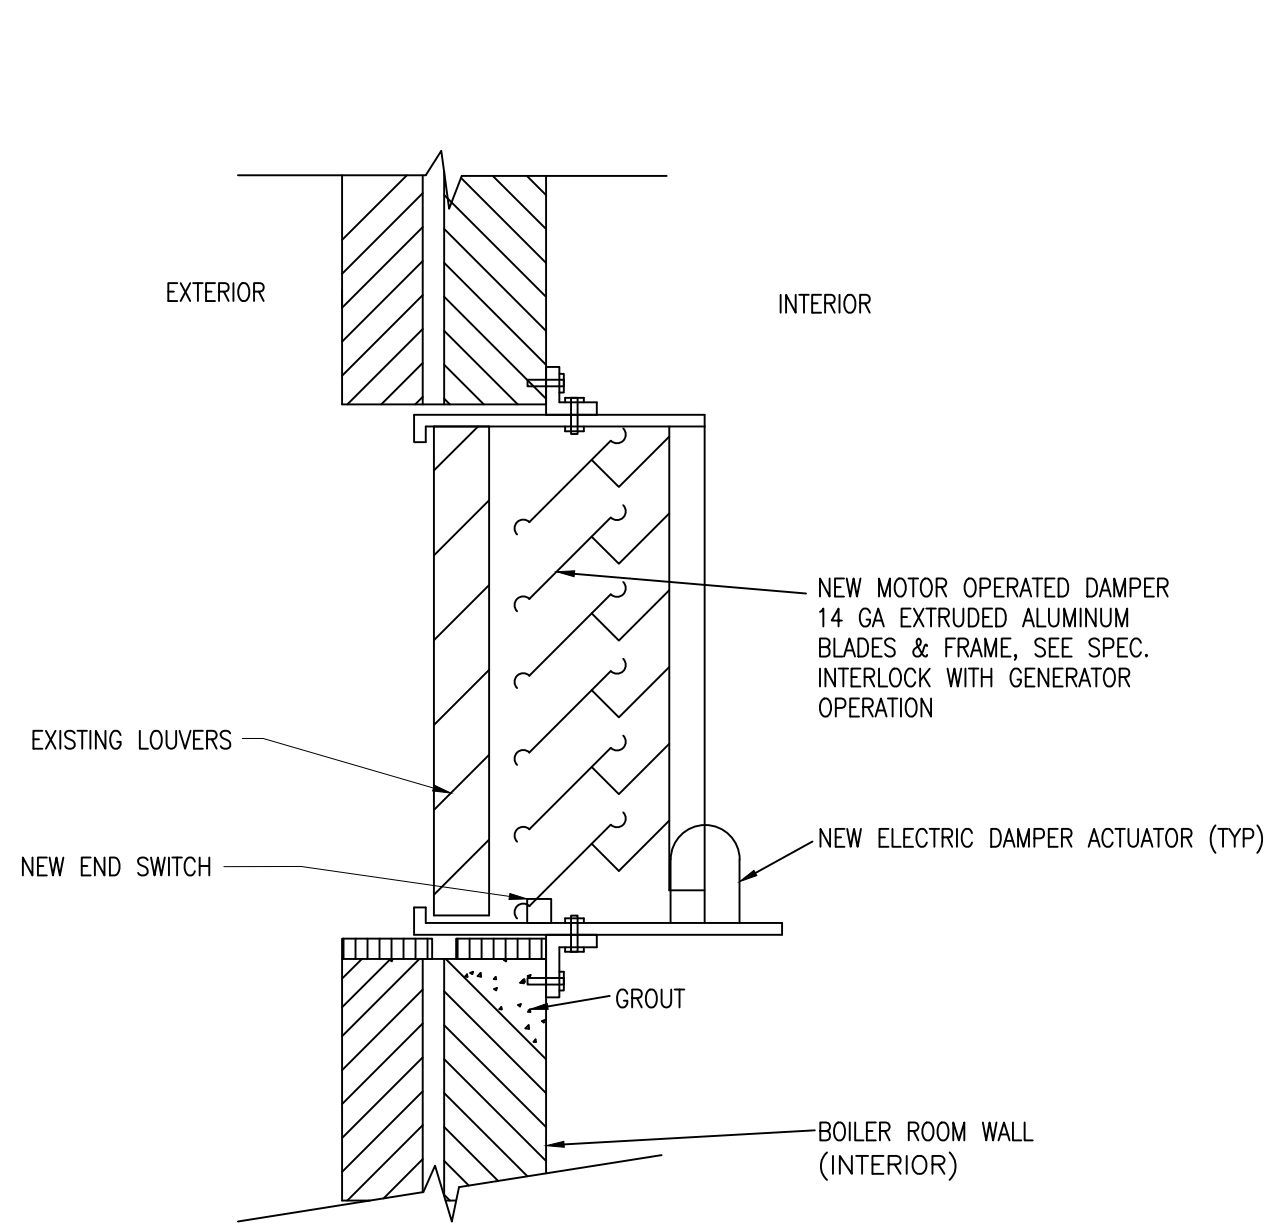

NOTE:
1. COORDINATE INSTALLATION WITH ALL DRAWINGS.

4 MOTORIZED DAMPER DETAIL

SCALE: NTS

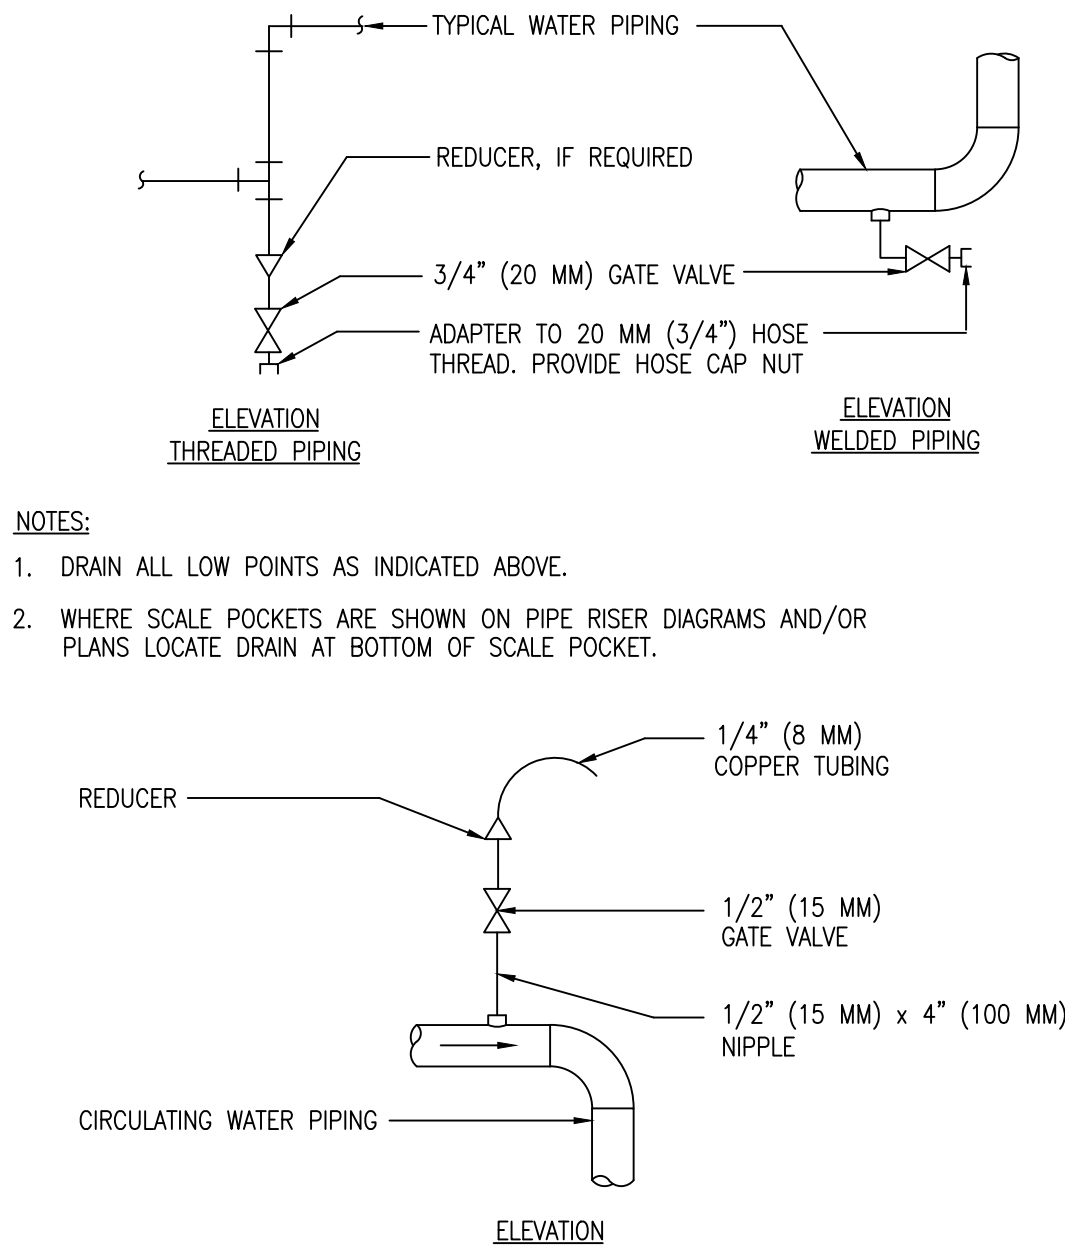


NOTES:
1. DRAIN ALL LOW POINTS AS INDICATED ABOVE.
2. WHERE SCALE POCKETS ARE SHOWN ON PIPE RISER DIAGRAMS AND/OR PLANS LOCATE DRAIN AT BOTTOM OF SCALE POCKET.

NOTES:
1. VENT ALL HIGH POINTS INDICATED ABOVE.
2. IF AUTOMATIC AIR VENTS ARE USED, PIPE DISCHARGE TO DRAIN

5 AIR VENT AND DRAIN DETAIL

SCALE: NTS

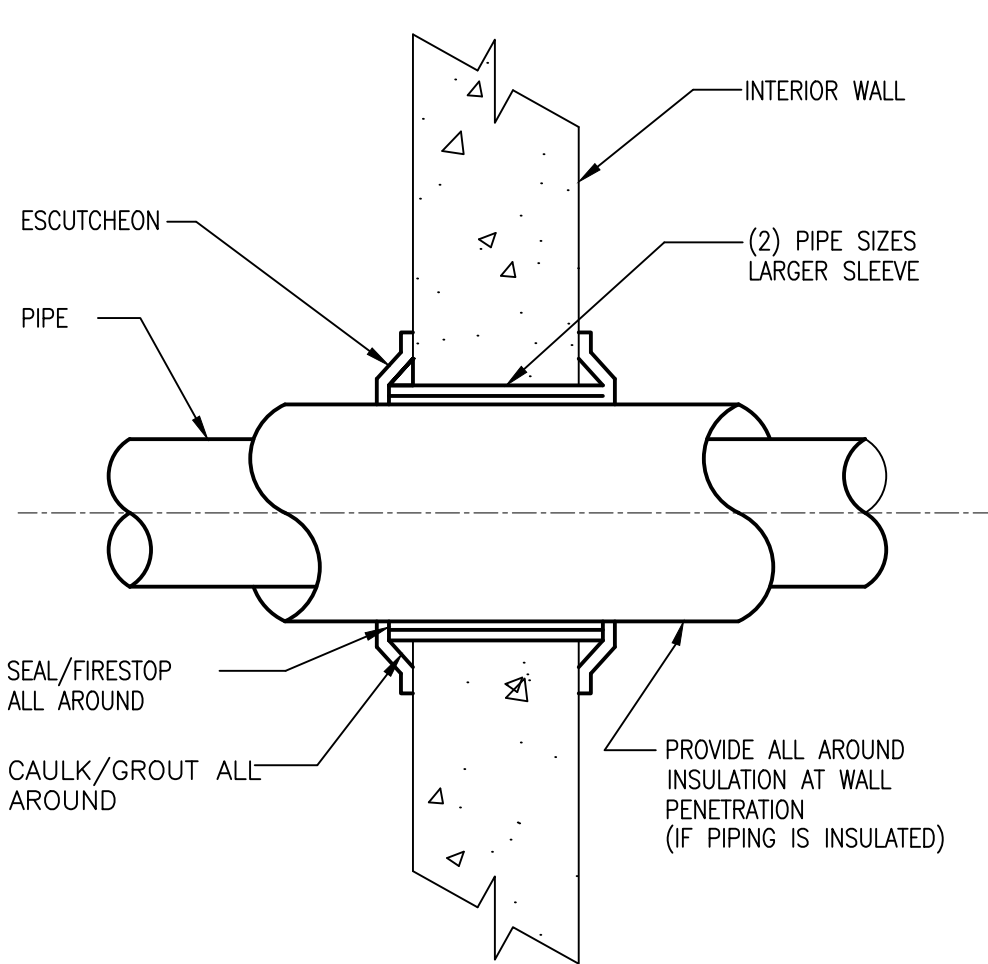


2 INTERIOR WALL PENETRATION

SCALE: NTS




NOTES:

1. PROVIDE A LISTED, APPROVED, VENTLESS GAS TRAIN ASSEMBLY IN ACCORDANCE WITH THE MANUFACTURER'S REQUIREMENTS AND SPECIFICATIONS.
2. SUBMIT BURNER GAS PIPING SHOP DRAWINGS FOR APPROVAL PRIOR TO FABRICATION.

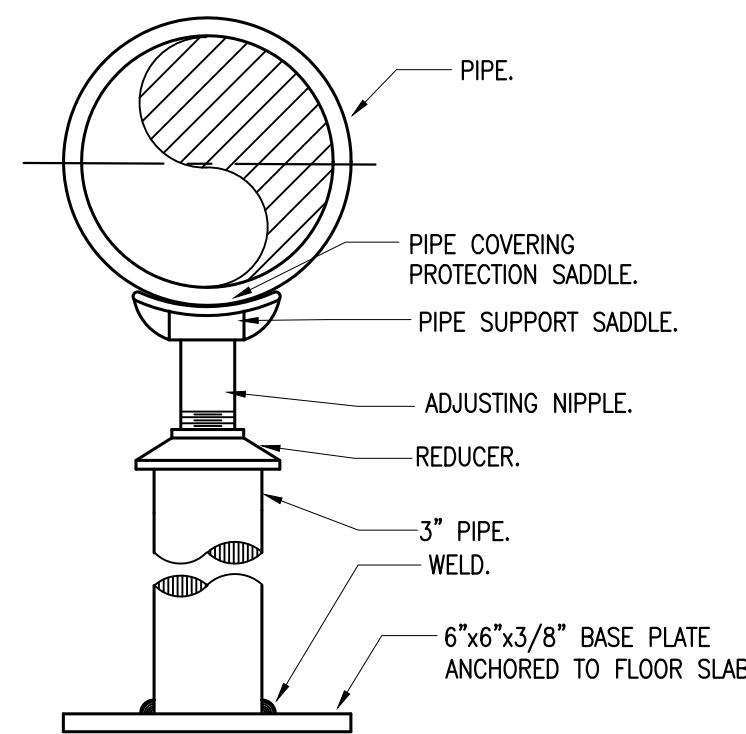


6 ADJUSTABLE PIPE/EQUIPMENT SUPPORT

SCALE: NTS

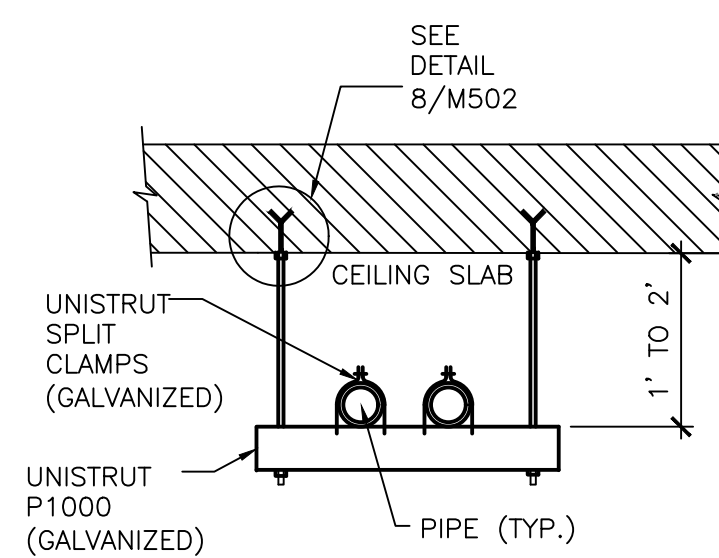

7 PIPE SUPPORT DETAIL

SCALE: NTS

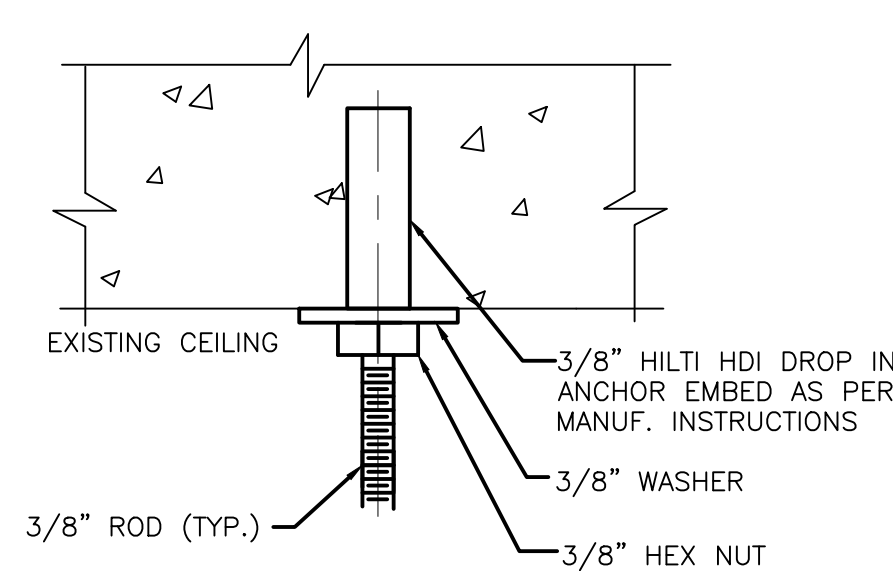


8 HANGER DETAIL

SCALE: NTS

KEYED NOTES: ①

- 1 MANUAL BALL VALVE
- 2 MAIN GAS STRAINER
- 3 MAIN GAS LOW PRESSURE SWITCH
- 4 GAS PRESSURE GAUGE
- 5 MANUAL TEST VALVE
- 6 MAIN MOTORIZED GAS VALVE WITH PROOF OF CLOSURE
- 7 MAIN GAS VALVE BODY
- 8 GAS LOW PRESSURE SWITCH (AUTO RESET)
- 9 MAIN REGULATOR/MOTORIZED SHUTOFF GAS VALVE WITH PROOF OF CLOSURE
- 10 MAIN GAS HIGH PRESSURE SWITCH
- 11 FUEL FLOW CONTROL VALVE (BUTTERFLY VALVE)
- 12 TEST COCK WITH PLUG
- 13 PILOT MANUAL BALL VALVE
- 14 PILOT STRAINER
- 15 PILOT GAS PRESSURE REGULATOR
- 16 PILOT GAS LOW PRESSURE SWITCH (MANUAL RESET)
- 17 PILOT SOLENOID VALVE
- 18 PILOT STRAINER

Revisions	Date	No.
1	05/31/24	BIDDING DOCUMENTS

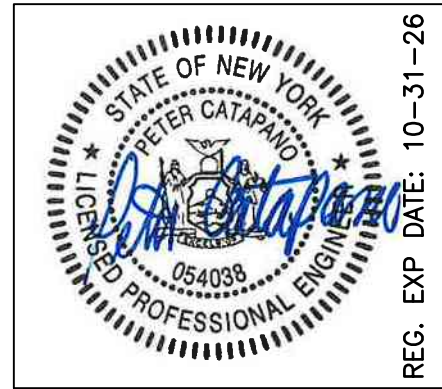

Drawn by	WM
Checked by	PC
Project No.	44023
Scale	AS SHOWN
Date	05/31/2024


GREENMAN PEDERSEN, INC. 3 EAST 17TH STREET, SUITE 202, SUFFERN, NY 10901	
Mechanical & Electrical Engineer:	Structural Engineer:

NORTH ROCKLAND HIGH SCHOOL EXTENSION BOILER REPLACEMENT	HIGH SCHOOL EXT SEDA# 50-02-01-08-0-010-037	COUNTY OF ROCKLAND
65 Chapel Street Garnettville, NY 10883		




© COPYRIGHT, MICHAEL SHILALE ARCHITECTS, ALL RIGHTS RESERVED.
Drawing Title
MECHANICAL DETAILS
- 2

Drawing No.
M-502

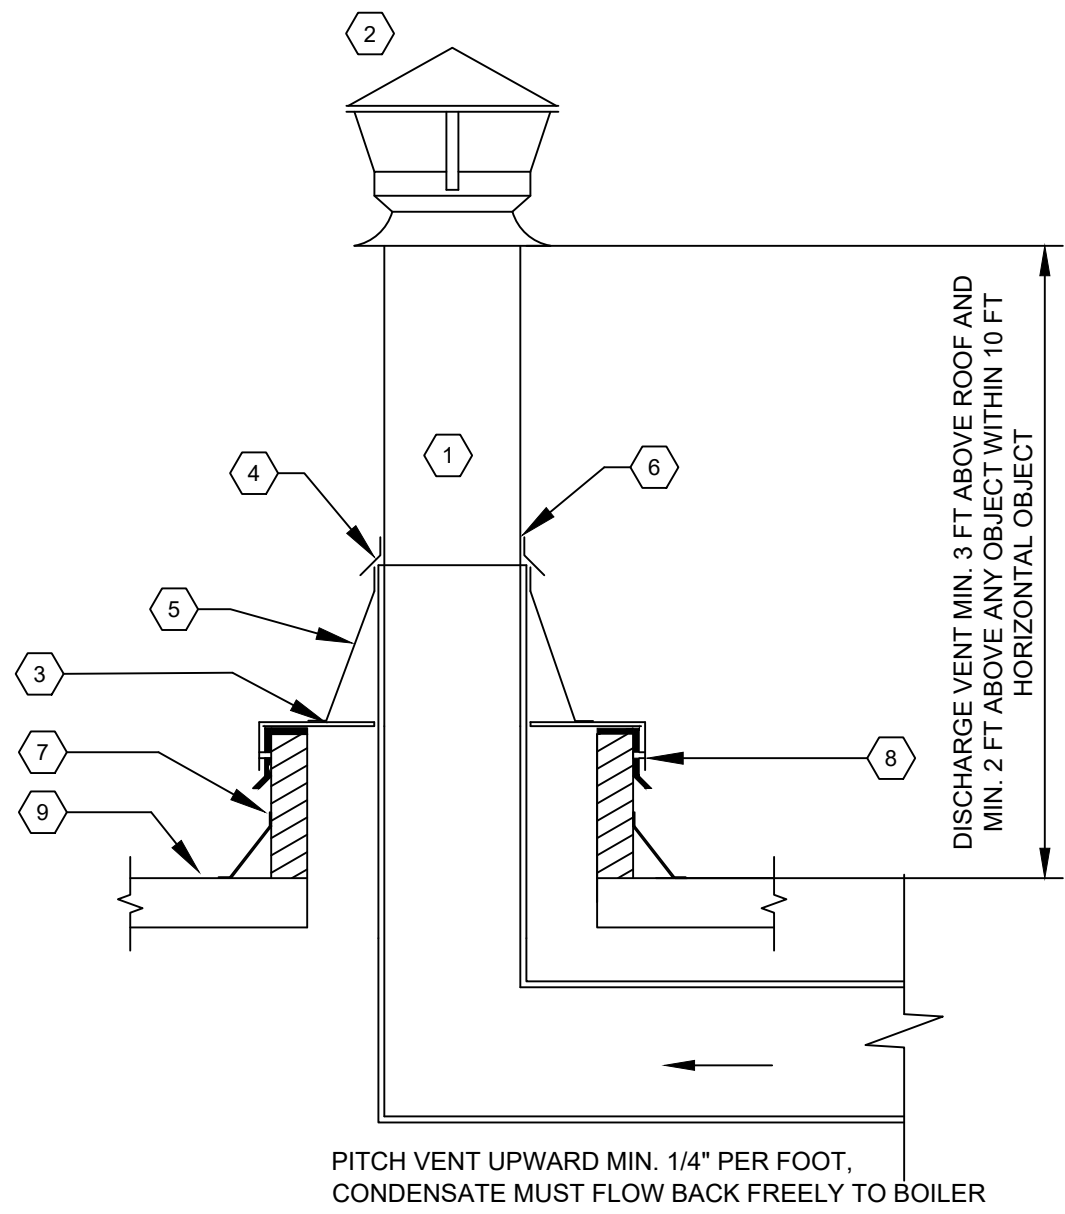


- 1 DOUBLE WALL FLUE PIPE
- 2 STACK CAP
- 3 MODIFIED ENCLOSURE OVER ROOF OPENING. REFER TO ARCH PLANS FOR ADDITIONAL DETAILS
- 4 STORM COLLAR
- 5 TALL CONE FLASHING
- 6 SILICONE SEALANT, AS REQUIRED, COORDINATE SEALING DETAILS WITH ARCHITECT.
- 7 EXISTING ROOF CURB AND FLASHING, COORDINATE ROOFING DETAILS WITH ARCHITECT.
- 8 LAG TO CURB, COORDINATE CURB CONNECTION DETAILS WITH ARCHITECT.
- 9 EXISTING ROOF CONSTRUCTION.

1 DOUBLE WALL FLUE PIPE DETAIL
SCALE: NONE

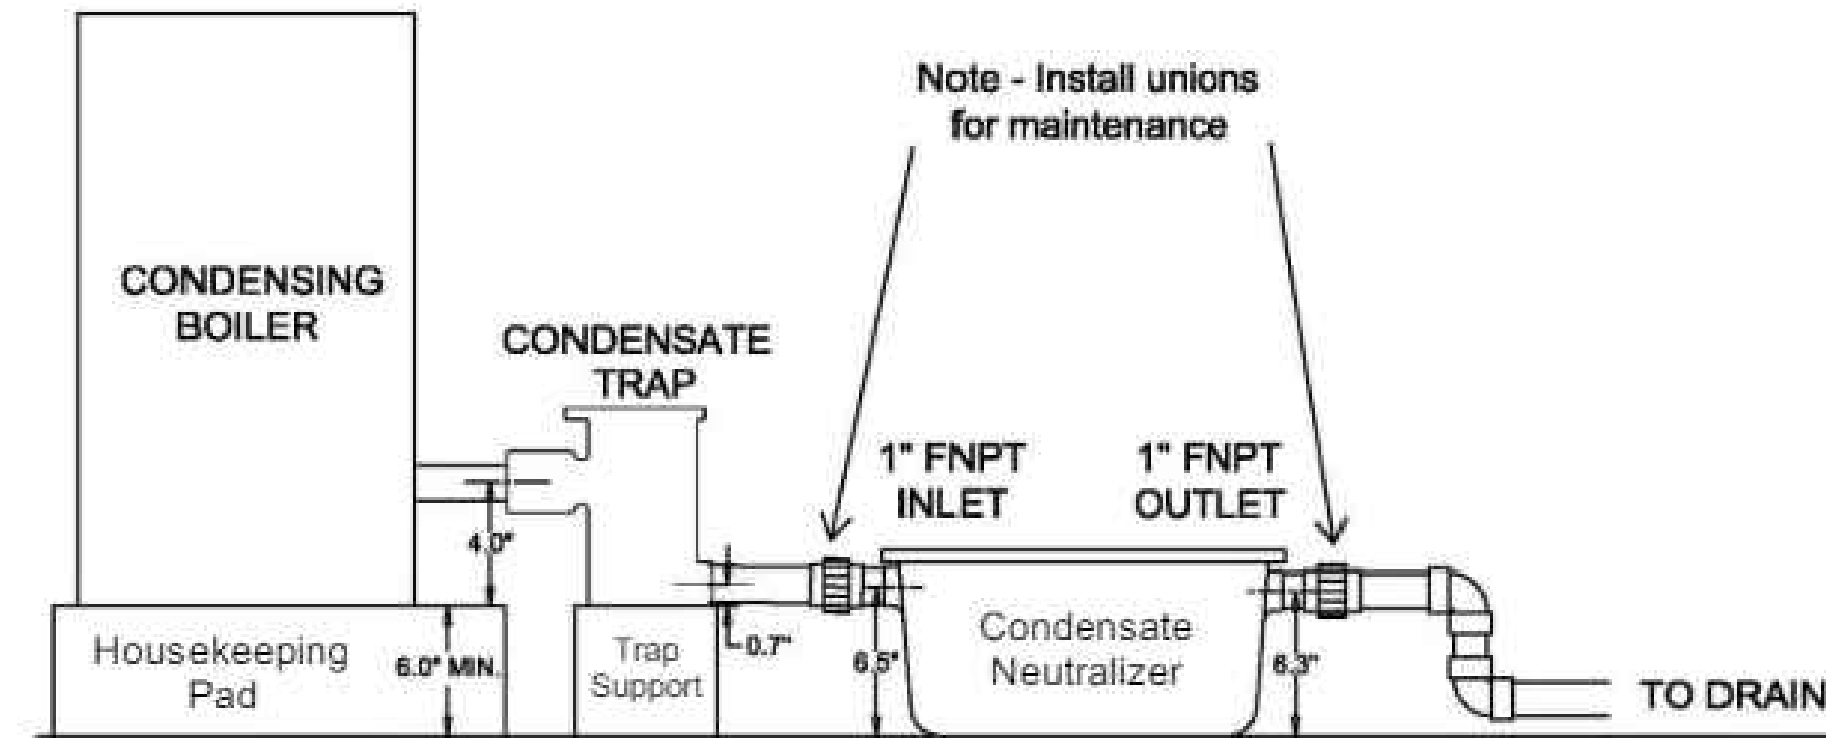


2 CONDENSATE NEUTRALIZER DETAIL
SCALE: NONE

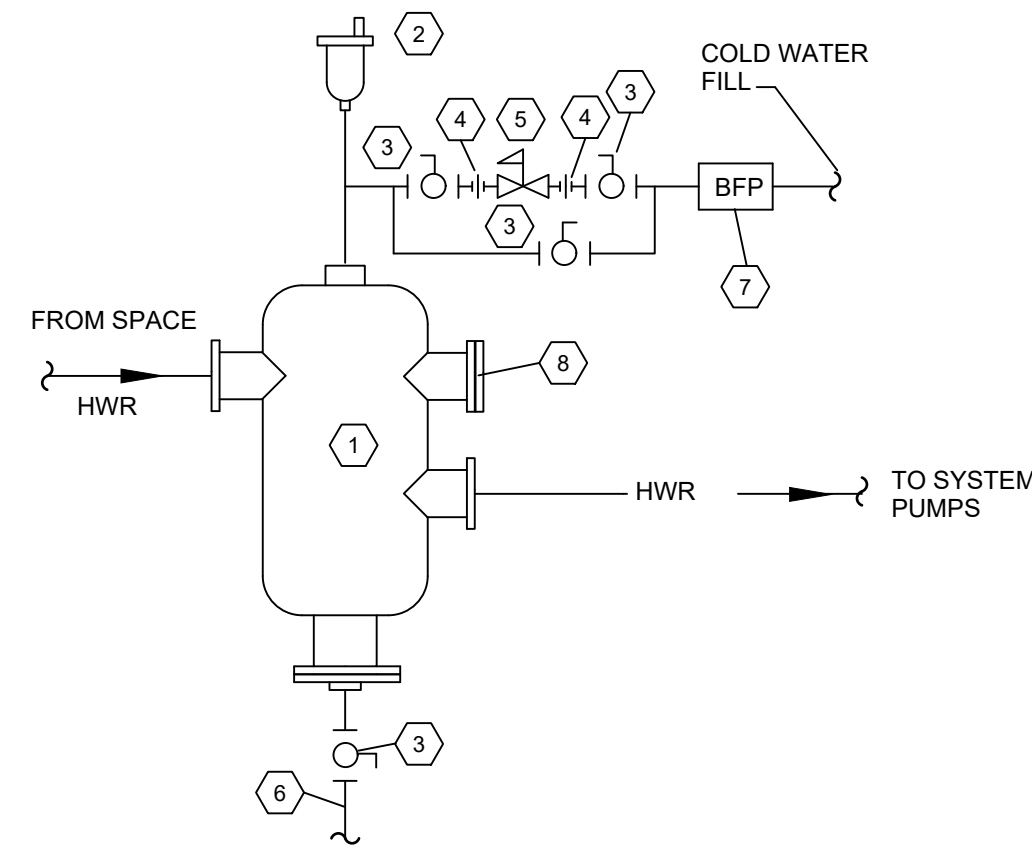


- 1 AIR SEPARATOR
- 2 HIGH CAPACITY FLOAT TYPE AIR VENT
- 3 BALL VALVE
- 4 UNION
- 5 REDUCING VALVE WITH CHECK VALVE
- 6 1\"/>

3 AIR SEPARATOR PIPING DETAIL
SCALE: NONE

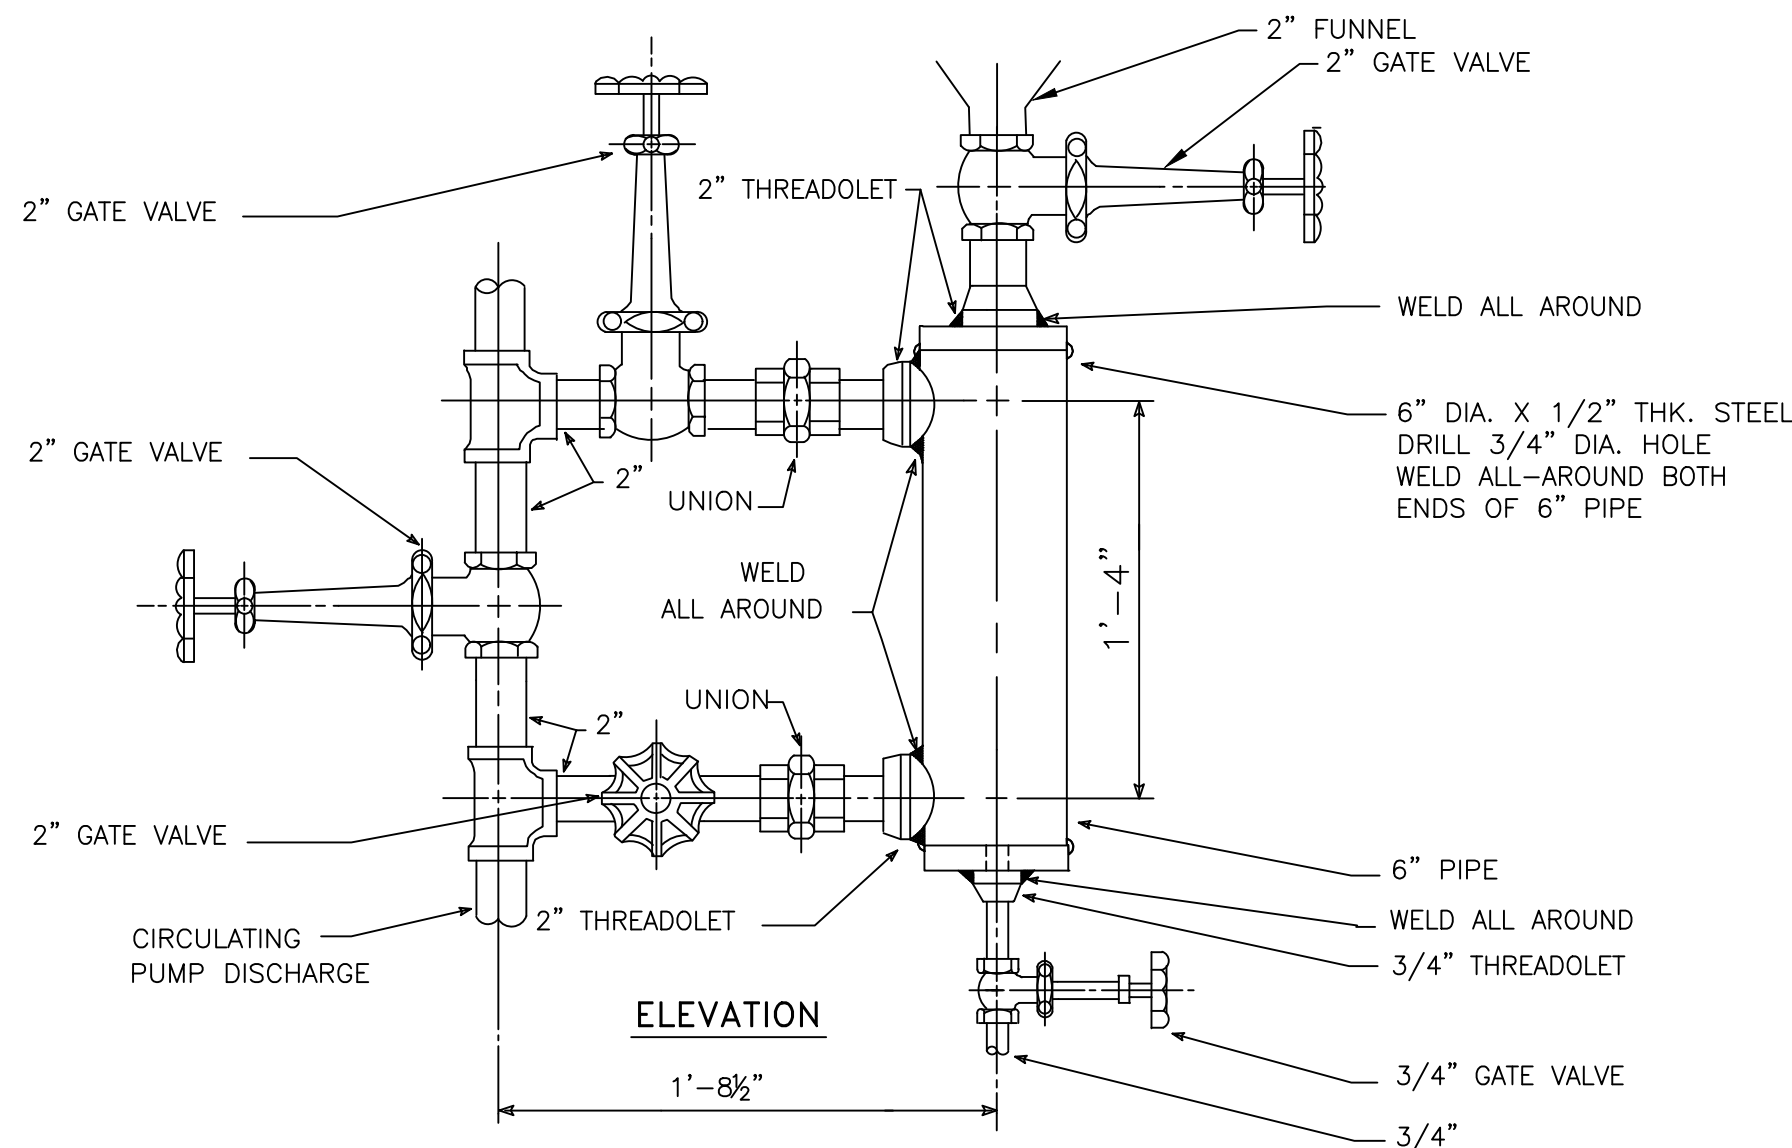

4 WATER TREATMENT SHOT FEEDER
SCALE: NONE

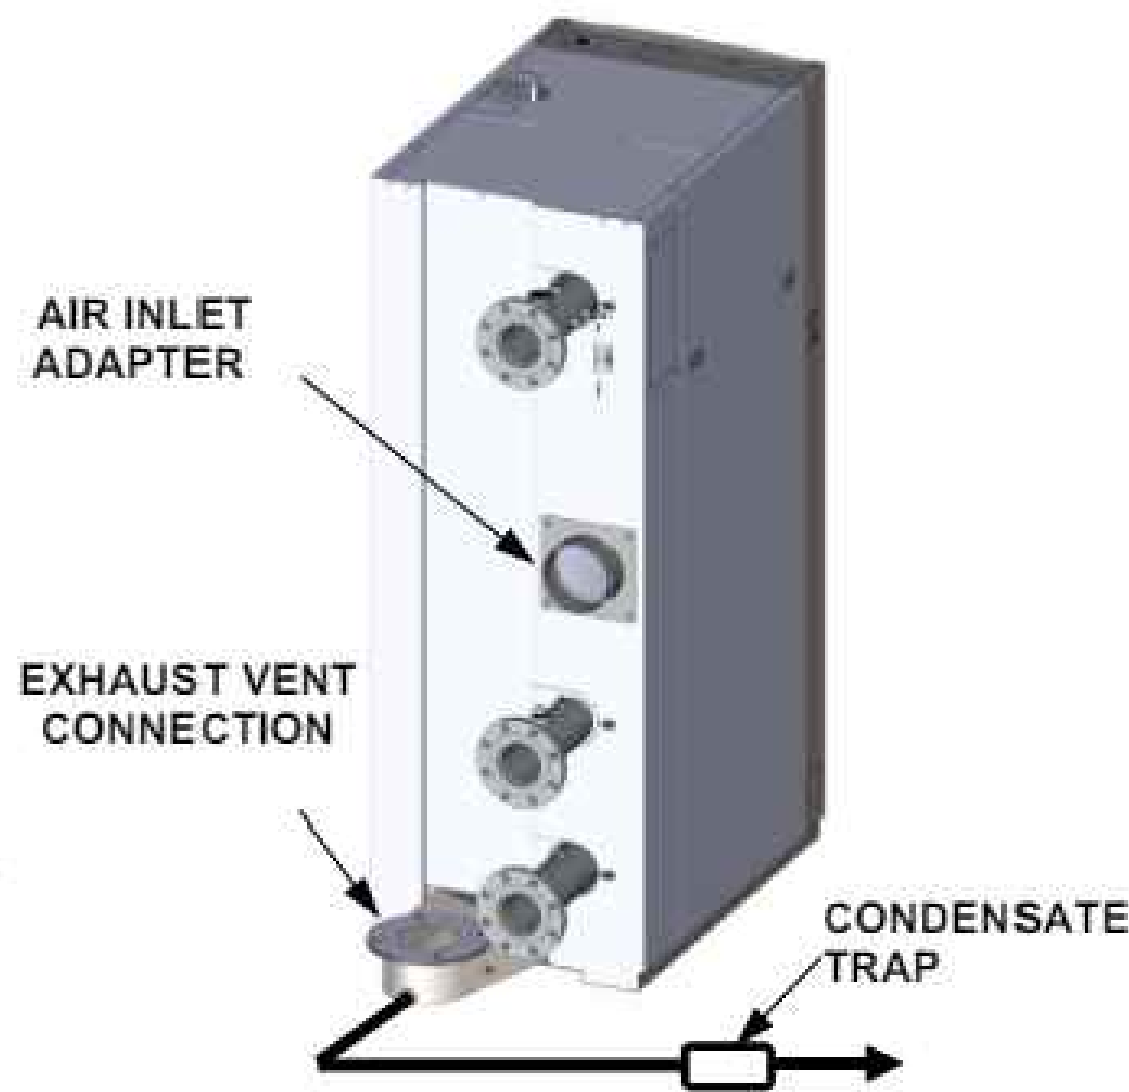

5 BOILER INTAKE AND EXHAUST VENT CONNECTION
SCALE: NONE


No.	Date	Revisions
1	05/31/24	BIDDING DOCUMENTS



Drawn by	WM
Checked by	PC
Project No.	44023
Scale	AS SHOWN
Date	05/31/2024

Mechanical & Electrical Engineer:	GREENMAN PEDERSEN, INC. 3 EAST 17TH STREET, SUITE 202 NEW YORK, NY 10011
Structural Engineer:	

NORTH ROCKLAND HIGH SCHOOL EXTENSION BOILER REPLACEMENT
HIGH SCHOOL EXT SBD# 50-02-01-06-0-016-037
65 Chapel Street Greenwich, NY 10623
COUNTY OF ROCKLAND

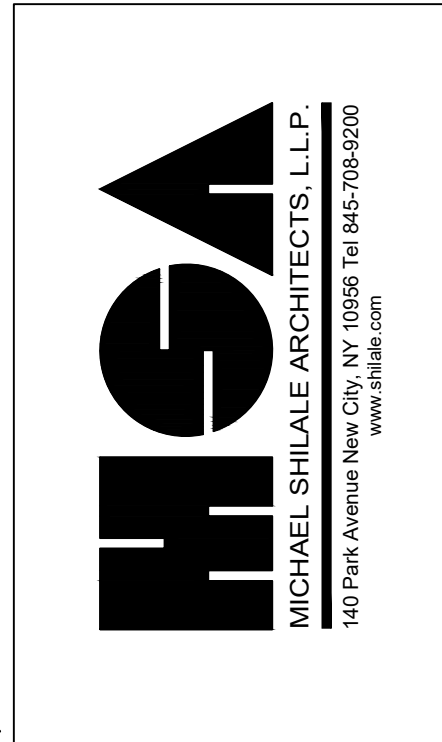

Drawing Title MECHANICAL DETAILS - 3	Drawing No. M-503
---	-----------------------------

© COPYRIGHT, MICHAEL SHILALE ARCHITECTS, ALL RIGHTS RESERVED.

POWER & SYSTEMS

SYMBOL	DESCRIPTION
	CONDUIT AND WIRE RUN CONCEALED IN FLOOR, CEILING OR WALL FOR NEW CONSTRUCTION AND SURFACE EXISTING WALLS. HASH MARKS DENOTE NUMBER OF WIRES IF MORE THAN TWO ARE REQUIRED. ARROWS DENOTE HOME-RUNS OF PARTICULAR CIRCUITS. MINIMUM 2#12+1#12G THHN/THWN IN 3/4" CONDUIT U.O.I. ALL BRANCH CIRCUITS FOR 120V IF GREATER THAN 100 FEET SHALL BE ONE SIZE LARGER MINIMUM, AND FOR 277V IF MORE THAN 200 FEET ONE SIZE LARGER MINIMUM (BOTH TO MEET VOLTAGE DROP REQUIREMENTS)
PNL-1	"PNL" INDICATES PANEL DESIGNATION AND "1" INDICATES CIRCUIT NUMBER. CIRCUIT WIRE SHALL BE MINIMUM 2#12+1#12G THHN/THWN IN 3/4" CONDUIT, U.O.I. ALL COMPUTER CIRCUIT SHALL ALSO BE PROVIDED WITH A SEPARATE NEUTRAL.
	LIGHTING AND POWER PANEL BOARD, FLUSH MOUNTED IN WALL WITH COVER.
$\$a$	SINGLE POLE, LINE-VOLTAGE TOGGLE SWITCH MOUNTED AT 48" A.F.F. SUBSCRIPT DENOTES LIGHTING FIXTURES CONTROLLED. 'k' INDICATES KEY OPERATED SWITCH. '3' INDICATES THREE-WAY SWITCH. 'vs' INDICATES INTEGRATED WITH OCCUPANCY (IN VACANCY MODE) SENSOR (MANUAL ON/AUTOMATIC OFF). 'oc' INDICATES INTEGRATED WITH OCCUPANCY SENSOR (AUTOMATIC ON/OFF). '1h' INDICATES LIGHTED HANDLE SWITCH. 'a' INDICATES LIGHTING FIXTURES CONTROL. 'e' INDICATES CONTROL OF EMERGENCY LIGHTING FIXTURE WITHIN THE ROOM OR SPACE INDICATED. REFER TO LIGHTING DWGS FOR LOCATION OF SWITCHES.
$\$La$	LOW VOLTAGE DECORA STYLE SWITCH FOR OCCUPANCY SENSOR IN VACANCY MODE (MANUAL 'ON'/AUTOMATIC OFF) MOUNTED AT 48" A.F.F. SUBSCRIPT INDICATES LIGHTING FIXTURES CONTROL.
S_D	LOW VOLTAGE SWITCH. 'D' DENOTES AN OVER-RIDE FOUR POSITION PUSH BUTTON SWITCH SET TO ON/OFF, 30%, 70% AND 100%, REFER TO LIGHTING DWGS FOR LOCATION OF SWITCHES. MOUNT AT 48" A.F.F.
S_{2D}	LOW VOLTAGE SWITCH. '2D' DENOTE AN OVER-RIDE TWO POSITION PUSH BUTTON SWITCH ON/OFF BUTTON WITH SLIDER FOR DIMMING
S_{DP}	LOW VOLTAGE THREE-WAY DIMMING PAD SWITCH
S_H	"SIVOIA QS" LOW VOLTAGE PUSHBUTTON SWITCH CONTROL MOUNTED AT 48" A.F.F. SUBSCRIPT "H" INDICATES WINDOW SHADES CONTROL.
$\$R/L$	THREE POSITION KEY ACTIVATED RAISE & LOWER CONTROL SWITCH MOUNTED AT 48" A.F.F.
S_{WP}^M	MOTOR STARTER SNAP ACTION TOGGLE SWITCH WITH THERMO OVERLOAD. "WP" INDICATES WEATHER PROOF
	DUPLEX THREE WIRE GROUND RECEPTACLE, 20A, 125V, (NEMA 5-20R) MOUNTED 18" A.F.F. U.O.I. SUBSCRIPT "F" INDICATES FURNITURE MOUNTED. SUBSCRIPT "K" INDICATES SAFETY TYPE, "S" INDICATES SURGE SUPPRESSOR, "R" RACK MOUNTED, "SW" INDICATES SWITCHED (CONTROLLED), NUMERAL INDICATES CIRCUIT NUMBER.
	DUPLEX THREE WIRE GROUND RECEPTACLE, 20A, 125V, (NEMA 5-20R) WITH "GFI" GROUND FAULT INTERRUPTER, MOUNTED 18" A.F.F. U.O.I. SUBSCRIPT "F" INDICATES FURNITURE MOUNTED, "WP" INDICATES WEATHER PROOF, NUMERAL INDICATES CIRCUIT NUMBER.
	SINGLE THREE WIRE GROUND RECEPTACLE, 20A, 125V, (NEMA 5-20R) MOUNTED 18" A.F.F. U.O.I. SUBSCRIPTS "30" INDICATES 30A (NEMA 5-30R) OUTLET, "L" INDICATES TWISTLOCK OUTLET. NUMERAL INDICATES CIRCUIT NUMBER.
	QUAD, THREE WIRE GROUND RECEPTACLE, 20A, 125V, (NEMA 5-20R) MOUNTED 18" A.F.F. U.O.I. SUBSCRIPTS "R" INDICATES FURNITURE MOUNTED, "S" INDICATES SURGE SUPPRESSOR, "R" INDICATES RACK MOUNTED, SUBSCRIPT "K" INDICATES SAFETY TYPE, "SW" INDICATES SWITCHED (CONTROLLED), NUMERAL INDICATES CIRCUIT NUMBER.
	SINGLE THREE WIRE GROUND RECEPTACLE, 20A, 250V, (NEMA L6-20R) MOUNTED 18" A.F.F. U.O.I. SUBSCRIPTS "R" INDICATES FURNITURE MOUNTED, "30" INDICATES 30A (NEMA L6-30R) OUTLET, "L" INDICATES TWISTLOCK OUTLET. NUMERAL INDICATES CIRCUIT NUMBER.
	DUPLEX THREE WIRE GROUND RECEPTACLE, 20A, 125V, (NEMA 5-20R) CEILING MOUNTED. "P" INDICATES MOUNTED AT CEILING WITH PULL-DOWN SAFETY REEL. NUMERAL INDICATES CIRCUIT NUMBER.
	DUPLEX THREE WIRE GROUND RECEPTACLE, 20A, 125V, (NEMA 5-20R) WITH "GFI" GROUND FAULT INTERRUPTER STANCHION MOUNTED 18" A.F.F. U.O.I. "WP" INDICATES WEATHERPROOF, NUMERAL INDICATES CIRCUIT NUMBER.
	COMBINATION DISCONNECT SWITCH/MOTOR STARTER W/ PUSH BUTTON STATIONS AND H-O-A. STARTER RATING AS PER HORSEPOWER OF THE MOTOR INDICATED.
	MOTOR STARTER WITHOUT DISCONNECT SWITCH, WITH PUSH BUTTON STATIONS & H-O-A. STARTER RATING AS PER HORSEPOWER OF THE MOTOR INDICATED.
	SWITCH RATING DISCONNECT SWITCH, RATING AND FUSING NOTED. HORSEPOWER RATING AS REQUIRED BY MOTOR LOAD. "WP" INDICATES WEATHERPROOF NEMA 4X ENCLOSURE, OTHERWISE NEMA 1. SUBSCRIPT "L" INDICATES LOCKABLE TYPE.
VFD	VARIABLE FREQUENCY DRIVE CONTROL PANEL WITH DISCONNECT SWITCH.
PB	PULL BOX. SIZE AS REQUIRED.
SS	REMOTE START - STOP PUSH BUTTON CONTROL
R	RELAY CONTROL
TK	TORK TIME CLOCK WITH DAY LIGHT SAVINGS AND FOR 360 DAYS SCHEDULING FEATURES
PC	PHOTOELECTRIC SENSOR - ROOF MOUNTED. LOCATION TO BE DETERMINED BASED ON FIELD CONDITION.

GENERAL NOTES:

2. ALL ELECTRICAL WORK SHALL BE DONE IN COMPLIANCE WITH 2020 NYS BUILDING CODE, NATIONAL ELECTRIC CODE 2017 AND ALL OTHER APPLICABLE CODE & LOCAL LAWS AS REQUIRED.
3. THE CONTRACTOR SHALL CHECK THE LOCATION, NUMBER AND SIZE OF ALL CHASES PROVIDED ON THE CONSTRUCTION PLANS AND ARRANGE FOR ANY CHASES REQUIRED FOR CABINET OR BOXES.
4. THE CONTRACTOR SHALL COORDINATE WITH THE HVAC, PLUMBING, ARCHITECTURAL AND STRUCTURAL TRADES FOR EXACT LOCATIONS OF MOTORS AND EQUIPMENT, IN ORDER TO AVOID INTERFERENCE.
5. THE CONTRACTOR SHALL CHECK WITH THE HVAC TRADE CONCERNING THE LOCATION OF STEEL PLATE FIRE STOPS IN CORRIDORS AND HUNG CEILING. FIRE SHALL FURNISH THE HVAC TRADE WITH SIZES AND LOCATIONS OF OPENINGS NECESSARY TO ACCOMMODATE THE ELECTRICAL CONDUITS PIERCING THE FIRE STOPS.
6. IN UNFINISHED PORTIONS OF THE BUILDING, SUCH AS BOILER ROOM, FAN ROOMS, PIPE SPACES, ETC., LOCATIONS OF CONDUIT AND OUTLETS ARE APPROXIMATE AND SHALL CLEAR PIPING AND ALL OTHER CONSTRUCTION. CONDUIT IN THESE PORTIONS OF THE BUILDING SHALL BE RUN EXPOSED.
7. IN THE BOILER ROOM, SYSTEM CONDUITS, SUCH AS FOR LIGHTING AND POWER FEEDERS, LOW VOLTAGE, FIRE SIGNAL, ETC., SHALL NOT BE RUN OVER BOILERS.
8. NO CONDUIT SHALL BE RUN IN ANY FLOOR IN CONTACT WITH THE EARTH UNLESS OTHERWISE DIRECTED ON THE PLAN. IN SUCH AREAS, CONDUIT FOR MOTORS AND STARTERS SHALL BE RUN OVERHEAD, SUPPORTED AS REQUIRED.
9. PULL AND JUNCTION BOXES SHALL BE SURFACE TYPE IN UNFINISHED AREAS AND FLUSH TYPE IN FINISHED AREAS (AT NEW WALLS/PARTITIONS), UNLESS OTHERWISE NOTED. THE JUNCTION AND PULL BOXES SHALL BE LOCATED TO SUIT CONDUIT RUN IN ALL BUT BE IN ALL BUT BE LOCATED TO AVOID INTERFERENCE WITH EQUIPMENT FROM OTHER TRADES AND SHALL BE LOCATED SO THAT COVERS ARE READILY ACCESSIBLE.
10. UNLESS OTHERWISE NOTED ON FLOOR PLANS OR IN FLOOR PLAN NOTES, SWITCHES SHALL BE INSTALLED AT 4'-0" ABOVE FINISHED FLOOR. WHERE SWITCH HEIGHTS ARE GIVEN ON THESE DRAWINGS FOR AREAS IN WHICH THERE ARE TILE WAINSCOTS, SUCH AS TOILETS, LOCKER ROOMS, ETC. THE CONTRACTOR SHALL ADJUST SWITCH HEIGHTS, IF NECESSARY TO AVOID INTERFERENCE WITH THE WAINSCOT.
11. CONTRACTOR SHALL PROVIDE SEPARATE RACEWAYS FOR CONDUCTORS ON NORMAL AND EMERGENCY CIRCUITS.
12. PROVIDE FIRE STOP SEALS TO ALL PENETRATIONS OF ALL EXISTING FLOORS, SLABS, AND WALLS/PARTITIONS, AND ALL NEW FIRE RATED WALLS & PARTITIONS.
13. PROVIDE DEFLECTION FITTINGS AT ALL REQUIRED CROSSINGS OF EXPANSION POINTS.
14. ALL CIRCUITS CONTAINING GFI OUTLETS AND CIRCUITS RECOMMENDED BY THE MANUFACTURERS SHALL HAVE A SEPARATE DEDICATED NEUTRAL.
15. ALL COMPONENTS SHOWN ON RISER DIAGRAMS, BUT NOT ON THE PLAN OR VICE VERSA, SHALL BE INCLUDED AS IF SHOWN ON BOTH.
16. CONTRACTOR SHALL NOT INSTALL MORE THAN 3 CURRENT CARRYING CONDUCTORS IN A RACEWAY UNLESS OTHERWISE SPECIFICALLY INDICATED ON THE DRAWINGS.
17. THE ELECTRICAL CONTRACTOR SHALL REVIEW ALL TRADES CONTRACT DOCUMENTS TO DETERMINE SPECIFIC MOUNTING LOCATIONS FOR ELECTRICAL EQUIPMENT.
18. ALL MOUNTING HEIGHTS SHALL BE MEASURED FROM FINISHED FLOOR TO

ABBREVIATIONS

A	AMPERE	KWH	KILOWATT HOUR
AC	ALTERNATING CURRENT	LP	LIGHTING PANEL
AF			
AFF	FUSE RATING IN AMPS	LTG	LIGHTING
AHU	ABOVE FINISHED FLOOR	MCC	MOTOR CONTROL CENTER
ARCH	AIR HANDLING UNIT	MECH	MECHANICAL
	ARCHITECTURAL	MER	MECHANICAL EQUIPMENT ROOM
ATS	SWITCH RATING IN AMPS		
	AUTOMATIC TRANSFER SWITCH	MLO	MAIN LUG ONLY
C		MTD	MOUNTED
	CONDUIT	N	NEUTRAL
CB	CIRCUIT BREAKER	N.C.	NORMALLY CLOSED
CLG	CEILING	N.O.	NORMALLY OPEN
CKT(S)	CIRCUIT(S)	P	POLE(S)
COL	COLUMN	PB	PULL BOX
		PNL	PANEL
DWG	DRAWING	PP	POWER PANEL
E	EXISTING TO REMAIN	PWR	POWER
ER	EXISTING TO BE REMOVED	RC	REMOTE CONTROL
ERR	EXISTING TO BE RELOCATED	REL	RELOCATED
		RG	RIGID GALVANIZED CONDUIT
EC	EMPTY CONDUIT		
		SECT	SECTION
EF	EXHAUST FAN	SP	SPARE
		SPR	SPARE
		STD	STANDARD
EXH	EXHAUST	SUR	SURFACE
FL	FLOOR	SW	SWITCH
		SWBD	SWITCHBOARD
G	GUARD		
GND	GROUND		
GFI	GROUND FAULT INTERRUPTER		
IG	ISOLATED GROUND	TP	TYPICAL
IB	INTERACTIVE WHITE BOARD	UOI	UNLESS OTHERWISE INDICATED
JWB	JUNCTION BOX	V	VOLT
		VAV	VARIABLE AIR VOLUME
KVA	KILOVOLT AMPERE	W	WATT
KW	KILOWATT	WP	WEATHER PROOF
ACFI	ARC FAULT CIRCUIT INTERRUPTER		

NOTE - ALL THE ABOVE ABBREVIATIONS MAY NOT BE USED

CENTERLINE OF DEVICES EXCEPT FOR EXIT SIGNS.

19. RIGID NONMETALLIC CONDUIT (RNMIC) SHALL NOT BE INSTALLED WITHIN THE BUILDING FOOTPRINT UNLESS OTHERWISE INDICATED.
20. NO CONDUIT IN THE BUILDING SHALL BE IN CONTACT WITH THE EARTH UNLESS OTHERWISE NOTED.
21. CONTRACTOR SHALL BE RESPONSIBLE FOR IDENTIFYING EACH CKT IN ALL MANHOLES, HAND HOLES, WIRE WAYS & ALL OTHER ENCLOSURES & AT ALL TERMINATION.
22. ALL SERVICE ENTRANCE CONDUITS ARE TO BE PITCHED AS REQUIRED AND SEALED AT THE POINT OF ENTRY INTO THE BUILDING IN ORDER TO AVOID WATER PENETRATION TO THE BUILDING THROUGH THESE CONDUITS.
23. FINAL LOCATION OF ALL ELECTRICAL EQUIPMENTS, DEVICES SHALL BE COORDINATED AT FIELD WITH ALL OTHER TRADES AND WITH EXISTING BUILDING ELEMENTS, PIPES, EQUIPMENTS, DEVICES ETC. IN ORDER TO HAVE CODE COMPLIANT INSTALLATION.
28. ROUTING OF ELECTRICAL CONDUITS IF SHOWN IN THE DRAWINGS ARE TENTATIVE. THE CONTRACTOR IS RESPONSIBLE TO FINALIZE THE ROUTING OF ALL ELECTRICAL CONDUITS AT FIELD IN COORDINATION WITH ALL OTHER TRADES AND EXISTING BUILDING ELEMENTS, STRUCTURES, PIPES, EQUIPMENTS, & DEVICES ETC. FOR CODE COMPLIANT INSTALLATION.
29. THE ELECTRICAL CONTRACTOR IS REQUIRED TO COORDINATE WITH THE MECHANICAL CONTRACTOR DURING THE MECHANICAL EQUIPMENT SUBMITTAL REVIEW PROCESS IN ORDER TO VERIFY THE REQUIREMENT OF INSTALLING NEUTRAL WIRE IN THE CONDUIT TO FEED ALL HVAC EQUIPMENT SUCH AS ROOF TOP UNIT PRIOR TO INSTALLATION OF THE WIRES IN CONDUIT.
30. THE ELECTRICAL CONTRACTOR IS RESPONSIBLE TO COORDINATE WITH OTHER TRADES AT FIELD SO THAT NO FOREIGN SYSTEM SUCH AS PIPING, DUCT, LEAK PROTECTION APPARATUS, OR OTHER EQUIPMENT FOREIGN TO THE ELECTRICAL INSTALLATION SHALL BE RUN OVER THE ELECTRICAL EQUIPMENT INSTALLATION.
31. THE CONTRACTOR IS REQUIRED TO PERFORM CONTINUITY AND INSULATION RESISTANCE TEST BY MEGGER FOR ALL FEEDERS AND BRANCH CIRCUITS BEING INSTALLED AND BEING MODIFIED UNDER THIS PROJECT.

ELECTRICAL CONSTRUCTION NOTES

1. CONTRACTOR SHALL MAINTAIN UNINTERRUPTED POWER SUPPLY TO THE SCHOOL BUILDING DURING THE CONSTRUCTION. POWER IS TO BE MAINTAINED AT ALL TIMES, UNLESS OTHERWISE INSTRUCTED, ALONG WITH THE ADEQUATE POWER SUPPLY FOR THE CONCURRENT CONSTRUCTION AND MAINTENANCE PROJECTS.
2. THE MAINTENANCE OF POWER SUPPLY INCLUDES BOTH THE OVERALL POWER SERVICE TO THE BUILDING AS WELL AS LOCAL POWER SUPPLY TO THE SCHOOL AREAS TEMPORARILY AFFECTED BY THE WORK OF THIS CONTRACT. THE CONTRACTOR SHALL COORDINATE ALL HIS WORK WITH THE SCHOOL.
3. PROVIDING UNINTERRUPTED POWER SERVICE TO THE ENTIRE BUILDING AND POWER SUPPLY TO SCHOOL AREAS TEMPORARILY AFFECTED BY THE WORK OF THIS CONTRACT SHALL BE ACCOMPLISHED BY VARIOUS MEANS SUCH AS TEMPORARY BYPASS FEEDERS, TEMPORARY SWITCHES SUPPLYING PERMANENT FEEDERS, ETC.
4. THE CONTRACTOR SHALL ARRANGE TO WORK CONTINUOUSLY, INCLUDING OVERTIME, IF REQUIRED, TO ASSURE THAT SERVICES WILL BE SHUTDOWN ONLY DURING THE TIME ACTUALLY REQUIRED TO MAKE THE NECESSARY DISCONNECTIONS/RECONNECTIONS TO EXISTING WORK.
5. THE CONTRACTOR SHALL GIVE THIRTY DAYS WRITTEN NOTICE IN ADVANCE TO THE SCHOOL OF ANY REQUIRED SHUTDOWN, INCLUDING THE ESTIMATED PERIOD.
6. THE CONTRACTOR IS REQUIRED TO COORDINATE WITH THE SCHOOL FACILITY TO ARRANGE FOR A METERED POWER FOR CONSTRUCTION PURPOSE BASED ON A RATE DEFINED BY THE FACILITY. THE CONTRACTOR IS RESPONSIBLE FOR THE TEMPORARY CONSTRUCTION POWER.

ELECTRICAL DEMOLITION NOTES

1. THE DEMOLITION WORK SHALL BE CARRIED ON IN EVERY RESPECT IN A THOROUGH AND WORKMANLIKE MANNER.
2. ALL DEMOLITION, REMOVAL, AND DISPOSAL WORK SHALL BE IN COMPLIANCE WITH THE REQUIREMENTS OF THE BUILDING CODE AND WITH ALL STATE AND FEDERAL REGULATIONS.
3. REMOVE ALL DEBRIS NOT EXPLICITLY DESIGNATED TO BE SALVAGED (TO REMAIN) FROM THE PREMISES AND LEGALLY DISPOSE OFF AWAY FROM PREMISES.
4. ITEMS INDICATED TO BE SALVAGED SHALL BE REMOVED EITHER BEFORE DEMOLITION OR DURING THE PROCESS OF THE WORK, STORED AND PROTECTED ON THE SITE IN A LOCATION DESIGNATED BY THE OWNER'S REPRESENTATIVE. THESE ITEMS WILL BE IDENTIFIED AND RETAINED BY THE OWNER.
5. CAREFULLY REMOVE AND PROTECT ALL ITEMS TO BE SAVED AND REUSED AS INDICATED ON DRAWINGS. REPLACE ANY ITEMS THAT ARE DAMAGED BY REMOVAL AT YOUR OWN COST. NOTIFY THE OWNER IN WRITING OF ANY ITEM THAT IS DAMAGED PRIOR TO REMOVAL SO THAT THEY MAY ASCERTAIN THE ITEMS' CONDITION.
6. PROTECT MATERIALS, SURFACES AND STRUCTURE, WHICH ARE TO REMAIN, FROM DAMAGE; IF DAMAGE OCCURS, REPAIR OR REPLACEMENT SHALL BE MADE BY THE CONTRACTOR, TO THE SATISFACTION OF THE OWNER, AND AT THE EXPENSE OF THE CONTRACTOR.
7. DISCONNECT, REMOVE AND RELOCATE ANY ELECTRICAL EQUIPMENT NOT SHOWN ON THESE DRAWINGS AS PART OF THIS CONTRACT, BUT INTERFERES WITH THE WORK UNDER THIS CONTRACT. THIS WORK SHALL NOT BE CONSIDERED EXTRA AND SHALL BE DONE AT NO ADDITIONAL COST TO THE OWNER.
8. VISIT AND EXAMINE CAREFULLY THE AREAS AFFECTED BY THIS WORK TO BECOME FAMILIAR WITH EXISTING CONDITIONS AND WITH THE DIFFICULTIES THAT ATTEND THE EXECUTION OF THIS WORK
9. RELOCATE AND/OR ALTER THE EXISTING BUILDING COMPONENTS AS DIRECTED BY OWNER'S REPRESENTATIVE. ALL RELOCATION OR ALTERATIONS TO BUILDING SHALL BE RESTORED TO THEIR ORIGINAL WORKING CONDITIONS AFTER SUCH RELOCATION OR ALTERATION WORK.
10. AT THE COMPLETION OF DEMOLITION WORK, ALL RUBBISH, DEBRIS AND WASTE MATERIALS SHALL BE REMOVED BY THE CONTRACTOR AND THE PREMISES SHALL BE LEFT IN CLEAN CONDITION.
11. THE CONTRACTOR SHALL DISCONNECT THE CIRCUIT WIRING NOT IN USE AND SHALL REMOVE ALL NECESSARY WIRING MATERIALS, INCLUDING EXPOSED CONDUITS AND JUNCTION BOXES WHICH IMPEDE THE NEW WORK.
12. MAINTAIN CONTINUITY FOR ALL EQUIPMENT TO REMAIN. PROVIDE ALL REQUIRED ACCESSORIES, WIRING AND CONDUIT AS REQUIRED.
13. SUBSTANTIAL JOB COMPLETION INCORPORATES DEMOLITION OF EXISTING SYSTEMS IN CONTRACT.
14. THE EXISTING FIRE ALARM SYSTEM SHALL REMAIN OPERATIONAL AT ALL TIMES DURING CONSTRUCTION.
15. THE CONTRACTOR IS REQUIRED TO COORDINATE WITH GC AND ALL OTHER TRADES TO REVIEW THE EXISTING ELECTRICAL COMPONENTS, CONDUITS, DEVICES, PULL BOX, JUNCTION BOX ETC. THAT ARE ASSOCIATED WITH THE WALL THAT ARE BEING DEMOLISHED OR RESURFACED, REROUTE THE CONDUITS AND RELOCATE THOSE ELECTRICAL COMPONENTS AS REQUIRED AND FOR THE COMPLETION OF GC WORK. EXTEND CONDUIT WIRING AS REQUIRED TO REROUTING. MAINTAIN CIRCUIT CONTINUITY OF THE DEVICES THAT ARE BEING AFFECTED.

[illegible]

REG. EXP DATE: 10-31-26

Drawn by	AWF
Checked by	SH
Project No.	44023
Scale	AS SHOWN
Date	05/31/2024

Mechanical & Electrical Engineer:	GREENMAN PEDERSEN, INC 2 EXECUTIVE BOULEVARD SUITE 202, SUFFERN, NY 10901
Structural Engineer:	

**NORTH ROCKLAND HIGH
SCHOOL EXTENSION BOILER
REPLACEMENT**

HIGH SCHOOL EXT SED# 50-02-01-06-0-016-037

85 Chapel Street,
Garnerville, NY 10923





MICHAEL SHILALE ARCHITECTS, L.L.P.
140 Park Avenue New City, NY 10956 Tel 845-708-9200
www.shilale.com

© COPYRIGHT, MICHAEL SHILALE ARCHITECTS, ALL RIGHTS RESERVED.

Drawing Title	ELECTRICAL NOTES AND SYMBOLS
---------------	---------------------------------

Drawing No.

E-001

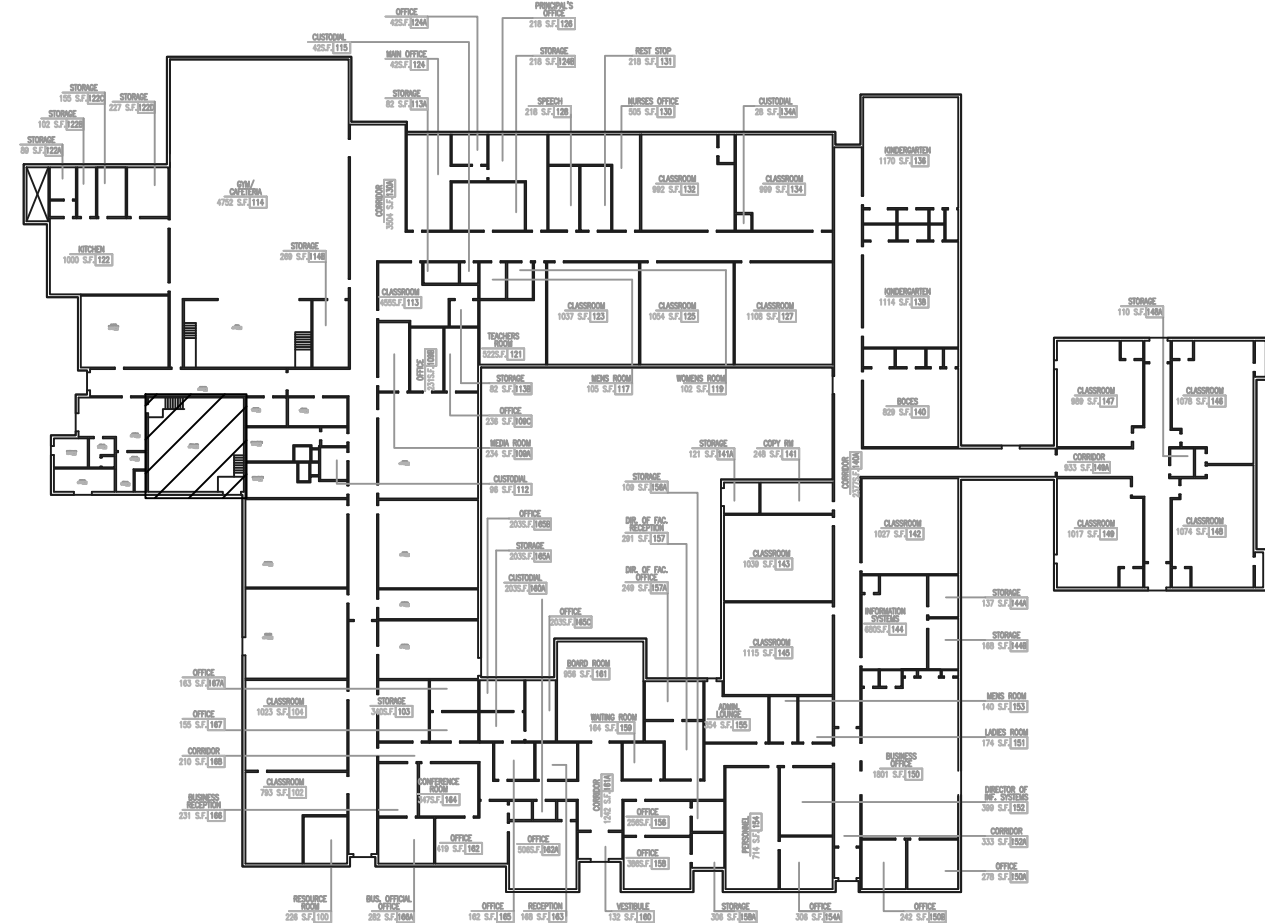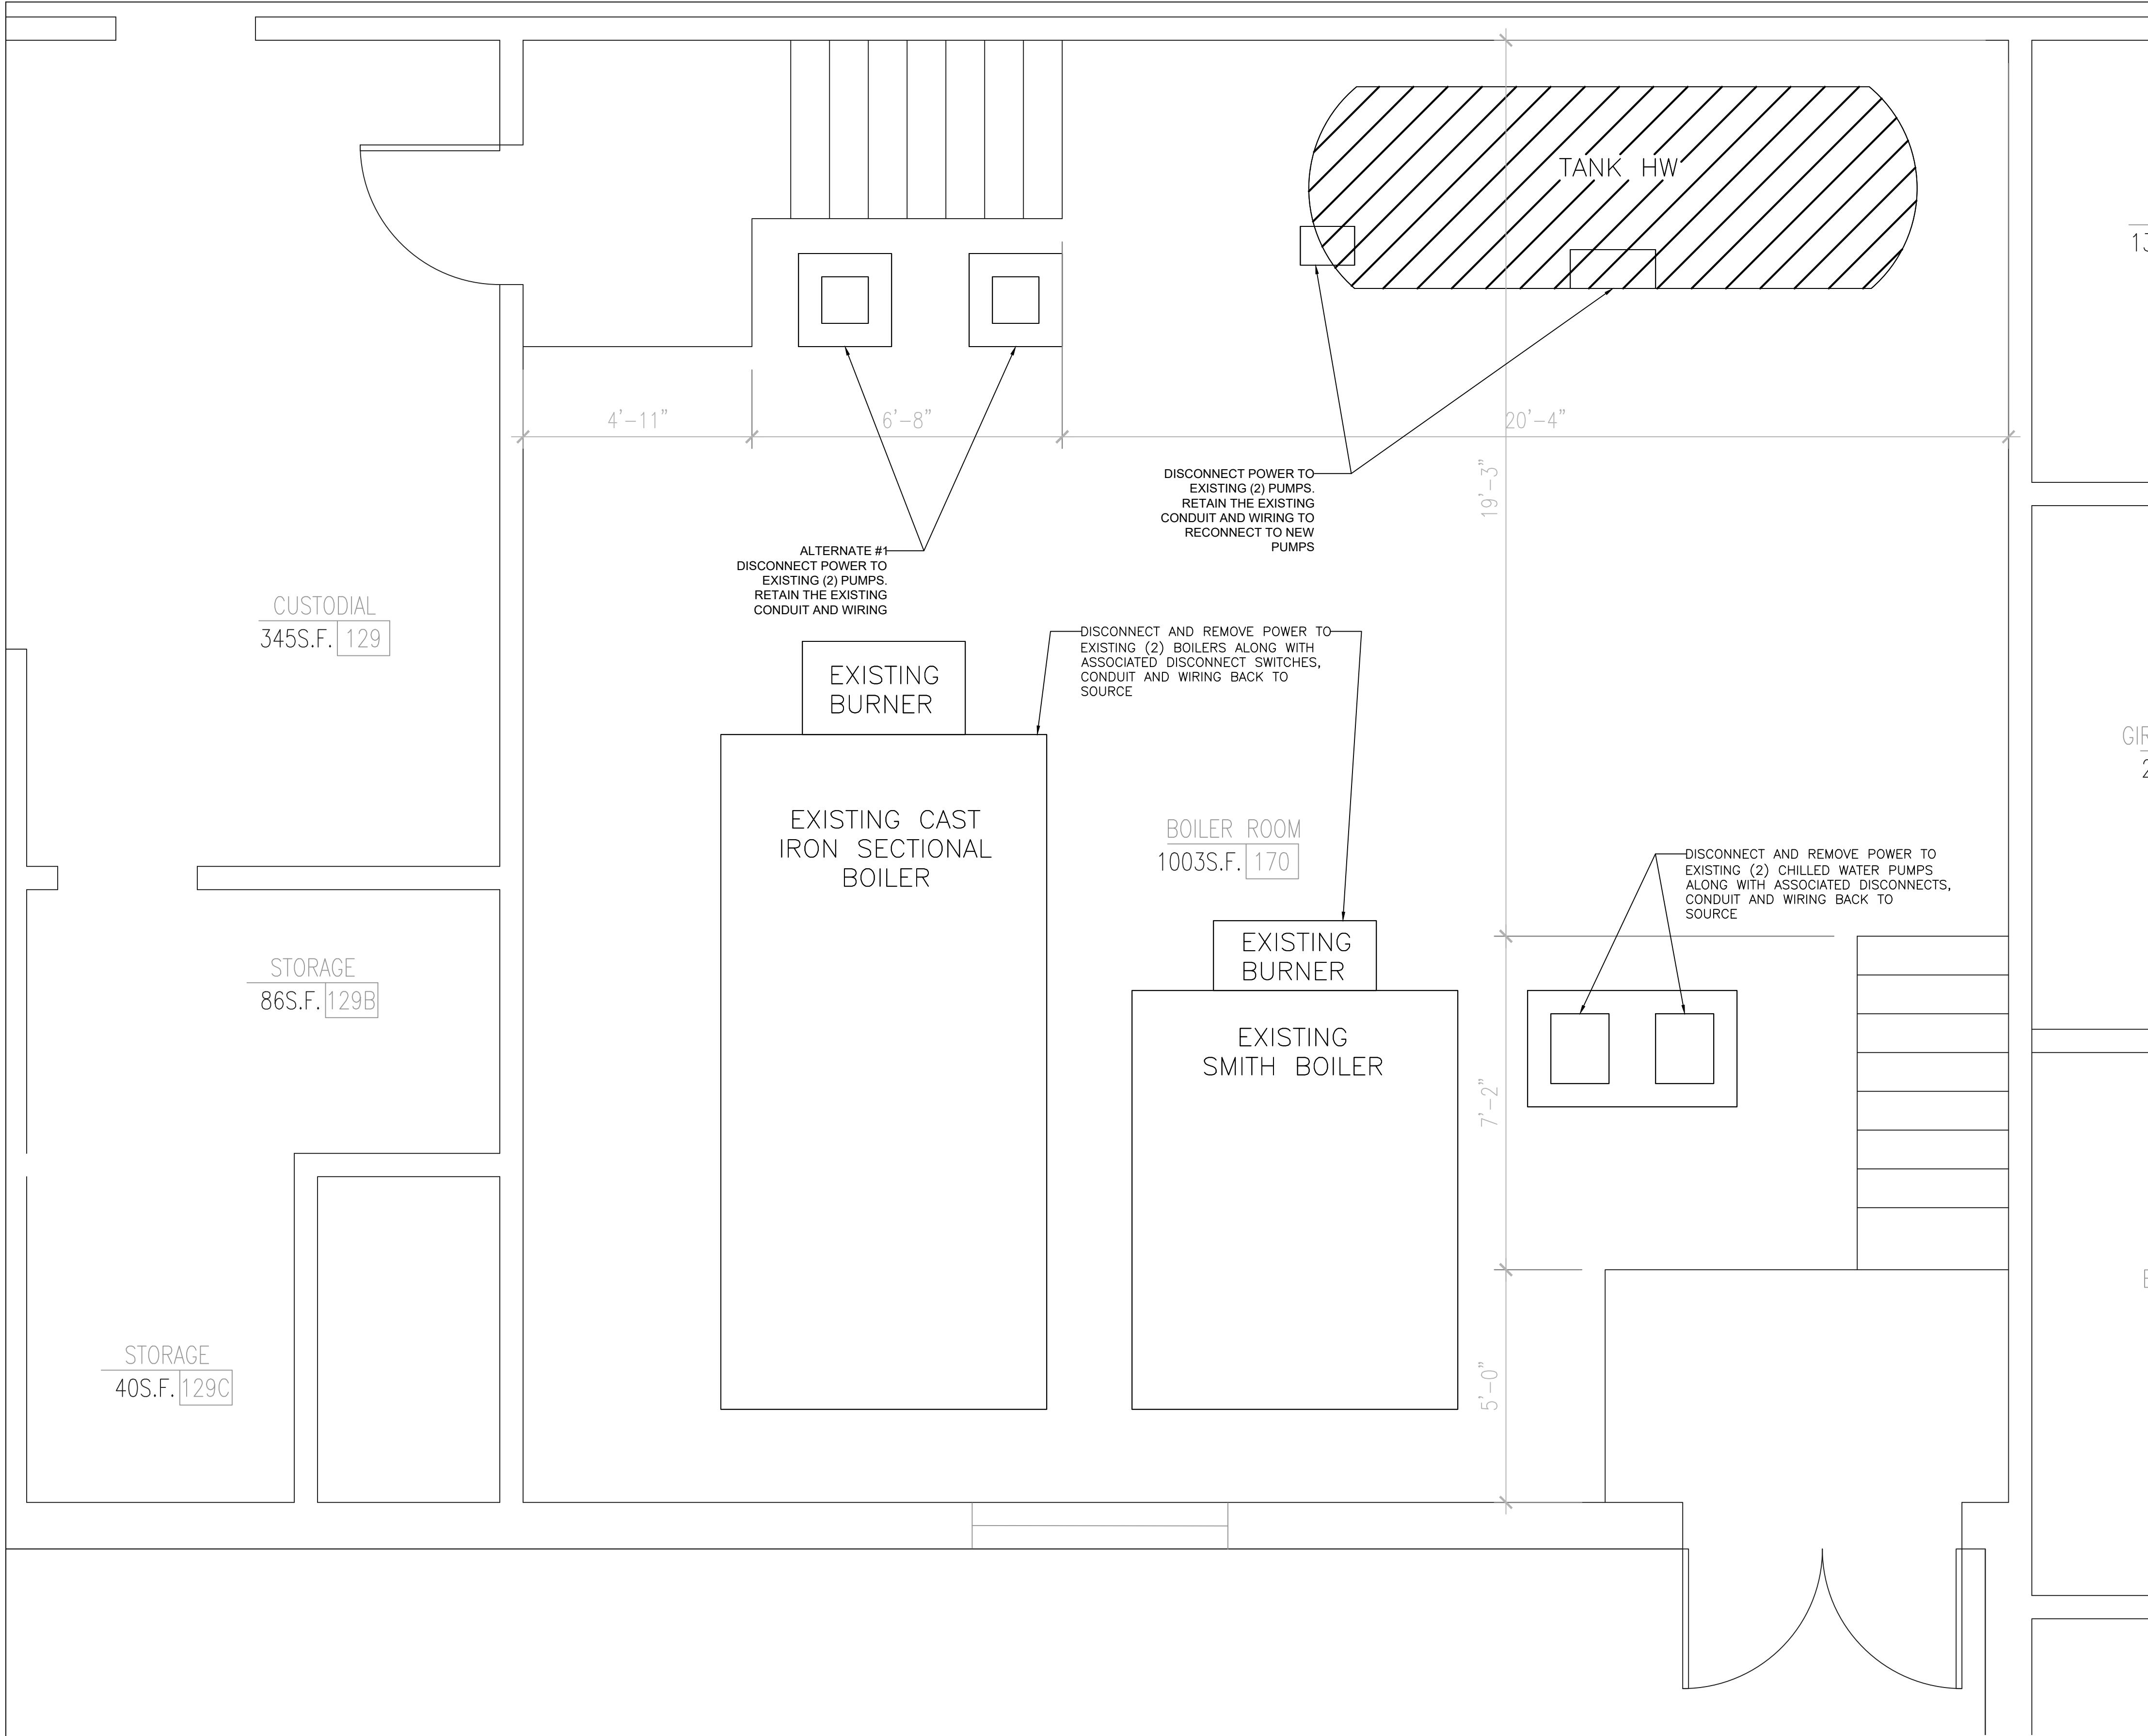

KEY PLAN

1 ELECTRICAL BOILER ROOM PLAN - REMOVAL
SCALE: 1/2" = 1'-0"



0 1/2 1
IF THIS BAR DOES NOT
MEASURE 1" THEN DRAWING IS
NOT TO FULL SCALE

Drawing Title
**ELECTRICAL
DEMOLITION PLAN**

Drawing No.
ED-101

MSA
MICHAEL SHILALE ARCHITECTS, LLP
140 Park Avenue New City, NY 10956 Tel 845-708-9200
www.shilale.com



**NORTH ROCKLAND HIGH
SCHOOL EXTENSION BOILER
REPLACEMENT**
HIGH SCHOOL EXT SEDA 50-02-01-06-0-016-037
45 Chapel Street
Greenburgh, NY 10623
COUNTY OF ROCKLAND

**GREENMAN
PEDERSEN, INC**
3 ROUTE 922, SUITE 202, SUFFERN, NY 10981
Mechanical
& Electrical
Engineer:
Structural
Engineer:

Drawn by AWF
Checked by SH
Project No. 44023
Scale AS SHOWN
Date 05/31/2024

REG. EXP DATE: 10-31-26


No.	Date	Revisions
1	05/31/24	BIDDING DOCUMENTS

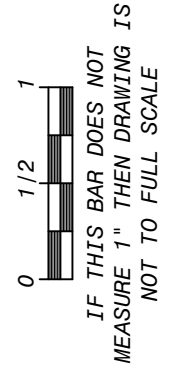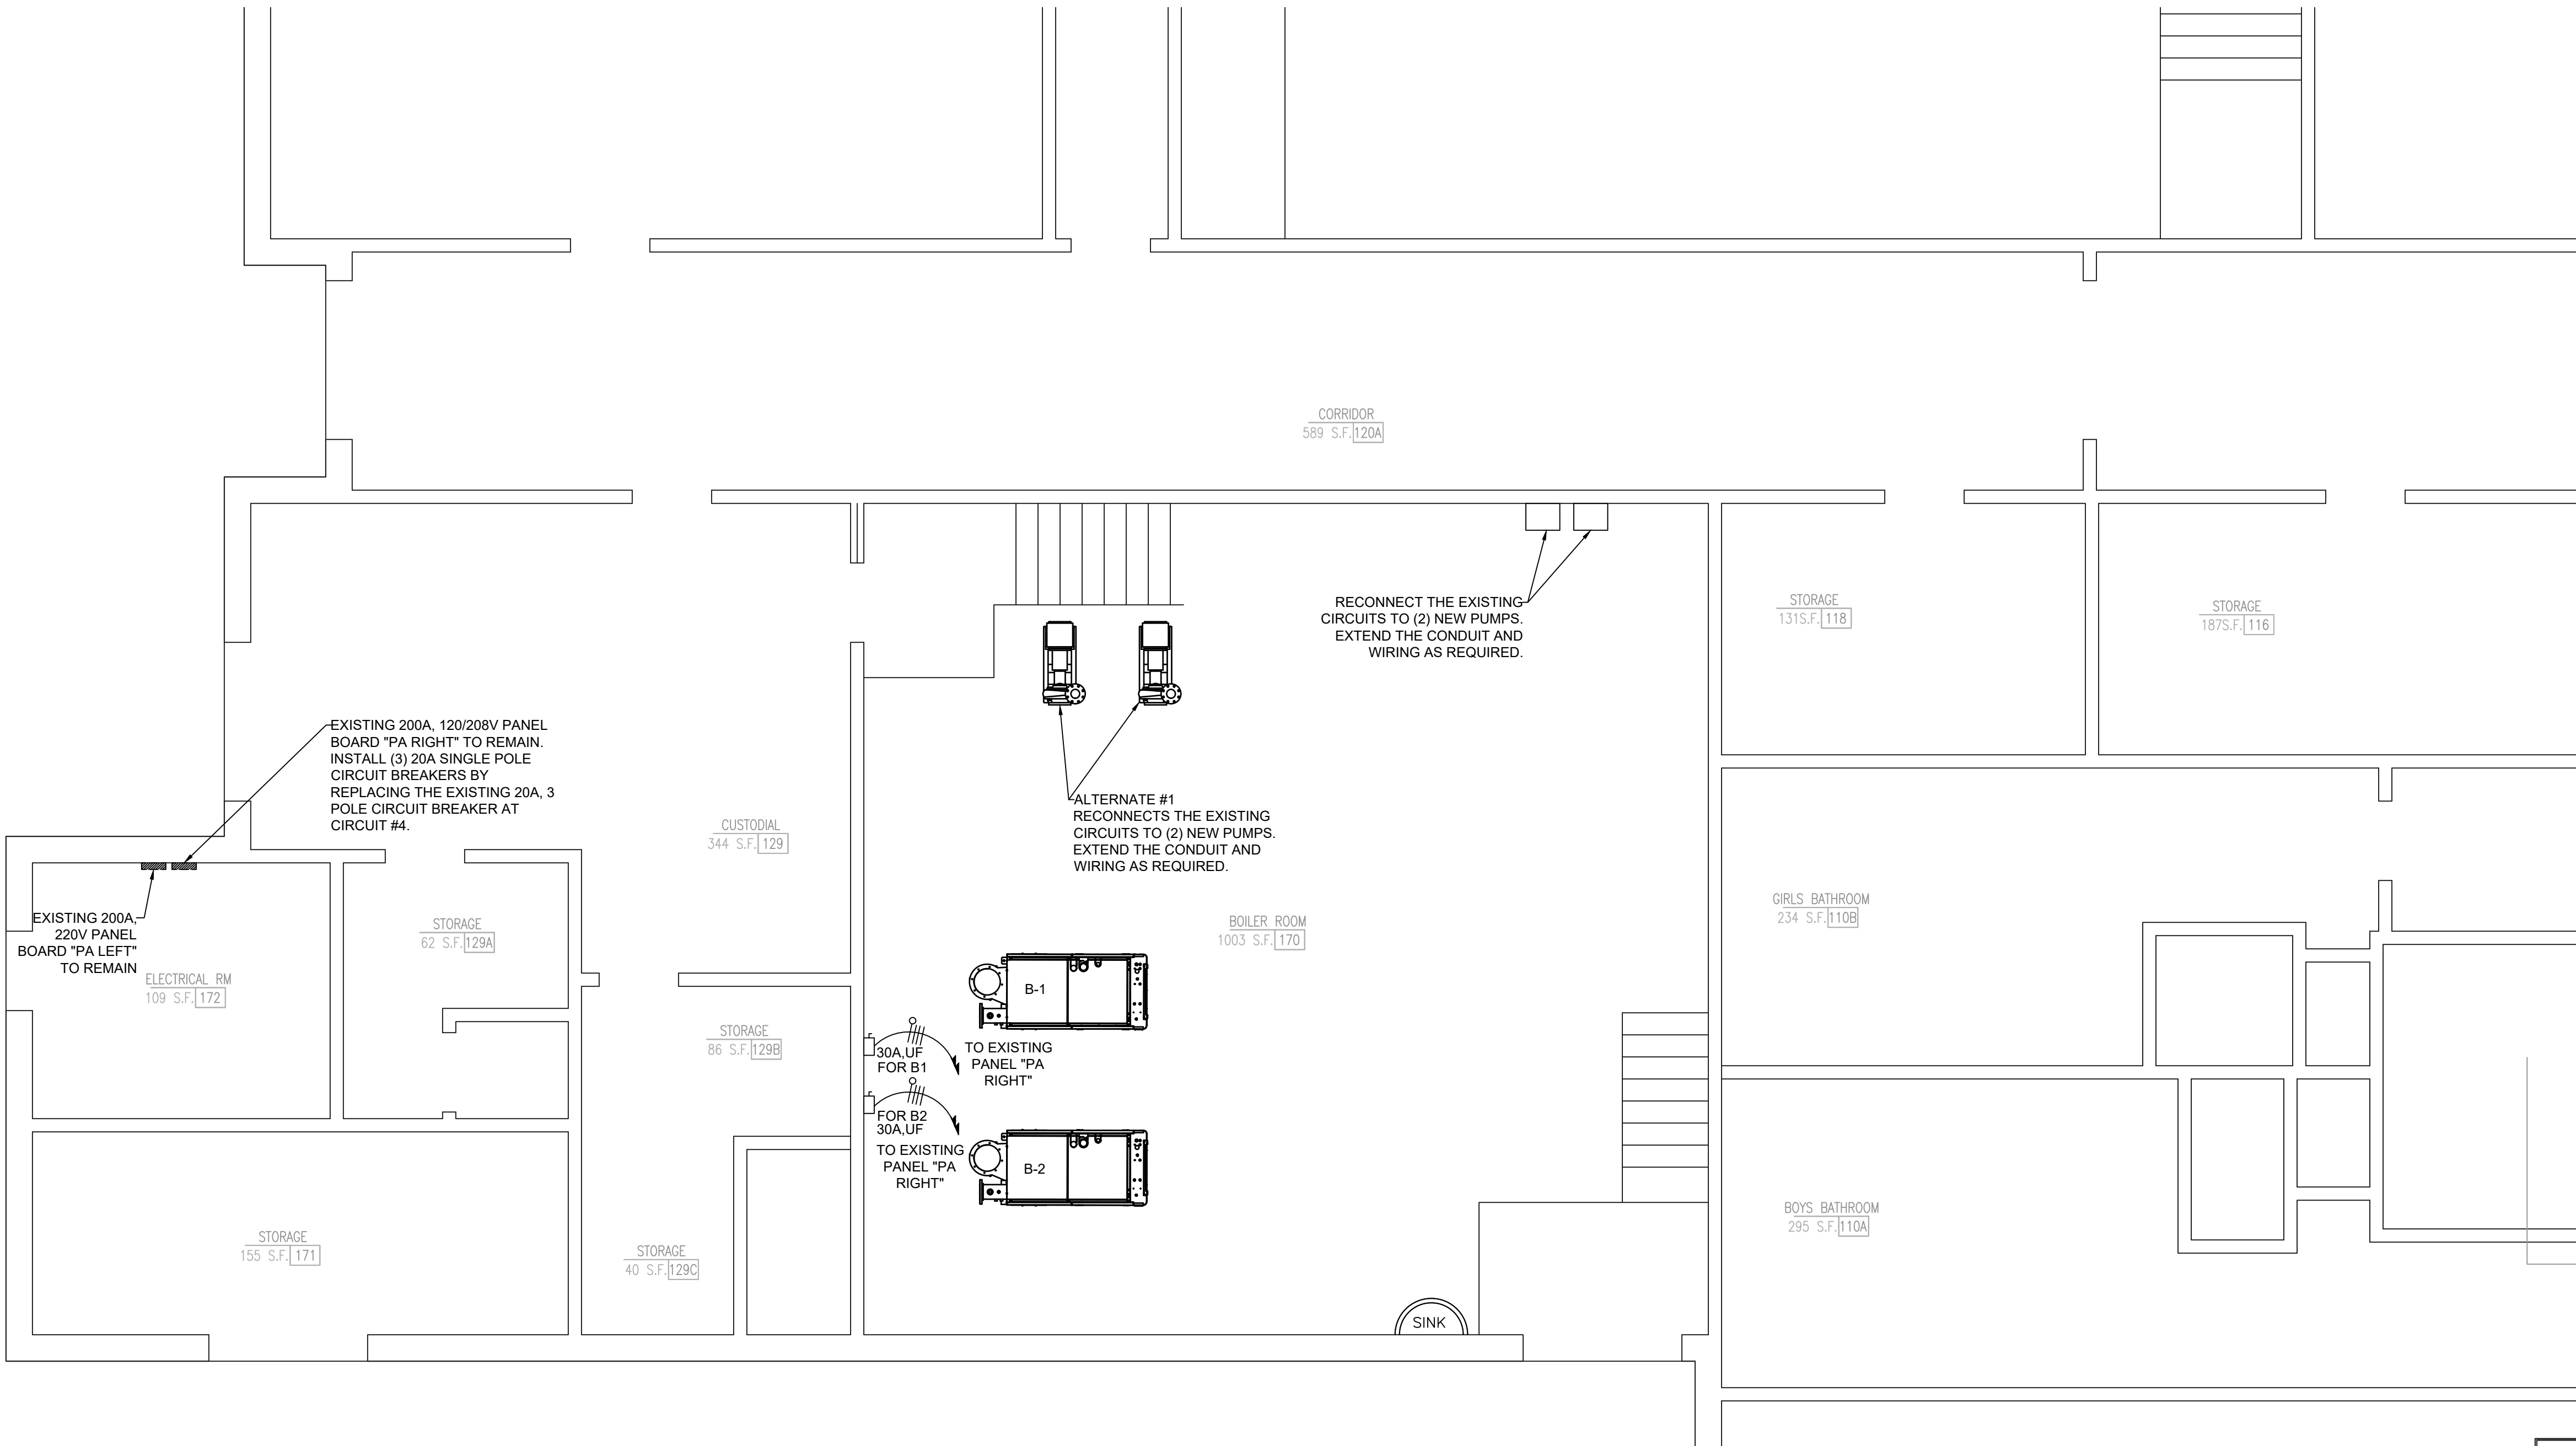

IF THIS BAR DOES NOT MEASURE 1" THEN DRAWING IS NOT TO FULL SCALE



PLAN NORTH

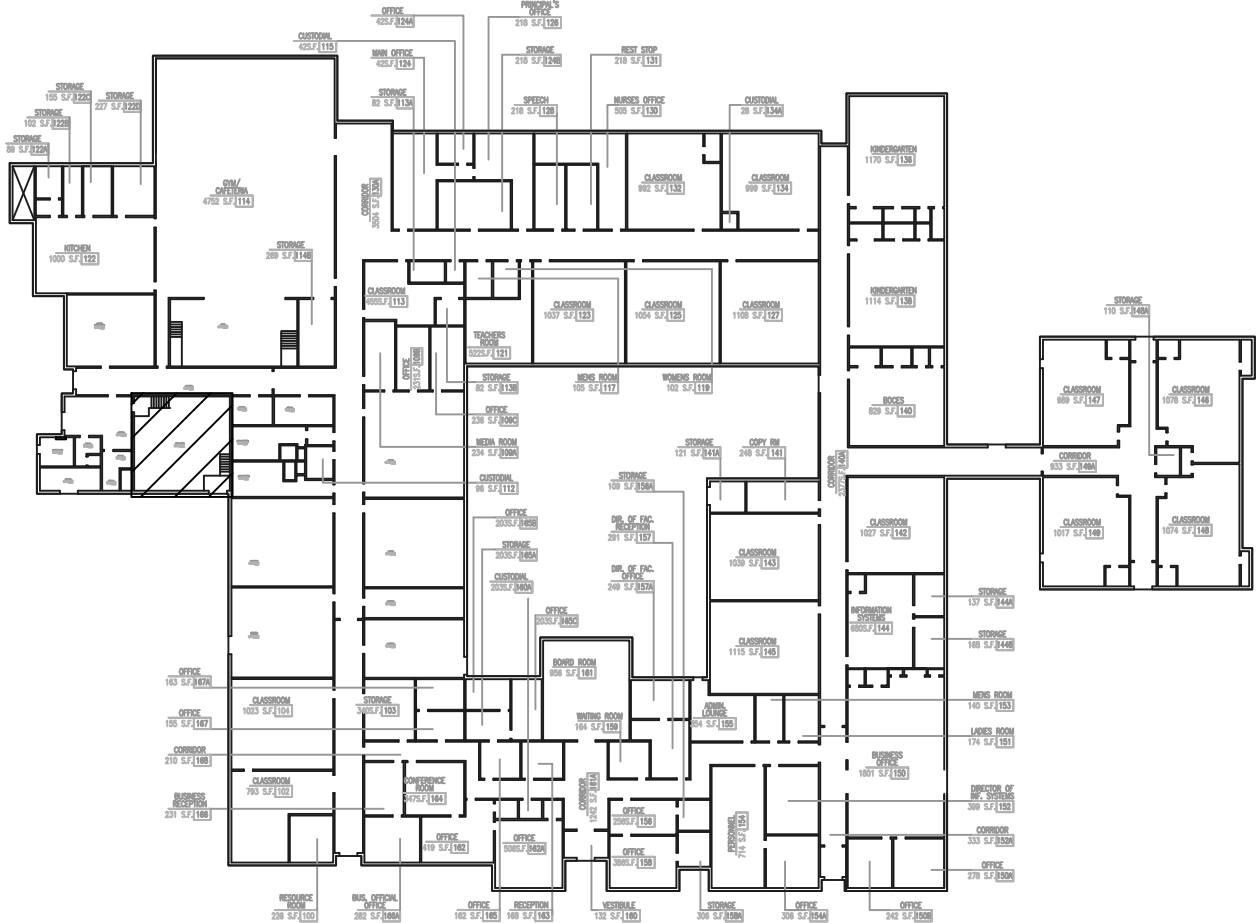

KEY PLAN

1

ELECTRICAL BOILER ROOM PLAN - NEW WORK

SCALE: 1/4" = 1'-0"

No.	Date	Revisions
1	05/31/24	BIDDING DOCUMENTS



REG. EXP. DATE: 10-31-26

Drawn by	AWF
Checked by	SH
Project No.	44023
Scale	AS SHOWN
Date	05/31/2024

MECHANICAL & ELECTRICAL ENGINEER:	STRUCTURAL ENGINEER:
GREENMAN PEDERSEN, INC 3 EAST 10TH AVE., SUITE 202 ROCKLAND, NY 10961	

NORTH ROCKLAND HIGH SCHOOL EXTENSION BOILER REPLACEMENT	HIGH SCHOOL EXT. SBD# 50-02-01-06-0-010-037
45 Chapel Street Greenwich, NY 10603	COUNTY OF ROCKLAND



MICHAEL SHILAIE ARCHITECTS, LLP
140 Park Avenue New City, NY 10956 Tel 845-708-9200
www.shilale.com


ELECTRICAL
INSTALLATION PLAN

Drawing No.
E-101

© COPYRIGHT, MICHAEL SHILAIE ARCHITECTS, ALL RIGHTS RESERVED.




- [illegible]

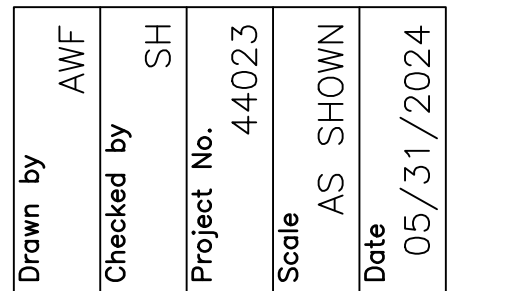

Mechanical & Electrical Engineer:	Structural Engineer:
-----------------------------------	----------------------

NORTH ROCKLAND HIGH
SCHOOL EXTENSION BOILER
REPLACEMENT

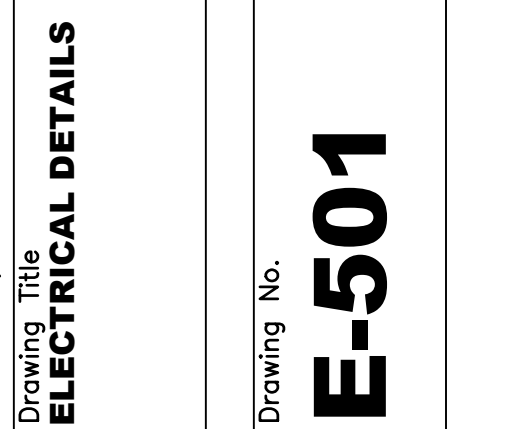

E-501