

CIRCUIT WIRING	
	HOME RUN TO PANEL "RP" INDICATES PANEL NO. & "1" INDICATES CIRCUIT NUMBER
	BRANCH CIRCUIT WIRING CONSISTING OF THIN COPPER CONDUCTORS RUN IN CONCEALED RACEWAY. IN AREAS WITH NO CEILING RUN OVERHEAD CONDUCTORS IN EXPOSED EMT. EQUIPMENT GROUNDING CONDUCTOR IS REQUIRED IN ALL CONDUIT/CABLE RUNS. CONTRACTOR SHALL RUN ANY RUN IN/CABLE (WHERE APPROVED BY CODE AND BY OWNER) IN WALLS & ABOVE CEILINGS IN FINISHED AREAS ONLY. CONTRACTOR IS RESPONSIBLE FOR DETERMINING QUANTITY OF CONDUCTORS IN RACEWAY.
	BRANCH CIRCUIT WIRING CONSISTING OF THIN COPPER CONDUCTORS IN APPROPRIATE RACEWAY. RUN UNDERGROUND, IN FLOOR SLAB, OR UNDER FLOOR.
	LOW VOLTAGE OR CONTROL WIRING CONSISTING OF THIN COPPER CONDUCTORS RUN IN EMT CONDUIT.
	BRANCH CIRCUIT WIRING CONSISTING OF CONDUCTORS RUN IN FLEXIBLE METAL CONDUIT TO LIGHTING FIXTURE OR MOTORIZED EQUIPMENT. RUN IN "SEALTITE" FOR ALL PUMP CONNECTIONS. 6'-0" MAX. UNSUPPORTED LENGTH FOR LIGHTING FIXTURES AND 30' FOR OTHER EQUIPMENT. THIS SYMBOL COULD ALSO REPRESENT A FLEXIBLE CORD FINAL CONNECTION TO LIGHT FIXTURES.

WIRING DEVICES	
(ALL WIRING DEVICES SHALL BE AS SPECIFIED OR APPROVED EQUAL. SHOP DRAWINGS ARE REQUIRED FOR ALL DEVICES; COLOR OF WIRING DEVICES AS PER ARCHITECT)	
	DUPLEX RECEPTACLE NEMA 5-20R; HUBBELL #HBL53621 (IVORY) IN SINGLE GANG BOX
	DOUBLE DUPLEX RECEPTACLE NEMA 5-20R (2); HUBBELL #HBL53621 (IVORY) IN TWO GANG BOX
	GROUND FAULT CIRCUIT INTERRUPTER DUPLEX RECEPTACLE, NEMA 5-20R; HUBBELL GF5352A (IVORY) IN SINGLE GANG BOX.
	GFI RECEPTACLE, NEMA 5-20R; HUBBELL #GF535201A (GRAY), WITH CARLON #90JVCN WEATHERPROOF COVER PLATE, (UL LISTED FOR "WET LOCATIONS" WHILE IN USE.)
	SPECIAL PURPOSE RECEPTACLE, NEMA CONFIGURATION PER DRAWINGS OR AS REQUIRED TO MATCH EQUIPMENT NAMEPLATE REQUIREMENTS.
	SINGLE POLE TOGGLE SWITCH; HUBBELL #1221, 20A-120/277V IN SINGLE GANG BOX
	SINGLE POLE MOTOR RATED TOGGLE SWITCH; HUBBELL #HBL78320, 30A, IN SINGLE GANG BOX
	TWO POLE MOTOR RATED SWITCH; #HBL13920, 30A, W/ ENCLOSURE
	THREE POLE MANUAL MOTOR CONTROLLER; HUBBELL #HBL7810UD, 30A, W/ ENCLOSURE
	SINGLE POLE MOTOR RATED TOGGLE SWITCH; HUBBELL #HBL78320, 30A IN SINGLE GANG WEATHERPROOF BOX WITH WEATHERPROOF COVER


POWER DISTRIBUTION	
	FUSED DISCONNECT SWITCH HEAVY DUTY TYPE. SEE DRAWINGS FOR SIZE, VOLTAGE AND FUSE SIZE. PROVIDE DUAL ELEMENT TIME DELAY TYPE RK5 FUSES
	NON FUSED DISCONNECT SWITCH HEAVY DUTY TYPE. SEE DRAWINGS FOR SIZE AND VOLTAGE
	COMBINATION STARTER AND C/B DISCONNECT HEAVY DUTY TYPE. SEE DRAWINGS FOR SIZES, HP AND VOLTAGE. FURNISHED AND INSTALLED BY E.C. UNLESS NOTED.
	PANEL BOARD SQUARE "D" # NQ FOR 208/120 VOLT 3Ø FOR BRANCH CIRCUIT PANEL BOARDS # NF FOR 480/277 VOLT 3Ø FOR BRANCH CIRCUIT PANEL BOARDS
	JUNCTION BOX
	JUNCTION BOX FOR HARD WIRE CONNECTION TO EQUIPMENT
	DRY-TYPE TRANSFORMER, 480-208/120V, 3Ø, OR AS NOTED ON DRAWINGS
	TRANSFER SWITCH

HVAC EQUIPMENT	
	MOTOR OR MOTORIZED EQUIPMENT - SEE DRAWINGS FOR EQUIPMENT POWER REQUIREMENTS (SEE NOTE BELOW)
	A/C UNIT - SEE DRAWINGS FOR EQUIPMENT POWER REQUIREMENTS (SEE NOTE BELOW)
	AIR HANDLER - SEE DRAWINGS FOR EQUIPMENT POWER REQUIREMENTS (SEE NOTE BELOW)
	HEATING ELEMENT - SEE DRAWINGS FOR EQUIPMENT POWER REQUIREMENTS (SEE NOTE BELOW)
	THERMOSTAT - PROVIDE BACKBOX AND 3/4" EMT TO ABOVE ACCESSIBLE CEILING
NOTE:	VERIFY MCA, FLA, MOP, VOLTAGE & PHASE WITH VENDOR SHOP DRAWINGS PRIOR TO INSTALLATION OF ELECTRICAL FEEDER TO EQUIPMENT AND PRIOR TO MAKING FINAL CONNECTIONS. VERIFY EXACT EQUIPMENT LOCATIONS WITH M.C. PRIOR TO ROUGH-INS.

FIRE ALARM SYSTEM	
	FIRE ALARM ADDRESSABLE DUCT DETECTOR WITH REMOTE INDICATING/TESTING DEVICE. INSTALLED BY E.C.
NOTE: THE FA SYSTEM INSTALLER IS RESPONSIBLE TO PROVIDE A COMPLETE SET OF SHOP DRAWINGS, INCLUDING MANUFACTURER SPECIFIC VOLTAGE DROP & BATTERY CALCULATIONS, SEQUENCE OF OPERATIONS MATRIX & DEVICE SPECIFICATION SHEETS TO THIS ENGINEER FOR APPROVAL. DRAWINGS SUBMITTED FOR REVIEW & APPROVAL SHALL BEAR THE SEAL OF A PROFESSIONAL ENGINEER LICENSED IN THE STATE OF NEW JERSEY.	

ELECTRICAL GENERAL NOTES	
1.	ALL BRANCH CIRCUIT WIRING SHALL BE RUN EMT CONDUIT, CONCEALED IN WALLS & CEILINGS IN FINISHED AREAS AND EXPOSED IN UNFINISHED AREAS. NO CABLE MAY BE RUN WHERE NOT SUBJECT TO PHYSICAL DAMAGE AND ONLY WHERE APPROVED BY THE AUTHORITY HAVING JURISDICTION. TYPE "AC" OR "NM" CABLE SHALL NOT BE USED. AN INSULATED EQUIPMENT GROUNDING CONDUCTOR MUST BE RUN IN ALL BRANCH CIRCUITS.
2.	ALL PANEL BOARD FEEDERS AND THREE PHASE EQUIPMENT FEEDERS IN EXCESS OF #12 AWG SHALL BE RUN IN EMT, IMC, RGS, OR PVC IN ACCORDANCE WITH THE NEC AND THE PROJECT SPECIFICATIONS.
3.	ALL EQUIPMENT SHALL BE INSTALLED IN A NEAT AND WORKMANLIKE MANNER, PARALLEL & PERPENDICULAR TO BUILDING STRUCTURE.
4.	MINIMUM CONDUIT SIZE SHALL BE 3/4", UNLESS NOTED OTHERWISE. MINIMUM WIRE SIZE SHALL BE #12 AWG TYPE THHN/THWN FOR POWER AND #14 THHN/THWN FOR CONTROL.
5.	REFER TO MECHANICAL & PLUMBING DRAWINGS FOR EXACT LOCATION OF HVAC & PLUMBING EQUIPMENT REQUIRING ELECTRICAL CONNECTIONS. E.C. SHALL NOT ROUGH IN FOR CONNECTIONS TO EQUIPMENT WITHOUT VERIFYING LOCATIONS ON MECHANICAL & PLUMBING DRAWINGS, AND WITHOUT VERIFYING FINAL LOCATIONS WITH MECHANICAL & PLUMBING CONTRACTOR.
6.	THE E.C. IS RESPONSIBLE FOR VERIFYING VOLTAGE, PHASE, MCA, AND MOP REQUIRED FOR ALL HVAC EQUIPMENT PRIOR TO PURCHASING AND INSTALLING CONDUCTORS, BREAKERS, DISCONNECTS AND CONDUIT. VERIFY RATINGS WITH MECHANICAL SUBMITTALS, NAMEPLATES AND DIRECTLY WITH MECHANICAL CONTRACTOR.
7.	ALL RACEWAYS RUNNING THROUGH BUILDING EXPANSION JOINTS SHALL BE EQUIPPED WITH EXPANSION FITTINGS.
8.	THE E.C. SHALL REVIEW ALL TRADES' CONTRACT DOCUMENTS TO DETERMINE SPECIFIC MOUNTING LOCATIONS FOR ELECTRICAL EQUIPMENT, COORDINATE EXACT MOUNTING LOCATIONS WITH THE ARCHITECT, OWNER, GENERAL CONTRACTOR OR CONSTRUCTION MANAGER.
9.	ALL WORK SHALL BE PERFORMED IN STRICT ACCORDANCE WITH ROCKLAND COUNTY AND THE STATE OF NY ADOPTION OF AND AMENDMENTS TO THE 2020 NATIONAL ELECTRICAL CODE, IFC 2021, IBC 2021, IECC 2018, THE LATEST STATE CODES, AND ALL LOCAL CODES.
10.	ALL ELECTRICAL EQUIPMENT, INCLUDING, BUT NOT LIMITED TO CONDUIT, WIRE, BOXES, AND FITTINGS, SHALL BE NEW AND FREE OF DEFECTS, SHALL BEAR THE UL LABEL, AND SHALL MEET NEMA AND ANSI STANDARDS.
11.	ALL WORK AND MATERIALS SHALL BE GUARANTEED FREE FROM DEFECTS FOR A MINIMUM PERIOD OF ONE YEAR UNLESS NOTED OTHERWISE. THE WARRANTY PERIOD SHALL BEGIN AT THE DATE OF BENEFICIAL OCCUPANCY OF THE SPACE UNLESS NOTED OTHERWISE IN THE PROJECT SPECIFICATIONS.
12.	THE E.C. IS RESPONSIBLE FOR OBTAINING NECESSARY PERMITS, CERTIFICATES OF INSPECTION AND SHALL DELIVER ALL CERTIFICATES OF INSPECTION TO OWNER/ CONSTRUCTION MANAGER OR GENERAL CONTRACTOR INCLUDING COPIES WITH MAINTENANCE MANUALS.
13.	FINAL LOCATIONS OF ELECTRICAL EQUIPMENT MUST BE COORDINATED WITH HVAC & PLUMBING CONTRACTORS TO ENSURE THAT NO PIPING, DUCTWORK, LEAK PROTECTION APPARATUS OR ANY OTHER EQUIPMENT FOREIGN TO THE ELECTRICAL INSTALLATION IS RUN DIRECTLY ABOVE PANELS, SWITCHBOARDS, MCC'S, OR SWITCH GEAR (SEE NEC ARTICLE 110).
14.	ALL FINAL CONNECTIONS TO VIBRATING OR MOTORIZED EQUIPMENT, INCLUDING DRY-TYPE TRANSFORMERS, SHALL BE MADE WITH FLEXIBLE METAL CONDUIT SUITABLE FOR THE ENVIRONMENT WHICH IT IS TO BE LOCATED (FMC OR LFM).
15.	ALL BRANCH CIRCUITS SHALL CONTAIN DEDICATED NEUTRAL CONDUCTORS. DO NOT SHARE NEUTRAL CONDUCTORS.
16.	ALL CONDUIT PENETRATIONS THROUGH FIRE RATED WALLS OR FLOORS SHALL BE FIRE-SEALED TO MAINTAIN THE FIRE RATING OF THE WALL OR FLOOR IN ACCORDANCE WITH INTERNATIONAL BUILDING CODE SECTION 713.
17.	OWNER SHALL APPLY ARC FLASH WARNING LABELS FOR ALL PANELS, SWITCHBOARDS, AND INDUSTRIAL CONTROL PANELS PER 2020 NEC 110.16.
18.	EACH DISCONNECTING MEANS SHALL BE MARKED TO INDICATE ITS PURPOSE PER 2020 NEC 110.22.

LIGHTING ABBREVIATIONS		
AREA OF BRANCH CIRCUIT		"HV1-3" "A1" "A" "PC" "TC" "EM" "NL"
AREA BRANCH CIRCUIT DESIGNATION		INDICATES PANEL "HV1", CIRCUIT #3 INDICATES SWITCH/DIMMER CONTROL INDICATES THROUGH PHOTOCELL INDICATES THROUGH TIMECLOCK INDICATES EMERGENCY FIXTURE INDICATES NIGHT LIGHT
NOTE: EM/NL FIXTURES SHALL BE WIRED AHEAD OF LOCAL SWITCHING.		

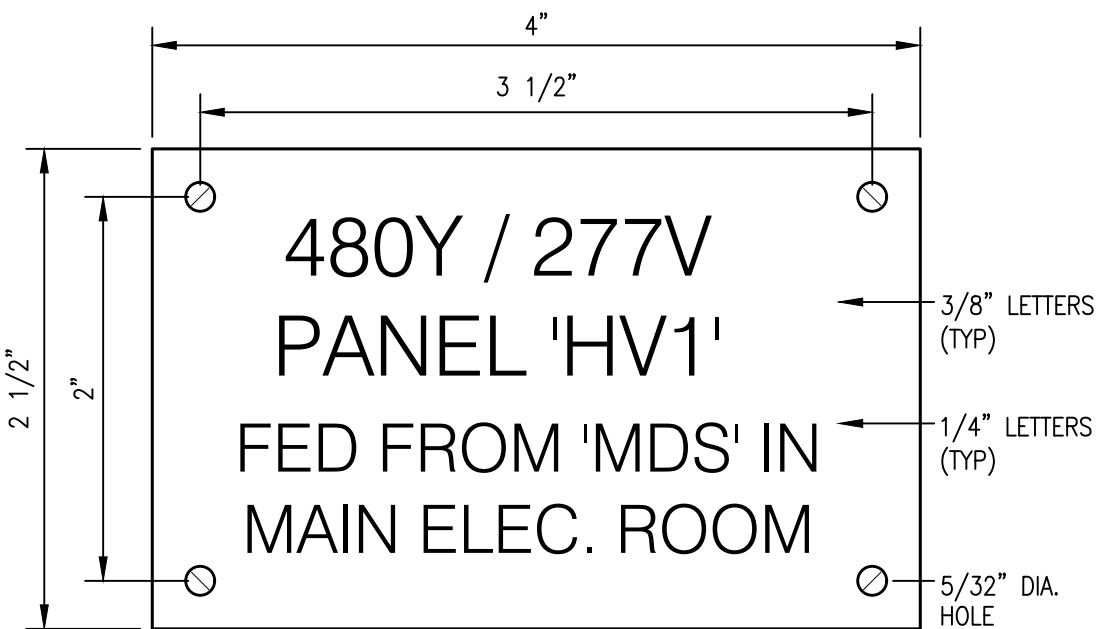


TYPICAL NAMEPLATE DETAIL

SCALE: NONE

NOTES:

- REFER TO SPECIFICATIONS FOR ADDITIONAL NAMEPLATE REQUIREMENTS.
- NAMEPLATE TO BE 1/16" THICK WHITE PLASTIC WITH BLACK CENTER LAMINATION. FACE SHALL BE BLACK, ENGRAVED LETTERS SHALL BE WHITE.
- SECURE NAMEPLATE TO SURFACES WITH (4) FLAT HEAD BRASS SCREWS. ADHESIVE CEMENT SHALL NOT BE ALLOWED.
- THIS NAMEPLATE DETAIL IS FOR FACILITIES THAT DO NOT ALREADY HAVE EXISTING PANEL NAMEPLATE NOMENCLATURE & CONTENT REQUIREMENTS; VERIFY NOMENCLATURE REQUIREMENTS WITH AUTHORIZED OWNER REPRESENTATIVE PRIOR TO PURCHASE & CONSTRUCTION.

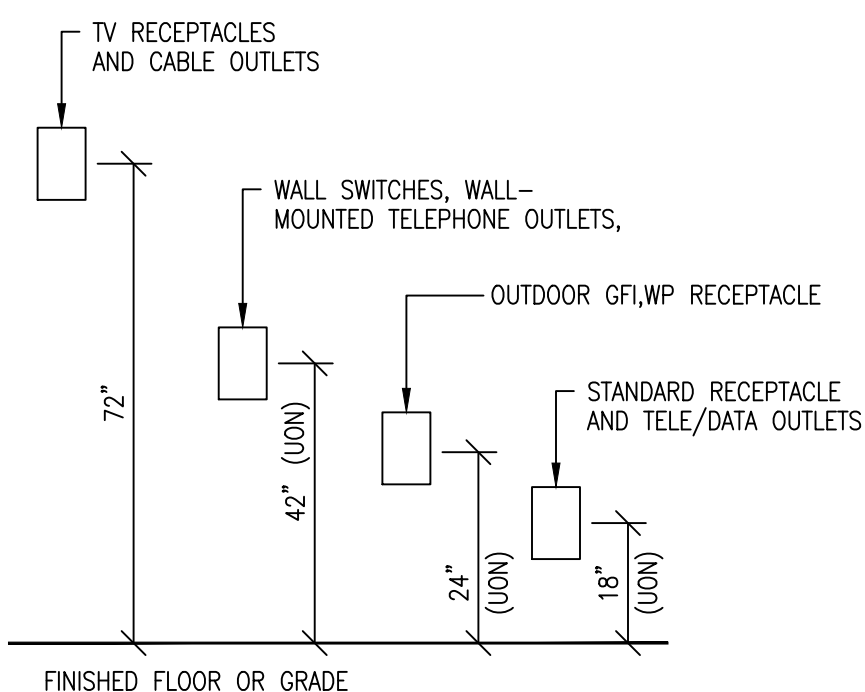

DEVICE MOUNTING HEIGHT ELEVATION

* NOTE: ANY MOUNTING HEIGHT SHOWN ON ARCHITECT'S DRAWINGS SHALL SUPERSEDE THOSE SHOWN ABOVE UNLESS IT CONFLICTS WITH CODE REQUIREMENTS.

ABBREVIATIONS							
SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION
A, AMP	AMPERES	EM	EMERGENCY	L	LOADING TYPE/LOAD	QTY	QUANTITY
AA	AMBIENT AIR	EMT	ELECTRICAL METALLIC TUBING	LA	LIGHTNING SURGE ARRESTOR	(R)	EXISTING TO BE REMOVED
AC	ALTERNATING CURRENT	EDL	END OF LINE DEVICE	LAN	LOCAL AREA NETWORK	REC/RECEPT	RECEPTACLE
ACR	ABOVE COUNTER RECEPTACLES	EPO	EMERGENCY POWER OFF	LT	LONG TIME	REQD, REQD	REQUIRED
AF	AMPERE FRAME (CIRCUIT BREAKER)	EQ	EQUAL	LTO	LIGHTING	RM	ROOM
AFF	ABOVE FINISH FLOOR	EQUIP	EQUIPMENT	LP	LIGHTING PANEL	RTU	ROOF TOP UNIT
AFG	ABOVE FINISH GRADE	ERMS	ENERGY REDUCTION MAINTENANCE SWITCH	LSI	LONG TIME, SHORT TIME, INSTANTANEOUS.	RUPS	ROTARY UPS
AFU	AMPERE FUSE	EW	ELECTRIC WATER COOLER	LSIG	LONG TIME, SHORT TIME, INSTANTANEOUS.	SCA	SHORT CIRCUIT AMPERES
AHU	AIR HANDLING UNIT	F	FUSE		GROUND FAULT.	SCCR	SHORT CIRCUIT CURRENT RATING
AIC	AMPERE INTERRUPTING CAPACITY	FA	FIRE ALARM	W	METER	SEC	SECONDARY
AL	ALUMINUM	FA	FORCED AIR	M.C.	MECHANICAL CONTRACTOR	SP	SPEARE
ARCH	ARCHITECT	FAF	FIRE ALARM ANNUNCIATOR PANEL	MCB	MAIN CIRCUIT BREAKER	SPD	SURGE PROTECTIVE DEVICE
AT	AMPERE TRIP (CIRCUIT BREAKER)	FAC	FIRE ALARM CONTROL PANEL	MCC	MOTOR CONTROL CENTER	SPEC	SPECIFICATION
ATS	AUTOMATIC TRANSFER SWITCH	FCC	FIRE COMMAND CENTER	MCCB	MOLDED CASE CIRCUIT BREAKER	SPKR	SPEAKER
AUX	AUXILIARY	FCU	FIRE COIL UNIT	MCP	MOTOR CIRCUIT PROTECTOR	ST	SHUNT TRIP
A/V	AUDIO VISUAL	FDR	FEEDER	MCP	MOTOR CIRCUIT PROTECTOR	STD	STANDARD
AWG	AMERICAN WIRE GAUGE	FLA	FULL LOAD AMPERES	MCP	MECHANICAL, ELECTRICAL, PLUMBING	STP	STANDARD
BAS	BUILDING AUTOMATION SYSTEM	FPB	FIRE POWERED BOX	MCP	MECHANICAL, ELECTRICAL, PLUMBING	STP	STANDARD
BKR	BREAKER	F/S	FUSED SWITCH	MFR	MANUFACTURER	STS	STATIC TRANSFER SWITCH
BLDG	BUILDING	FEET	FEET	MH	MANHOLE	SW	SWITCH
BYP, BP	BYPASS	F/F	FUSED SWITCH	MI	MINERAL INSULATED	SWB	SWITCHBOARD
C	CONDUIT - RACEWAY	FU	FUSES	MISC	MISCELLANEOUS	SWGR	SWITCHGEAR
CATV, TV	CABLE TELEVISION	FUT	FUTURE	MLO	MAIN LUGS ONLY	SYM	SYMMETRICAL
CB	CIRCUIT BREAKER	FVR	FULL VOLTAGE REVERSIBLE	MTD	MOUNTED	SYS	SYSTEM
CCV	CLOSED CIRCUIT TELEVISION	FNVR	FULL VOLTAGE NON-REVERSIBLE	MTD	MOUNTING	TB	TERMINAL BLOCK
CCT	CIRCUIT	G	GROUND OR GROUNDING	MTS	MANUAL TRANSFER SWITCH	TVSS	TRANSIENT VOLTAGE SURGE SUPPRESSOR
CLG	CEILING	GND, GRD	GROUND OR GROUNDING	N	NEUTRAL/NORMAL	UC	UNDERCOUNTER
COAX	COAXIAL CABLE	N.C.	NORMALLY CLOSED	N	NEUTRAL/NORMAL	UG	UNDERGROUND
C/L	CENTERLINE	N.O.	NORMALLY OPEN	N	NEUTRAL/NORMAL	UH, EUH	UNIT HEATER
COL	COLUMN	GEN	GENERATOR	NEC	NATIONAL ELECTRICAL CODE	UL	UNDERSHIELDS LABORATORY
COMM	COMMUNICATIONS	GF	GROUND FAULT	NEC	NATIONAL ELECTRICAL CODE	UON, UNO	UNLESS OTHERWISE NOTED
CPT	CENTRAL POWER TRANSFORMER	GFCI, GFI	GROUND FAULT CIRCUIT INTERRUPTER	N	NOT IN CONTRACT	UPS	UNINTERRUPTIBLE POWER SUPPLY
CRU	CARD READER	GRC	GENERATOR PARALLELING SWITCHGEAR	N	NON-FUSED SAFETY SWITCH	UTP	UNSHIELDED TWISTED PAIR
CS	CONTROL SWITCH	GRD	GROUND	NL	NIGHT LIGHT	V	VOLTS
CU	COPPER	HH	HAND HOLE	NTS	NOT TO SCALE	VAV	VARIABLE AIR VOLUME BOX
CUH	CABINET UNIT HEATER	HD	HIGH INTENSITY DISCHARGE	OCFI	OWNER FURNISHED, CONTRACTOR INSTALLED	VFD	VARIABLE FREQUENCY DRIVE
CT	CURRENT TRANSFORMER	HON	HAND-OFF-AUTOMATIC SWITCH	OS	OCCUPANCY SENSOR	VM	VOLTMETER
D	DEDICATED	HP	HORSEPOWER	P	POLE	VMS	VOLTMETER SWITCH
DC	DIRECT CURRENT	HZ	HERTZ	PB	PUSHBUTTON/PULLBOX	W	WIRE/WATT
DD	DIRECT DIGITAL CONTROL	I/INST	INSTANTANEOUS	PC	PHOTOCELL	W/	WITH
DOC	DIRECT DIGITAL CONTROL	IG	ISOLATED GROUND	PC	PHOTOCELL	WM	WATTMETER
DEMO	DIRECT DIGITAL CONTROL	IMC	INTERMEDIATE METAL CONDUIT	PDU	POWER DISTRIBUTION UNIT	WP	WEATHERPROOF
DI	DIMMER	JBL, JBOX	JUNCTION BOX	PF	POWER FACTOR	WG	WITH WIREGUARD
DIA	DIAMETER	K	KEY LOCK (KEY INTERLOCK SCHEME)	PH, Ø	PHASE	WT	WATERTIGHT
DIST	DISTRIBUTION	KA	KILOAMPERES	PMS	POWER MONITORING SYSTEM	WT	WATERTIGHT
DWG	DRAWING	KCMIL	THOUSAND CIRCULAR MILS	PML	PANEL BOARD	TRANSF	TRANSFORMER
DW	DOWN	KVA	KILOVOLT AMPERES	PVC	POLYVINYL CHLORIDE	XMR	TRANSFORMER
(E)	EXISTING TO REMAIN	KW	KILOWATTS	PWR	POWER	Δ	DELTA
EC	ELECTRICAL CONTRACTOR	KWH	KILOWATT HOUR	PRI	PRIMARY	Δ	DELTA
EF	EXHAUST FAN	KV	KILOVOLTS	PS	POWER SUPPLY	Δ	DELTA
ELEV	ELEVATOR	KVAR	KVA REACTIVE	PT	POTENTIAL TRANSFORMER	Δ	DELTA

INTERIOR LIGHTING FIXTURE SCHEDULE							
SYMBOL	TYPE	LAMPS		MOUNTING	CATALOG NUMBER	REMARKS	
		NO.	INPUT WATTS				
	A	1	321	LED	CABLE/CHAIN	T1 LIGHTING # T1-G2HBLD-U-321-50-OS	2' X 4' LED W/ INTEGRAL MOTION SENSOR
	B	1	31	LED	SURFACE/CHAIN	HUBBELL # MPS4-35MN-CW-EU	4'-0" LINEAR LED STRIP FIXTURE
	C	1	18	LED	RECESSED	EURI LIGHTING # DLC6C-18W-103SWEJ	6" WET-RATED LED DOWNLIGHT (VERIFY FIXTURE WITH OWNER)
	X1	1	2.5	LED	WALL	BEST LIGHTING # LEDCXTU-2-R-W-RC	UNIVERSAL MOUNT THERMOPLASTIC; COMBINATION EXIT LIGHT WITH TWO INTEGRAL EMERGENCY LAMPS & REMOTE CAPABILITY TO POWER DUAL REMOTE HEADS
	X2	1	2.5	LED	WALL	BEST LIGHTING # RHLED-2 PWP MV HL	DUAL WEATHERPROOF REMOTE HEAD, THERMOPLASTIC
NOTE: ALL FIXTURES SHALL BE AS SPECIFIED OR APPROVED EQUAL. FINAL SELECTIONS, CONTROL & MOUNTING REQUIREMENTS, COLORS/FINISHES, LAMP CRI & CCT, ARE BY ARCHITECT &/OR AUTHORIZED OWNER REPRESENTATIVE; VERIFY REQUIREMENTS PRIOR TO PURCHASE. ALL CONTROLS SHALL BE FULLY COMPATIBLE WITH FINAL FIXTURE & DRIVER/BALLAST SELECTIONS. EC SHALL REPORT ANY DISCREPANCIES TO THIS ENGINEER PRIOR TO PURCHASE & CONSTRUCTION.							

EXTERIOR LIGHTING FIXTURE SCHEDULE							
SYMBOL	TYPE	LAMPS		MOUNTING	CATALOG NUMBER	REMARKS	
		NO.	INPUT WATTS				
	W1	1	21	LED	WALL	GE CURRENT #EWS01-A2AN730-XXXXXXX	WALL MOUNTED LED; MOUNT AT 25'-0" AFF; VERIFY WITH CIVIL DRAWINGS
	W2	1	130	LED	WALL	GE CURRENT #EWS01-6A4F730-XXXXXXX	WALL MOUNTED LED; MOUNT AT 25'-0" AFF; VERIFY WITH CIVIL DRAWINGS
	A1	1	570	LED	POLE	CURRENT #EALP03-Q5SH730-XXXXXXX	POLE MOUNTED LED; MOUNT AT 25'-0" AFF; VERIFY WITH CIVIL DRAWINGS
	A-BB	1	478	LED	POLE	CURRENT #EAL03-K4AH730-XXXXXXX	POLE MOUNTED LED; MOUNT AT 25'-0" AFF; VERIFY WITH CIVIL DRAWINGS
	A2	1	239	LED	POLE	CURRENT #EAL03-K4AH730-XXXXXXX	POLE MOUNTED LED; MOUNT AT 25'-0" AFF; VERIFY WITH CIVIL DRAWINGS
NOTE: ALL FIXTURES SHALL BE AS SPECIFIED OR APPROVED EQUAL. FINAL SELECTIONS, CONTROL & MOUNTING REQUIREMENTS, COLORS/FINISHES, LAMP CRI & CCT, ARE BY ARCHITECT &/OR AUTHORIZED OWNER REPRESENTATIVE; VERIFY REQUIREMENTS PRIOR TO PURCHASE. ALL CONTROLS SHALL BE FULLY COMPATIBLE WITH FINAL FIXTURE & DRIVER/BALLAST SELECTIONS. EC SHALL REPORT ANY DISCREPANCIES TO THIS ENGINEER PRIOR TO PURCHASE & CONSTRUCTION.							

CURRENT ISSUE: ISSUE FOR PERMIT			
ELECTRICAL DRAWING LIST			
DWG NO.	DRAWING TITLE	A	B O
E1.0	ELECTRICAL SYMBOLS, NOTES, DETAILS & ABBREVIATIONS	<input checked="" type="radio"/>	<input checked="" type="radio"/>
E2.0	WAREHOUSE LIGHTING PLAN	<input checked="" type="radio"/>	<input checked="" type="radio"/>
E3.0	WAREHOUSE POWER PLAN	<input checked="" type="radio"/>	<input checked="" type="radio"/>
E4.0	ENLARGED LIGHTING & POWER PLANS	<input checked="" type="radio"/>	<input checked="" type="radio"/>
E5.0	ELECTRICAL ONE LINE DIAGRAM & SCHEMATICS	<input checked="" type="radio"/>	<input checked="" type="radio"/>
E6.0	ELECTRICAL PANEL SCHEDULES	<input checked="" type="radio"/>	<input checked="" type="radio"/>
E7.0	ELECTRICAL DETAILS	<input checked="" type="radio"/>	<input checked="" type="radio"/>
E8.0	ELECTRICAL SPECIFICATIONS	<input checked="" type="radio"/>	<input checked="" type="radio"/>
EN1.0	ENERGY COMPLIANCE	<input checked="" type="radio"/>	<input checked="" type="radio"/>
ESP1.0	ELECTRICAL SITE LIGHTING PLAN	<input checked="" type="radio"/>	<input checked="" type="radio"/>

DESIGNER / BUILDER

ARCO
DESIGN/BUILD
44 SOUTH BROADWAY, SUITE 1003
WHITE PLAINS, NY 10601
P: 914.821.5535 F: 914.306.6010

ADB / **DESIGN SERVICES**

PROJECT TITLE
ROCKLAND LOGISTICS CENTER BLDG 2
25 OLD MILL RD. SUFFERN, NY 10901

OWNER
BROOKFIELD PROPERTIES
1 MEADOWLANDS PLAZA SUITE 802
EAST RUTHERFORD, NJ 07073

ARCHITECT
ADB DESIGN SERVICES LLC
325 S. ALABAMA ST, SUITE 1003
WHITE PLAINS, NY 10601

CIVIL ENGINEER
DYNAMIC ENGINEERING CONSULTANTS
1904 MAIN STREET
LAKE COMO, NJ 07719

STRUCTURAL ENGINEER
ADB STRUCTURAL ENGINEERING
11840 BORMAN DRIVE
INDIANAPOLIS, IN 46204

MECHANICAL ENGINEER
NATIONAL DESIGN BUILD SERVICES
11840 BORMAN DRIVE
MARYLAND HEIGHTS, MO 63146

ELECTRICAL ENGINEER
FXB ENGINEERING
5 CHRISTY DRIVE, SUITE 307
CHADDYS FORD, PA 19317

PLUMBING ENGINEER
MOCCARTHY ENGINEERING
2500 E HIGH STREET, SUITE 630
POTTSTOWN, PA 19464

FIRE PROTECTION ENGINEER
S.A. COMUNALE
2900 NEWPARK DRIVE
BARBERTON, OH 44203


SEAL

NY License #: 077635-1
NY License Expiration Date: 04/30/2026



Peter J. Bonni

KEY PLAN

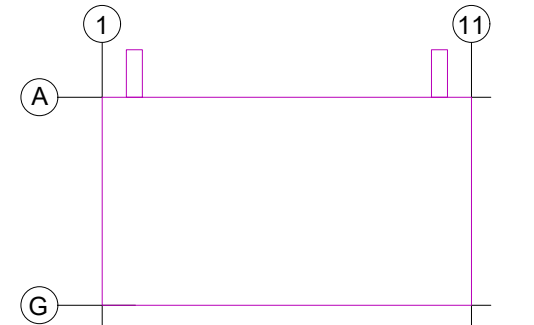

SUBMITTALS

NO.	DATE	DESCRIPTION
A	11.20.2024	ISSUE FOR REVIEW
B	02.02.2024	ISSUE FOR REVIEW
O	02.09.2024	ISSUE FOR PERMIT

PROJECT NO.
AS397-22 | NY154

DRAWN BY
NGF

SHEET TITLE
ELECTRICAL SYMBOLS, NOTES, DETAILS, & ABBREVIATIONS

SHEET NO.

E1.0