

SUBMITTALS

REV	Date	Description
A	01/13/2024	10% PROGRESS SET
B	02/02/2024	30% PROGRESS SET
C	02/09/2024	PERMIT SET

PROJECT NO. J23289 DRAWN BY AML

SHEET TITLE
OVERALL FLOOR PLAN


SHEET NO. M100

GENERAL NOTES:


1. GAS PIPING TO BE HUNG FROM TOP CHORD OF BAR JOISTS. GAS PIPING SHALL BE INSTALLED ABOVE BOTTOM CHORD OF JOISTS, BETWEEN JOIST WEBBING, AND NOT WITHIN 1'-0" OF ANY SPRINKLER HEAD. GAS PIPING SHALL PENETRATE THE ROOF NEAR THE GAS CONNECTION AT EACH GAS-FIRED UNIT.

KEYED NOTES:

- 1 MC TO INSTALL AND WIRE MAU CONTROL PANEL 6'-0" AFF ON COLUMN FACING DOCK WALL.
- 2 MC TO CONNECT TO GAS METER BY OTHERS. PROVIDE 7,400 CFH AT 1 PSI. MC TO INSTALL GAS PIPING DOWN WALL ON INSIDE OF BUILDING AND CONNECT TO METER PER DETAIL 10M500.
- 3 EC TO MOUNT COOLING ONLY THERMOSTAT AND WIRE TO EXHAUST FAN PER WIRING DIAGRAM 1/M400. MC TO PROVIDE DAYTON 1UHH4 COOLING ONLY T-STAT.
- 4 MC TO INSTALL 3-WAY DIFFUSER PER DETAIL 1/M500. 35'-0" AFF TO BOTTOM OF DIFFUSER
- 5 MC TO INSTALL DRIP PAN PER DETAIL 2/M500
- 6 EC TO INSTALL MOTOR STARTER PER WIRING DIAGRAM 3/M400. MS PROVIDED BY MC.
- 7 LOUVER TO BE INSTALLED 25'-0" AFF. 96"X102" OPENING BY OTHERS.
- 8 MC TO INSTALL INLINE FAN AND FIRE DAMPER PER DETAIL 6/M500 12'-0" AFF TO BOTTOM OF FAN. 14"X14" OPENING BY OTHERS.
- 9 MC TO INSTALL AND FIRE DAMPER PER DETAIL 7/M500. 12'-0" AFF TO BOTTOM OF DAMPER. 14"X14" OPENING BY OTHERS.
- 10 MC TO MOUNT AWH 2'-0" AFF TO BOTTOM OF HEATER. EC TO WIRE.
- 11 EC TO MOUNT COOLING ONLY THERMOSTAT AND WIRE TO EXHAUST FAN AND LOUVER PER WIRING DIAGRAM 2/M400. MC TO PROVIDE DAYTON 1UHH4 COOLING ONLY T-STAT.
- 12 OPEN TO EF ON ROOF ABOVE.
- 13 LOUVER TO BE INSTALLED 8'-0" AFF. 30"X30" OPENING BY OTHERS.
- 14 MC TO INSTALL 1" OF 1" G. VALVE AND CAP FOR FUTURE USE OF 150 CFH.
- 15 1 1/4" G UP TO MAU ON ROOF ABOVE.
- 16 EC TO INTERLOCK LOUVERS AND EF PER WIRING DIAGRAM 3/M400.
- 17 MC TO INSTALL NDM-11M GAS METER IN PARALLEL TO INCOMING GAS LINE. INSTALLATION ON INSIDE OF BUILDING AT LOWEST POSSIBLE CONNECTION POINT. INSTALL PER MANUFACTOR INSTRUCTIONS.

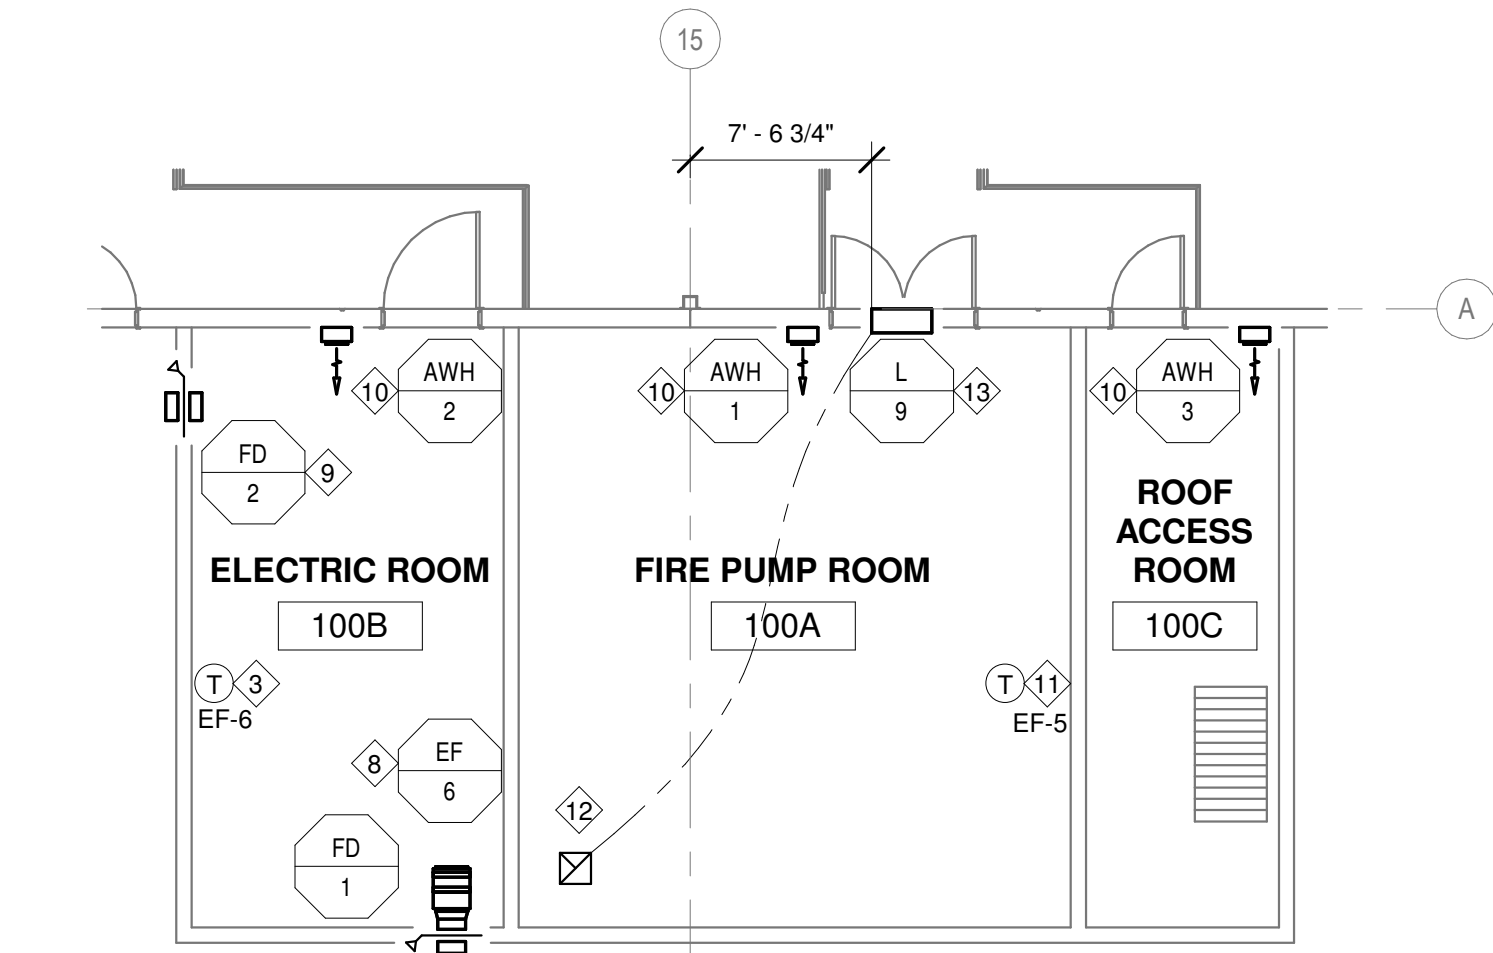

2 ENLARGED FLOOR PLAN - UTILITY ROOMS
1/8" = 1'-0"

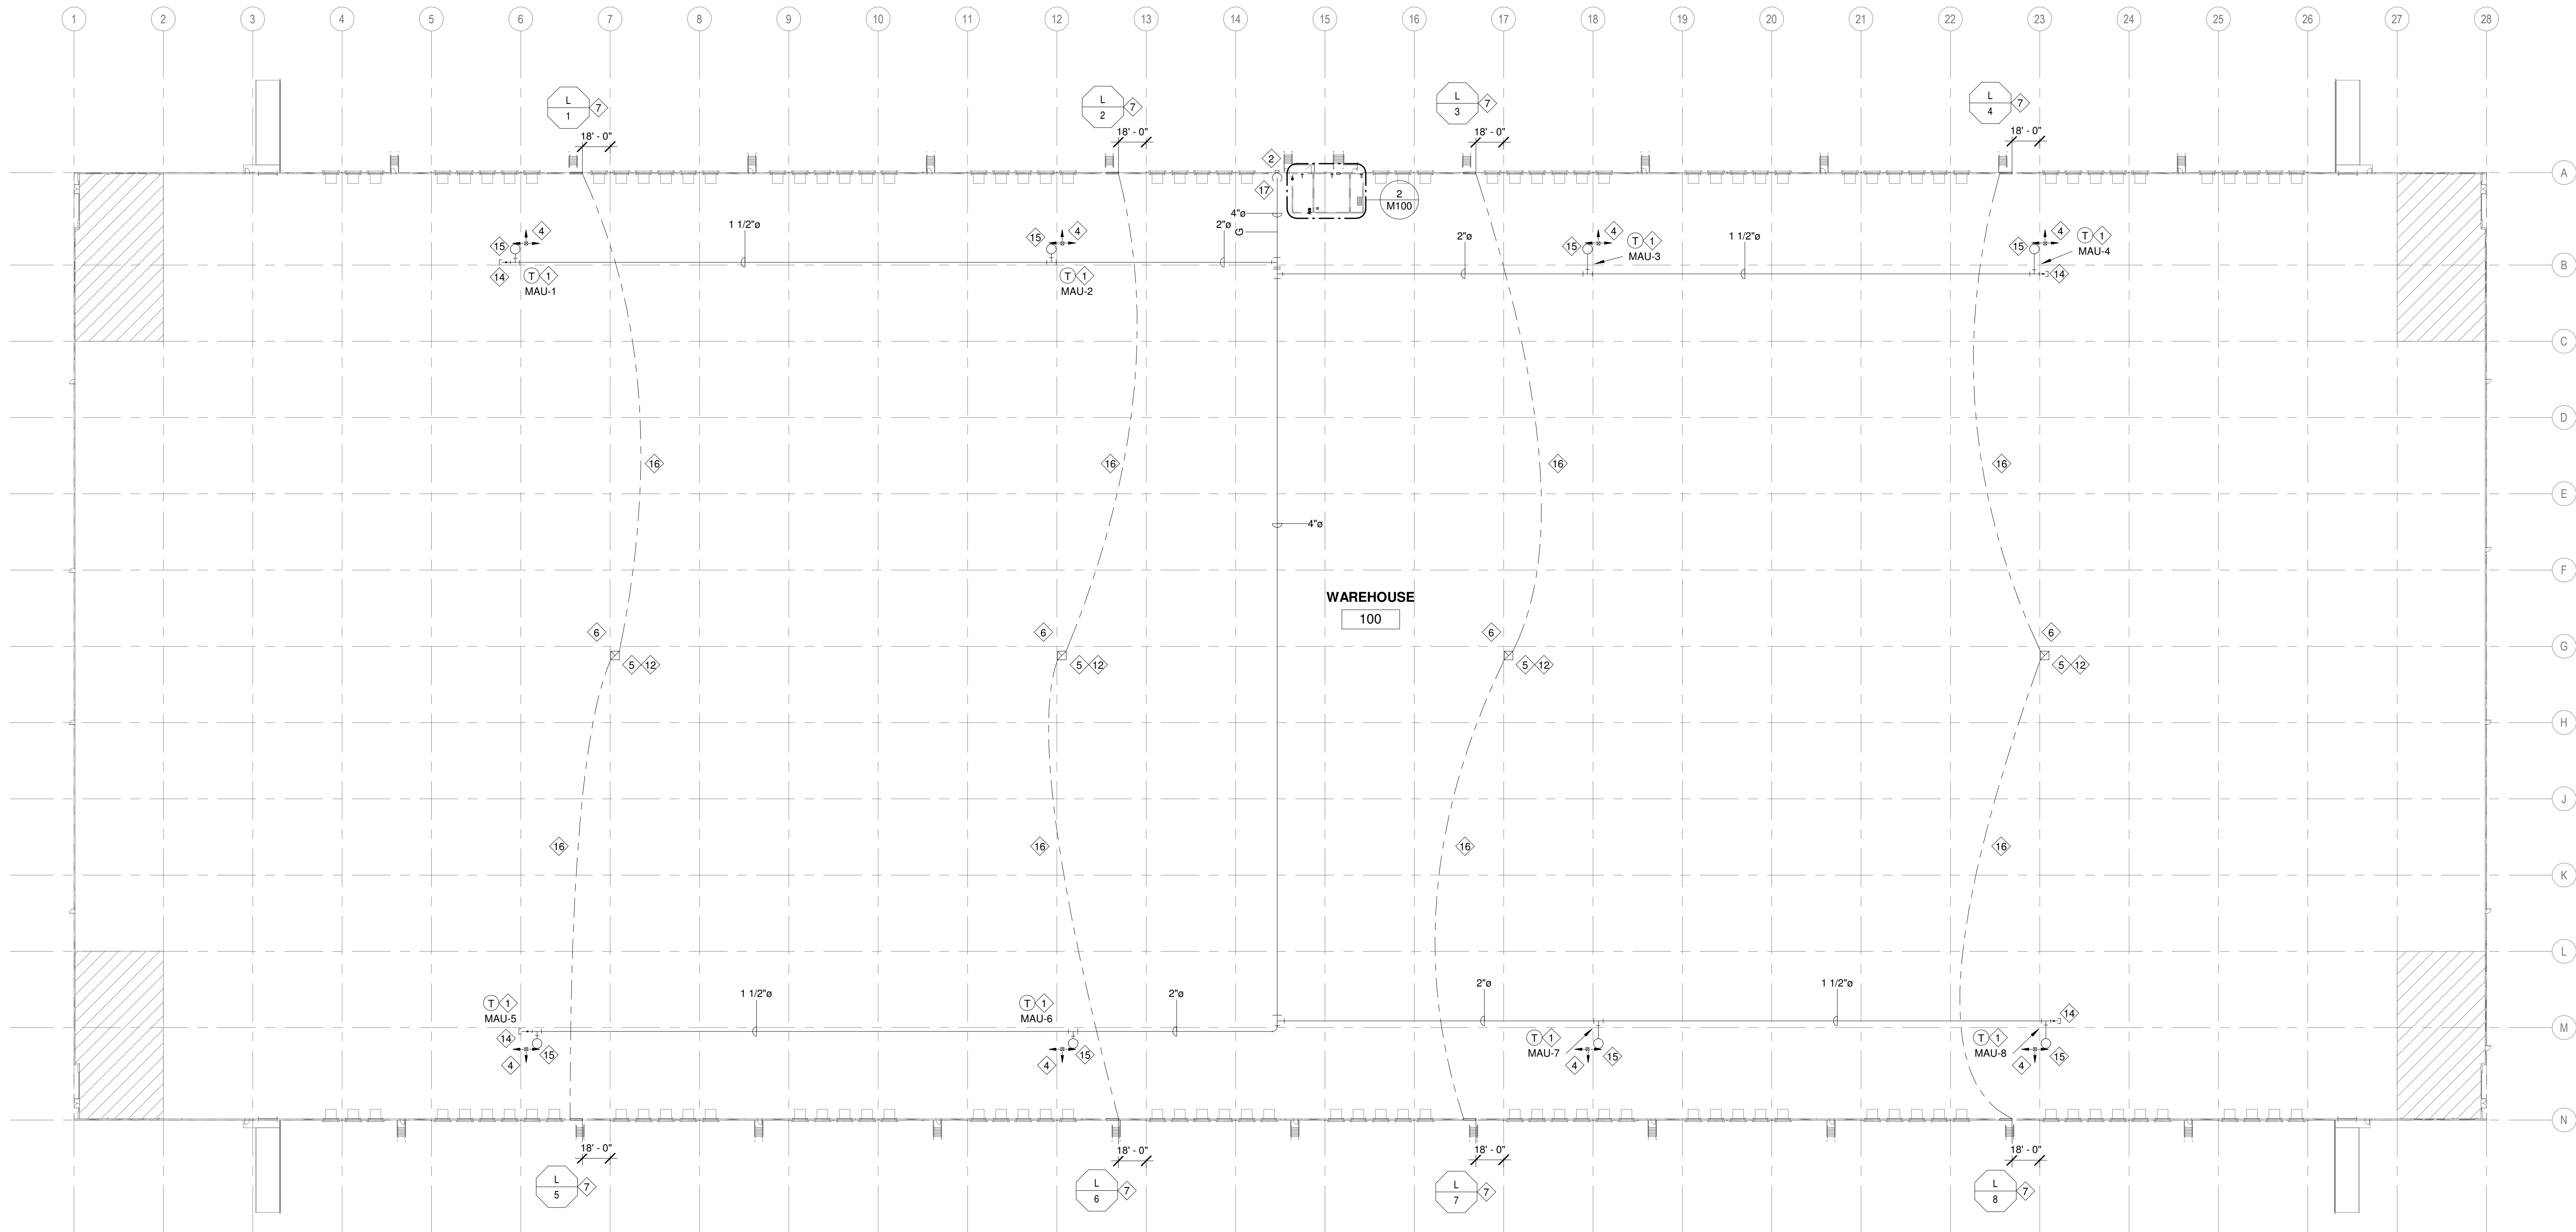

1 OVERALL FLOOR PLAN - BLDG. 1
1" = 50'-0"