


Keyed Notes

- 1 DISCONNECT AND REMOVE ELECTRICAL CIRCUITRY BACK TO SOURCE. LABEL BREAKER AS SPARE AND UPDATE PANELBOARD SCHEDULE.
- 2 DE-ENERGIZE EQUIPMENT. DISCONNECT ELECTRICAL CONDUCTORS, MAKE NEAT AND SAFE. SAFEGUARD FOR REUSE.

General Notes

- A. REFER TO DRAWING AE100 FOR GENERAL DEMOLITION NOTES
- B. SEE SHEET G-001 FOR SYMBOLS LEGEND AND ABBREVIATIONS
- C. REFER TO AE600 PANEL BOARD SCHEDULES FOR ADDITIONAL INFORMATION

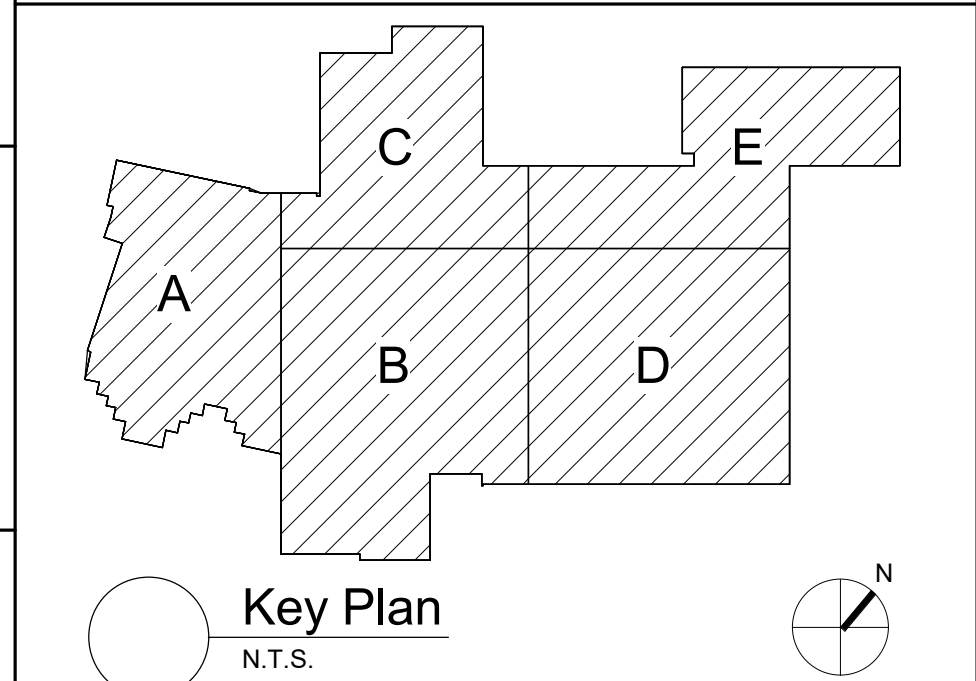

S.E.D. Control No. 62-18-01-06-0-007-019

Rev. No.:	Date:	Description:



complex world
CLEAR SOLUTIONS

Tetra Tech Engineers, Architects
& Landscape Architects, P.C.

BID SET



Wallkill Central School District
Wallkill, New York

Reconstruction to:
Wallkill Senior High School

Roof Demolition Plan

Drawn By: CR/ded	Date: 06/30/2023	Drawing Number:
Project No.: 17597-22002	AE107	