


Keyed Notes:

- 1 PROVIDE (3)#12, (1)#12G IN 1/2" C. TO PANEL 1. PROVIDE 20A, 208V, 3P BREAKER
- 2 RECONNECT REINSTALLED EQUIPMENT TO CIRCUIT PREVIOUSLY SAFEGUARDED FOR REUSE.
- 3 PROVIDE (2)#12, (1)#12G IN 1/2" C. TO PANEL 3. PROVIDE 20A, 208V, 2P BREAKER
- 4 PROVIDE (3)#6, (1)#10G IN 3/4" C. TO PANEL 1. PROVIDE 50A, 208V, 3P BREAKER
- 5 PROVIDE (3)#12, (1)#12G IN 1/2" C. TO PANEL 1. PROVIDE 20A, 120V, 1P BREAKER
- 6 PROVIDE (3)#10, (1)#10G IN 3/4" C. TO PANEL PG. PROVIDE 25A, 208V, 3P BREAKER
- 7 PROVIDE (3)#2, (1)#6G IN 1-1/4" C. TO MDP. PROVIDE 90A, 208V, 3P BREAKER
- 8 PROVIDE (3)#3/0, (1)#6G IN 2" C. TO MDP. PROVIDE 200A, 208V, 3P BREAKER
- 9 PROVIDE (3)#12, (1)#12G IN 1/2" C. TO PANEL PG. PROVIDE 20A, 120V, 1P BREAKER
- 10 PROVIDE FAN SHUTDOWN AND SUPPLY SIDE DUCT SMOKE DETECTOR. CONNECT TO EXISTING FIRE ALARM CIRCUITS. PROVIDE REQUIRED TESTING AND PROGRAMMING.
- 11 PROVIDE FAN SHUTDOWN AND CONNECT TO EXISTING FIRE ALARM CIRCUITS. PROVIDE REQUIRED TESTING AND PROGRAMMING.

General Notes:

- A. REFER TO DRAWING AE050 FOR GENERAL NOTES
- B. REFER TO AE600 PANEL BOARD SCHEDULES FOR ADDITIONAL INFORMATION

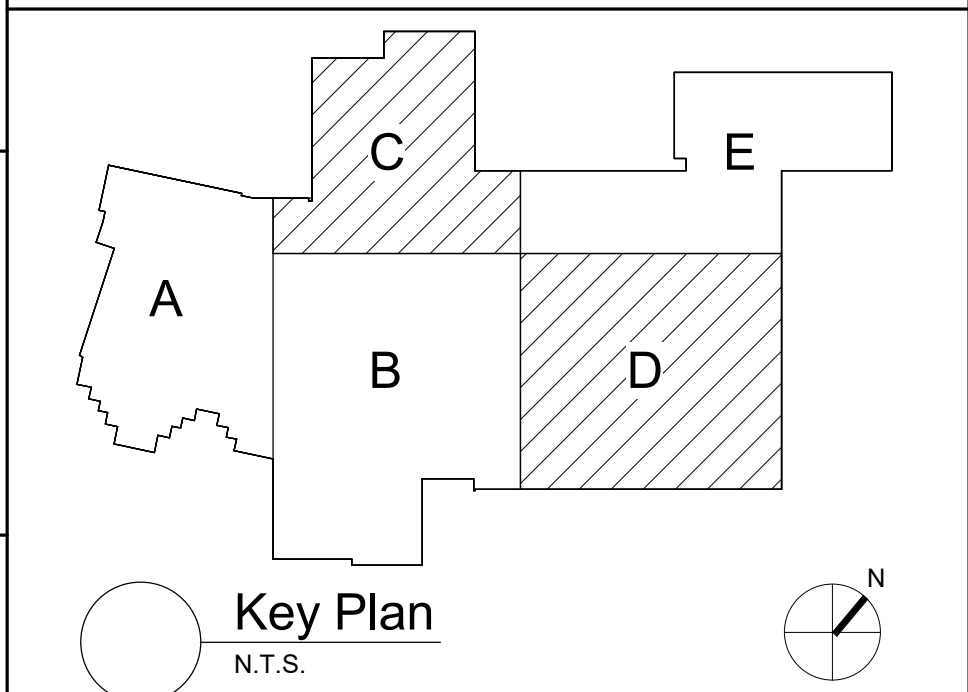

S.E.D. Control No. 62-18-01-06-0-007-019

Rev. No.:	Date:	Description:



complex world | CLEAR SOLUTIONS

Tetra Tech Engineers, Architects & Landscape Architects, P.C.

BID SET



Wallkill Central School District
Wallkill, New York

Reconstruction to:
Wallkill Senior High School

Roof Power Plans - Area C and D

Drawn By: GLK/ded	Date: 06/30/2023	Drawing Number: AE167
Project No.: 17597-22002		