


ELEVATION NOTES

- 1. ALL ELEVATIONS ARE REFERENCED FROM 0'-0" = LEVEL 1 FINISH FLOOR.
- 2. GRIDLINES ARE LOCATED AT EXTERIOR FACE OF PEMB STEEL LINES.
- 3. DETAILS ON THESE PLANS ARE INTENDED TO DEPICT THE GENERAL CONSTRUCTION METHODS FOR THIS STRUCTURE CONNECTIONS, DETAILS AND CONDITIONS NOT SPECIFICALLY SHOWN THAT ARE SIMILAR TO THOSE THAT ARE SPECIFIED SHALL BE ASSUMED ONE AND THE SAME. IF QUESTIONS REGARDING THE APPLICATION OF DETAILS ARE ENCOUNTERED, NOTIFY THE ARCHITECT / ENGINEER FOR CLARIFICATION IN A TIMELY MANNER PRIOR TO BID OPENING.
- 4. ALIGN JOINTS OF 42" ROOF PANELS WITH JOINTS OF 42" WALL PANELS.
- 5. DOOR, WINDOW, & STOREFRONT MANUFACTURER RESPONSIBLE FOR DESIGN OF ALL CONNECTIONS TO JAMBS, SILLS, & HEADERS.
- 6. DIMENSIONS SHOWN ON ELEVATIONS ARE ROUGH OPENING OF STRUCTURAL FRAME.
- 7. CONTRACTOR TO INSTALL PRE-ENGINEERED METAL BUILDING (PEMB) MATERIALS FOR PEMB FURNISHED UNDER SEPARATE CONTRACT.
- 8. REFER TO SPECIFICATION 074116, 074213.19, AND 133419 FOR REQUIRED WARRANTIES.
- 9. CONTRACTOR TO PROVIDE PROOF OF MANUFACTURER'S INSTALLATION CERTIFICATION AND TRAINING.
- 10. CONTRACTOR TO PROVIDE DOCUMENTATION OF THE NECESSARY MANUFACTURER'S INSTALLATION. CERTIFICATION AND TRAINING CAN BE OBTAINED PRIOR TO INSTALLATION OF THE PEMP STRUCTURE.
- 11. ROOF PANELS SHALL BE 36" WIDE, 6" THICK, 24 GAUGE METAL SPAN INSULATED PANELS, LS-36, OR EQUAL.
- 12. WALL PANELS SHALL BE 36" WIDE, 3" THICK, 24-GAUGE METAL SPAN INSULATED PANELS, LS-36 OR EQUAL.

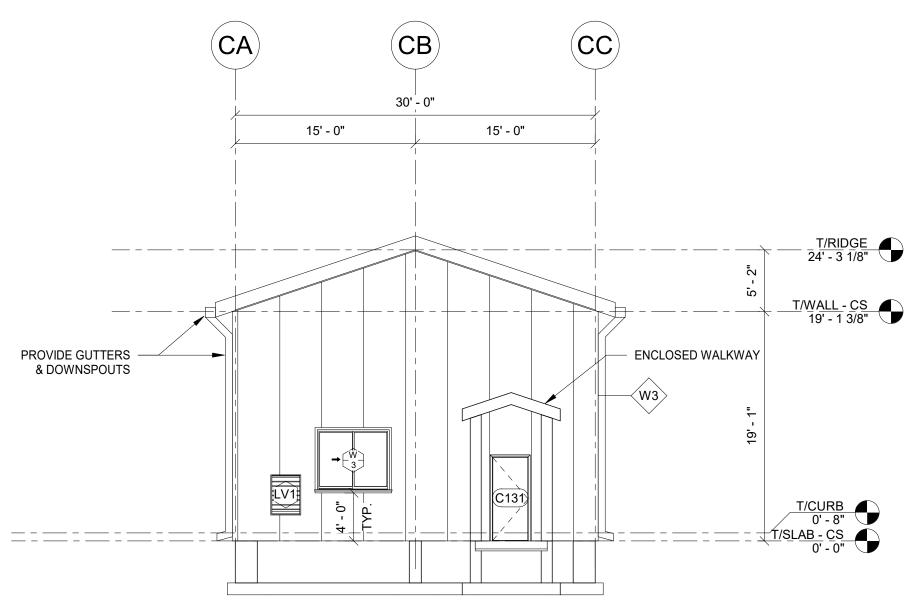



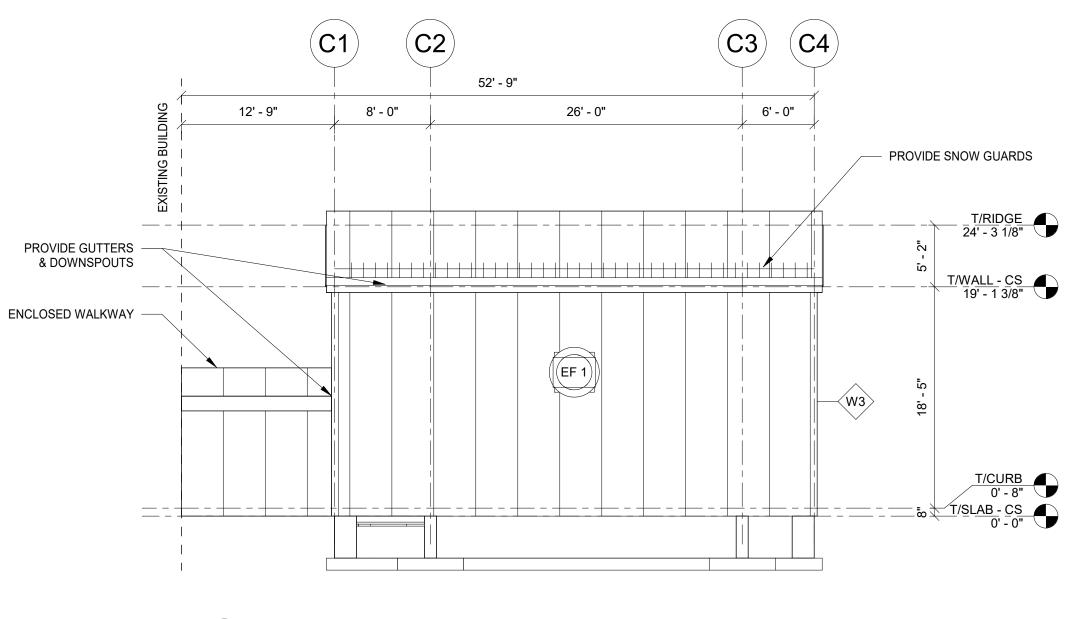

2 SOUTH ELEVATION A-200 1/8" = 1'-0"

