

PROVIDE DOAS WITH BOTH SUPPLY AND RETURN DUCT SMOKE DETECTORS.

GAS FIRED DOAS UNIT DETAIL

N.T.S.

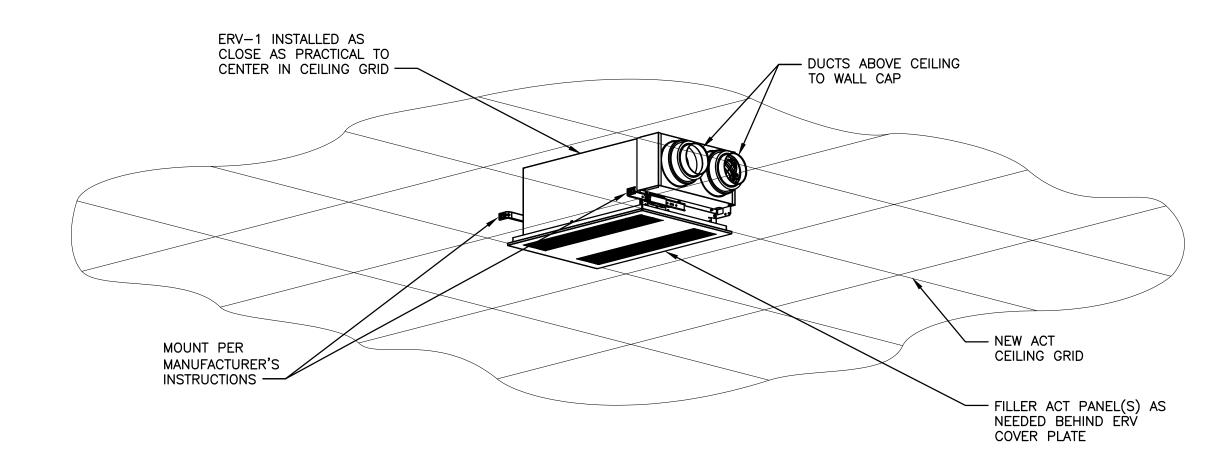


4 ERV-1 INSTALLATION DETAIL (DROP CEILING)
N.T.S.

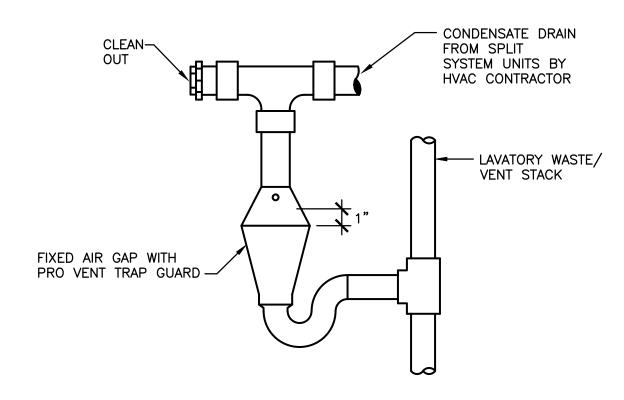

SPLIT SYSTEM

CONDENSATE DRAIN DETAIL

N.T.S.

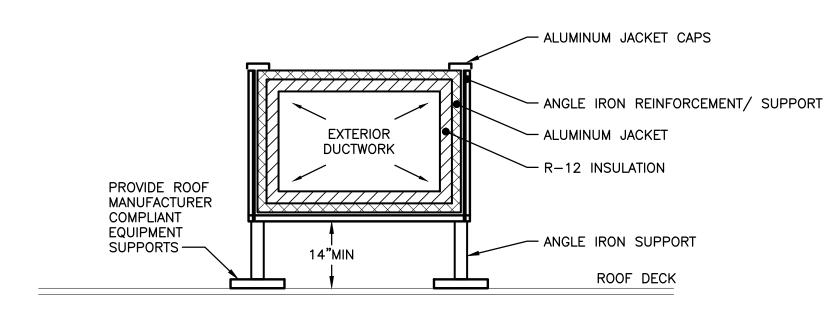

1. SEAL ALL DUCTWALL PENETRATIONS AT POINTS OF SUPPORT ATTACHMENT AND REINFORCEMENT ATTACHMENT.

2. WATERPROOF ALL SEAMS AND JOINTS IN DUCTS.


EXTERIOR INSULATED DUCTWORK DETAIL

www.fellp.com

22 Mulberry St., Suite 2A,

t 845-343-1481 fx 845-343-4986

Middletown, NY 10940

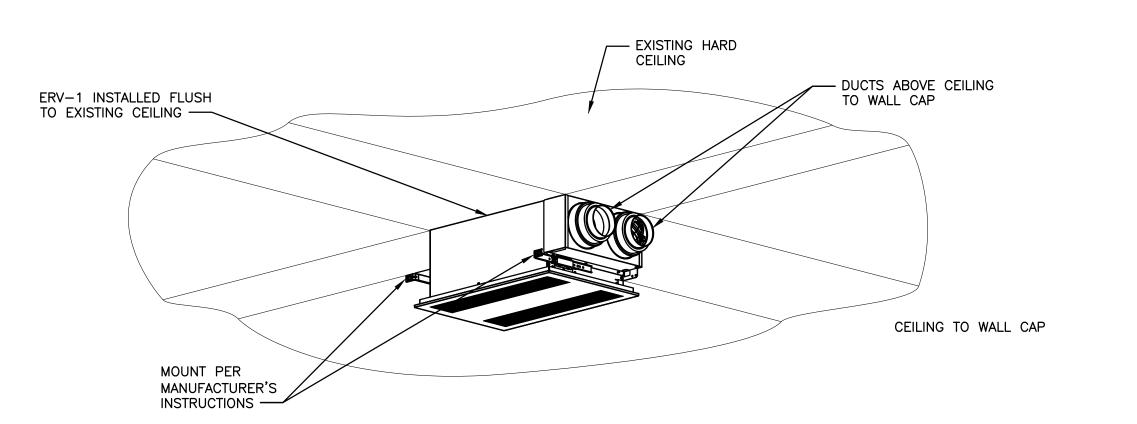

5 ERV-1 INSTALLATION DETAIL (HARD CEILING)
N.T.S.

UNAUTHORIZED ALTERATION OR ADDITION TO A PLAN BEARING A LICENSED PROFESSIONAL ENGINEER'S SEAL IS A VIOLATION OF SECTION 7209, SUB-DIVISION 2 OF THE N.Y. STATE EDUCATION LAW. FELLENZER ENGINEERING, LLP CERTIFICATE OF AUTHORIZATION #: 0017795 Date: September 17, 2024 Revisions: ENGINEERING LLP

> 181 Church St., Suite 100, Poughkeepsie, NY 12601

> > 23-369

t 845-454-9704 fx 855-320-8735


EDF

REFERENCE SCALE

ARCHITECI Joseph G. Thompson Architect, PLLC

108 N Division Street, Ste 100 Peekskill, New York 10566 PH: (8 4 5) 5 3 2 - 8 1 5 6 EM: joe@jthompsonarch.com

IT IS A VIOLATION OF THE LAW FOR ANY PERSON, UNLESS ACTING UNDER THE DIRECTION OF A LICENSED ARCHITECT OR ENGINEER, TO ALTER AN ITEM IN ANY WAY. IF AN ITEM BEARING THE SEAL OF AN ARCHITECT OR ENGINEER IS ALTERED, THE ALTERING ARCHITECT OR ENGINEER SHALL AFFIX TO HIS ITEM THE SEAL AND THE NOTATION "ALTERED BY" FOLLOWED BY HIS SIGNATURE AND THE DATE OF SUCH ALTERATION, AND A SPECIFIC DESCRIPTION OF THE ALTERATION. DO NOT SCALE DRAWINGS. WRITTEN DIMENSIONS GOVERN. © JOSEPH G THOMPSON ARCHITECT, PLLC. ALL RIGHTS RESERVED



NY PROFESSIONAL ENGINEER

NO. 073084-1 ISSUED 1995; EXP. 8/25

NCUB,

ONSTRUCTION OR C - NOT FOR PERMIT

CONSTRUCTION DOCUMENT