


**1 FRESH AIR INTAKE (F.A.I.) DETAIL**  
SCALE: NTS

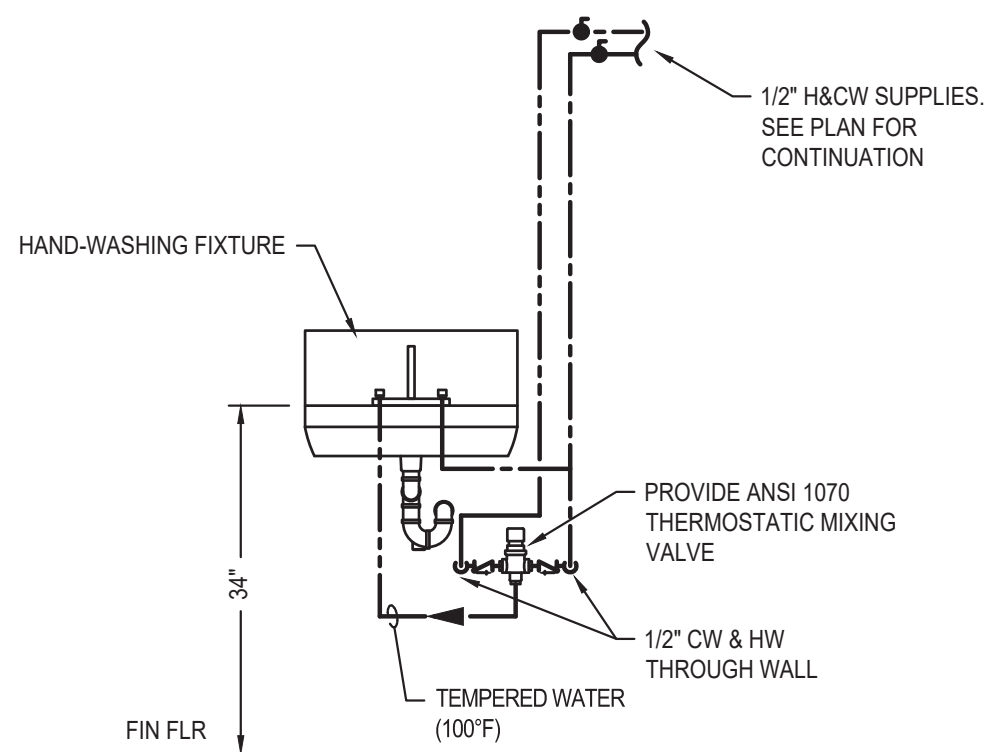

**2 LAVATORY SUPPLY PIPING DETAIL**  
SCALE: NTS

NOTE:  
COORDINATE MIXING VALVE LOCATION TO COMPLY WITH A.D.A.  
CLEARANCE REQUIREMENTS

## GENERAL NOTES - NEW INSTALLATIONS

1. THE CONTRACTOR SHALL CHECK AND VERIFY ALL CONDITIONS AND DIMENSIONS AT THE SITE BEFORE PROCEEDING WITH THE WORK AND REPORT ANY DISCREPANCIES TO THE ARCHITECT/ENGINEER FOR CORRECTION PRIOR TO BEGINNING ANY WORK. DISCOVERY OF ANY DISCREPANCIES AFTER WORK HAS COMMENCED SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR. PROVIDE VALVING, PIPING AND TEMPORARY CONNECTIONS TO EXISTING SYSTEMS AS NECESSARY FOR CONTINUATION OF OPERATIONS.
2. CONTRACTOR SHALL COORDINATE INSTALLATION OF WORK WITH EXISTING STRUCTURE AND FIELD CONDITIONS. MODIFY POINTS OF CONNECTION TO EXISTING SYSTEMS AS NECESSARY FOR JOB CONDITIONS. PROVIDE VALVING, PIPING AND TEMPORARY CONNECTIONS TO NEW SYSTEMS AS NECESSARY FOR WORK CONTINUATION.
3. COORDINATE ALL WORK WITH THE FUNCTIONS OF ADJACENT AREAS. ALL EXISTING SYSTEMS NOT IN THE CONSTRUCTION PHASE SHALL REMAIN IN SERVICE. ALL SYSTEM SHUTDOWNS SHALL BE COORDINATED AND OCCUR ONLY WITH THE WRITTEN APPROVAL OF THE FACILITY.
4. DO NOT SCALE THESE DRAWING FOR EXACT DIMENSIONS. VERIFY ALL FIGURES, CONDITIONS, DIMENSIONS, ETC. AT THE JOB SITE.
5. DO NOT INSTALL ANY PLUMBING WORK ABOVE ELECTRICAL PANELS. DO NOT INSTALL ANY PLUMBING WORK ABOVE OR THROUGH ELEVATOR EQUIPMENT ROOM, UNLESS SPECIFICALLY SERVING EQUIPMENT ROOM.
7. THIS CONTRACTOR IS RESPONSIBLE FOR CUTTING AND PATCHING MADE NECESSARY BY HIS WORK.
6. PROVIDE SLAB CUTTING AND PATCHING AS NECESSARY TO MAKE CONNECTIONS TO UNDER FLOOR PIPING. (UNLESS NOTED ON THE GENERAL CONTRACT PLANS).
7. IN ALL AREAS WHERE PATCHING IS REQUIRED, THE CONTRACTOR SHALL PATCH THE SUBSURFACE WHERE THE NEW SURFACE IS TO BE FINISHED BY THE GENERAL CONTRACTOR. THIS SUBSURFACE MUST BE PROVIDED SO THAT IT DOES NOT INHIBIT THE INSTALLATION OF OR AFFECT THE APPEARANCE OF THE NEW FINISH. IF A NEW FINISH WILL NOT BE PROVIDED BY THE GENERAL CONTRACTOR, THE CONTRACTOR IS RESPONSIBLE TO PATCH TO MATCH THE SURROUNDING SURFACE. (UNLESS NOTED BY THE GENERAL CONTRACTORS PLANS).
8. CEILINGS THAT NEED TO BE TEMPORARILY REMOVED TO ALLOW FOR THE INSTALLATION OF PIPING OR EQUIPMENT AND ARE NOT SCHEDULED TO BE REMOVED ON THE ARCHITECTURAL DRAWINGS SHALL BE REMOVED AND REPLACED BY THIS CONTRACTOR. COORDINATE THE REMOVAL AND THE REPLACEMENT WITH THE ELECTRICAL CONTRACTOR AND THE FIRE PROTECTION CONTRACTOR.
9. SLEEVE AND SEAL ALL PIPE PENETRATIONS OF WALL AND FLOORS. PACK VOID BETWEEN PIPE AND SLEEVE WITH INSULATION IN FIRE-RATED WALLS AND FLOORS, APPLY INTUMESCENT FIRE SAFING COMPOUND AT PENETRATION, MAINTAINING INTEGRITY AND RATING OF FIRE SEPARATION. SLEEVES THROUGH FLOORS SHALL EXTEND 2" ABOVE FLOOR, BE GROUTED INTO PLACE AND WATERPROOFED. PIPING THROUGH EXTERIOR WALLS SHALL BE SLEEVED AND SEALED WEATHER TIGHT.
10. THIS CONTRACTOR SHALL BE RESPONSIBLE FOR DISINFECTION OF POTABLE WATER SYSTEM (NYS PC 610); NEW OR REPAIRED POTABLE WATER SYSTEMS SHALL BE PURGED OF DELETERIOUS MATTER AND DISINFECTED PRIOR TO UTILIZATION. THE METHOD TO BE FOLLOWED SHALL BE IN ACCORDANCE WITH THE APPLICABLE NEW YORK STATE DEPARTMENT OF HEALTH REGULATIONS.
11. THIS CONTRACTOR SHALL BE RESPONSIBLE TO HIRE AND PAY AN INDEPENDENT TESTING LABORATORY TESTING AGENCY TO CONDUCT WATER LEAD TESTING FOR ALL NEW PIPING INSTALLED UNDER THIS CONTRACT. PROVIDE TO THE ENGINEER TWO COPIES OF THE FINAL REPORTS ONE FOR THE OWNER AND THE OTHER FOR THE ENGINEER. ALL TESTING SHALL BE IN ACCORDANCE WITH NYSDOH LEAD IN WATER REGULATIONS (10NYCRR 67-4)
12. THIS CONTRACTOR SHALL PROVIDE FOR PLUMBING FITTINGS AND COMPONENTS MEETING NSF/ASME 372 REQUIREMENTS FOR LEAD.

## GENERAL REMOVAL NOTES

1. ALL REMOVAL WORK SHALL BE COORDINATED WITH THE WORK OF THE OTHER TRADES.
2. THE OWNER SHALL HAVE THE OPTION TO RETAIN ANY FIXTURES, CONTROLS, PIPING, AND ACCESSORIES SCHEDULED TO BE REMOVED.
3. THROUGHOUT THE REMOVAL PROCESS, IT IS OF PARAMOUNT IMPORTANCE THAT ANY AND ALL SYSTEMS SHALL BE MAINTAINED IN PROPER WORKING ORDER FOR AS LONG AS PRACTICAL.
4. THROUGHOUT THE REMOVAL PROCESS ALL AREAS OF WORK SHALL BE KEPT FREE OF DEBRIS AND IN A CLEAN AND ORDERLY STATE.
5. ALL CUTTING REQUIRED TO SAFELY AND PROPERLY REMOVE PIPING ETC., SHALL BE PERFORMED BY THIS CONTRACTOR, UNLESS SPECIFICALLY CALLED OUT BY OTHERS.
6. REMOVALS SHALL BE TO BEYOND FINISHED SURFACES TO ALLOW PATCHING AND FINISHING TO MATCH ADJACENT SURFACES.
7. REMOVE ALL COLD WATER, HOT WATER, RE-CIRCULATION PIPING, AS INDICATED ON PLANS. REMOVE ALL PIPING BACK TO BRANCH CONNECTION WITHIN 2" OF MAIN OR AS CLOSE AS POSSIBLE TO AVOID DEAD LEGS AND REDUCE RISK OF WATER BORN PATHOGENS. PROVIDE TEMPORARY OR PERMANENT CAPPED END ON PIPING. PIPING SHALL NOT BE LEFT OPEN ENDED.
8. WHERE PIPING IS BEING REMOVED THROUGH AND EXISTING WALL, THE CORE-DRILLED HOLE OR SLEEVE SHALL BE SEALED WITH A SUITABLE METHOD OF SEALING.
9. WHERE PIPING IS REMOVED THROUGH FIRE RATED CONSTRUCTION THE ABANDONED WALL PENETRATIONS SHALL BE SEALED WITH THE APPROPRIATE FIRE RATED SEALING ELEMENTS.
10. AVOID DEAD ENDS OF 24" LONG OR GREATER WHEN REMOVING SANITARY OR STORM WATER PIPING. PROVIDE SUITABLE PLUG OR CAP ON PIPING TO REMAIN. WHERE INDICATED PROVIDE A FLOOR CLEANOUT.
11. WHERE PIPING BELOW GRADE IS TO BE REMOVED, PROVIDE SUITABLE SHORINGS OF TRENCH WALLS AND DE-WATERING EQUIPMENT AS NECESSARY. TRENCHES SHALL BE PROPERLY SHORED AND DE WATERED THROUGHOUT THE REMOVAL PROCESS. (INFILL OF THE PIPING WITH CONCRETE OR OTHER MATERIALS SHALL NOT BE ACCEPTABLE).
12. WHERE VENT TERMINALS AND ROOF DRAINS ARE REMOVED, THE ROOF OPENING SHALL BE PATCHED AND REPAIRED SO THE BUILDING ROOF WILL SHED WATER.
13. CEILINGS THAT NEED TO BE TEMPORARILY REMOVED TO ALLOW FOR THE REMOVAL OF PIPING OR EQUIPMENT AND ARE NOT SCHEDULED TO BE REMOVED ON THE ARCHITECTURAL DRAWINGS SHALL BE REMOVED AND REPLACED BY THIS CONTRACTOR. COORDINATE THE REMOVAL AND THE REPLACEMENT WITH ALL TRADES IMPACTED.
14. WHERE PIPING TO BE REMOVED IS DISCOVERED TO BE IN AN UNSAFE LOCATION OR IS IN A STATE WHICH MAY POSE A HEALTH CARE RISK, THE ARCHITECT AND THE ENGINEER SHALL BE INFORMED IMMEDIATELY. DIRECTION AS TO HOW TO PROCEED SHALL BE DETERMINED ON A CASE BY CASE BASIS.
15. ALL NATURAL GAS AND LIQUEFIED PROPANE SHALL BE REMOVED AS INDICATED; THE PIPING SHALL FIRST BE PURGED OF GAS PER THE REQUIREMENTS OF NFPA 54 AND 58.

## DRAINAGE

	FLOOR DRAIN OR FLOOR SINK
	ROOF DRAIN
	FLOOR CLEANOUT
	GRADE CLEANOUT
	VENT TERMINAL THROUGH ROOF
	END OF LINE CLEANOUT

## VALVES

	BALL VALVE
	GATE VALVE
	OS & Y GATE VALVE
	BALANCING VALVE
	SOLENOID VALVE
	PLUG VALVE
	CHECK VALVE
	BUTTERFLY / WAFER VALVE
	PRESSURE REDUCING VALVE

## FITTINGS AND ACCESSORIES

	SHOCK ARRESTOR
	STRAINER
	FREEZE PROOF WALL HYDRANT
	FREEZE PROOF WALL HYDRANT (RECESSED)
	HOSE BIBB
	UNION
	REDUCER
	PRESSURE GAUGE
	AQUASTAT CONTROLLER
	THERMOMETER
	PIPE CAPPED END
	PIPE / ELBOW TURNING UP
	PIPE / ELBOW DROP/RISE
	DOWNWARD TEE

## GENERAL

	REMOVAL NOTE
	INSTALLATION NOTE
	REMOVE / CONNECT TO
	EDGE BREAK LINE
	PIPING BREAK

## PIPING

	EXISTING PIPING TO REMAIN
	PIPING BEING REMOVED
	DOMESTIC COLD WATER
	DOMESTIC HOT WATER
	DOMESTIC HOT WATER RETURN
	SANITARY ABOVE FLOOR
	SANITARY BELOW FLOOR
	SANITARY VENT
	STORM ABOVE FLOOR
	STORM BELOW FLOOR
	NATURAL GAS
	LIQUEFIED PETROLEUM GAS
	CONDENSATE DRAIN
	COMPRESSED AIR
	ACID WASTE ABOVE FLOOR
	ACID WASTE BELOW FLOOR
	ACID VENT

## ABBREVIATIONS

AD	ACCESS DOOR
AF	ABOVE FINISHED FLOOR
AFG	ABOVE FINISHED GRADE
AP	ACCESS PANEL
AV	ACID VENT
AW	ACID WASTE
BCO	BASE CLEANOUT
BF	BELOW FLOOR
BFP	BACKFLOW PREVENTER
CO2	CARBON DIOXIDE
CA	COMPRESSED AIR
CLG	CEILING
CO	CLEAN OUT
COND	CONDUCTOR
CW	COLD WATER
CTE	CONNECT TO EXISTING
CI	CAST IRON
DIA	DIAMETER
DN	DOWN
DF	DRINKING FOUNTAIN
DWG	DRAWING
ECO	END OF LINE CLEANOUT
EWC	ELECTRIC WATER COOLER
EXR	EXISTING TO REMAIN
FAI	FRESH AIR INLET
FCO	FLUSH FLOOR CLEANOUT
FD	FLOOR DRAIN
FLR	FLOOR
FF	FINISH FLOOR
FFE	FINISHED FLOOR ELEVATION
G	GAS
GA	GAUGE
GPR	GAS PRESSURE REGULATOR
GC	GENERAL CONTRACTOR
HB	HOSE BIBB
HW	HOT WATER
HWR	HOT WATER RE-CIRCULATION
IA	INSTRUMENT AIR
INW EL	INVERT ELEVATION
IW	INDIRECT WASTE
LAV	LAVATORY
LDR	LEADER
LPG	LIQUEFIED PETROLEUM GAS
MA	MEDICAL AIR
MAX	MAXIMUM
MB	MOP BASIN
MC	MECHANICAL CONTRACTOR
MFR	MANUFACTURER
MIN	MINIMUM
MV	MEDICAL VACUUM
N	NITROGEN
N2O	NITROUS OXIDE
OS&Y	OUTSIDE SPINDLE & YOKE
O2	OXYGEN
PC	PLUMBING CONTRACTOR
PG	PRESSURE GAUGE
PRV	PRESSURE REDUCING VALVE
PS	PRESSURE SWITCH
PSI	POUNDS PER SQ IN
PO	PLUGGED OUTLET
RD	ROOF DRAIN
RZ	REDUCED PRESSURE ZONE
SA	SHOCK ARRESTOR
SAN	SANITARY
SH	SHOWER
SK	SINK
ST	STORM
TEMP	TEMPERATURE
TYP	TYPICAL
UR	URINAL
V	VENT
VIF	VERIFY IN FIELD
VTR	VENT THRU ROOF
W	WASTE
WAGD	WASTE ANESTHESIA GAS DISPOSAL
WC	WATER CLOSET
WCO	WALL CLEANOUT

PLUMBING PIPING SPECIALTIES SCHEDULE									
TAG	ITEM	MANUFACTURER & MODEL	WASTE	VENT	CW	HW	FITTINGS/ACCESSORIES OR DESIGN DATA	ITEM DESCRIPTION	
FD-1	FLOOR DRAIN	ZURN ZN415	SEE PLAN	SEE PLAN	NA	NA	PROVIDE P-TRAP WITH Z1072 Z SHIELD BARRIER TRAP SEAL DEVICE.	DURA COATED CAST IRON BODY, BOTTOM OUTLET, MEMBRANE CLAMP ADJUSTABLE COLLAR, WEEP HOLES NICKEL BRONZE STRAINER	
FCO-1	FLOOR CLEANOUT	ZURN Z 1400 LEVEL TROL WITH ROUND COVER	SEE PLAN	NA	NA	NA	PROVIDE ZN DURA COATED NICKEL BRONZE TOP	ADJUSTABLE FLOOR CLEANOUT WITH ROUND COVER	

PLUMBING FIXTURE SCHEDULE									
TAG	ITEM	MANUFACTURER & MODEL	WASTE	VENT	CW	HW	FITTINGS/ACCESSORIES OR DESIGN DATA	ITEM DESCRIPTION	
WC-1	FLOOR MOUNTED WATER CLOSET	GERBER NORTH POINT #G30025833	4"	2"	1"	NA	SLOAN ROYAL MODEL 111-1.28 FLUSH VALVE, CHURCH 5321.112 SEAT	VITREOUS CHINA, WATER SAVER 1.28 GPF, SIPHON JET ACTION, ELONGATED BOWL, MEETS ASME A112.19.2.	
WC-2	FLOOR MOUNTED WATER CLOSET A.D.A.	GERBER NORTH POINT #G0025733	4"	2"	1"	NA	SLOAN ROYAL MODEL 111-1.28 FLUSH VALVE, CHURCH 5321.112 SEAT	VITREOUS CHINA, WATER SAVER 1.28 GPF, SIPHON JET ACTION, ELONGATED BOWL, MEETS ASME A112.19.2. ADA COMPLIANT	
L-1	WALL-HUNG LAVATORY	KOHLER K-2005	1-1/2"	1-1/2"	1/2"	1/2"	T & S BRASS #B-2711-VF05, 4" CTR FAUCET, ZURN ZR-1231 CARRIER, KOHLER 8820 STRAINER TAILPIECE, MCGUIRE 8902.8820 WASTE OUTLET AND SUPPLY KITS	VITREOUS CHINA, REAR OVERFLOW, 3 HOLE 4" CENTERS, CONCEALED ARM SUPPORTS, 1-1/4" P-TRAP. PROVIDE LEONARD #170-LF-STSTL ASSE 1070 THERMOSTATIC MIXING VALVE TO PROVIDE TEMPERED WATER AS PER NOTE #6 BELOW.	
L-2	A.D.A. WALL-HUNG LAVATORY	KOHLER K-2005	1-1/2"	1-1/2"	1/2"	1/2"	T & S BRASS #B-2711-VF05, 4" CTR FAUCET, ZURN ZR-1231 CARRIER, KOHLER 8820 STRAINER TAILPIECE, MCGUIRE 8902.8820 WASTE OUTLET AND SUPPLY KITS	VITREOUS CHINA, REAR OVERFLOW, 3 HOLE 4" CENTERS, CONCEALED ARM SUPPORTS, 1-1/4" P-TRAP, A.D.A. TRIM COVERS. PROVIDE LEONARD #170-LF-STSTL ASSE 1070 THERMOSTATIC MIXING VALVE TO PROVIDE TEMPERED WATER AS PER NOTE #6 BELOW.	
DF-1	DRINKING FOUNTAIN	ELKAY #LVRCITLDDWSK	1-1/2"	1-1/2"	1/2"	NA	VANDAL-RESISTANT BOTTLE FILLING STATION & B-LEVEL COOLER FILTERED NON-REFRIGERATED STAINLESS, LAMINAR FLOW, REAL DRAIN, VANDAL RESISTANT, VISUAL FILTER MONITOR	PROVIDES 1-1/2" C.P. WASTE, P-TRAP, SUPPLY WITH SHUT-OFF, AND IN WALL CARRIER (IF REQUIRED).	
MB-1	MOP BASIN	STERN WILLIAMS MTB-3624 WHITE DRIFT	3"	1 1/2"	1/2"	1/2"	STERN WILLIAMS T-10-VB CHROME PLATED SERVICE FAUCET WITH VACCUUM BREAKER 3/4" HOSE THREAD	SS INTEGRAL CAST DRAIN, PROVIDE OPTIONS, 36" WALL GUARD, V70 VINYL BUMPER GARD, T-35 HOSE, T-40 MOP HANGER, C10 SILICONE SEALER	

- NOTES:
1. REFER TO ARCHITECTURAL DRAWINGS FOR LEFT-HAND OR RIGHT-HAND FIXTURES. ADA STANDARDS, FLUSH CONTROLS SHALL BE LOCATED ON THE OPEN SIDE OF THE WATER CLOSET.
  2. FIXTURE COLORS ARE TO BE WHITE UNLESS OTHERWISE DIRECTED BY ARCHITECT
  3. FOR ADA SINKS AND LAVATORIES, ON EXPOSED TRIM PROVIDE WHITE MOLDED CLOSED CELL VINYL INSULATION KIT FOR P-TRAP AND ANGLE VALVE ASSEMBLIES, TRUEBRO, INC. "HANDI LAV-GUARD", OR APPROVED EQUAL.
  4. SEE ARCHITECTURAL DRAWINGS FOR ADDITIONAL PLUMBING ACCESSORIES.
  5. FAUCETS WITH HOT & COLD SUPPLIES WITH HOSE CONNECTIONS SHALL BE PROVIDED WITH VACUUM BREAKER & INTEGRAL CHECK VALVES OR CHECK VALVES ON ACCESSIBLE SUPPLY PIPING NEXT TO SERVICE VALVES.
  6. FOR EACH 1070 THERMOSTATIC MIXING VALVE INSTALLED, SET WATER OUTLET TEMPERATURE AT 100°F FOR ELEMENTARY SCHOOLS AND 110°F AT MIDDLE AND HIGH SCHOOLS.

SED NUMBERS: 64-15-00-01-0-009-013

BEFORE WORK IS STARTED, CONTRACTOR SHALL VERIFY ALL THE DIMENSIONS AT THE SITE AND IMMEDIATELY NOTIFY THE ARCHITECT OF ALL DISCREPANCIES. ALTERATION OF THIS DOCUMENT BY OTHER THAN AN AUTHORIZED LICENSED REGISTERED ARCHITECT IS ILLEGAL AND A VIOLATION OF SECTION 7307 OF THE NEW YORK STATE EDUCATION LAW.

Revision:  
05/21/2025

Drawing Title:

PLUMBING NOTES, SYMBOLS,  
ABBREVIATIONS, & SCHEDULES

Drawing Number:

APN: 2226-2A Date: 10/11/2024 Drawn by: J.J.

Alterations to Administration Building

Peekskill City School District  
Peekskill, New York

Consultant

Seal

engineered solutions

646 Plank Road #104  
Clifton Park, NY 12065

Phone: (518) 280-2410  
Fax: (518) 280-2481

www.solutionsgic.com  
ES # 24088



MOSAIC  
ASSOCIATES

Mosaic Associates Architects, PC

The Fred Building, 2 Third Street, Suite 440, Troy, NY 12180

P  
001



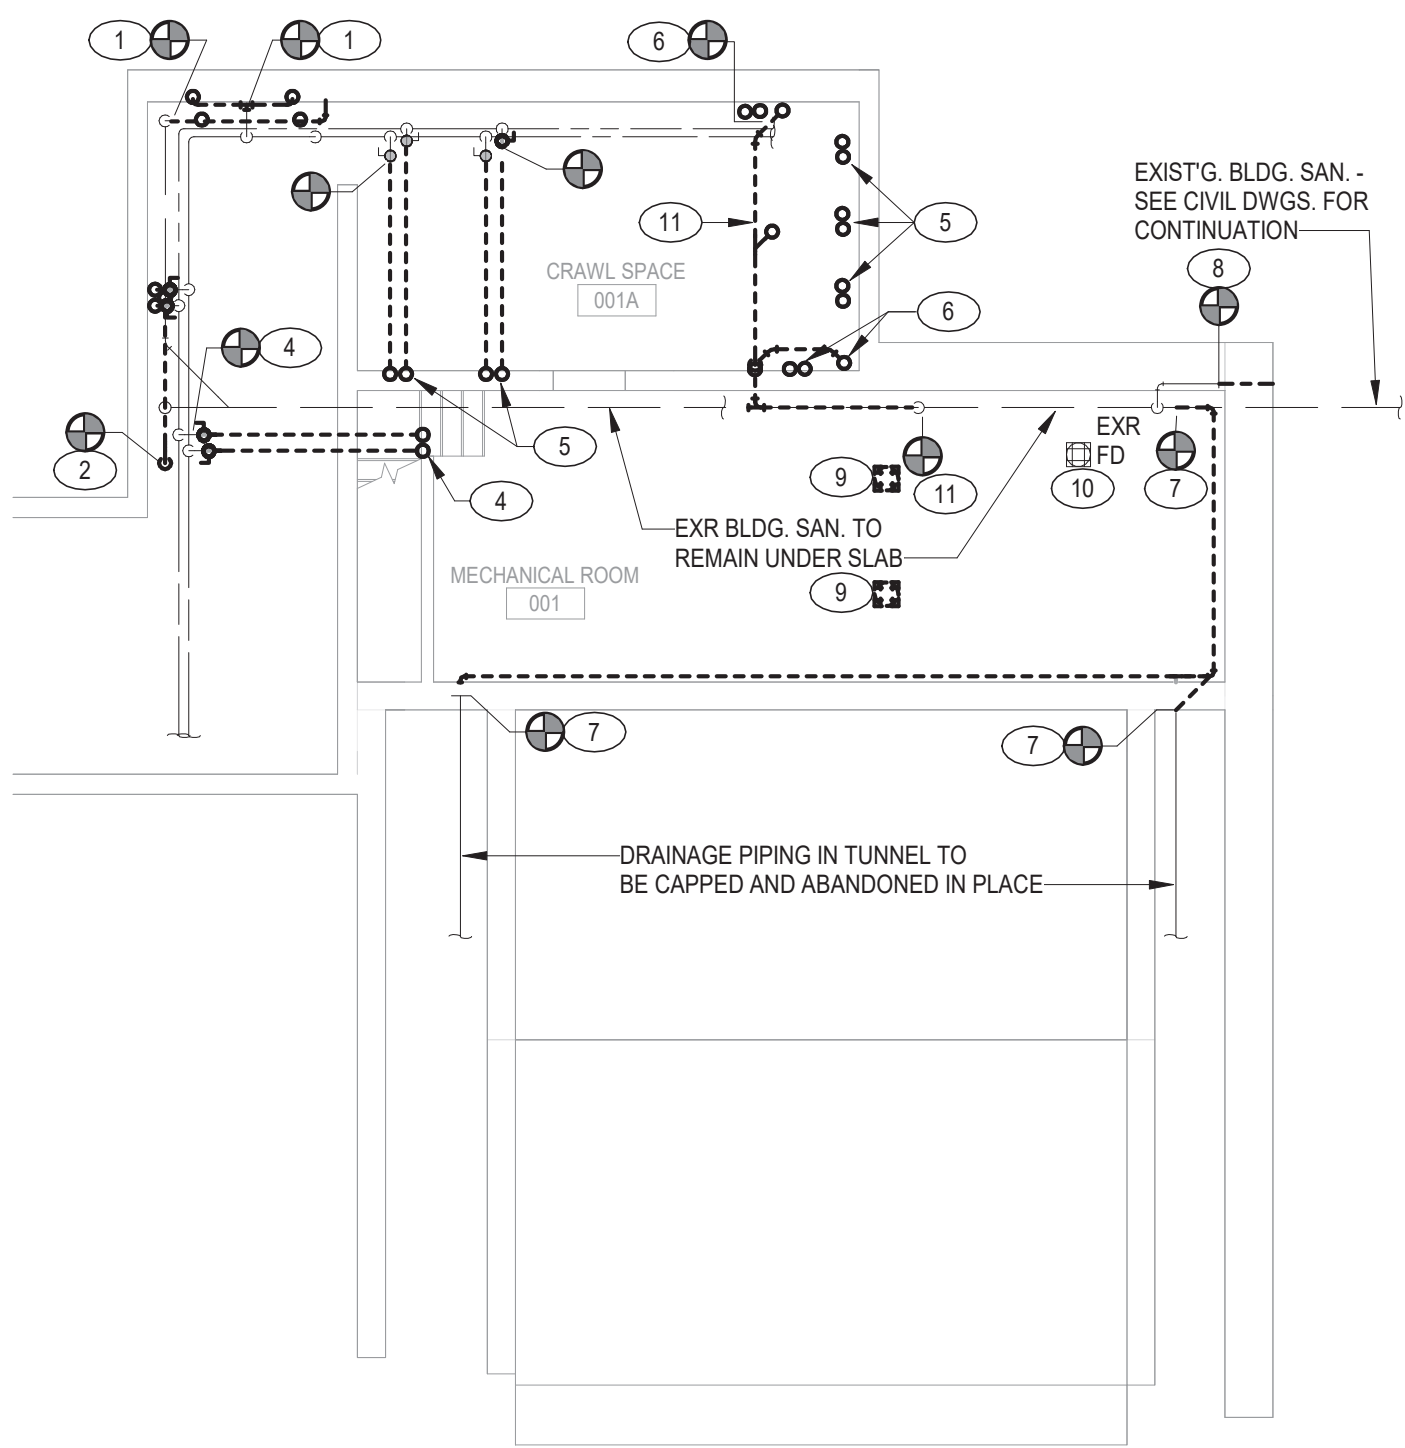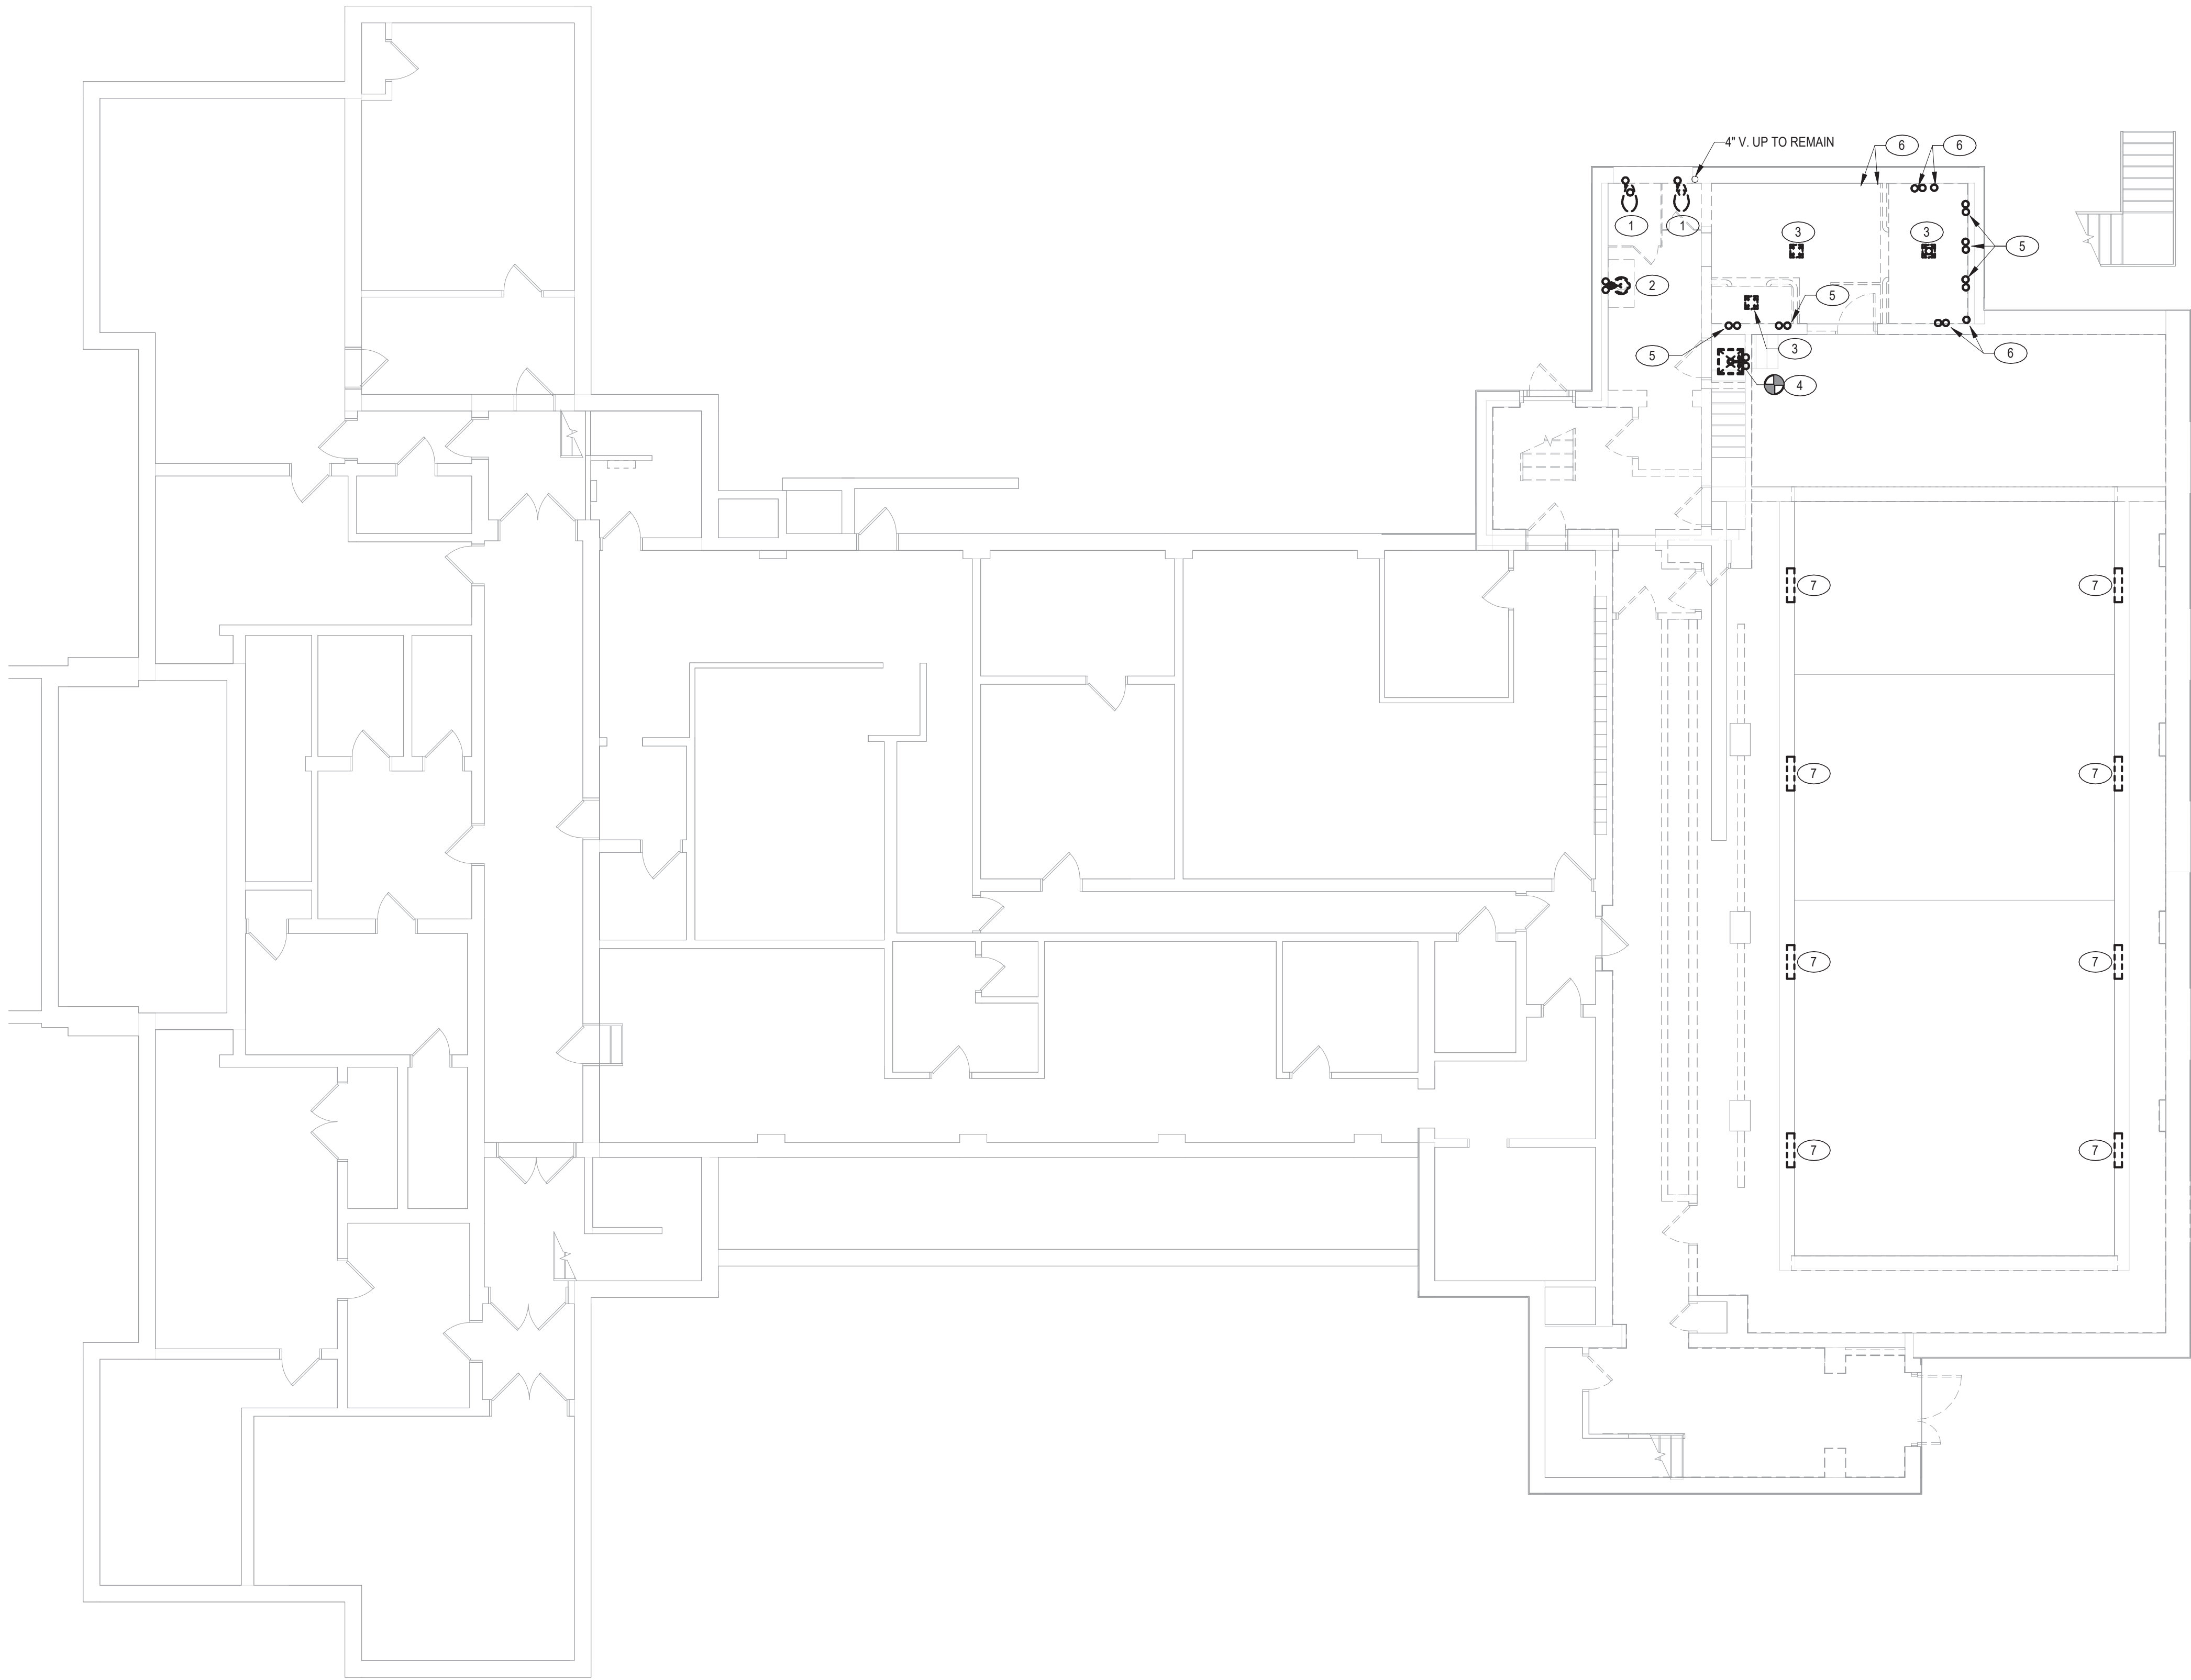

REMOVAL NOTES: ○

1. DISCONNECT & REMOVE WATER CLOSETS. REMOVE CW, SANITARY PIPING, & CAP AT CONNECTION TO MAIN PIPING.
2. DISCONNECT & REMOVE LAVATORY. REMOVE CW, HW, WASTE & VENT PIPING, & CAP AT CONNECTION TO MAIN PIPING.
3. REMOVE FLOOR DRAIN & WASTE PIPING, CAP AT CONNECTION TO MAIN PIPING.
4. DISCONNECT AND REMOVE LAUNDRY SINK AND ASSOCIATED COLD WATER, HOT WATER, WASTE AND VENT PIPING AND CAP AT CONNECTION TO MAIN PIPING.
5. DISCONNECT AND REMOVE SHOWER, COLD WATER AND HOT WATER PIPING. CAP AT CONNECTION TO MAIN.
6. DISCONNECT AND REMOVE 1/2" COLD WATER, HOT WATER, AND 2" STANDPIPE FOR WASHING MACHINES (TO BE REMOVED BY OTHERS).
7. DISCONNECT AND REMOVE POOL DRAINS INCLUDING PIPING IN MECH ROOM #001 AND CAP PIPING. PIPING IN AND UNDER POOL TO BE ABANDONED IN PLACE.
8. DISCONNECT AND REMOVE 4" FRESH AIR INTAKE PIPING BEFORE WALL PENETRATION IN MECH ROOM #001 INCLUDING BROKEN PIPING THROUGH WALL.
9. EXISTING FLOOR DRAINS TO BE REMOVED AND PIPING CAPPED BELOW SLAB.
10. EXISTING FLOOR DRAIN TO BE CLEANED AND FLUSHED. PROVIDE NEW STRAINER.
11. DISCONNECT & REMOVE WASTE PIPING FROM CRAWLSPACE. DISCONNECT FROM MAIN SANITARY PIPING UNDER SLAB AND CAP AT CONNECTION TO MAIN PIPING.

**2 BASEMENT PLUMBING REMOVAL PLAN**  
SCALE: 1/8" = 1'-0"

**1 LOWER LEVEL PLUMBING REMOVAL PLAN**  
SCALE: 1/8" = 1'-0"

SED NUMBERS: ■ Administration Building: 66-15-00-01-0-009-013  
BEFORE WORK IS STARTED, CONTRACTOR SHALL VERIFY ALL THE DIMENSIONS AT THE SITE AND IMMEDIATELY NOTIFY THE ARCHITECT OF ALL DISCREPANCIES. ALTERATION OF THIS DOCUMENT BY OTHER THAN AN AUTHORIZED LICENSED REGISTERED ARCHITECT IS ILLEGAL AND A VIOLATION OF SECTION 2307 OF THE NEW YORK STATE EDUCATION LAW.

Drawing Title:

BASEMENT & LOWER LEVEL  
PLUMBING REMOVAL PLAN

Revision:  
05/21/2023


Revised by: J.L.

**Alterations to Administration Building**  
Peekskill City School District  
Peekskill, New York

Seal

Consultant:

engineered solutions




646 Plank Road #104  
Clifton Park, NY 12065  
Phone: (518) 280-2410  
Fax: (518) 280-2481  
www.esolutionspllc.com  
ES # 2408

MOSAIC  
ASSOCIATES


1 LOWER LEVEL DRAINAGE PLAN

SCALE: 1/8" = 1'-0"

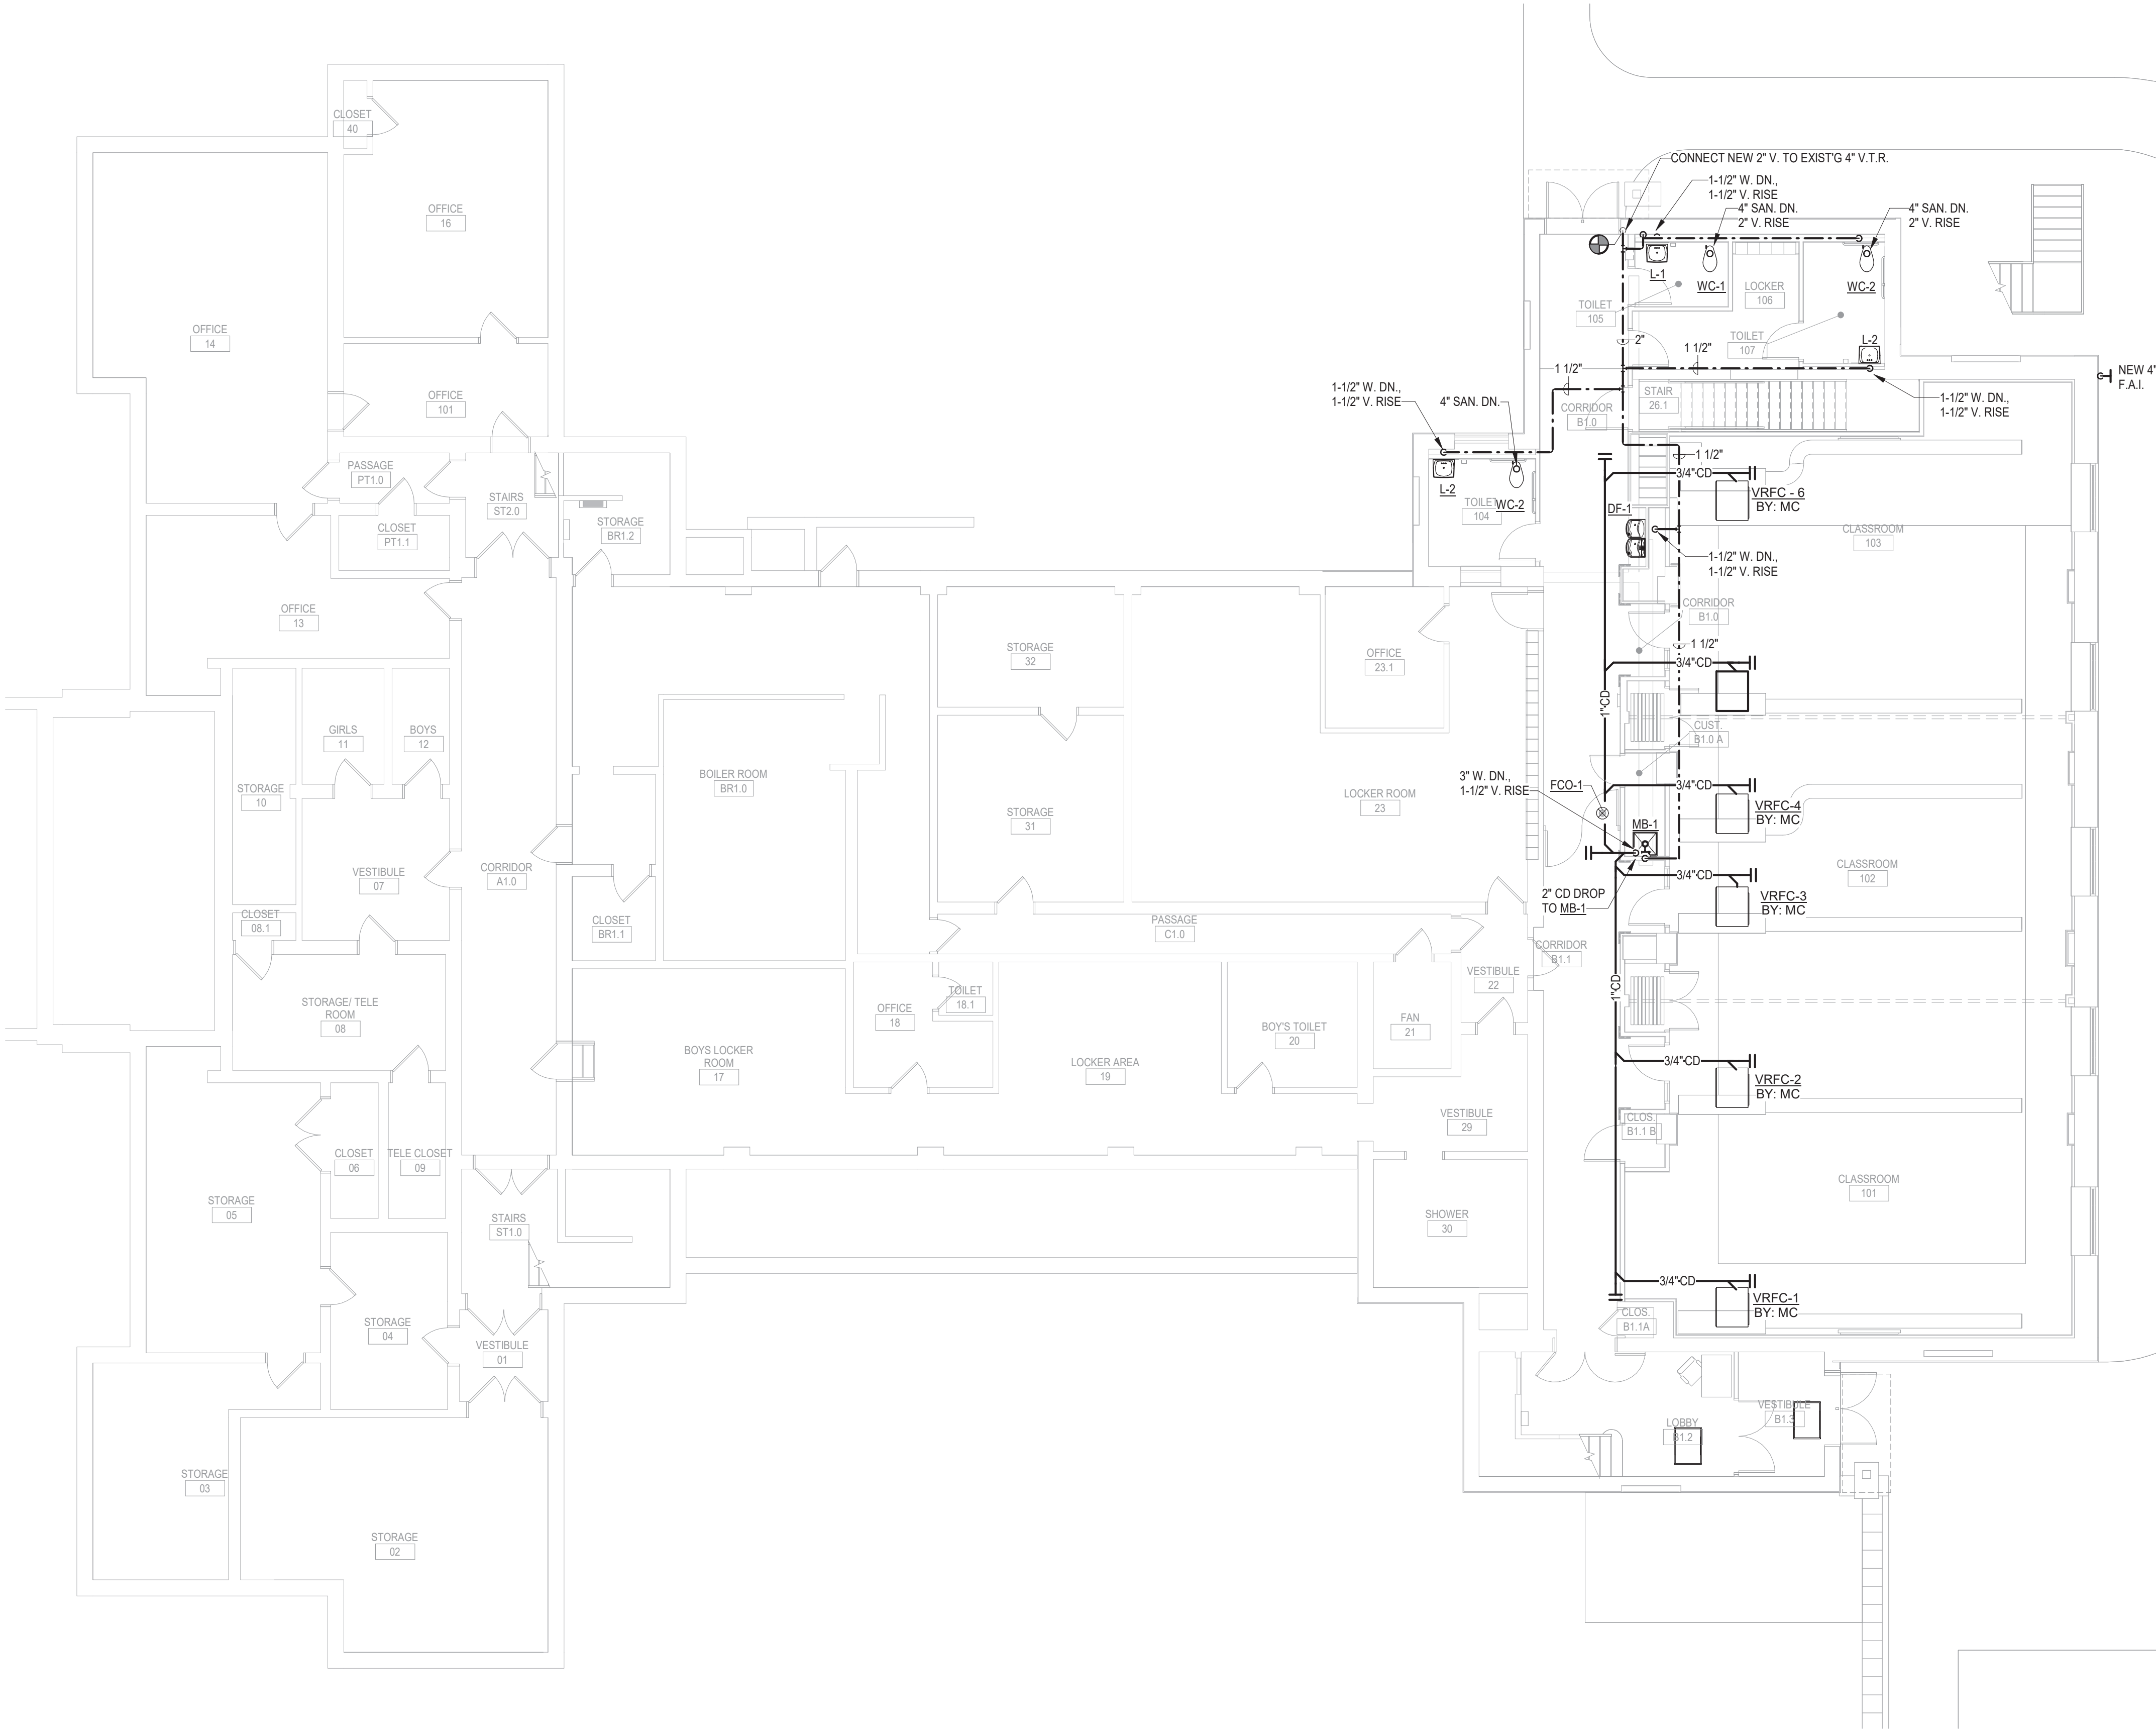

2 BASEMENT DRAINAGE PLAN

SCALE: 1/8" = 1'-0"

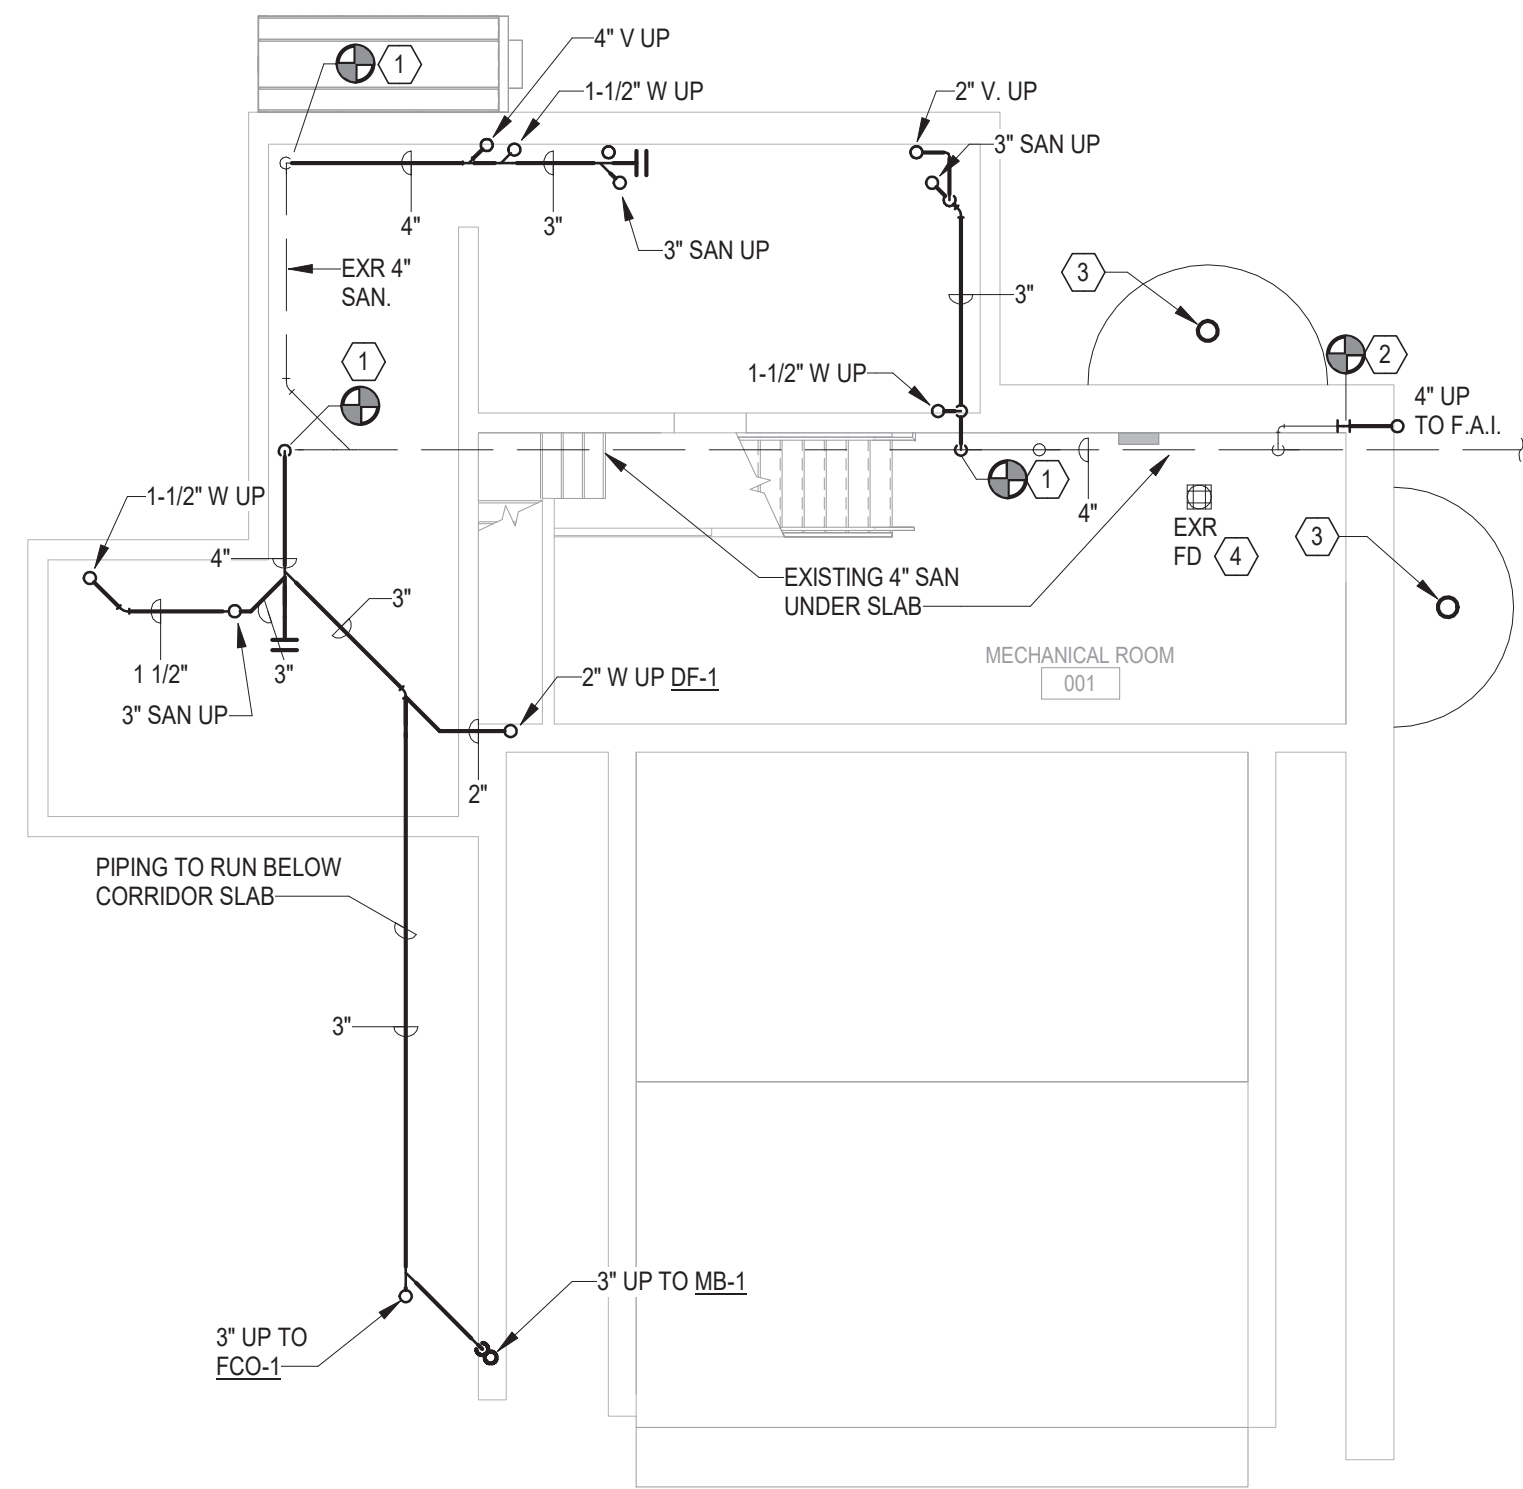

DRAWING NOTES:

1. CONNECT NEW SANITARY WASTE PIPING TO EXISTING SANITARY RISERS.
2. CONNECT NEW 4" FRESH AIR INLET PIPING TO EXISTING. SEE DETAIL # 1/P001.
3. EXISTING WINDOW WELLS AND DRAIN AT BOTTOM TO BE CLEANED OUT. DRAIN SHALL BE FLUSHED AND JETTED.
4. EXISTING FLOOR DRAIN TO BE CLEANED AND FLUSHED. PROVIDE NEW STRAINER.

SED NUMBERS: ■ Administration Building: 66-15-00-01-0-009-013

BEFORE WORK IS STARTED, CONTRACTOR SHALL VERIFY ALL THE DIMENSIONS AT THE SITE AND IMMEDIATELY NOTIFY THE ARCHITECT OF ALL DISCREPANCIES.

ALTERNATION OF THIS DOCUMENT BY OTHER THAN AN AUTHORIZED LICENSED REGISTERED ARCHITECT IS ILLEGAL AND A VIOLATION OF SECTION 2307 OF THE NEW YORK STATE EDUCATION LAW.

Alterations to Administration Building

Peekskill City School District  
Peekskill, New York

Revision:  
09/21/2023

BASEMENT & LOWER LEVEL  
DRAINAGE PLAN

Drawing Number:

APN: 2226.2A Date: 10/11/2024 Drawn by: J.L.

P  
301

engineered solutions




646 Plank Road #104  
Clifton Park, NY 12065  
Phone: (518) 280-2410  
Fax: (518) 280-2481  
www.esolutionspllc.com  
ES # 2408


Consultant:

Seal


Seal

**1 LOWER LEVEL SUPPLY PLAN**  
SCALE: 1/8" = 1'-0"

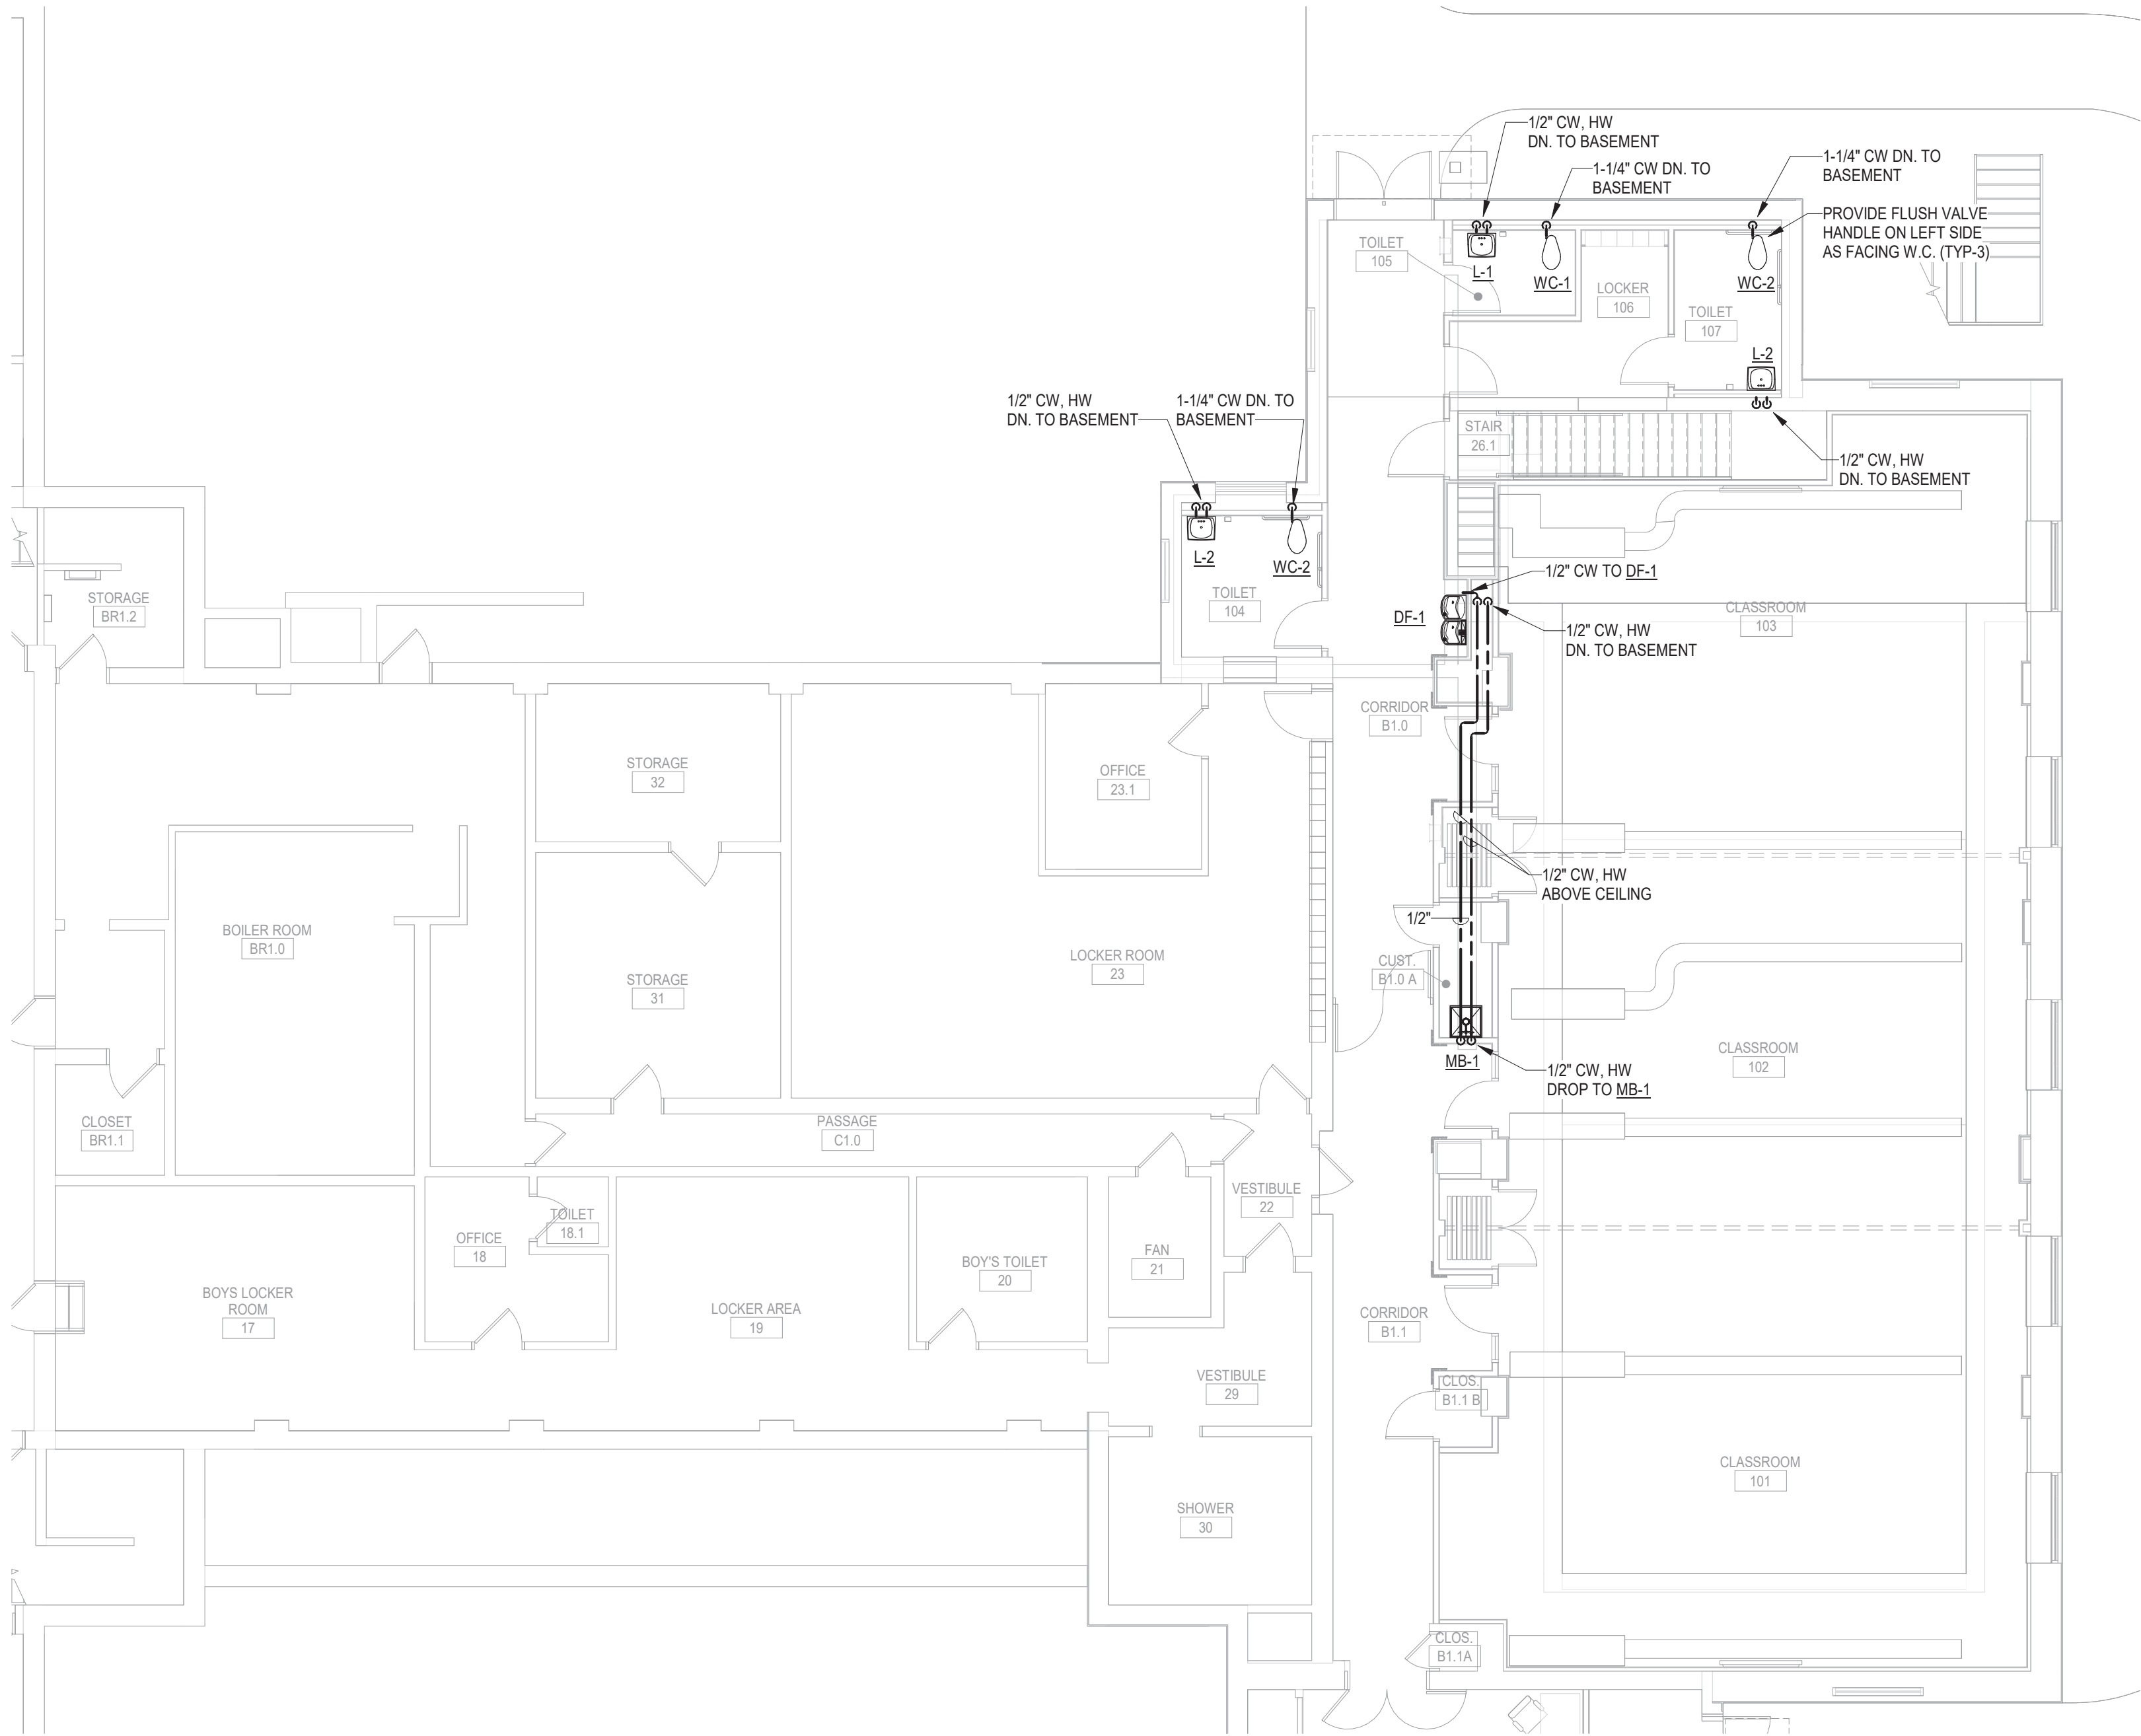

DRAWING NOTES:   
1. CONNECT NEW HOT & COLD WATER TO EXISTING MAIN PIPING.

**2 BASEMENT SUPPLY PLAN**  
SCALE: 1/8" = 1'-0"

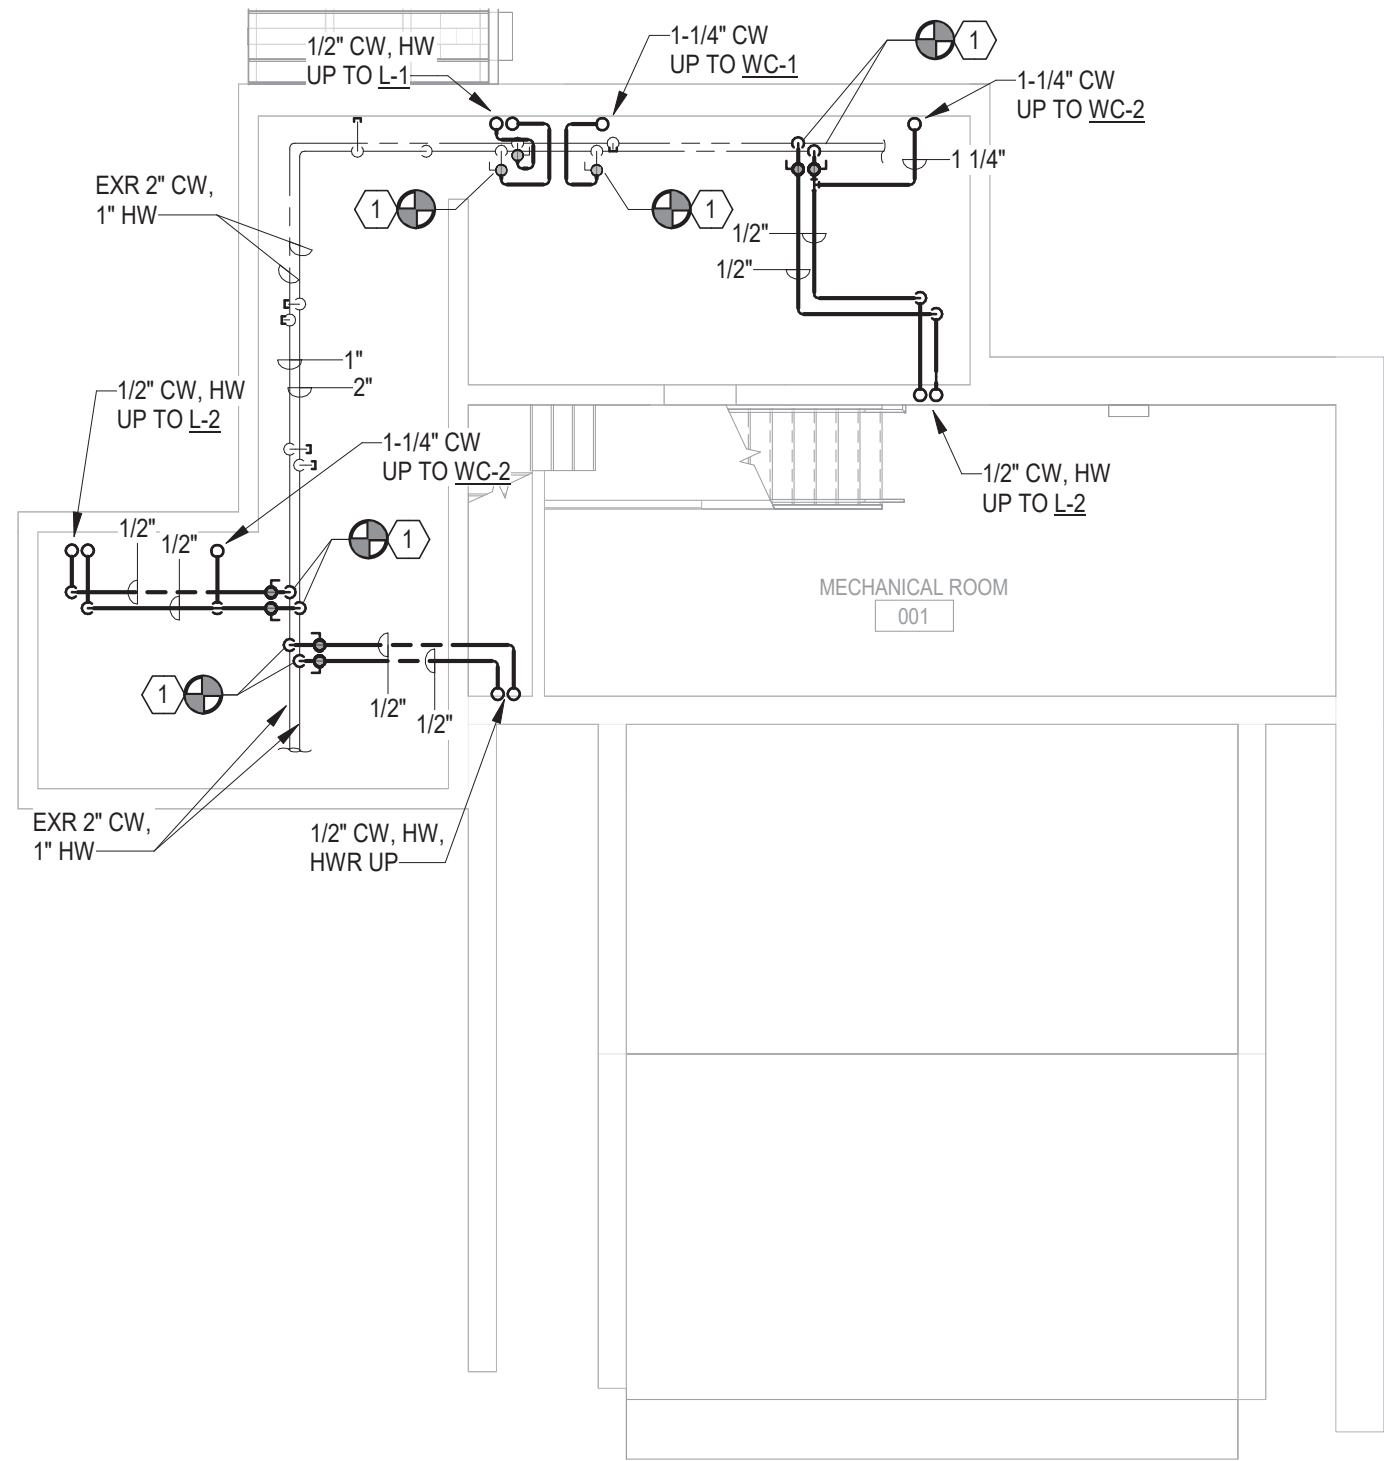

SED NUMBERS: ■ Administration Building: 66-15-00-01-0-009-013

BEFORE WORK IS STARTED, CONTRACTOR SHALL VERIFY ALL THE DIMENSIONS AT THE SITE AND IMMEDIATELY NOTIFY THE ARCHITECT OF ALL DISCREPANCIES.

ALTERNATION OF THIS DOCUMENT BY OTHER THAN AN AUTHORIZED LICENSED REGISTERED ARCHITECT IS ILLEGAL AND A VIOLATION OF SECTION 2307 OF THE NEW YORK STATE EDUCATION LAW.

Revision:  
05/21/2025

Drawing Title:  
**BASEMENT & LOWER LEVEL  
SUPPLY PLAN**

Drawing Number:

**P  
401**

APN: 2226.2A Date: 10/11/2024

Drawn by: J.L.

**Alterations to Administration Building**

Peekskill City School District  
Peekskill, New York

Consultant:

Seal

engineered solutions

646 Plank Road #104  
Clifton Park, NY 12065  
Phone: (518) 280-2410  
Fax: (518) 280-2481  
www.esolutionspllc.com  
ES # 2408

**MOSAIC  
ASSOCIATES**