



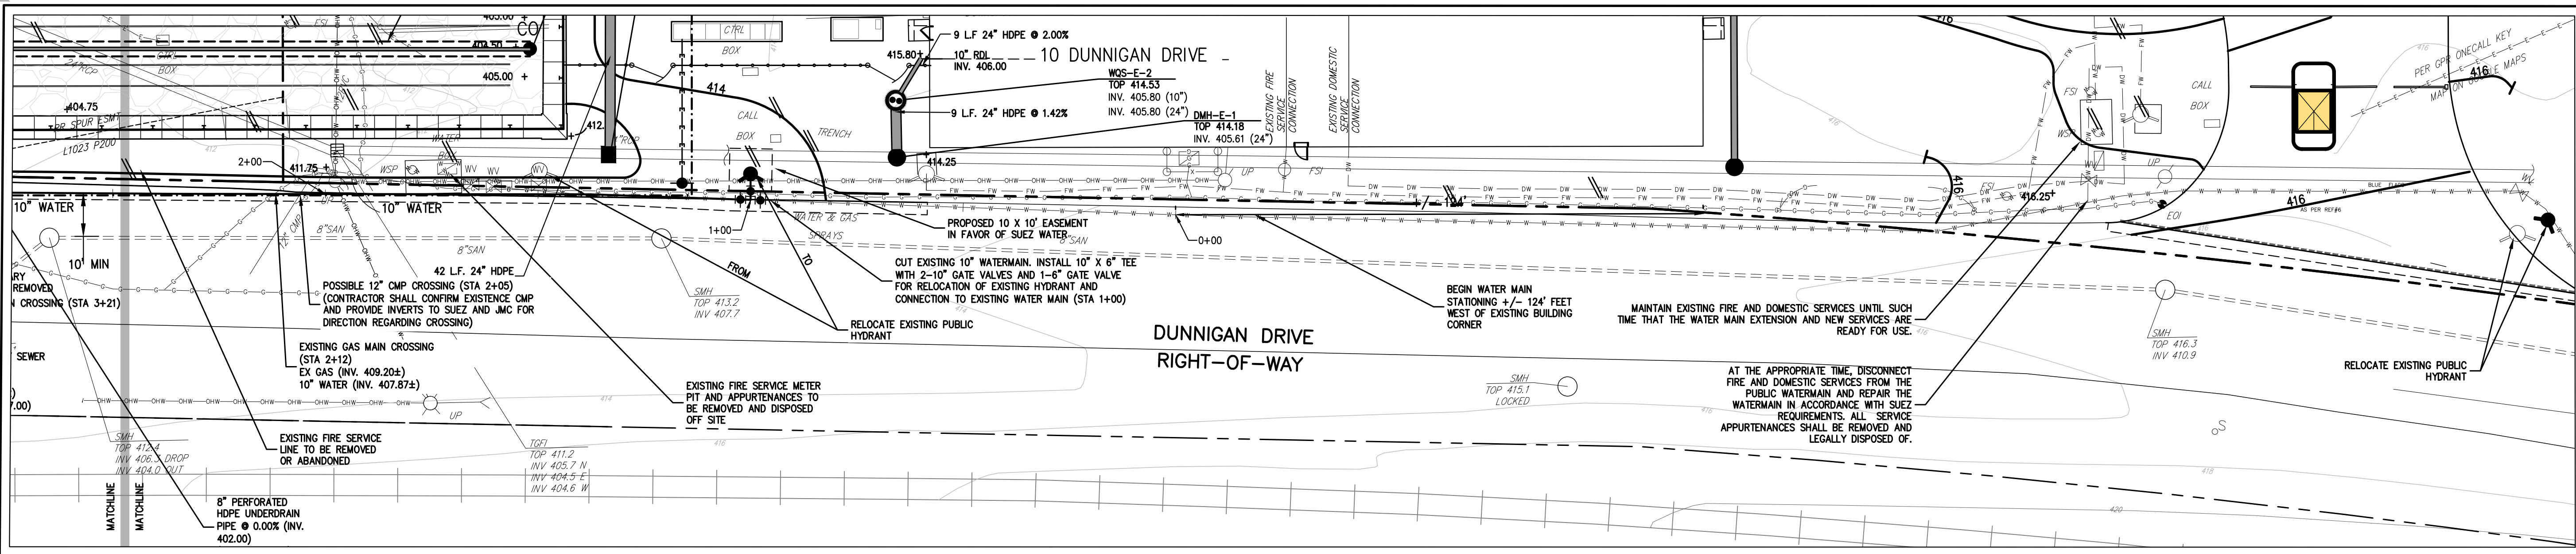


WATER MAIN EXTENSION PLAN STATION - 0+00-2+83

SCALE: 1"=20'

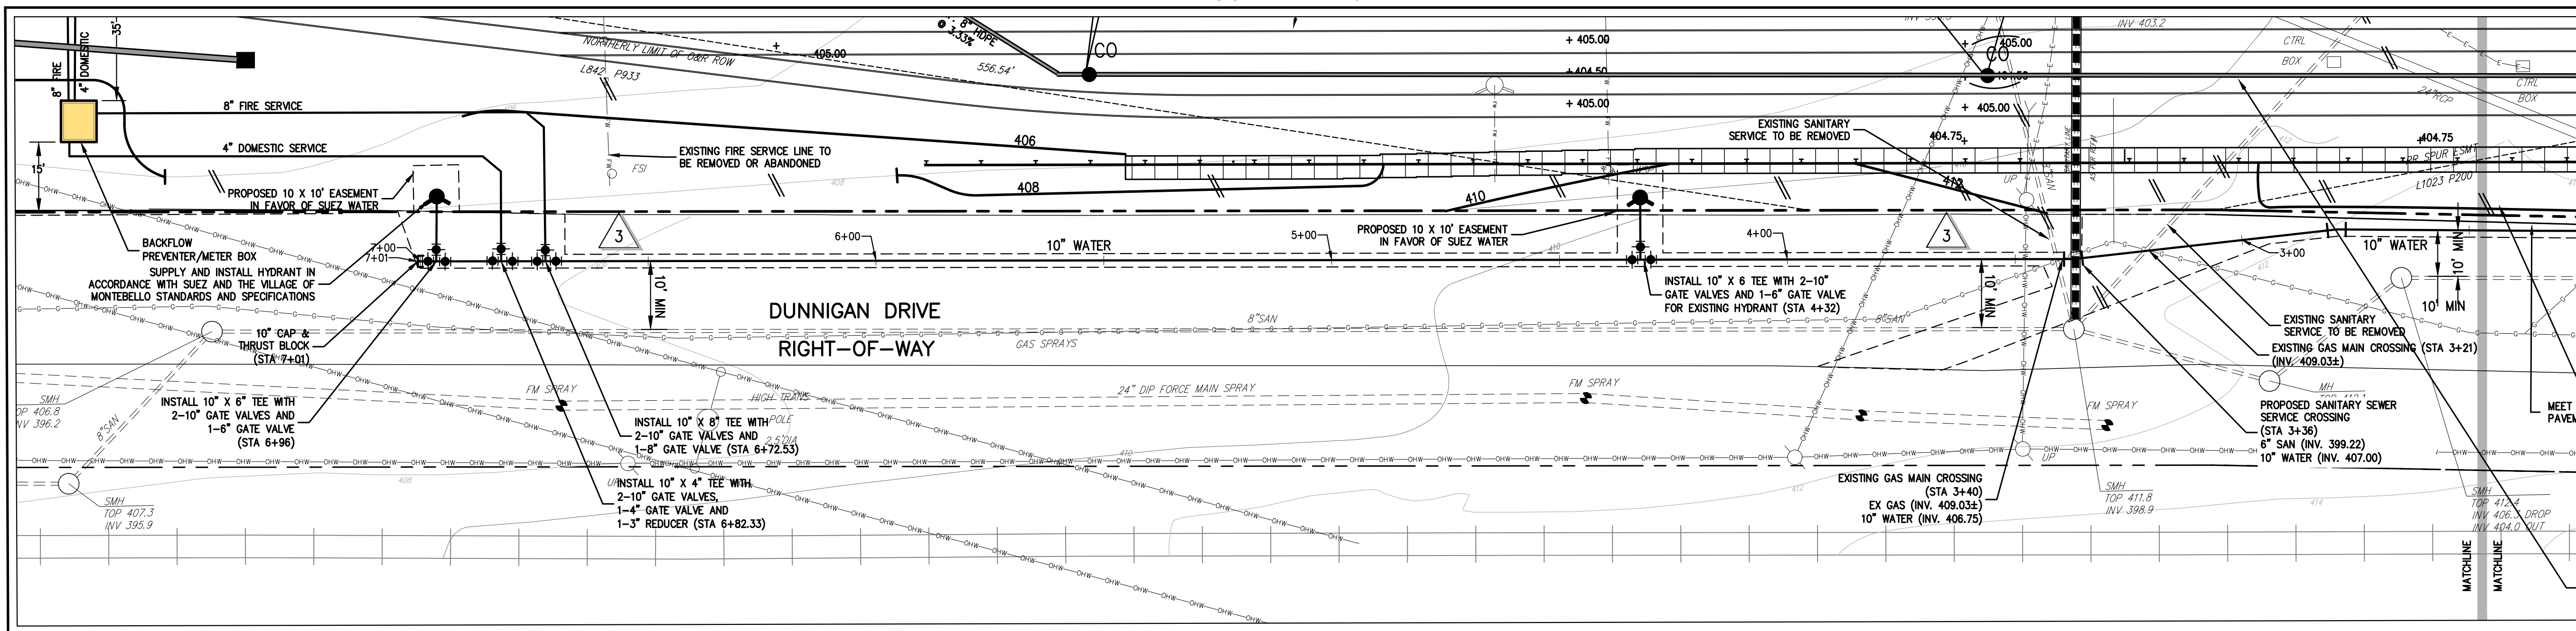


WATER MAIN EXTENSION PLAN STATION - 2+83-7+01

SCALE: 1"=20'

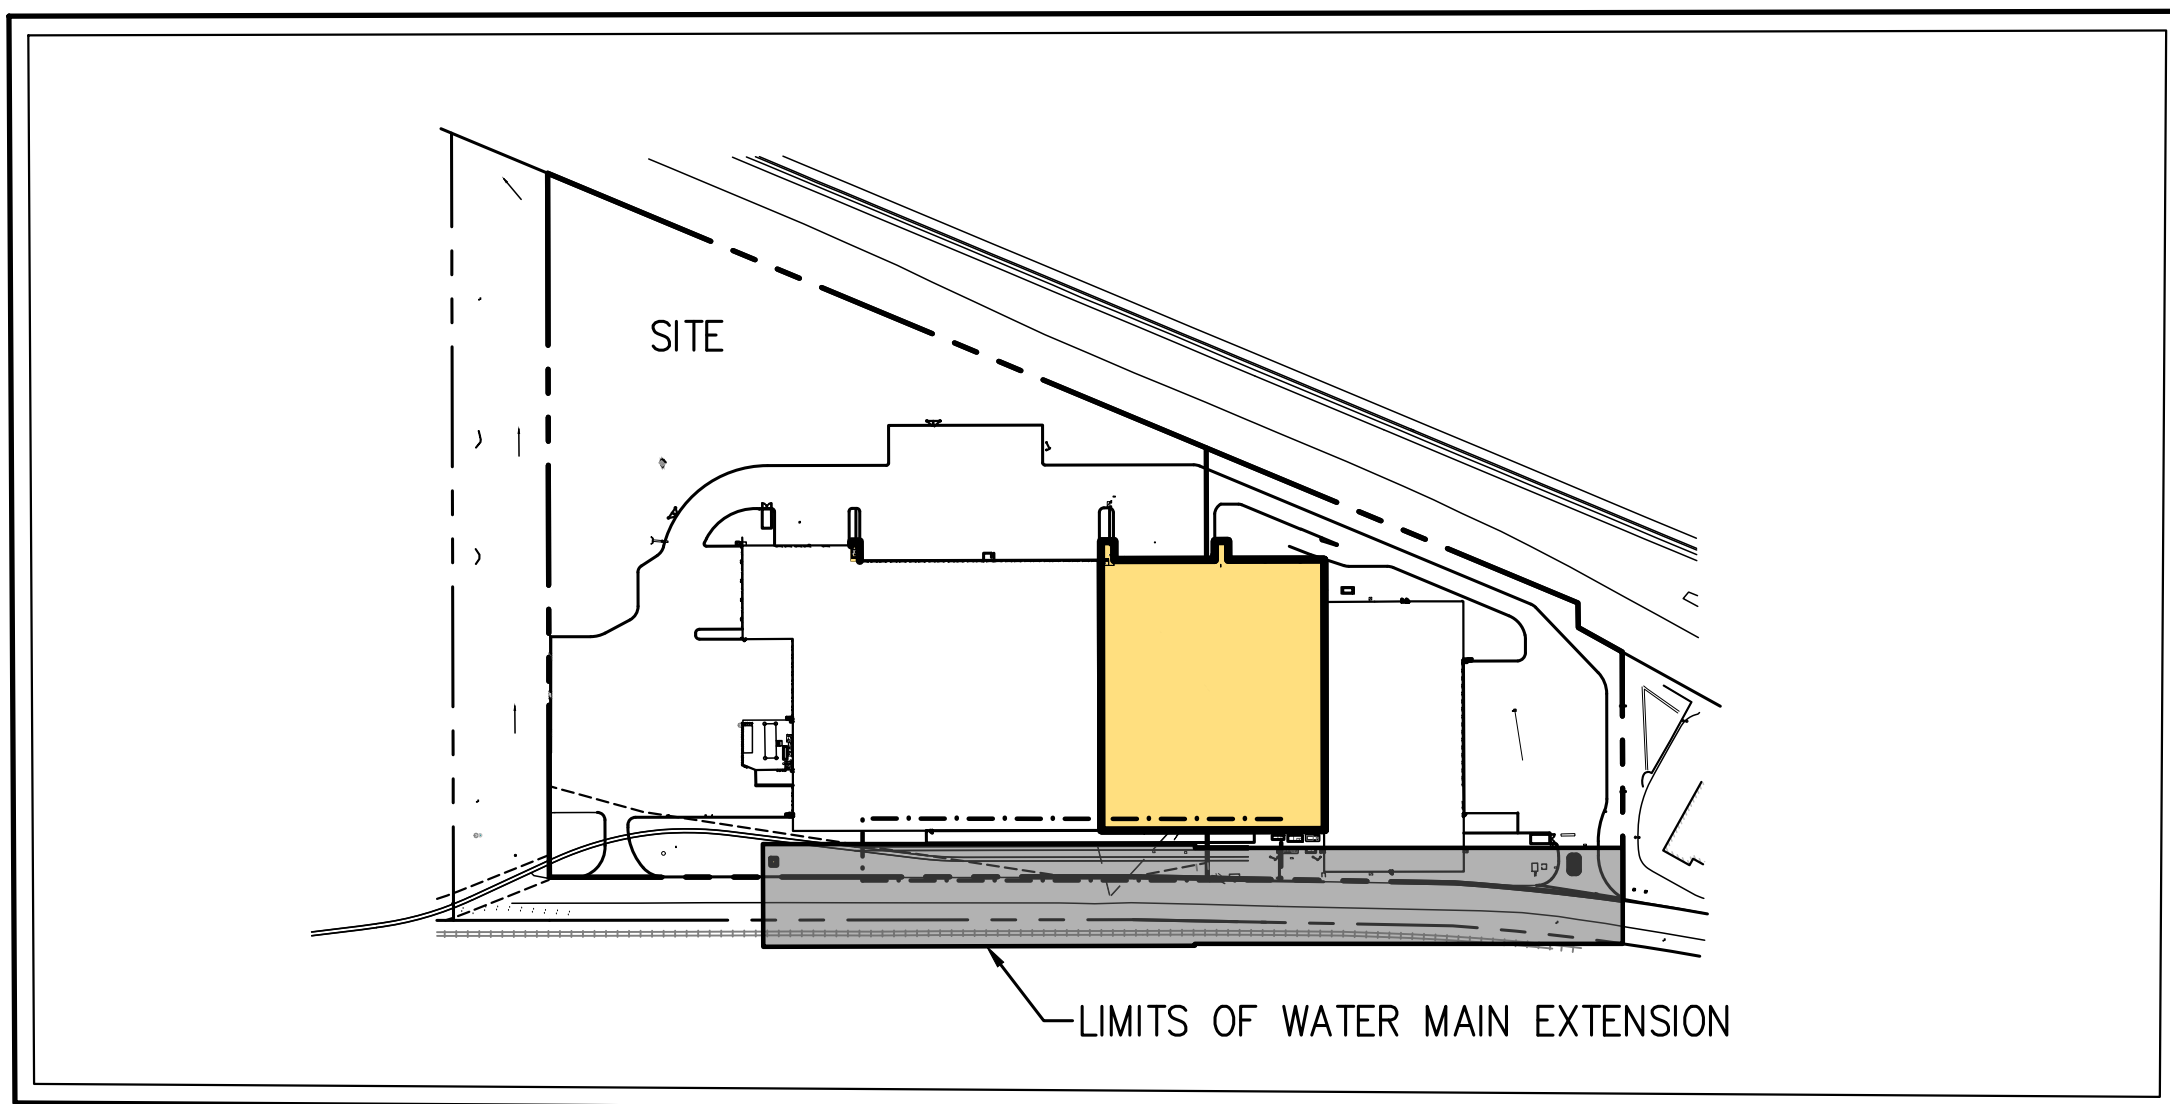

NOTES:

- EXISTING CONDITIONS DEPICTED HEREON HAVE BEEN TAKEN FROM SURVEY TITLED "SURVEY OF PROPERTY," PREPARED BY JAY A. GREENWELL, PLS, LLC, LAST REVISED ON 07/27/21 AND FURTHER SUPPLEMENTED WITH INFORMATION PROVIDED ON 08/30/2021. PRIOR TO ISSUANCE OF A BID, THE CONTRACTOR SHALL SATISFY HIMSELF AS TO THE ACCURACY OF THE EXISTING CONDITIONS. ANY DISCREPANCIES SHALL BE REPORTED TO THE OWNER'S FIELD DEPARTMENT AND JMC.
- THIS PLAN IS PROVIDED FOR REVIEW, APPROVAL, AND CONSTRUCTION OF THE PROPOSED PUBLIC WATER MAIN EXTENSION AND ASSOCIATED IMPROVEMENTS. THE CONTRACTOR SHALL REFER TO THE FULL SET OF C-SERIES DRAWINGS FOR OTHER IMPROVEMENTS SHOWN HEREON. ANY DISCREPANCIES SHALL BE BROUGHT TO THE IMMEDIATE ATTENTION OF JMC IN WRITING PRIOR TO THE START OF CONSTRUCTION.
- UNLESS OTHERWISE SPECIFIED, PIPE FOR WATER LINES SHALL BE DOUBLE CEMENT-LINED DUCTILE IRON PIPE (DIP), CLASS 52, WITH PUSH-ON JOINTS IN ACCORDANCE WITH AWWA C-150, C-151, C-104 AND C-111, WITH PLAIN TIPPED RUBBER GASKETS AND 2 BRASS WEDGES PER JOINT. FITTINGS SHALL BE CEMENT LINED AND MECHANICAL JOINT, AWWA C-153, C-111 AND C-104; PRESSURE RATED 350 PSI.
- ALL WORK SHALL BE PERFORMED IN ACCORDANCE WITH THE SUEZ AND VILLAGE OF MONTEBELLO STANDARDS AND SPECIFICATIONS.

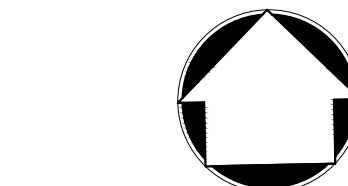

ANY ALTERATION OF PLANS, SPECIFICATIONS, PLATS AND REPORTS BEARING THE SEAL OF A LICENSED PROFESSIONAL ENGINEER OR LICENSED LAND SURVEYOR IS A VIOLATION OF SECTION 7209 OF THE NEW YORK STATE EDUCATION LAW, EXCEPT AS PROVIDED FOR BY SECTION 7209, SUBSECTION 2.

ARCHITECT
di Domenico + Partners LLP
Architecture
Landscape Architecture
Planning
3743 Crescent Street, 3rd Floor
Long Island City, New York 11101
Tel 212-337-0400
Fax 212-337-3567

CIVIL PLANNING ENGINEER
JMC
JMC Planning Engineering Landscape
Architecture & Land Surveying, PLLC
120 Bedford Road
Armonk, New York 10504
Tel 914-273-5225
Fax 914-273-2102

MEP ENGINEER
Burns
BURNS ENGINEERING, PC.
1261 Broadway, Suite 708
New York, New York 10001
Tel 212-962-3503

STRUCTURAL ENGINEER
GEI
GEI50
1385 Broadway, 20th FL
New York, New York 10018
Tel 212-687-8282

MANHATTAN BEER DISTRIBUTORS
20 DUNNIGAN DRIVE
SUFFERN, NEW YORK

REV	DESCRIPTION	DATE
1	ISSUED FOR DOB SUBMISSION	09.10.21
2	ISSUED FOR BID	10.15.21
3	REVISED FOR SUEZ SUBMISSION	10.29.21
4	REVISED BID/PERMIT SET	02.25.22

DRAWN BY:	DC
CHECKED BY:	JPM/JAR
APPROVED BY:	DL
DATE:	09.10.2021
SCALE:	AS NOTED
ISSUE:	

DRAWING TITLE:
**WATER MAIN EXTENSION
PLAN**

DWG NUMBER:
C-304

STATE OF NEW YORK
DAVID P. LOMBARDI
LICENSED PROFESSIONAL ENGINEER
071001

JMC PROJECT: 19005-1
SCR WATER MAINS
DWG FILE: 10054-018

COPYRIGHT © 2021 BY JMC. All Rights Reserved. No part of this document may be reproduced, stored in a retrieval system, or transmitted, in any form or by any means, electronic, mechanical, photocopying, recording or otherwise, without the prior written permission of JMC. JMC PLANNING ENGINEERING LANDSCAPE ARCHITECTURE & LAND SURVEYING, PLLC, A PROFESSIONAL CORPORATION, 120 BEDFORD ROAD, ARMONK, NEW YORK 10504. ANY MODIFICATION OR ALTERATION TO THIS DOCUMENT WITHOUT THE WRITTEN PERMISSION OF JMC SHALL BE AT THE USER'S SOLE RISK AND WITHOUT LIABILITY.