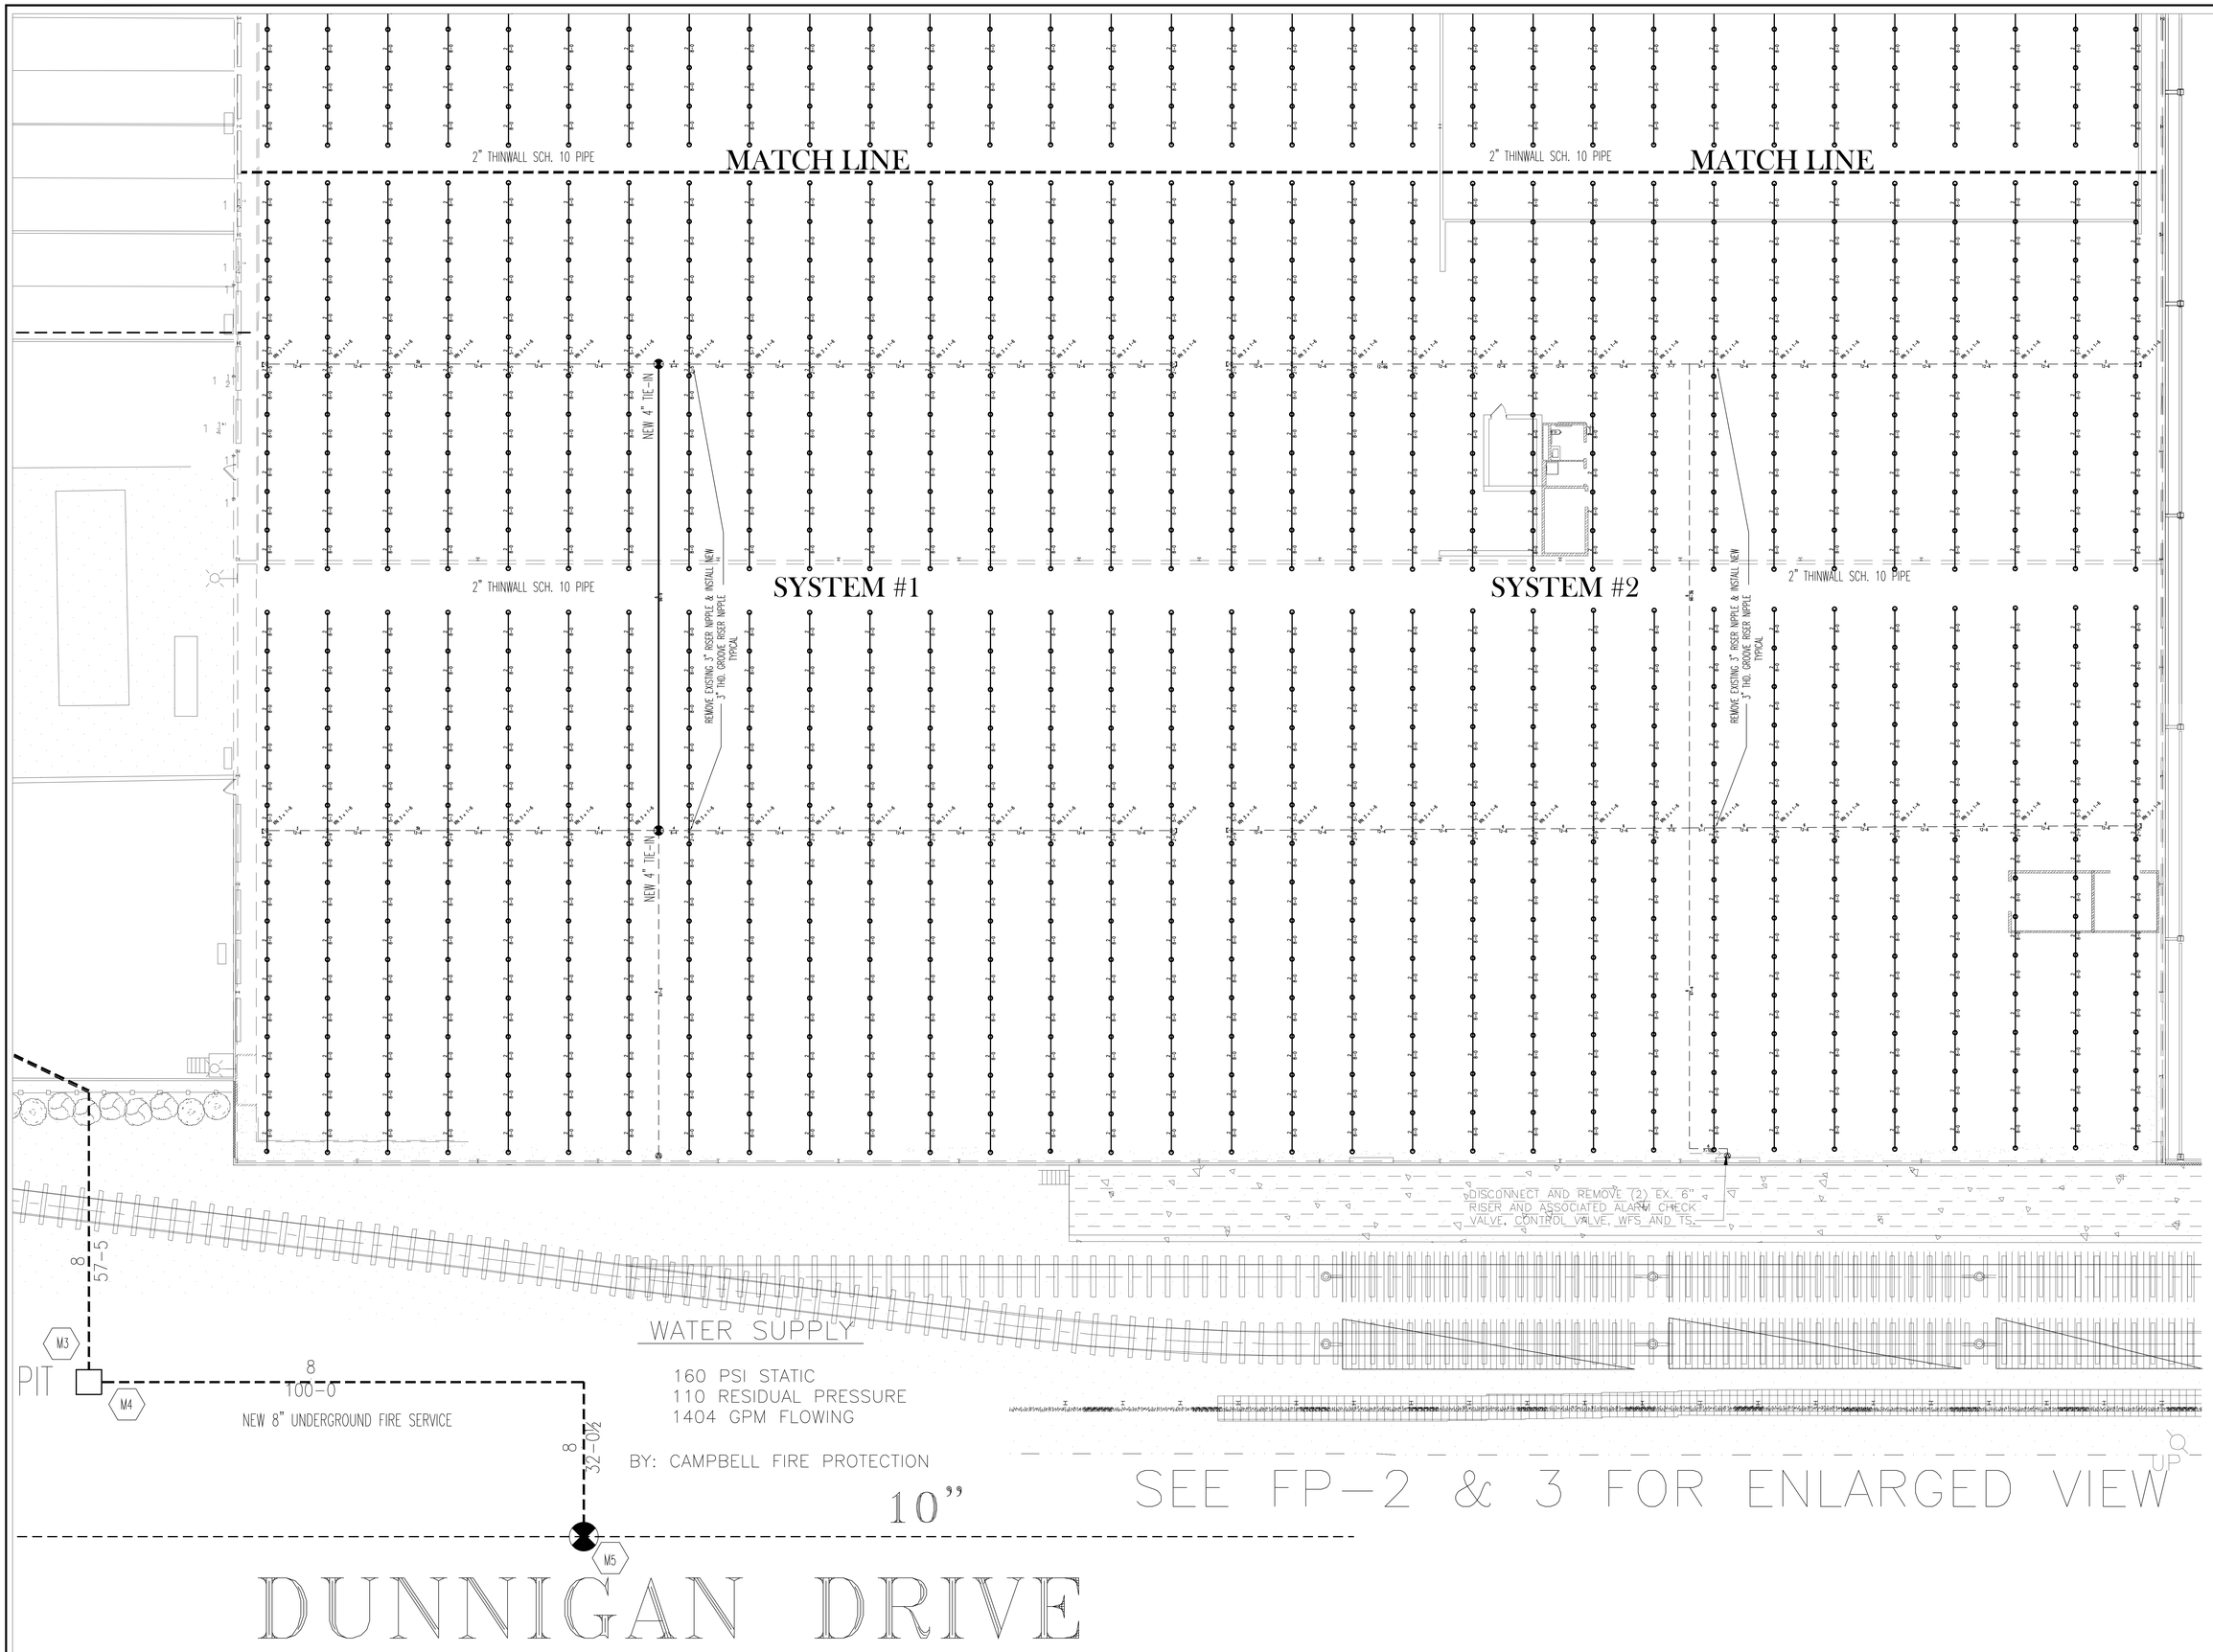

Contractor:

Campbell Fire Protection Inc
43 Chestnut Street
Suffern, New York 10901
tel: 845-357-1441
fax: 845-357-1444

Protection Of Pipe Against Freezing
Use Dry Pipe Sprinkler Systems Where Wet Pipe Sprinkler Systems Against Freezing.

Indicates Centerline Of Pipe Above Finished Floor.
Indicates Centerline Of Pipe Below Top Of Steel.
Indicates Hydraulic Reference Point.

Fire Protection
Consulting
Design
Engineering

PRO-FIRE SYSTEMS

89 High Street
Nutley, New Jersey 07110
tel: (973) 338-3600
fax: (973) 338-4499
www.profiresystems.com

No.	Date & Description
	REVISIONS

DRAWING TITLE: FIRE PROTECTION SPRINKLER SYSTEM #1 & #2

PROJECT: MANHATTAN BEER
20 DUNNIGAN DRIVE
SUFFERN, NEW YORK

DESIGNER: PFS
JOB No.
DATE: 6/16/2022
SCALE: 3/16"=1'-0"
FILENAME: CAMP
DWG. No.

FP-2

of 3