



- KEYED NOTES:**
- DISCONNECT AND REMOVE UTILITY EXHAUST FAN LOCATED WITHIN ATTIC ABOVE SECOND FLOOR. DISCONNECT AND REMOVE EA INLET DUCTWORK AT DISCONNECTION POINT. DISCONNECT AND REMOVE EA OUTLET DUCTWORK UP THROUGH ROOF PENETRATION.
 - DISCONNECT AND REMOVE CEILING MOUNTED EXHAUST FAN INCLUDING ASSOCIATED EA DUCTWORK ABOVE CEILING.
 - DISCONNECT, REMOVE, AND SALVAGE TEMPERATURE SENSOR AT LOCATION TO ACCOMMODATE ARCHITECTURAL RENOVATIONS. REFER TO INSTALLATION PLAN FOR RELOCATION.
 - DISCONNECT AND REMOVE FLEXIBLE DUCTWORK BETWEEN CONNECTION POINTS SHOWN. CAP DUCTWORK AT SA MAIN AND REMOVE FLEXIBLE DUCTWORK CONNECTED TO SA DIFFUSER. MAINTAIN SA DIFFUSER AT LOCATION SHOWN FOR REUSE.
 - DISCONNECT AND REMOVE CEILING EXHAUST AIR REGISTER INCLUDING ASSOCIATED FLEXIBLE DUCTWORK TO DISCONNECTION POINT SHOWN ON THE 12"x12" EA MAIN WITHIN THE CEILING OF CORRIDOR 1-045.
 - DISCONNECT AND REMOVE UN-DUCTED CEILING EA REGISTER OPEN TO CEILING PLENUM ABOVE CEILING SYSTEM.
 - DISCONNECT AND REMOVE CONNECTOR ELEMENT, CONNECTOR ENCLOSURE, HWS/R PIPING DOWN TO FIRST FLOOR CEILING AND ASSOCIATED TEMPERATURE SENSOR. DISCONNECT AND REMOVE CONTROL WIRING.
 - DISCONNECT AND REMOVE FLEXIBLE DUCTWORK BACK TO DISCONNECTION POINT SHOWN ON THE SA MAIN AND CAP. DISCONNECT AND REMOVE ASSOCIATED SA DIFFUSER.
 - DISCONNECT AND REMOVE 3/4" HWS/R PIPING BETWEEN DISCONNECTION POINTS TO ACCOMMODATE WALL REMOVAL WORK.

J1 1ST FLOOR VESTIBULE REMOVALS
1/4" = 1'-0"

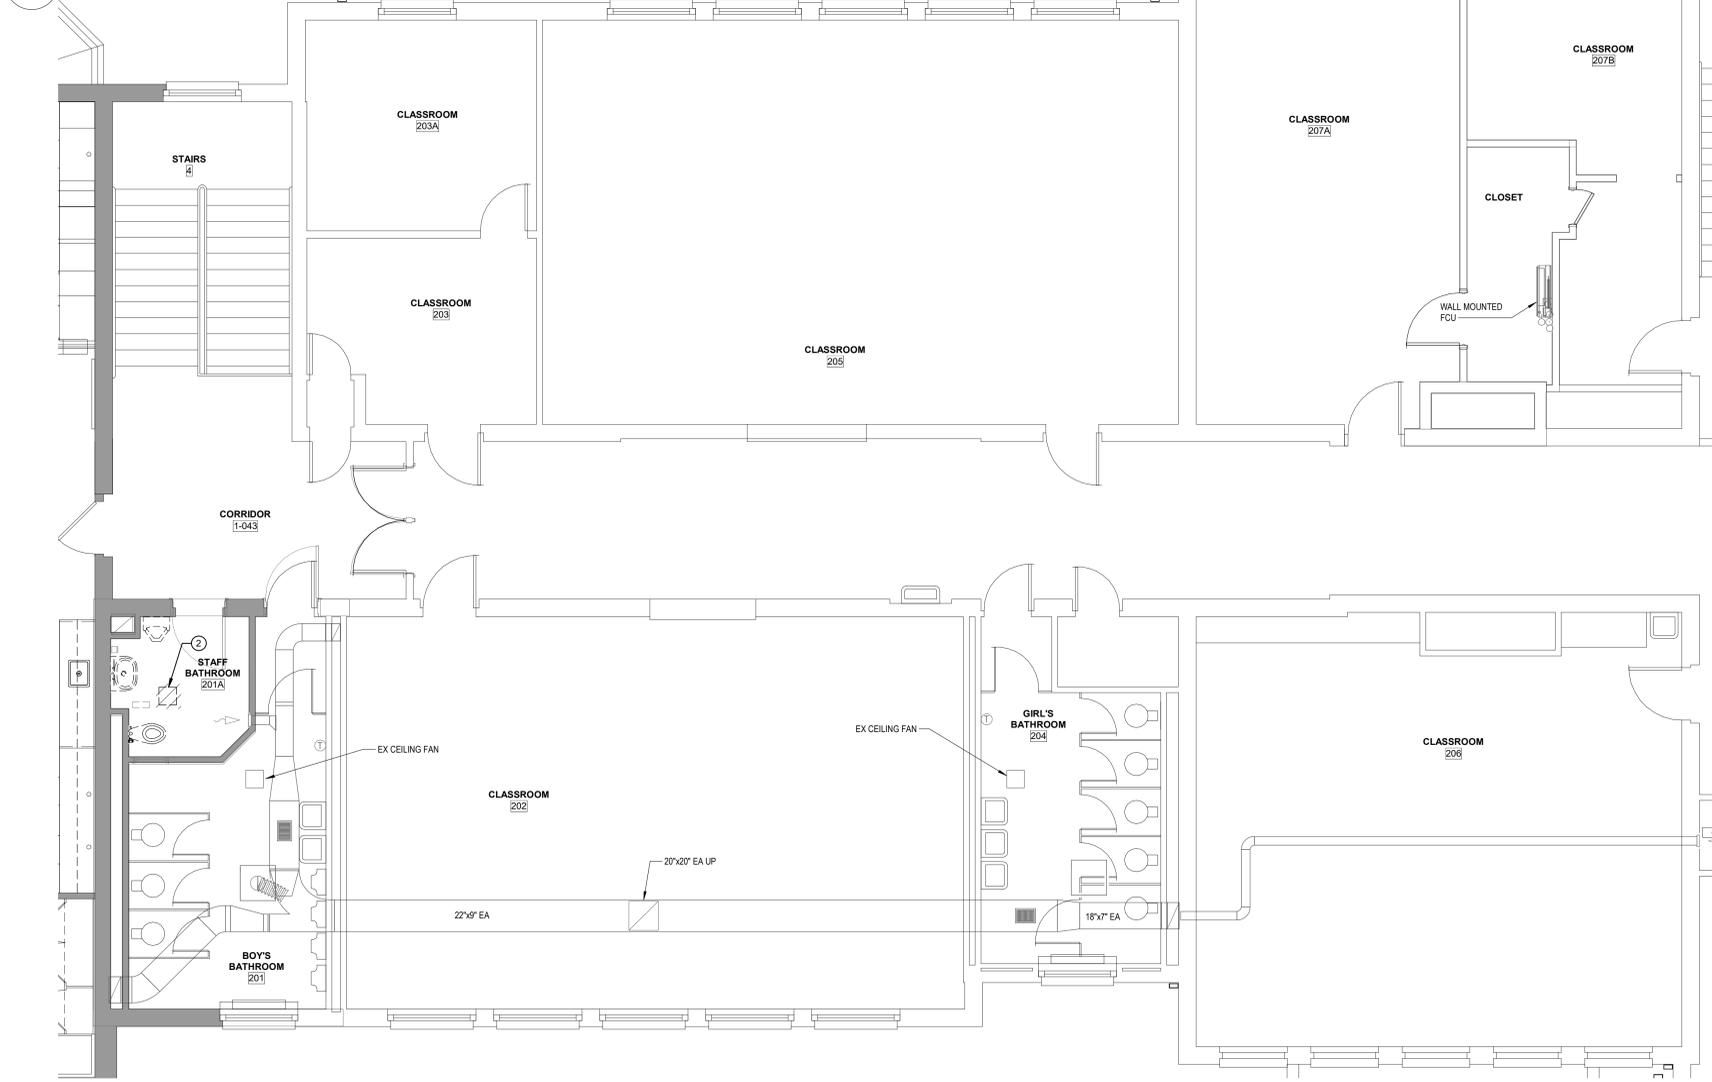

A18 2ND FLOOR NORTH TOILET ROOMS REMOVALS
1/4" = 1'-0"

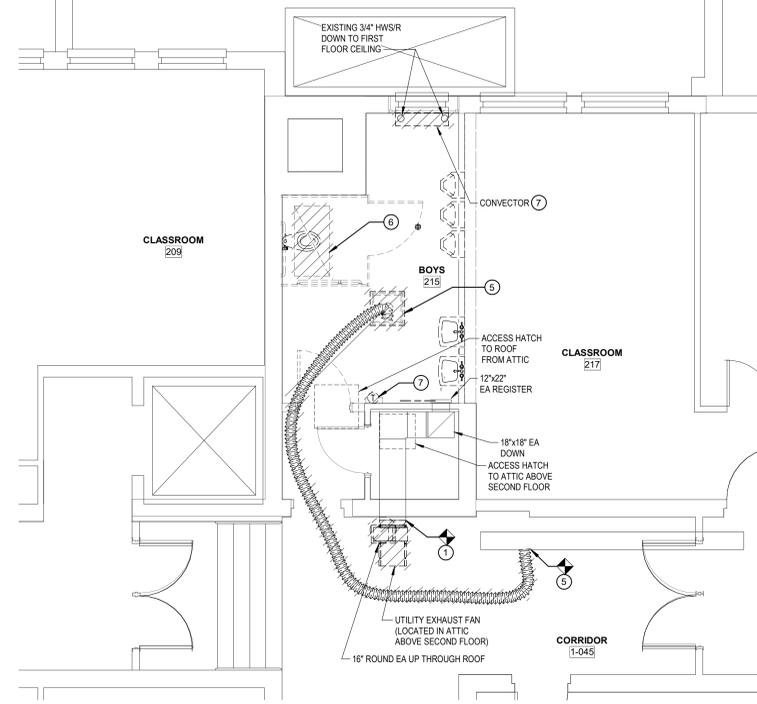

A6 2ND FLOOR CENTER TOILET ROOM REMOVALS
1/4" = 1'-0"

ARCHITECT
ksqdesign
NEW YORK OKLAHOMA

KSQ Design
215 W 40th Street 15th Floor
New York, NY 10018
646.435.0660 office
www.ksqdesign.com

Owner
Nanuet Union Free School District
101 Church Street
Nanuet, NY 10954
845.627.9880
www.nanuetd.org

Structural Engineer
Clapper Structural Engineering
160 Partition Street
Saugerties, NY 12477
845.943.9801
www.clappersstructural.com

MEP Engineer
Sage Engineering Associates, LLP
9 Columbia Circle
Albany, NY 12203
518.453.6091
www.sagegrp.com
www.nyprofessionalnumbers.com


Environmental Engineer
Quest Environmental Solutions
1376 Route 9
Wappingers Falls, NY 12590
845.298.6251
www.qualityenv.com

Construction Manager
Jacobs
One Penn Plaza
24th Floor, Suite 2400
New York, NY 10119
646.906.6550
www.jacobs.com



NUFSD BOND PROJECT PHASE 5 - HIGHVIEW

- SED#50-01-08-03-0-002-020 (HIGHVIEW ES)
 - SED#50-01-08-03-0-003-001-002 (Maintenance)
 - SED#50-01-08-03-0-003-001-004 (OEC)
 - SED#50-01-08-03-0-001-028 (MILLER ES)
 - SED#50-01-08-03-0-004-022 (BARR MS)
- Highview Elementary School**
24 Highview Ave
Nanuet, NY 10954
- OEC Building**
135 Convent Rd
Nanuet, NY 10954
- Maintenance Building**
103 Church St.
Nanuet, NY 10954
- Miller Elementary School**
50 Blauvelt Rd Unit 1
Nanuet, NY 10954
- A MacArthur Barr Middle School**
143 Church St
Nanuet, NY 10954



REVISIONS

No.	Description	Date
1	BID ADDENDUM #4	02/05/25

ISSUED: BID SET
DATE: 06/21/2024
SCALE: 1/4" = 1'-0"
SHEET NAME: 1ST FLOOR VESTIBULE, 2ND FLOOR, AND ATTIC HVAC REMOVALS
SHEET NUMBER:

HE-MR102

ISSUE FOR BID SET

2/4/2025 8:42:14 AM