## **DESIGN DATA:**

STRUCTURAL DESIGN HAS BEEN PERFORMED IN ACCORDANCE WITH THE FOLLOWING CODES AND STANDARDS:

A) 2020 NEW YORK STATE BUILDING CODE. B) ACI 318-14, BUILDING CODE REQUIREMENTS FOR STRUCTURAL CONCRETE C) AISC, MANUAL OF STEEL CONSTRUCTION, ALLOWABLE STRESS DESIGN, 14TH ED.

1. DEAD LOADS SELF WEIGHT + ROOF: 10 PSF CEILING: 10 PSF

FLOOR: 15 PSF 2. LIVE LOADS

FLOOR - 100 PSF

3. WIND LOADS BASIC WIND SPEED: 115 MPH (3-second gust) RISK CATEGORY: III

# 4. SNOW LOADS

GROUND SNOW LOAD: 30 PSF DESIGN FLAT ROOF SNOW LOAD: 30 PSF

### 5. SEISMIC

RISK CATEGORY: III SITE CLASS: D Sds: 0.264g Sd1: 0.093g SEISMIC DESIGN CATEGORY: B

**EXPOSURE CATEGORY: B** 

## **GENERAL INFORMATION:**

(UNLESS OTHERWISE NOTED OR SHOWN ON PLAN, THE FOLLOWING SHALL APPLY)

"LOADS" INDICATED ON THIS DRAWING ARE THOSE FOR THE DESIGN OF THE BUILDING

- SUPERSTRUCTURE ALL DETAILS MARKED "TYPICAL" IN THE SET OF STRUCTURAL DRAWINGS SHALL BE APPLIED THROUGHOUT THE PROJECT AS REQUIRED TO SATISFY THE REQUIREMENTS OF THE CONSTRUCTION DOCUMENTS. THE CONTRACTOR SHALL COORDINATE REQUIREMENTS FOR QUANTITY AND LOCATION WHERE THE "TYPICAL" DETAILS APPLY.
- 2. FAILURE ON THE PART OF THE CONTRACTOR TO REVIEW THE DRAWINGS OF OTHER DISCIPLINES (i.e. ARCHITECTURAL, MECHANICAL, ELECTRICAL, PLUMBING, ETC.) TOGETHER WITH THE FULL EXTENT OF THE PROJECT SPECIFICATIONS DOES NOT RELIEVE THEM OF THE RESPONSIBILITY TO FURNISH AND INSTALL ITEMS THAT ARE PART OF THEIR WORK AS INDICATED BY THE DRAWINGS AND SPECIFICATIONS OF OTHER TRADES. ALL STRUCTURAL TRADE CONTRACTORS AND SUB-CONTRACTORS ARE PROHIBITED FROM EXCLUDING STRUCTURAL WORK FROM THEIR CONTRACT NOT SHOWN IN THE STRUCTURAL DRAWINGS.
- 3. ALL CONTRACTORS AND SUBCONTRACTORS WORKING ON THIS PROJECT TO HAVE A MINIMUM OF 5 YEARS VERIFIABLE EXPERIENCE IN THEIR RESPECTIVE FIELDS.
- 4. THE CONTRACTOR SHALL VERIFY ALL DIMENSIONS IN FIELD PRIOR TO ORDERING AND PRE-FABRICATED ITEMS, INCLUDED BY NOT LIMITED TO; TRUSSES, SIPS, PLANK AND STEEL.
- 5. DRAWINGS MAY NOT BE SCALED. USE NOTES AND DIMENSIONS SPECIFIED ON DRAWINGS AND CONFIRM THESE DIMENSIONS WITHIN FIELD MEASUREMENTS DURING CONSTRUCTION.
- 6. DISCREPANCIES, OMISSIONS OR UNFORESEEN PROBLEMS DISCOVERED AT SITE SHALL BE REPORTED TO THE ENGINEER FOR IMMEDIATE CONSULTATION AND AMENDMENT.
- 7. TEMPORARY SHORING AND SHORING OF EXCAVATION IS BY OTHERS. THESE DRAWINGS SHOW FINAL CONDITIONS ONLY.

#### STRUCTURAL STEEL GENERAL NOTES

(UNLESS OTHERWISE NOTED OR SHOWN ON PLAN, THE FOLLOWING SHALL APPLY)

- 1. STRUCTURAL STEEL SHALL CONFORM TO THE A.I.S.C. STEEL CONSTRUCTION MANUAL 14TH EDITION.
- 2. UNLESS OTHERWISE NOTED, ALL MATERIALS SHALL BE IN ACCORDANCE WITH THE FOLLOWING SPECIFICATIONS.

A.S.T.M. MIN. STRENGTH ROLLED SHAPES 42 KSI BASE PLATES PLATES, CHANNELS, & ANGLES **CONNECTION BOLTS** ANCHOR BOLTS 36 KSI THREADED BOLTS NON-SHRINK GROUT C1107 8,000 PSI

- 3. WELDING SHALL BE IN ACCORDANCE WITH A.W.S. D1.1 USING E70XX ELECTRODES UNLESS OTHERWISE NOTED, PROVIDE CONTINUOUS MINIMUM SIZED FILLET WELDS PER A.I.S.C. REQUIREMENTS. FILLER MATERIAL SHALL HAVE A MINIMUM YIELD STRENGTH OF 58 K.S.I.
- MOMENT CONNECTIONS DENOTED THUS (▶) ON PLAN. SEE TYPICAL DETAILS. HOLES IN STEEL BEAMS SHALL BE DRILLED OR PUNCHED. ALL SLOTTED HOLES SHALL BE PROVIDED WITH SMOOTH EDGES. BURNING OF HOLES AND TORCH CUTTING AT THE
- 6. THE STRUCTURAL STEEL ERECTOR SHALL PROVIDE TEMPORARY GUYING AND BRACING AS REQUIRED. COLUMNS, ANCHOR BOLTS, BASE PLATES, ETC. HAVE BEEN DESIGNED FOR THE FINAL COMPLETE CONDITION, AND HAVE NOT BEEN INVESTIGATED FOR POTENTIAL LOADINGS ENCOUNTERED DURING STEEL ERECTION AND CONSTRUCTION ANY INVESTIGATION OF THE COLUMNS, ANCHOR BOLTS, FRAMING, ETC. FOR ADEQUACY DURING THE STEEL ERECTION AND CONSTRUCTION PROCESS IS THE SOLE RESPONSIBILITY OF THE CONTRACTOR.

#### CAST-IN-PLACE CONCRETE GENERAL NOTES:

(UNLESS OTHERWISE NOTED OR SHOWN ON PLAN, THE FOLLOWING SHALL APPLY)

- 1. CONCRETE WORK SHALL CONFORM WITH THE REQUIREMENTS OF THE AMERICAN CONCRETE INSTITUTE ACI 318 (LATEST EDITION).
- 2. UNLESS OTHERWISE INDICATED ON DRAWINGS, CAST-IN-PLACE CONCRETE SHALL DEVELOP A STRENGTH OF 3,500 PSI (FOOTINGS, FOUNDATION WALLS AND
- RETAINING WALLS); 3,500 PSI (SLAB ON GRADE) AT 28 DAYS. 3. TEMPERATURE REINFORCING SHALL BE SUFFICIENTLY EMBEDDED TO DEVELOP FULL
- STRENGTH IN CONCRETE WALLS AND SLABS. 4. PROVIDE ADEQUATE TIES FOR REINFORCEMENT IN SLABS, BEAMS, PIERS AND
- WALLS. REINFORCEMENT TO BE HELD AT CORRECT DISTANCE FROM FORMS AND EARTH BY STEEL CHAIRS OR TIES. 5. FOLLOW C.R.S.I. RULES FOR PLACING OF REINFORCING STEEL AND ACCESSORIES.
- 6. THIS CONTRACTOR SHALL COOPERATE WITH OTHER TRADES AND WHERE REQUIRED INSTALL ALL BUILT-IN WORK, SLEEVES, INSERTS, ETC., AS REQUIRED
- FOR A COMPLETE JOB. 7. STRUCTURAL MEMBERS SHALL BE POURED FOR THEIR FULL DEPTHS IN ONE OPERATION. CONSTRUCTION JOINTS SUCH AS A DAY'S POUR JOINTS SHALL BE LOCATED IN THE MIDDLE THIRD OF THE SPAN, MAIN REINFORCING TO RUN THROUGH THE JOINT, KEY AND ROUGHEN JOINTS TO EXPOSE AGGREGATE FOR
- CHEMICAL BOND. 8. NO HORIZONTAL JOINTS SHALL BE PLACED IN WALLS EXCEPT AS SHOWN ON THE
- DRAWINGS, WITHOUT THE APPROVAL OF THE ENGINEER. 9. STRUCTURAL SLABS ON GRADE SHALL BE OF A THICKNESS AND REINFORCED AS
- INDICATED ON DRAWINGS. 10. SLABS-ON-GRADE SHALL HAVE THICKENINGS, DEPRESSIONS, OPENINGS, ETC., AS
- REQUIRED OR AS SHOWN HEREIN OR ON ARCHITECTURAL DRAWINGS.
- 11. PROVIDE 100% CONTINUITY OVER SUPPORTS FOR CONTINUOUS SLABS AND
- 12. TOP ELEVATION OF SLABS SHALL VARY ACCORDING TO FINISH FLOOR MATERIAL. SEE ARCHITECTURAL DRAWINGS.
- 13. SEE MECHANICAL AND ARCHITECTURAL DRAWINGS FOR SIZE AND LOCATION OF
- OPENINGS IN, FLOORS AND WALLS NOT SHOWN ON STRUCTURAL DRAWINGS.
- 15. MAXIMUM STEP OF FOOTINGS SHALL BE ONE VERTICALLY TO TWO HORIZONTALLY
- WHERE ELEVATIONS CHANGE. 16. CONCRETE SHALL CONSIST OF THE FOLLOWING:
  - READY MIX CONCRETE (ASTM C94)
  - MAX WATER TO CEMENT RATIO = 0.50 MAX AGGREGATE CONTENT SIZE OF 3/4 INCH (ASTM C33)
  - MAX SLUMP OF 5" + OR AN INCH (ASTM C143)
  - PORTLAND CEMENT: ASTM-C 150, TYPE 1 CLEAN POTABLE DRINKING WATER
- AIR CONTENT TO BE 6% +/- 1.5% (INTERIOR SLABS TO HAVE 0% AIR) 17. REINFORCING STEEL SHALL CONSIST OF THE FOLLOWING:
- REINFORCING BARS: ASTM -A 615 GRADE 60 KSI WELDED WIRE FABRIC: ASTM-A 185
- 18. PROVIDE CONTINUOUS REINFORCING WHEREVER POSSIBLE, PLACE ONLY AS SHOWN OR APPROVED, STAGGER SPLICES WHERE POSSIBLE.
- 19. ALL REINFORCING STEEL AND EMBEDMENT TO BE HELD SECURELY IN PLACE PRIOR TO PLACING CONCRETE. PROVIDE SUFFICIENT SUPPORTS TO ALLOW WALKING ON REINFORCEMENT.
- 20. DETAIL ACCORDING TO ACI STANDARD 315, MANUAL OF STANDARD PRACTICE FOR DETAILING REINFORCING CONCRETE STRUCTURES.
- 21. CONCRETE MEMBERS SHALL NOT BE LOADED UNTIL SATISFACTORY CONCRETE STRENGTH HAS BEEN OBTAINED.
- 22. NO ADMIXTURES MAY BE USED UNLESS PRIOR APPROVAL BY THE OWNER/ENGINEER.
- 23. COLD WEATHER REQUIREMENT SHALL BE USED DURING FREEZING OR NEAR
- FREEZING WEATHER ACI 306.1-90. COLD WEATHER IS DEFINED AS 3 DAYS WITH AVG. TEMP. BELOW 40F.
- 24. DURING HOT WEATHER CONCRETE SHALL BE PLACED AND CURED IN ACCORDANCE WITH ACI 305.

ARCHITECT

NEW YORK OKLAHOMA

215 W 40th Street 15th Floor New York, NY 10018 646.435.0660 office www.ksq.design

Nanuet Union Free School District 101 Church Street Nanuet, NY 10954 845.627.9880 www.nanuetsd.org

Structural Engineer Clapper Structural Engineering 160 Partition Street Saugerties, NY 12477

MEP Englneer

845.943.9601 www.clapperstructural.com

Sage Engineering Associates, LLP 9 Columbia Circle Albany NY 12203 518.453.6091

www.sagellp.com Environmental Engineer

**Quest Environmental Solutions** 1376 Route 9 Wappingers Falls, NY 12590 845.298.6251 www.qualityenv.com

Construction Manager One Penn Plaza 24<sup>th</sup> Floor, Suite 2400 New York, NY 10119 646.908.6550

www.jacobs.com





# NUFSD BOND PROJECT PHASE 5 -HIGHVIEW ES

SED#50-01-08-03-0-002-020 (HIGHVIEW ES) SED#50-01-08-03-7-007-002 (Maintenance) SED#50-01-08-03-7-012-004 (OEC) SED#50-01-08-03-0-001-026 (MILLER ES) SED#50-01-08-03-0-004-022 (BARR MS)

Highview Elementary School 24 Highview Ave Nanuet, NY 10954 OEC Building 135 Convent Rd

Nanuet, NY 10954

Miller Elementary School

Maintenance Building 103 Church St. Nanuet, NY 10954

50 Blauvelt Rd Unit1 Nanuet, NY 10954 A MacArthur Barr Middle School


143 Church St Nanuet, NY 10954 KEY PLAN


VISIONS	


**ISSUED:** BID SET **DATE:** 06/21/2024

**SCALE:** AS NOTED SHEET NAME: STRUCTURAL

**SHEET NUMBER:** 

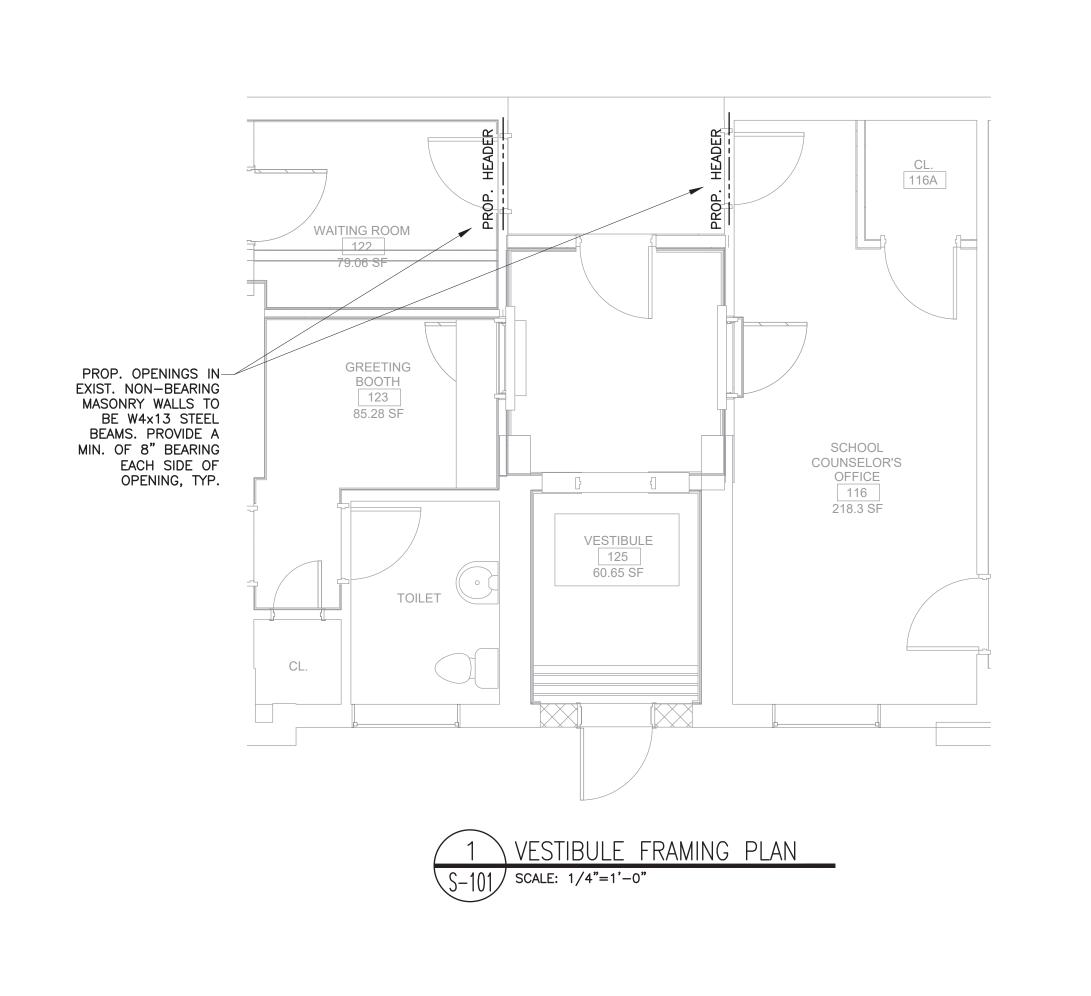

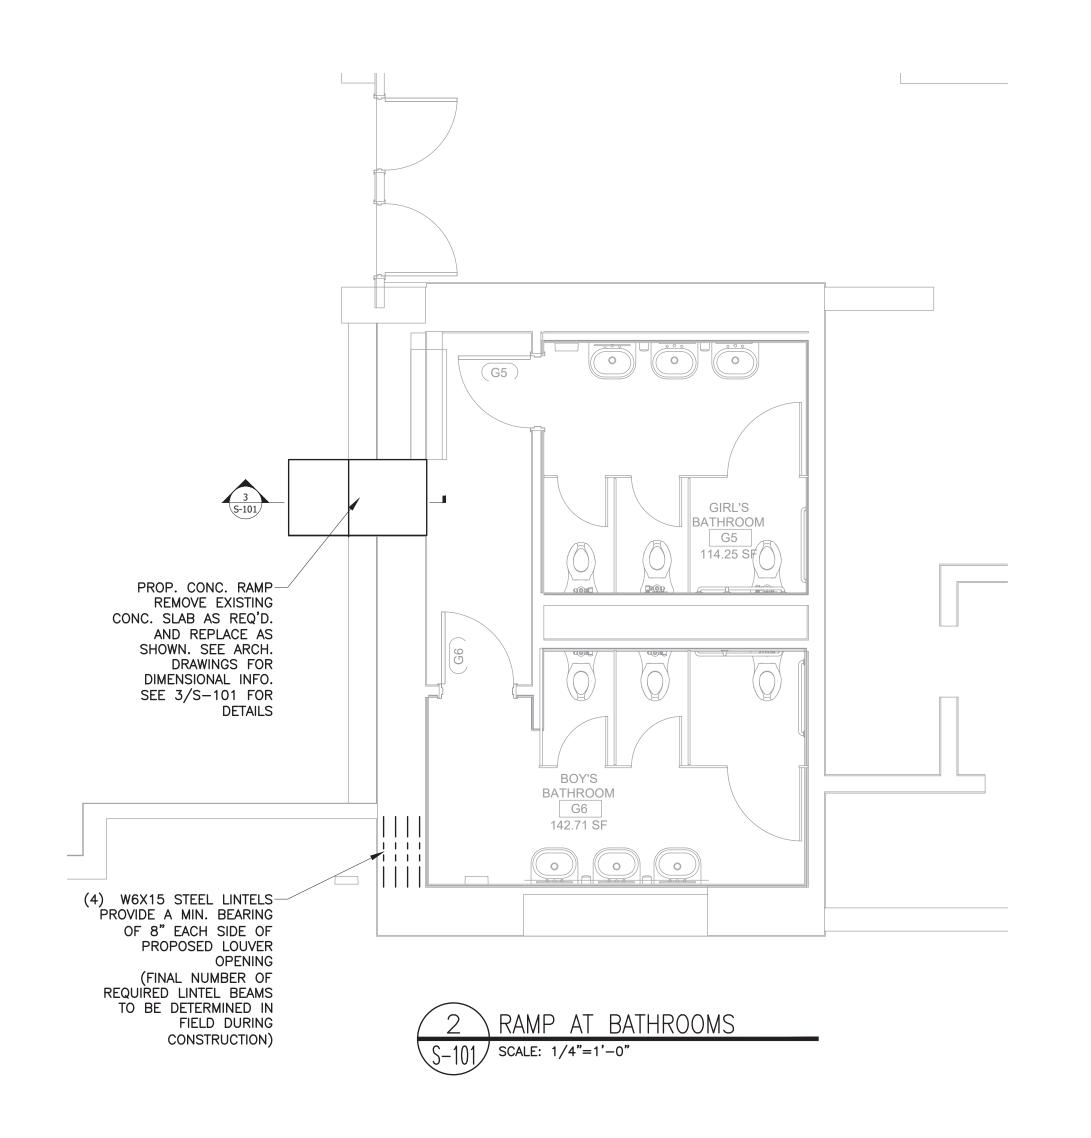

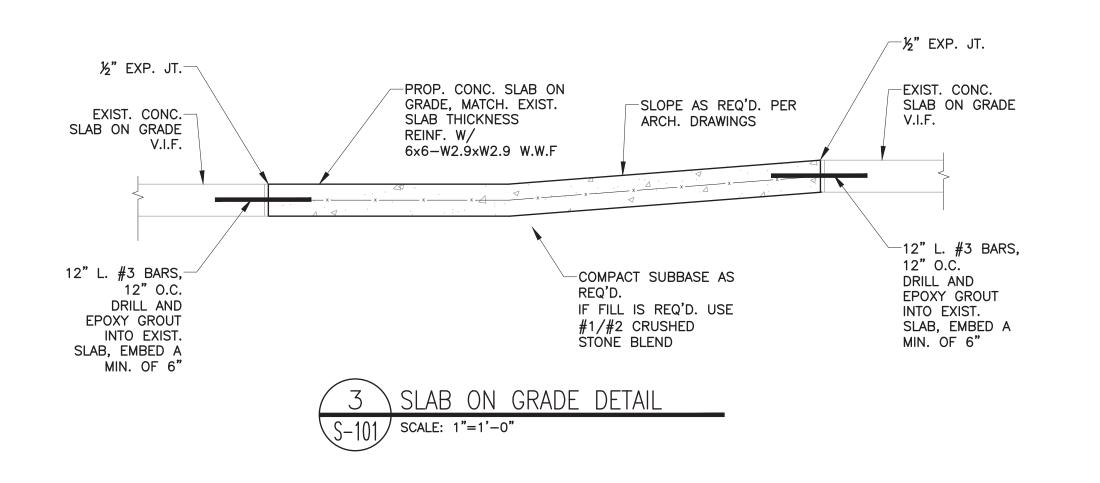

11

ARCHITECT

NEW YORK OKLAHOMA

KSQ Design 215 W 40th Street 15th Floor New York, NY 10018 646.435.0660 office www.ksq.design

Owner Nanuet Union Free School District

101 Church Street Nanuet, NY 10954 845.627.9880 www.nanuetsd.org

Structural Engineer Clapper Structural Engineering 160 Partition Street

Saugerties, NY 12477 845.943.9601

www.clapperstructural.com

MEP Engineer Sage Engineering Associates, LLP
9 Columbia Circle
Albany NY 12203

518.453.6091 www.sagellp.com

**Environmental Engineer** Quest Environmental Solutions 1376 Route 9

Wappingers Falls, NY 12590 845.298.6251 www.qualityenv.com

**Construction Manager** Jacobs One Penn Plaza 24th Floor, Suite 2400

New York, NY 10119

646.908.6550 www.jacobs.com



EXP. DATE: 2/28/2026



# NUFSD BOND PROJECT PHASE 5 -HIGHVIEW ES

SED#50-01-08-03-0-002-020 (HIGHVIEW ES)

SED#50-01-08-03-7-007-002 (Maintenance)

SED#50-01-08-03-7-012-004 (OEC)

SED#50-01-08-03-0-001-026 (MILLER ES)

SED#50-01-08-03-0-004-022 (BARR MS)

Highview Elementary School 24 Highview Ave Nanuet, NY 10954 **OEC** Building

Nanuet, NY 10954 Maintenance Building 103 Church St. Nanuet, NY 10954

135 Convent Rd

Miller Elementary School 50 Blauvelt Rd Unit1 Nanuet, NY 10954

A MacArthur Barr Middle School 143 Church St Nanuet, NY 10954

KEY PLAN

REVISIONS

ISSUED: BID SET

**DATE:** 06/21/2024 SCALE: AS NOTED

SHEET NAME: VESTIBULE FRAMING PLAN

SHEET NUMBER:

HE-S101