ABBREVIATIONS LEGEND

BTM	BOTTOM
BTUH	BRITISH THERMAL UNITS/HOUR
CAP	CAPACITY
CO	CLEAN OUT
CONT.	CONTINUATION
CW	DOMESTIC COLD WATER
DCW	DOMESTIC COLD WATER
DCWS	DOMESTIC COLD WATER SUPPLY
DHWR	DOMESTIC COLD WATER RECIRCULATION
DIA	DIAMETER
DN	DOWN
DPCO	DECK PLATE CLEAN OUT
DWG	DRAWING
°F	DEGREES FAHRENHEIT
FD	FLOOR DRAIN
FLR	FLOOR
FT. OR '	FEET
GAL	GALLON
GPM	GALLONS PER MINUTE
HW	DOMESTIC HOT WATER
IN OR "	INCHES
L	LENGTH
LAV	LAVATORY
MIN	MINIMUM
MAX	MAXIMUM
N/A	NOT APPLICABLE
N/C	NORMALLY CLOSED
P	PUMP
PC	PLUMBING CONTRACTOR
PD	PRESSURE DROP
PH	PHASE
PPM	PARTS PER MILLION
PRV	PRESSURE REDUCING VALVE
PSI	POUNDS PER SQUARE INCH
PSIG	POUNDS PER SQUARE INCH GAUGE
RD	ROOF DRAIN
RL	ROOF LEADER
RO	ROOF OVERFLOW DRAIN
RP	RECIRCULATION PUMP
RPM	REVOLUTIONS PER MINUTE
RPZ	REDUCED PRESSURE ZONE
S OR SAN	SANITARY
SF	SQUARE FOOT
SH	SHOWER
SK	SINK
SP	SUMP PUMP
SR	SHORT RADIUS
SS	SERVICE SINK/JANITOR'S SINK
ST	STORM PIPING
TD	TRENCH DRAIN
TEMP	TEMPERATURE
TV	THERMOSTATIC MIXING VALVE
TYP	TYPICAL
UR	URINAL
V	VENT
VERT	VERTICAL
VTR	VENT THRU ROOF
W	WASTE
WC	WATER CLOSET
WHA	WATER HAMMER ARRESTOR

PLUMBING LEGEND

- COLD WATER PIPING (CW)
- HOT WATER PIPING (HW)
- HOT WATER RECIRC PIPING (HWR)
- SAN — SANITARY ABOVE GRADE
- SAN — SANITARY BELOW GRADE
- V — VENT PIPING
- W — WASTE PIPING
- NATURAL GAS PIPING
- 90 DEGREE PIPE ELBOW DOWN
- PIPE RISER UP SYMBOL
- BRANCH PIPE CONNECTOR OFF BOTTOM OF PIPING MAIN
- OR — PIPE CAP
- MID-PIPE DOWN
- PIPE BREAK
- PIPE DOWN WITH VALVE IN VERTICAL
- UNION
- CLEAN OUT
- CHECK VALVE
- OR — OR — SHUTOFF BALL VALVE
- OR — PRESSURE REDUCING VALVE
- OR — PLUG VALVE
- PUMP
- FLOOR DRAIN
- CLEANOUT DECKPLATE
- OR — GATE VALVE
- OR — DOUBLE CHECK VALVE
- BUTTERFLY VALVE
- OR — PIPE REDUCER

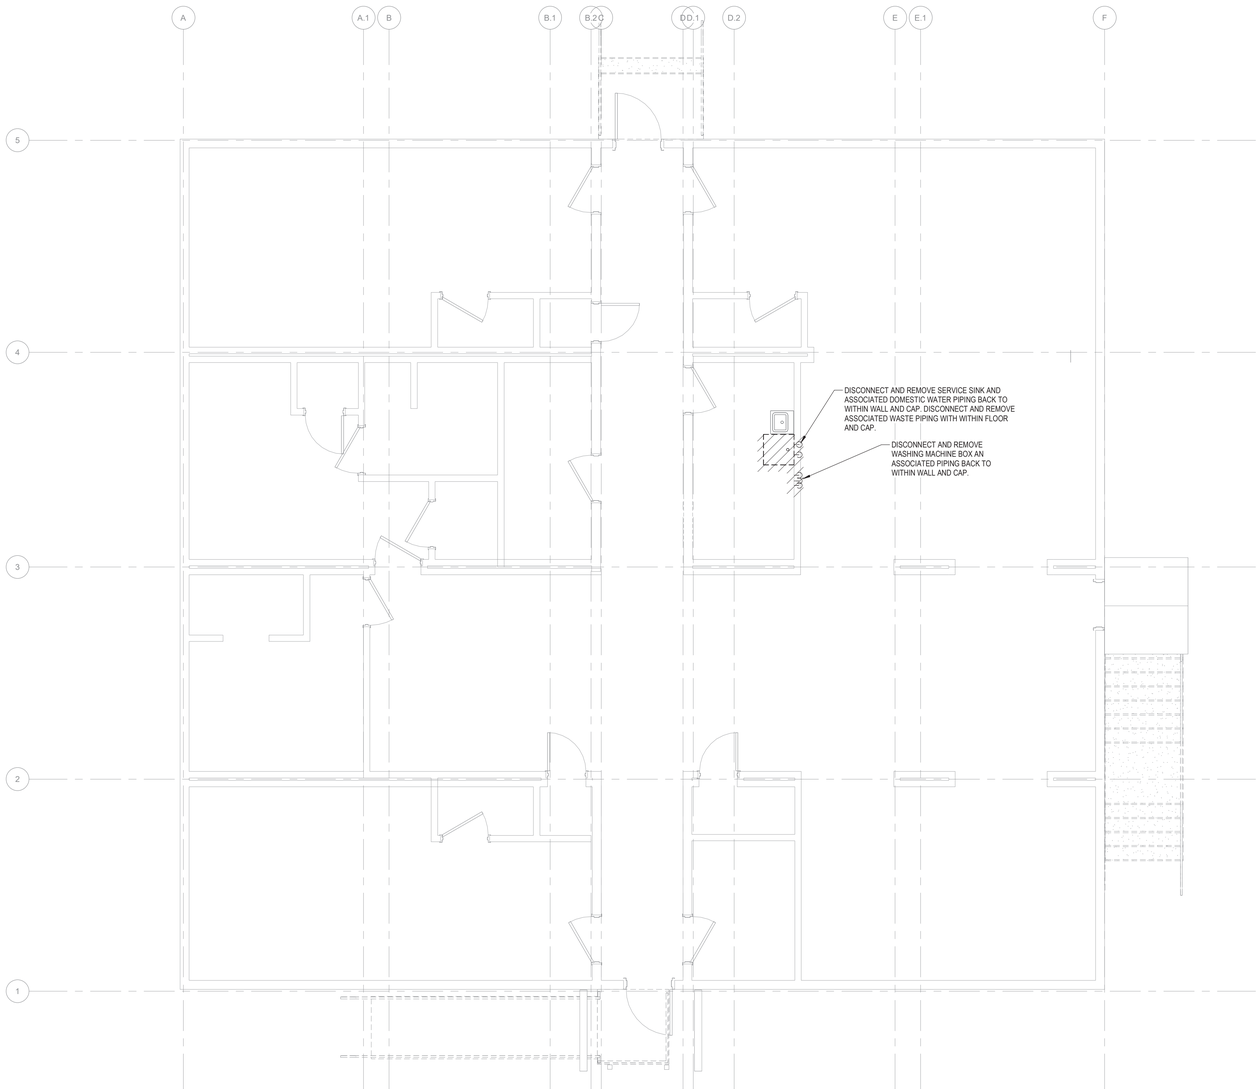

A12 FIRST FLOOR PLUMBING REMOVALS PLAN

1/4" = 1'-0"

ARCHITECT

ksqdesign

NEW YORK OKLAHOMA

KSQ Design
215 W 40th Street 15th Floor
New York, NY 10018
646.435.0660 office
www.ksq.design

Owner

Nanuet Union Free School District
101 Church Street
Nanuet, NY 10954
845.627.9880
www.nanuetsd.org

Structural Engineer

Clapper Structural Engineering
160 Partition Street
Saugerties, NY 12477
845.943.9601
www.clapperstructural.com

MEP Engineer

Sage Engineering Associates, LLP
9 Columbia Circle
Albany NY 12203
518.453.6091
www.sagellp.com
NYS CERTIFICATE AUTHORIZATION NUMBER 0010844

Environmental Engineer

Quest Environmental Solutions
1376 Route 9
Wappingers Falls, NY 12590
845.298.6251
www.qualityenv.com

Construction Manager

Jacobs
One Penn Plaza
24th Floor, Suite 2400
New York, NY 10119
646.908.6550
www.jacobs.com

STATE OF NEW YORK · JOHN VENDITTI · 083994 · LICENSED PROFESSIONAL ENGINEER

REGISTRATION EXPIRES: 11/30/2026

NUFSD BOND PROJECT PHASE 5 - OEC

- ☐ SED#50-01-08-03-0-002-020 (HIGHVIEW ES)
- ☐ SED#50-01-08-03-7-007-002 (Maintenance)
- ■ SED#50-01-08-03-7-012-004 (OEC)
- ☐ SED#50-01-08-03-0-001-026 (MILLER ES)
- ☐ SED#50-01-08-03-0-004-022 (BARR MS)

Highview Elementary School
24 Highview Ave
Nanuet, NY 10954

OEC Building
135 Convent Rd
Nanuet, NY 10954

Maintenance Building
103 Church St.
Nanuet, NY 10954

Miller Elementary School
50 Blauvelt Rd Unit1
Nanuet, NY 10954

A MacArthur Barr Middle School
143 Church St
Nanuet, NY 10954

KEY PLAN

REVISIONS

No.	Description	Date

ISSUED: BID SET

DATE: 06/21/2024

SCALE: As indicated

SHEET NAME:
PLUMBING REMOVALS PLAN

SHEET NUMBER:
OEC-PR101

ISSUE FOR BID SET

DRAWN BY: Author
CHECKED BY: Checker
Checker Sheet Documents\106_OEC_MEPH_PHS_Ishwagi8737.rvt

6/19/2024 2:35:20 PM

PROJECT NUMBER: 00000.00

COPYRIGHT © 2023 KSQ ARCHITECTS, PC