

SUBMITTAL REVIEW**CLIENT NAME:** Vails Gate Fire Department**PROJECT TITLE:** Vails Gate FD - New Firehouse**SUBMITTAL No.:** 233113-2**H2M PROJECT No.:** VGFD2001**SUBMITTAL NAME:** Sheetmetal SD (Phase 2)**SUBMITTAL REVIEW**

**REVIEW IS FOR GENERAL COMPLIANCE WITH CONTRACT DOCUMENTS.
NO RESPONSIBILITY IS ASSUMED FOR CORRECTNESS
OF DIMENSIONS OR DETAILS**

- | | |
|--|---|
| ☐ NO EXCEPTIONS TAKEN | ☐ SUBMIT SPECIFIED ITEM |
| ☒ MAKE CORRECTIONS NOTED
<small>(RESUBMISSION NOT REQUIRED)</small> | ☐ NO ACTION TAKEN
<small>(REVIEW IS THE RESPONSIBILITY OF ANOTHER PARTY)</small> |
| ☐ REVISE & RESUBMIT | ☐ NO ACTION TAKEN
<small>(THIS SUBMITTAL IS NOT REQUIRED BY THE CONTRACT)</small> |
| ☐ REJECTED - SEE REMARKS | ☐ RECEIVED FOR RECORD |

Corrections or comments made on the shop drawings during this review do not relieve contractor from compliance with requirements of the drawings and specifications. This check is only for review of general conformance with the design concept of the project and general compliance with the information given in the contract documents. The contractor is responsible for: confirming and correlating all quantities and dimensions; selecting fabrication processes and techniques of construction; coordinating their work with that of all other trades; and performing the work in a safe and satisfactory manner.

H2M architects + engineers

Date: 04/25/2023

By: MJV

Rev.: 2020-05-20

Comments:

QTR MASTER (114): Lower exhaust to designed 15 CFM.

Coordinate with other trades.

Coordinate with branch selector boxes.

CONTRACTOR'S COMPANY NAME
ADDRESS

SUBMISSION TRANSMITTAL FORM
CLIENT NAME: Vails Gate Fire District
PROJECT TITLE: VGFD2001-New Firehouse

H2M PROJECT NO.: VGFD2001

Product, Item, or System Submitted:	Sheetmetal Shop Drawings (Phase 2)		
Submission Date:	4/11/23	Submission Log No.:	233113-2
Specification Section:	233113	Paragraph Reference:	1.05/A
Contract Drawing Reference(s):			
Manufacturer's Name:			
Manufacturer's Mailing Address:			
Manufacturer's Contact Information:	<i>Name</i>	() <i>Tel. no.</i>	<i>Email</i>
Supplier's Name:	Joseph Lombardo Plumbing & Heating		
Supplier's Mailing Address:			
Supplier's Contact Information:	<i>Name</i>	() <i>Tel. no.</i>	<i>Email</i>
This item is a substitution for the specified item:	☒ No	☐ Yes	
KEY CONSTRUCTION SERVICES, LLC Project No: VGFD2001 Reviewed for General Acceptance Only. This review does not relieve the Subcontractors or Suppliers of responsibility for making the work conform to the requirements of the contract. The Subcontractor and Suppliers are responsible for all dimensions, correct fabrication and accurate fit with the work of other trades. <u>SUBJECT TO ARCHITECT AND OR ENGINEER APPROVAL</u> <i>Signed Joseph Manfredi (PM) Date: 4/11/23</i> Contractor's Approval Stamp with Signature & Date		<u>Contractor's Brief Comments or Remarks</u> (attach separate letter as needed): By making this submission, we represent that we have determined and verified all field measurements and dimensions, field construction criteria, site and building constraints in terms of limitations in moving the item into the enclosed space, materials, catalog and model numbers and similar data and that we have checked and coordinated this submission with other work at or adjacent to the installed location in accordance with the requirements contained in the Contract Documents.	

END OF SECTION 013300

Joe Lombardo
Plumbing & Heating of Rockland, Inc.

321 Spook Rock Road
Suffern, NY 10901
Ph. 845-357-6537 Fx 845-357-8529
E: info@josephlombardo.com
Website: www.josephlombardo.com

Rockland Cty. Plumbing #1000 Rockland Cty. Cooling # 1468
Westchester Cty. Plumbing #460 New Jersey State Plumbing #12702

TO: Key Construction
4246 Albany Post Rd. Suite 1
Hyde Park, NY 12538

LETTER OF TRANSMITTAL

DATE: 4-10-23	JOB NO.
ATTENTION: Joe Manfredi	
RE: Vails Gate Firehouse	

WE ARE SENDING YOU ☐ Attached ☐ Under separate cover via _____ the following items:

☐ Shop Drawings ☐ Prints ☐ Plans ☐ Samples ☐ Specifications

☐ Copy of letter ☐ Change order ☐ _____

EMAIL	DATE	No.	DESCRIPTION
1	4-10-23	233113	SHEETMETAL SHOP DWGS phase 2 MAIN

THESE ARE TRANSMITTED as checked below:

☐ For approval ☐ No Exceptions Taken ☐ Resubmit _____ copies for review



☐ For your use ☐ Make Corrections Noted ☐ Submit _____ copies for distribution

☐ As requested ☐ Rejected ☐ Return _____ corrected prints

☐ For review and comment ☐ _____

☐ FOR BIDS DUE _____ 20 ____ ☐ PRINTS RETURNED AFTER LOAN TO US

COPY TO: Joe Manfredi SIGNED: Ronald J. Lombardo

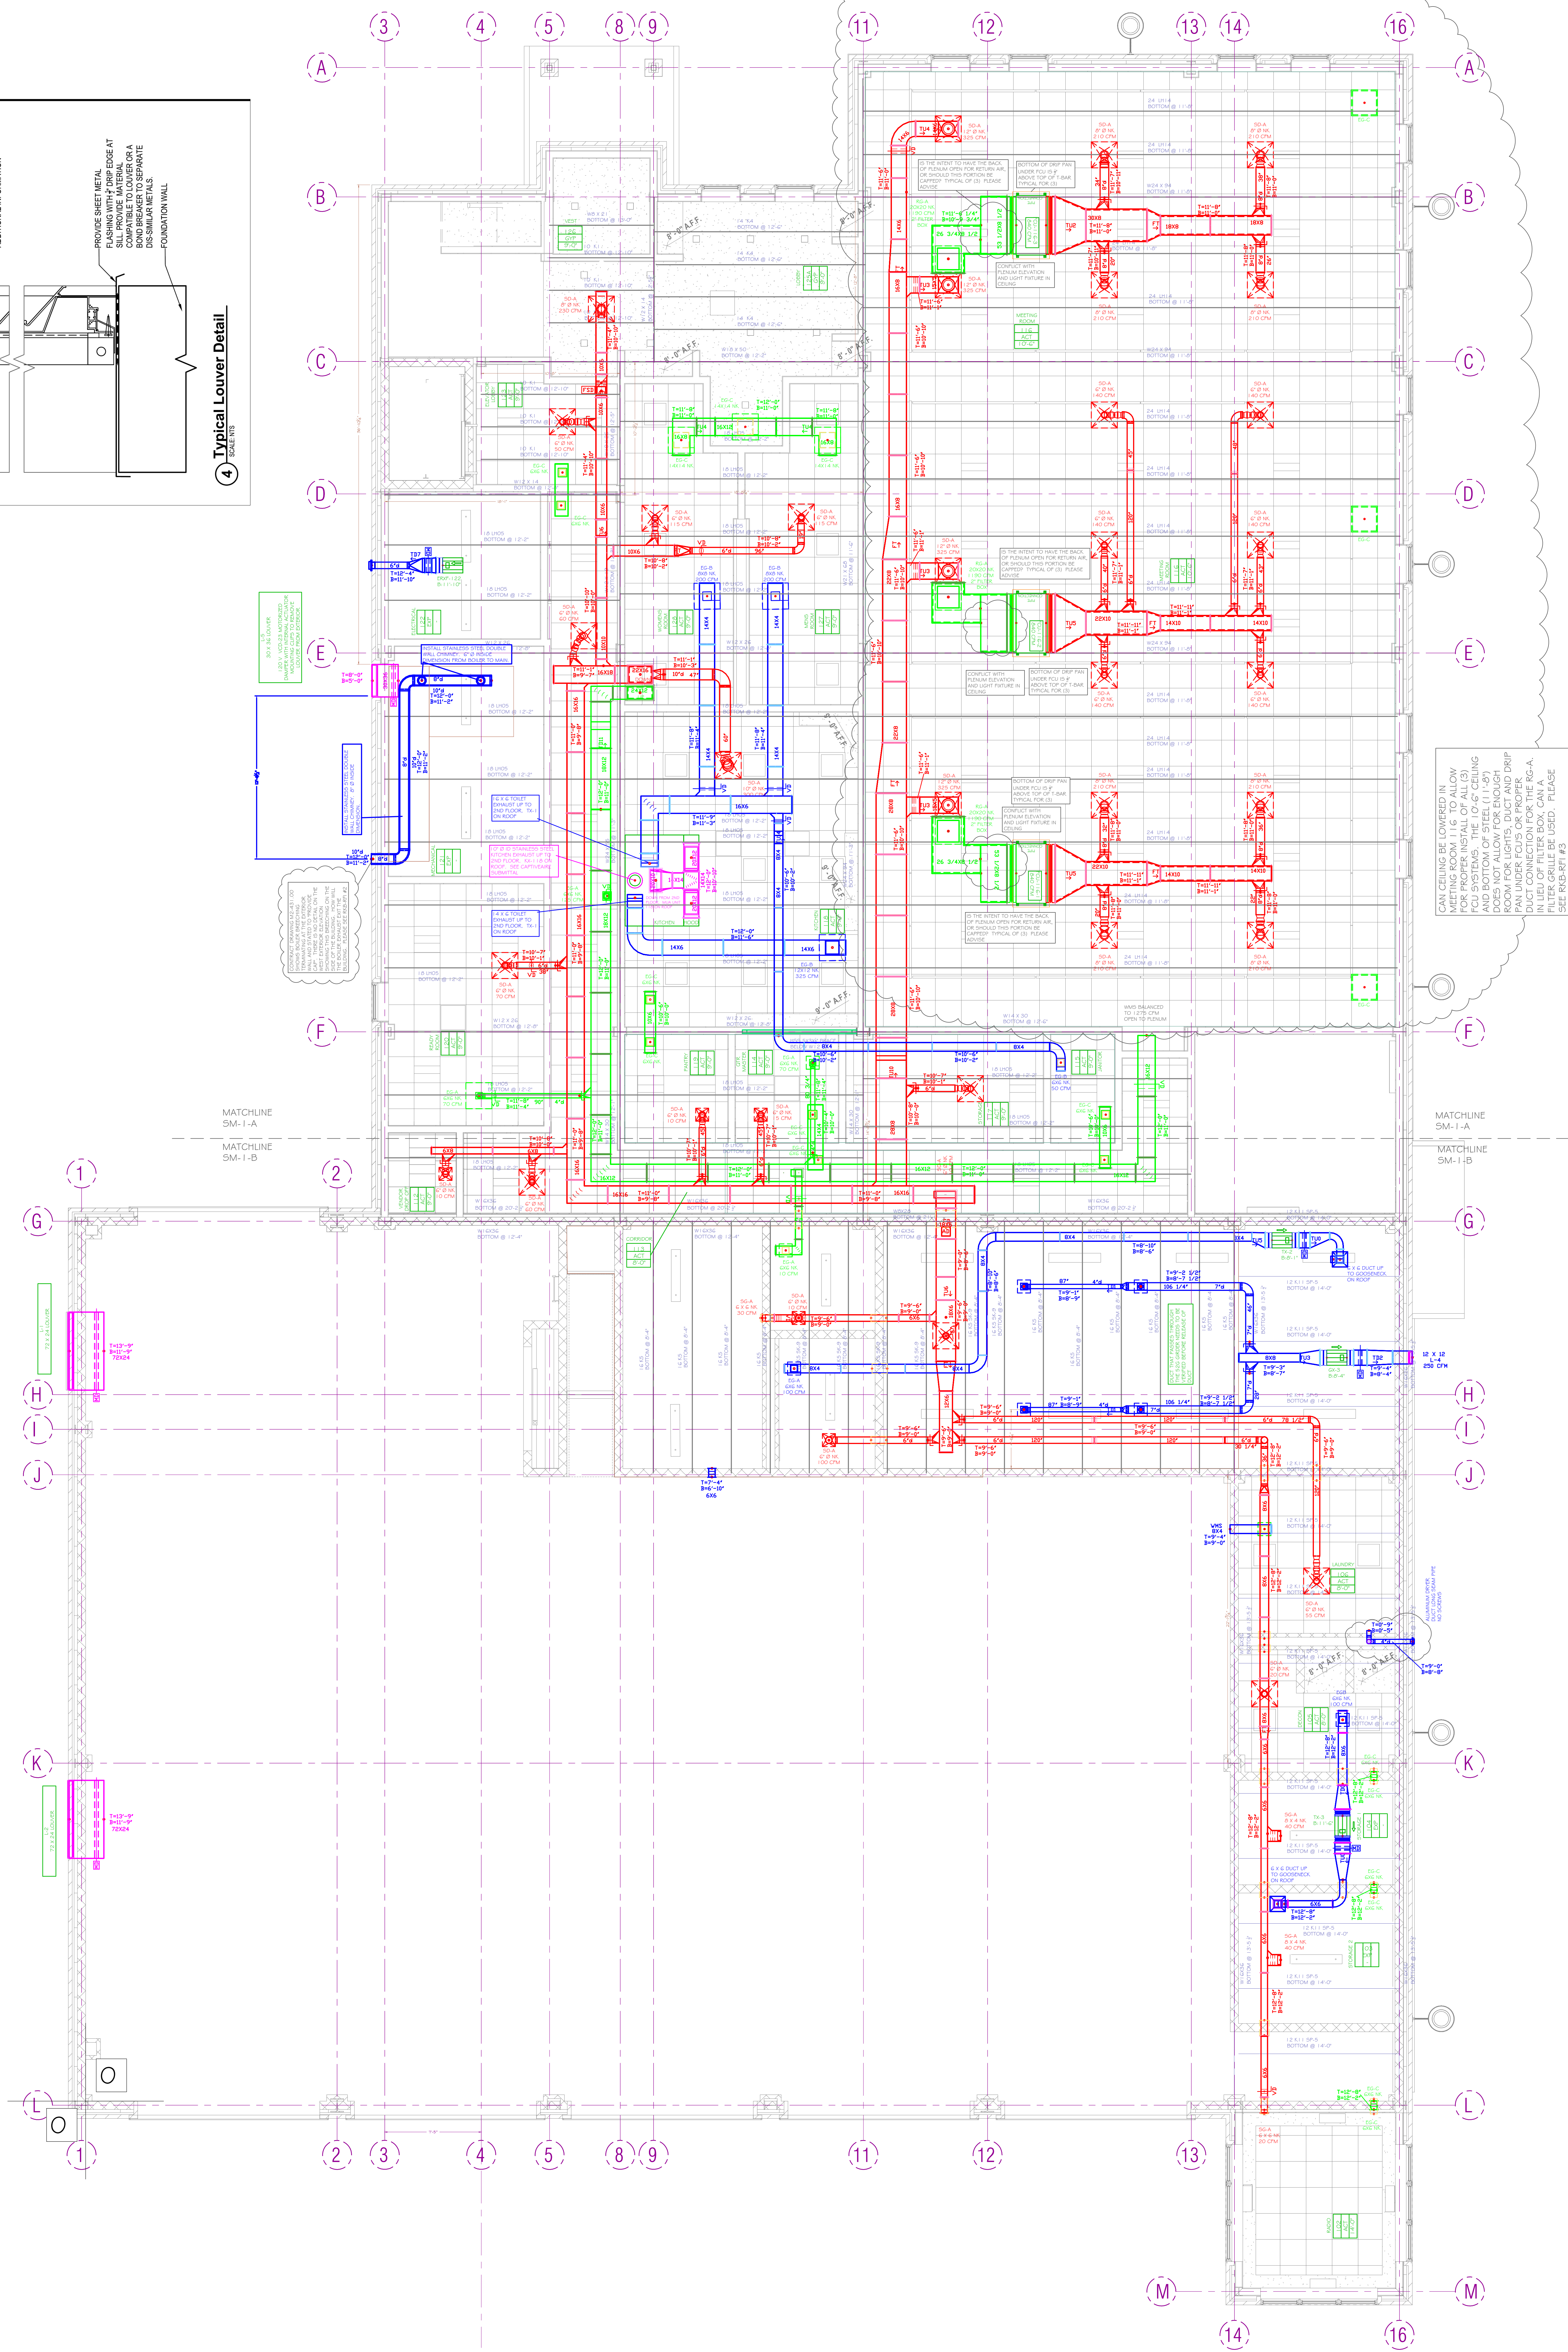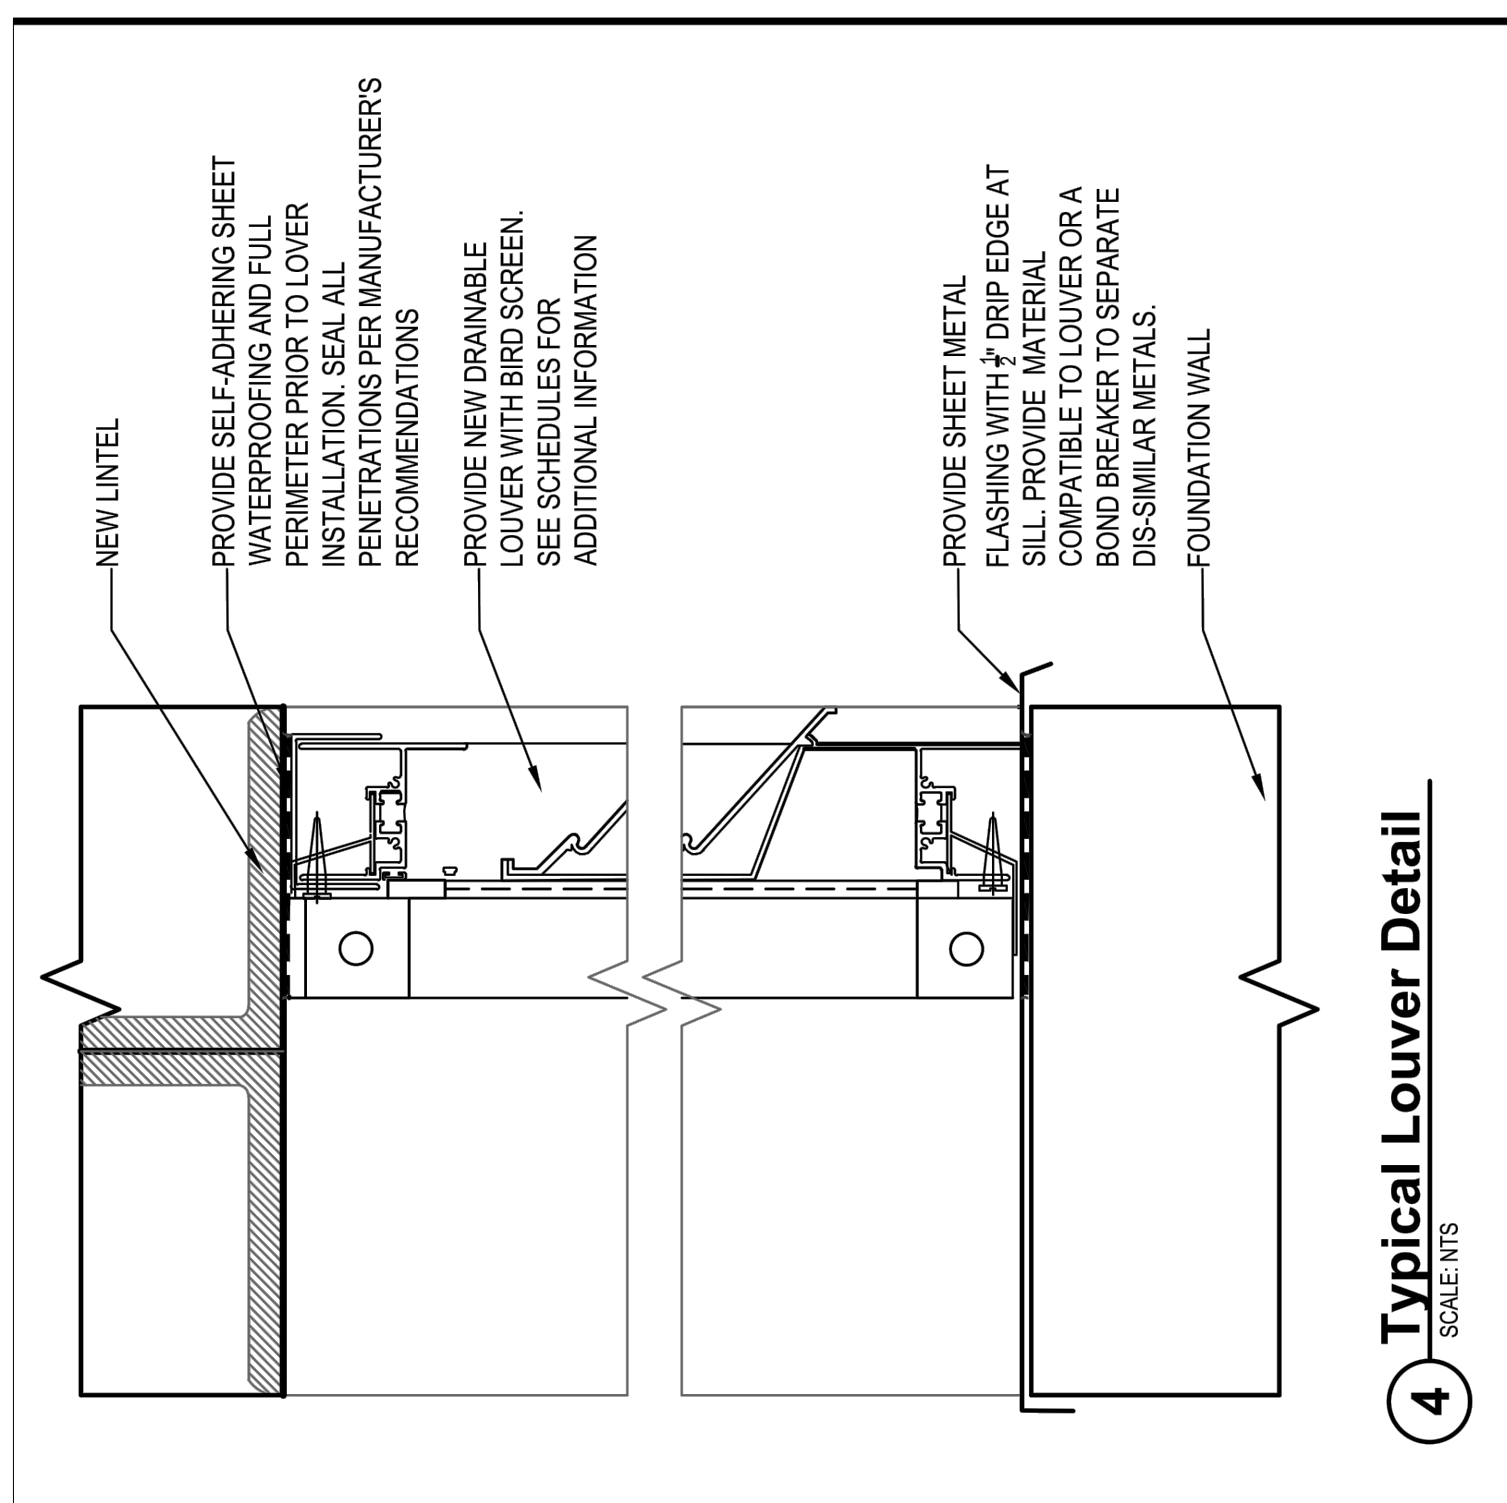

CAN CEILING BE LOWERED IN MEETING ROOM 116 TO ALLOW FOR PROPER INSTALL OF ALL (3) FCU SYSTEMS. THE 10'-6" CEILING AND BOTTOM OF STEEL (11'-8") DOES NOT ALLOW FOR ENOUGH ROOM FOR LIGHTS, DUCT AND DRIP PAN UNDER FCU'S OR PROPER DUCT CONNECTION FOR THE RG-A. IN LIEU OF FILTER BOX, CAN A FILTER GRILLE BE USED. PLEASE SEE P. 26, P. 42

