

Elevator Job Site Requirements

THE FOLLOWING NOTES ARE DESIGNATED FOR THE 'OTIS' GEN2 MACHINE-ROOM LESS ELEVATOR SYSTEM. SEE SPECIFICATION SECTION 142100 FOR ADDITIONAL INFORMATION.

HOISTWAY:

- HOISTWAY MUST BE CONSTRUCTED PER FINAL LAYOUT DRAWINGS.
- THE LOCATION OF ATTACHMENT SUPPORT FOR THE TOP RAIL BRACKET IS AT A CRITICAL ELEVATION CALLED OUT ON THE HOISTWAY LAYOUT.
- AN OVERHEAD BEAM MUST BE PROVIDED AT THE LOCATION CALLED OUT ON THE HOISTWAY LAYOUT AND DESIGNED TO SUPPORT 7,500 LBS PER ELEVATOR.
- PROVIDE A CLEAR PLUMB HOISTWAY WITH VARIATIONS FROM THE SIZE SHOWN ON THE OTIS LAYOUT NOT TO EXCEED -0.7+1" (25MM) AND NOT LESS THAN THE CLEAR DIMENSIONS SHOWN ON THE OTIS LAYOUT.
- PRIOR TO THE START OF INSTALLATION, PROVIDE A DRY, PROPERLY FRAMED, ENCLOSED AND VENTED HOISTWAY IN ACCORDANCE WITH ALL APPLICABLE CODES.
- FRONT ENTRANCE WALL AT MAIN AND TOP LANDING, OR LANDING BELOW TOP LANDING IF THE CONTROLLER IS LOCATED THERE, IS NOT TO BE CONSTRUCTED UNTIL OR AFTER ALL ELEVATOR EQUIPMENT IS INSTALLED IN THE HOISTWAY.

SMOKE DETECTORS:

- PROVIDE SMOKE DETECTORS, LOCATED AS REQUIRED, WITH WIRING FROM THE SENSING DEVICES TO THE CONTROLLERS DESIGNATED BY OTIS.
- IF SPRINKLERS ARE INSTALLED IN THE HOISTWAY OR MACHINE SPACE, A MEANS TO AUTOMATICALLY DISCONNECT THE MAIN LINE POWER SUPPLY UPON OR PRIOR TO THE APPLICATION OF WATER IS REQUIRED (UNLESS PROHIBITED BY LOCAL CODE).

PIT:

- PIT FLOOR DESIGNED TO SUSTAIN VERTICAL FORCES ON CAR AND COUNTERWEIGHT RAILS AND IMPACT LOADS ON CAR AND COUNTERWEIGHT BUFFERS AS SHOWN ON OTIS LAYOUT.

GENERAL NOTES:

- THE GC IS RESPONSIBLE FOR ALL ITEMS LISTED ABOVE, ON THE OTIS LAYOUT PAGE, THE CONFIRMATION OF POWER SUPPLY DOCUMENT AND ALL CODE REQUIREMENTS. WHERE CONFLICTS BETWEEN DIFFERENT BUILDING CODES OCCUR, THE MORE STRINGENT CODE SHALL TAKE PRECEDENCE.
- THESE NOTES ARE SPECIFIC TO THE ELEVATOR LISTED AS BASIS OF DESIGN. IF THE CONTRACTOR PROVIDES A SUBSTITUTION FOR THE ELEVATOR, THE CONTRACTOR SHALL BE RESPONSIBLE FOR FOLLOWING ALL JOBSITE REQUIREMENTS SET FORTH BY THE SUBSTITUTED MANUFACTURER. (SEE SPECIFICATION FOR SUBSTITUTION PROCEDURES)


- PIT MUST BE CLEAN AND DRY PRIOR TO START OF INSTALLATION.
- LIGHT MUST HAVE AN EXTERNAL GUARD AND BE LOCATED AT A POINT WHERE ILLUMINATION ON THE PIT LADDER BASE IS NO LESS THAN 10 FOOT CANDLES.

ELECTRICAL:


- PROVIDE PERMANENT THREE PHASE ELECTRICAL FEEDER WITH SEPARATE GROUNDING CONDUCTOR TERMINATING IN CONTROLLER EITHER AT THE TOP LANDING OR LANDING BELOW BEFORE THE START OF THE INSTALLATION.
- PROVIDE A TEMPORARY 220 VOLT, 30 AMP SINGLE PHASE, 4 WIRE ELECTRICAL SUPPLY FOR PLATFORM OPERATION DURING CONSTRUCTION AND AVAILABLE AT THE START OF ELEVATOR INSTALLATION.
- PROVIDE A 125 VOLT, 15 AMP SINGLE PHASE BRANCH CIRCUIT FOR THE ELEVATOR CAR/LIGHT CIRCUITS AT THE START OF THE INSTALLATION OF THE TOP LANDING.
- PROVIDE A TEMPORARY 220 VOLT, 30 AMP SINGLE PHASE, 4 WIRE ELECTRICAL SUPPLY FOR PLATFORM OPERATION DURING CONSTRUCTION AND AVAILABLE AT THE START OF ELEVATOR INSTALLATION.
- PROVIDE A PERMANENT LIGHT FIXTURE AT THE TOP OF THE HOISTWAY. ILLUMINATION SPECIFICATIONS AND LOCATION OF THE LIGHT SWITCH ARE PROVIDED IN THE OTIS LAYOUT.
- INSTALL A PERMANENT LIGHT FIXTURE AT THE TOP LANDING ENTRANCE IN THE HALL. ILLUMINATION SPECIFICATIONS AND LOCATION OF THE LIGHT SWITCH ARE PROVIDED IN THE OTIS LAYOUT.
- PROVIDE ELECTRIC POWER FOR LIGHTS TOOLS, WELDING, HOISTING, ETC.
- PROVIDE ONE DEDICATED OUTSIDE TELEPHONE LINE, PER ELEVATOR, AND TERMINATED AT THE CONTROLLER.

BARRICADES (MUST MEET MINIMUM OSHA REQUIREMENTS):

- GC SHALL PROVIDE GUARDING AND PROTECTION OF THE HOISTWAY DURING CONSTRUCTION.
- HOISTWAY BARRICADES SHALL BE CONSTRUCTED, MAINTAINED, AND REMOVED BY THE GC.
- GC SHALL PROVIDE A FREESTANDING REMOVABLE BARRICADE AT EACH HOISTWAY OPENING AT EACH FLOOR.
- BARRICADES SHALL BE 42" HIGH, HAVE CENTERBOARD AND KICK BOARD AND WITHSTAND 200 LBS. OF LATERAL FORCE.
- GC SHALL PROVIDE FULL ENTRANCE SCREENING/MESH IN FRONT OF ALL HOISTWAY ENTRANCES.

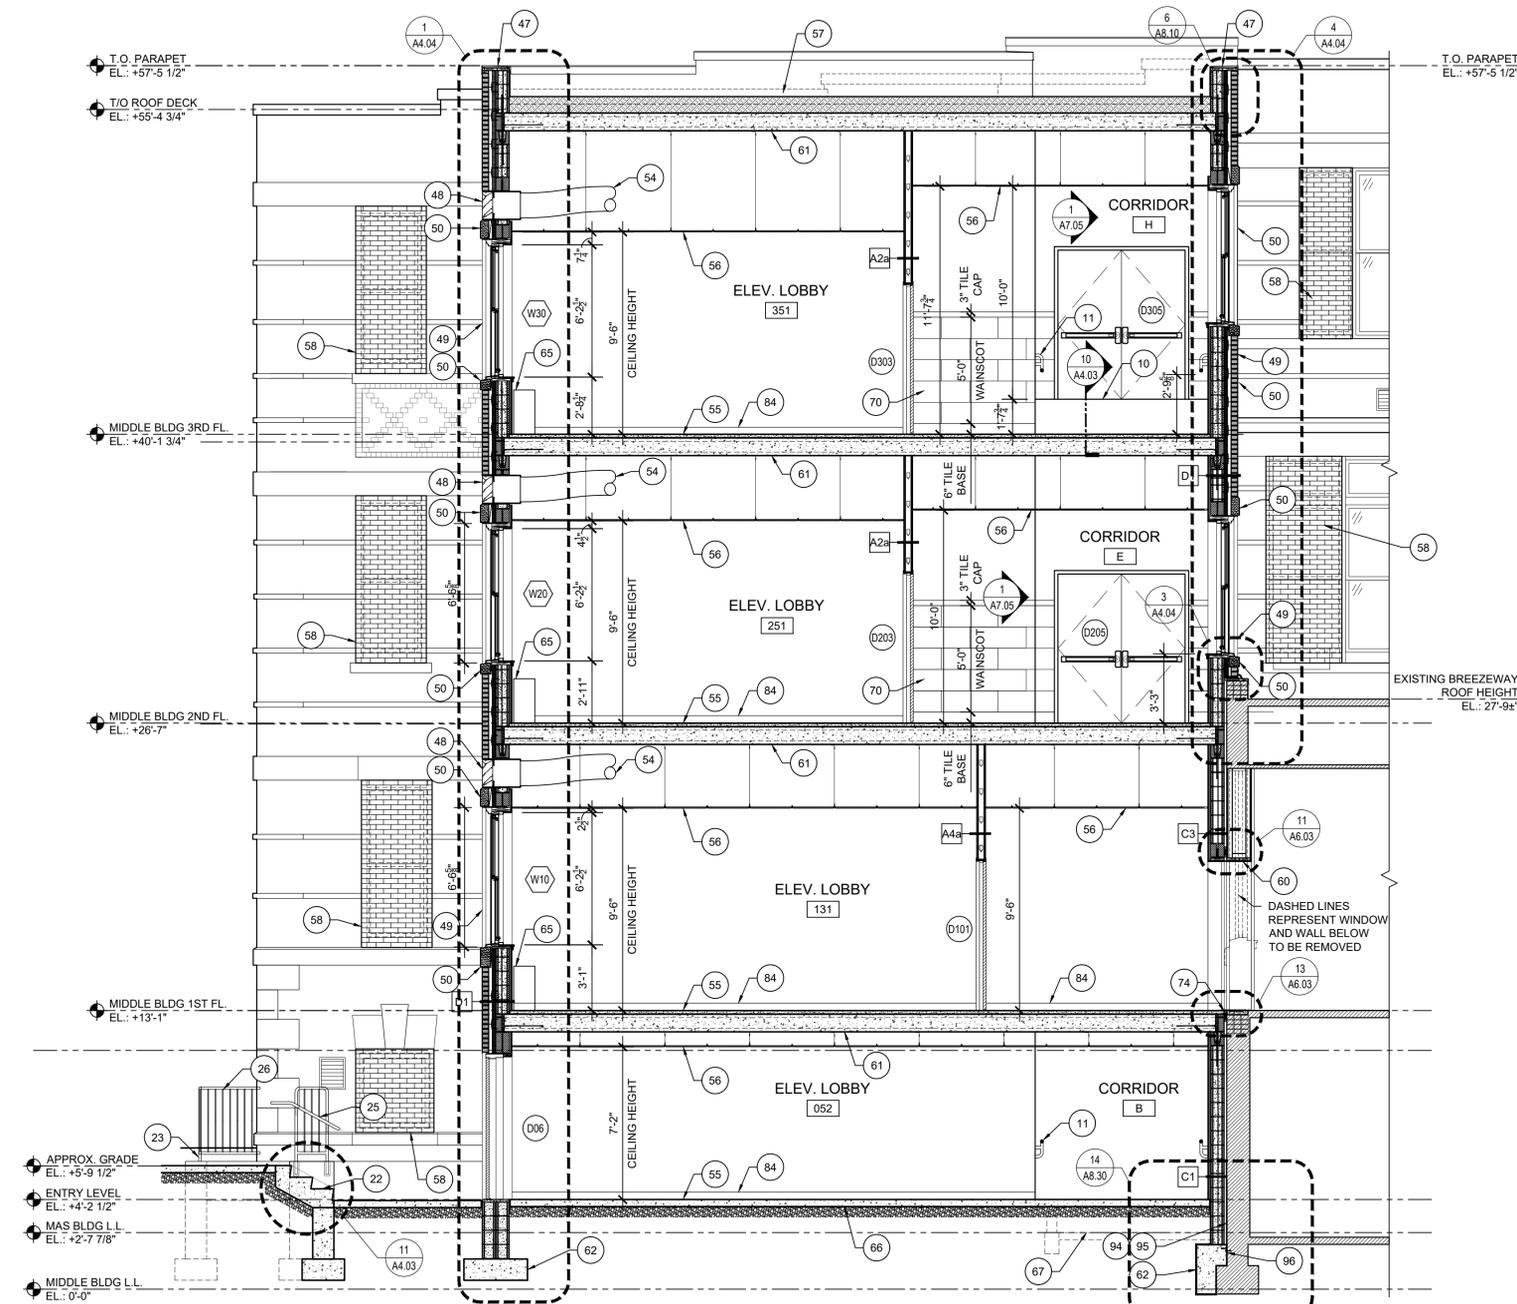

1
A4.01 1/4" = 1'-0"

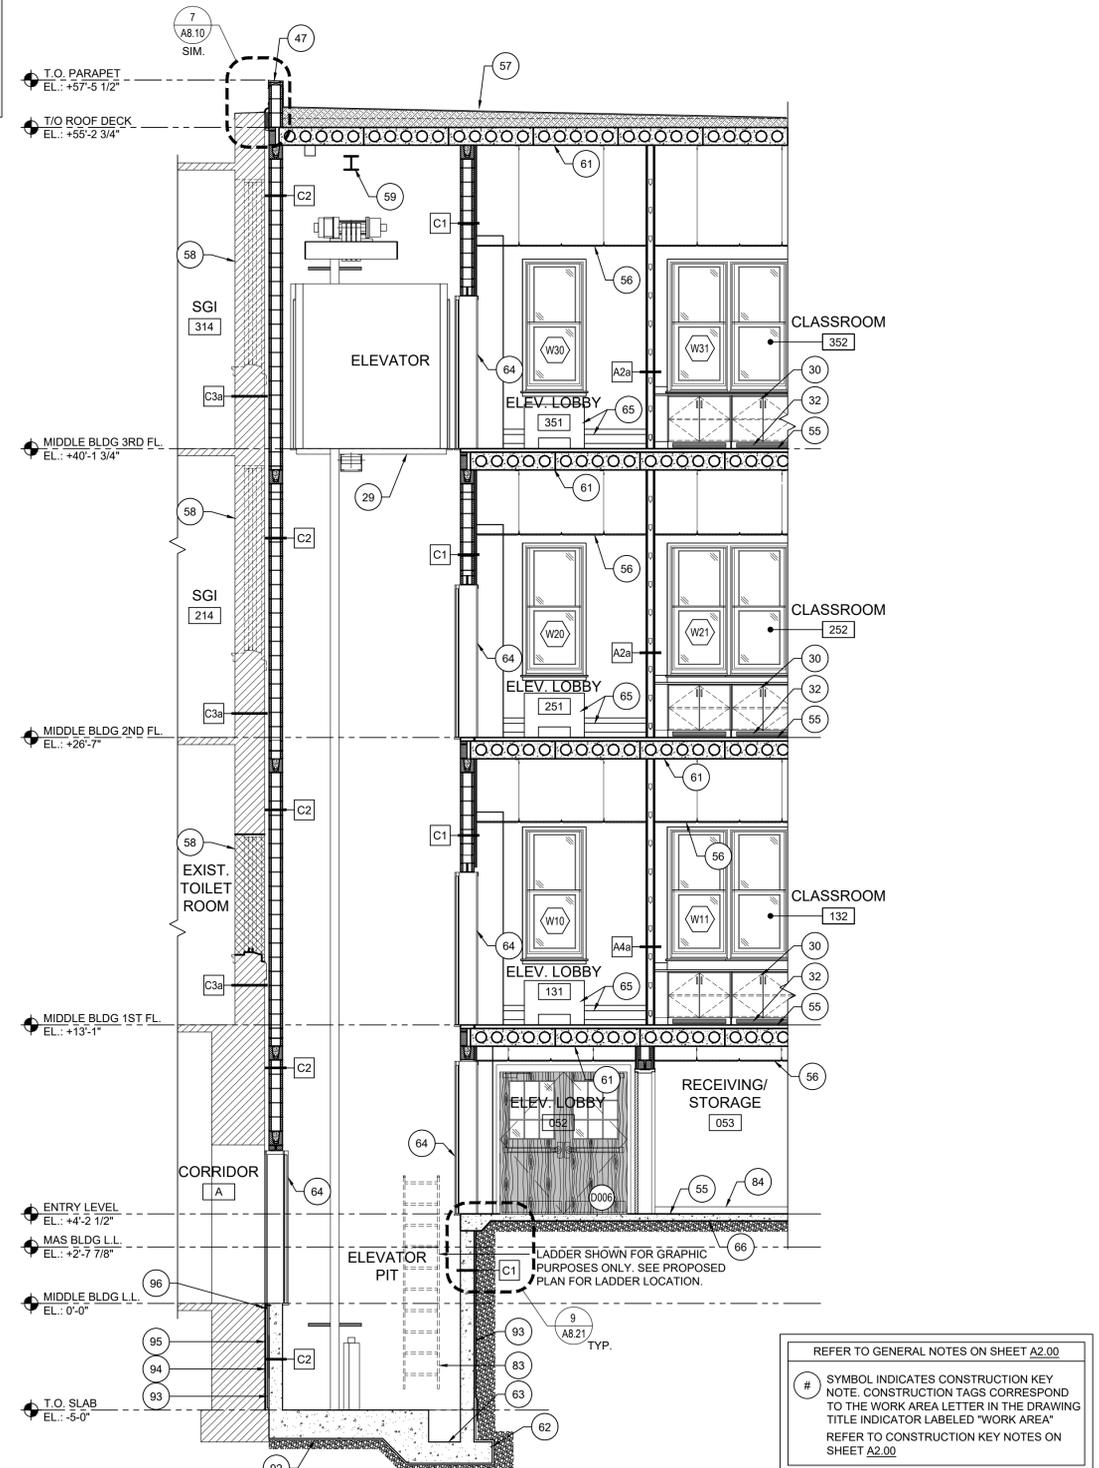

2
A4.01 1/4" = 1'-0"

REFER TO GENERAL NOTES ON SHEET A2.00
SYMBOL INDICATES CONSTRUCTION KEY
NOTE: CONSTRUCTION TAGS CORRESPOND TO THE WORK AREA LETTER IN THE DRAWING TITLE INDICATOR LABELED "WORK AREA"
REFER TO CONSTRUCTION KEY NOTES ON SHEET A2.00

DATE: 1/10/20
CHECKED: DLF
DRAWN: TT
MICHAEL J. MCGOVERN, P.E.
REGISTERED ARCHITECT
LICENSE NO. 022237-1

Revisions:
ISSUE TO BID
11/23/20

UNAUTHORIZED ALTERATIONS OR ADDITIONS TO THIS DOCUMENT IS A VIOLATION OF SECTION 2209 OF THE NEW YORK STATE EDUCATION LAW. THESE DOCUMENTS REMAIN THE EXCLUSIVE PROPERTY OF THE ENGINEER, AND MAY NOT BE USED FOR ANY PURPOSE WHATSOEVER WITHOUT THE WRITTEN CONSENT OF THE ENGINEER.

J.J.B.
LAN ASSOCIATES
engineering • planning • architecture • surveying
252 MAIN STREET, GOSHEN, NEW YORK 10924 (845)813-0350

BUILDING SECTION
2019 BOND REFERENDUM
MAMARONECK AVENUE ELEMENTARY SCHOOL
MAMARONECK AVENUE FREE SCHOOL DISTRICT
850 MAMARONECK AVENUE, MAMARONECK, NY 10543
JOB NO. 4.1092.72.2
FILE NO. 10927202A401

NYSED PROJECT # 66-07-01-03-0-004-030
A4.01