



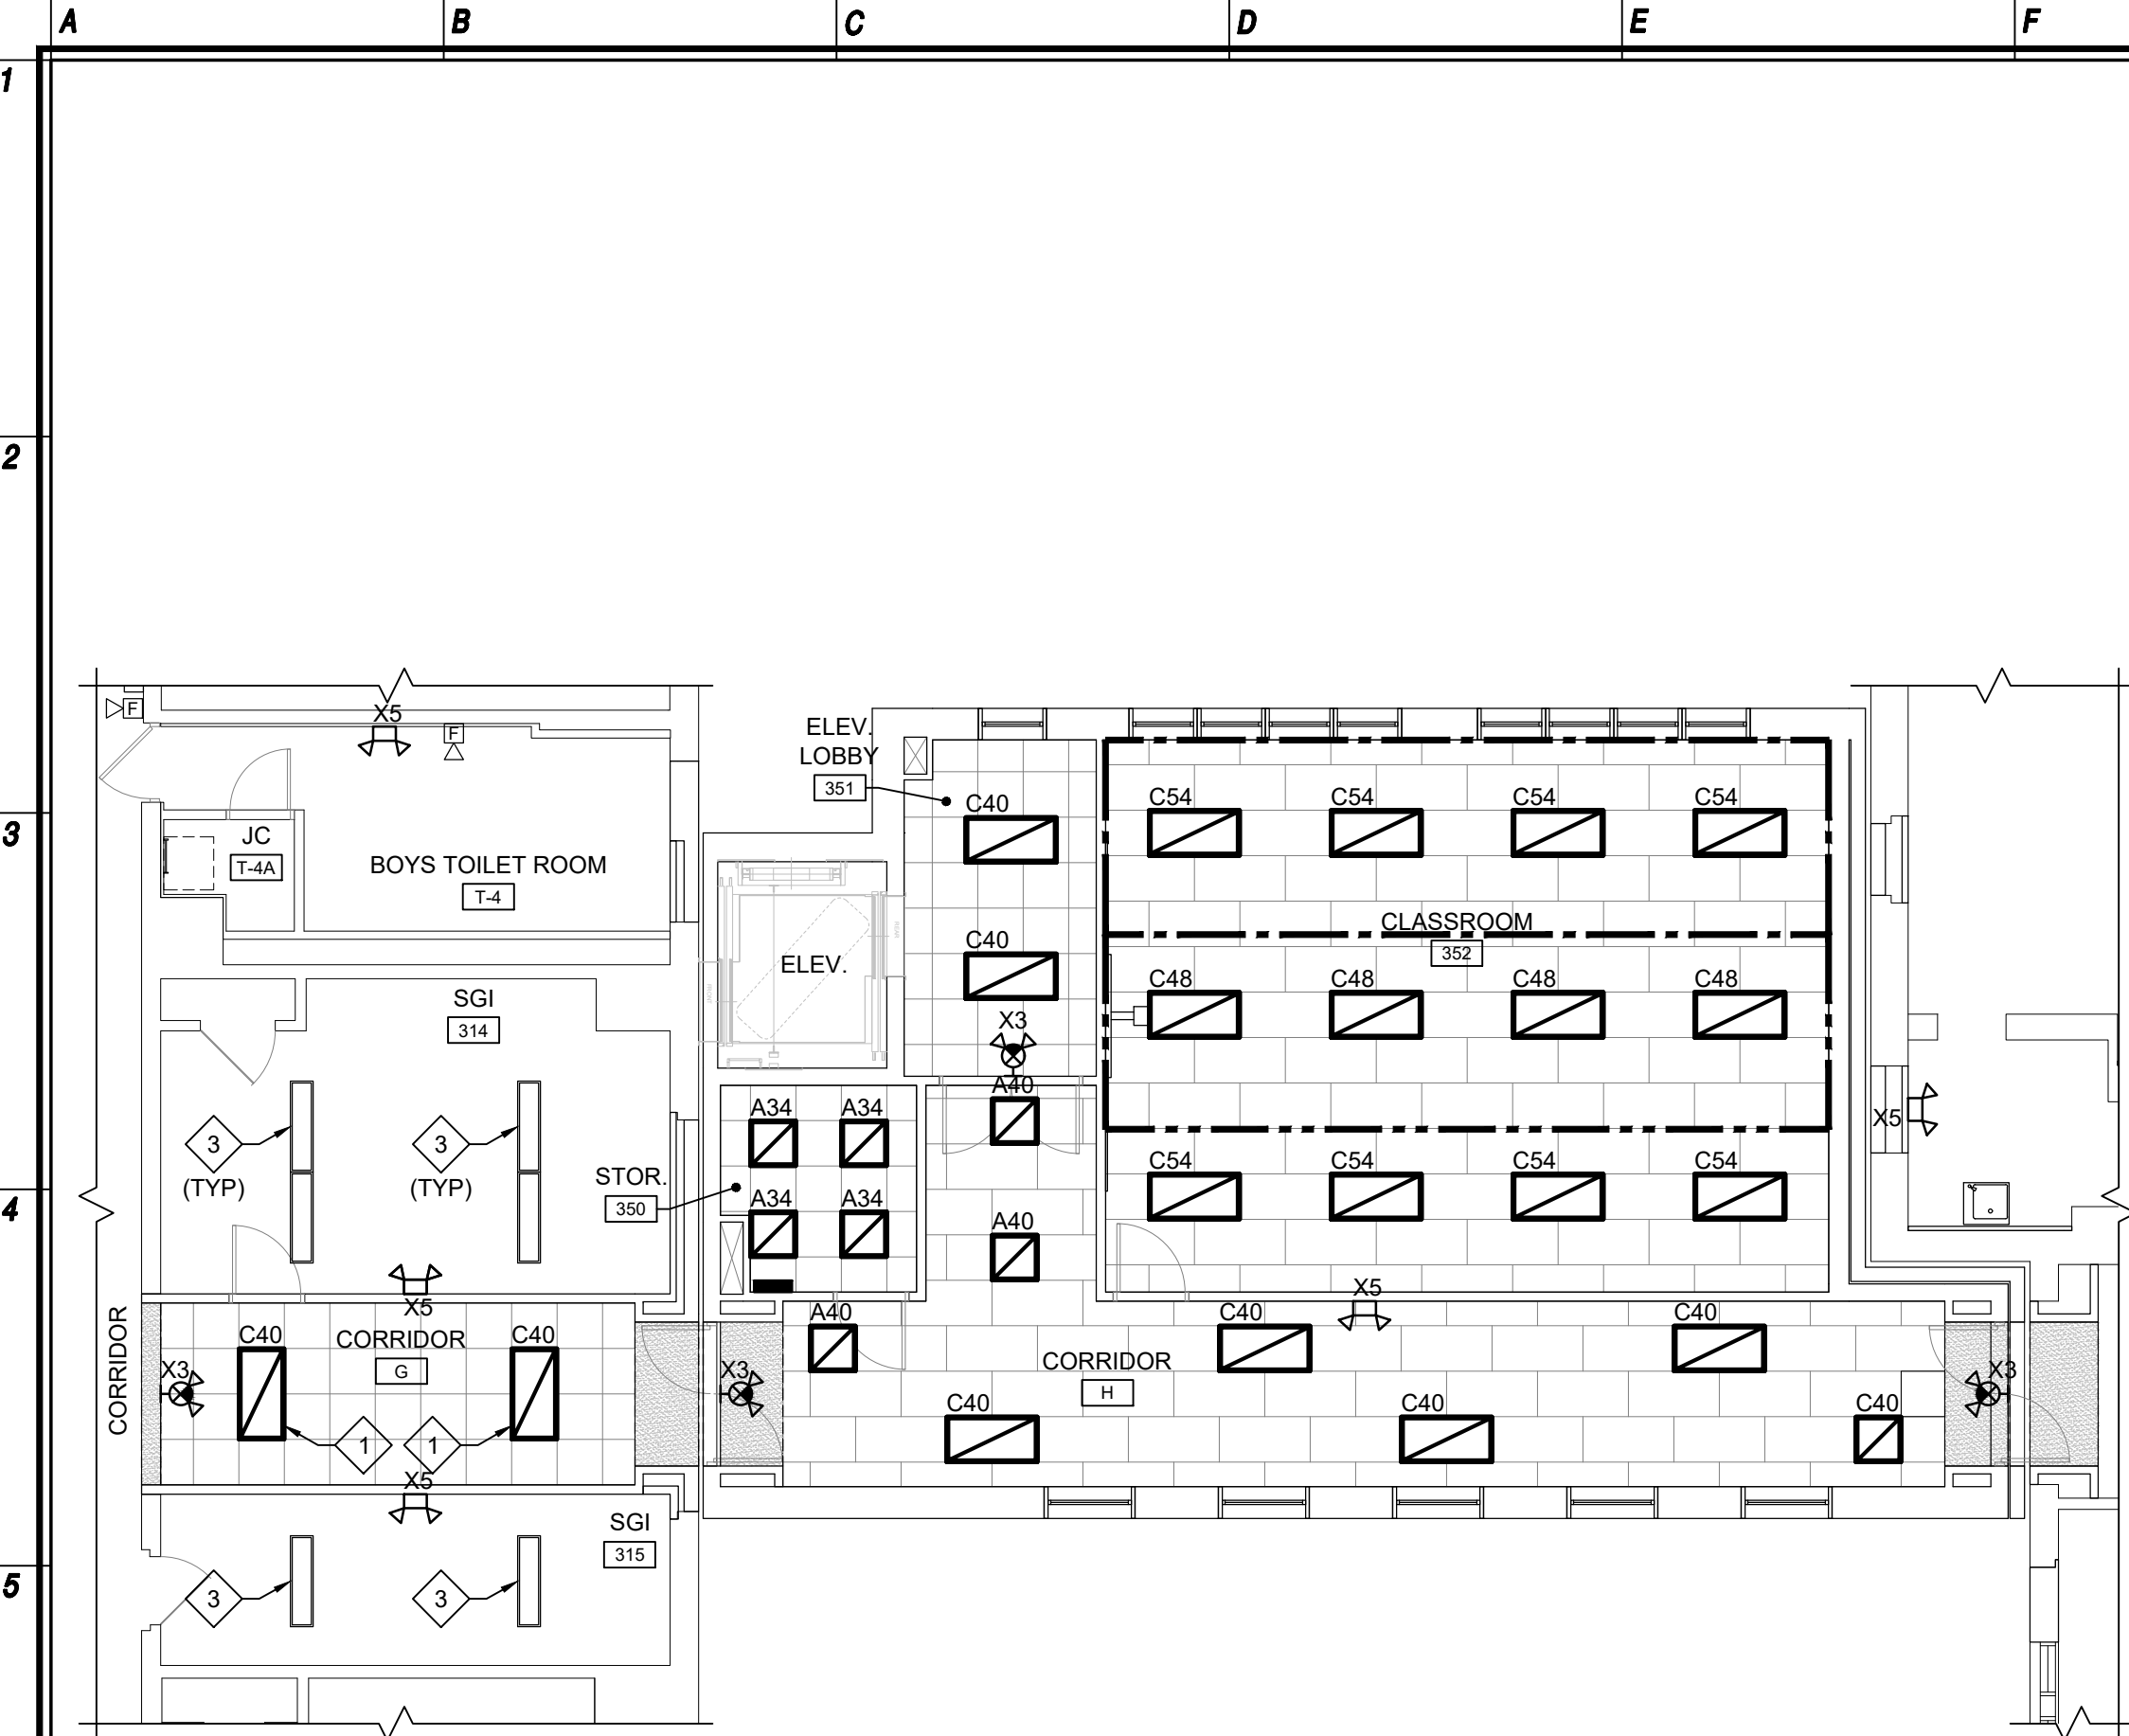


Proposed Lighting Plan - Third Floor

E5.01 1/8" = 1'-0" ALL LIGHTING IN THIS AREA SHALL BE ON CIRCUIT BPL3-14

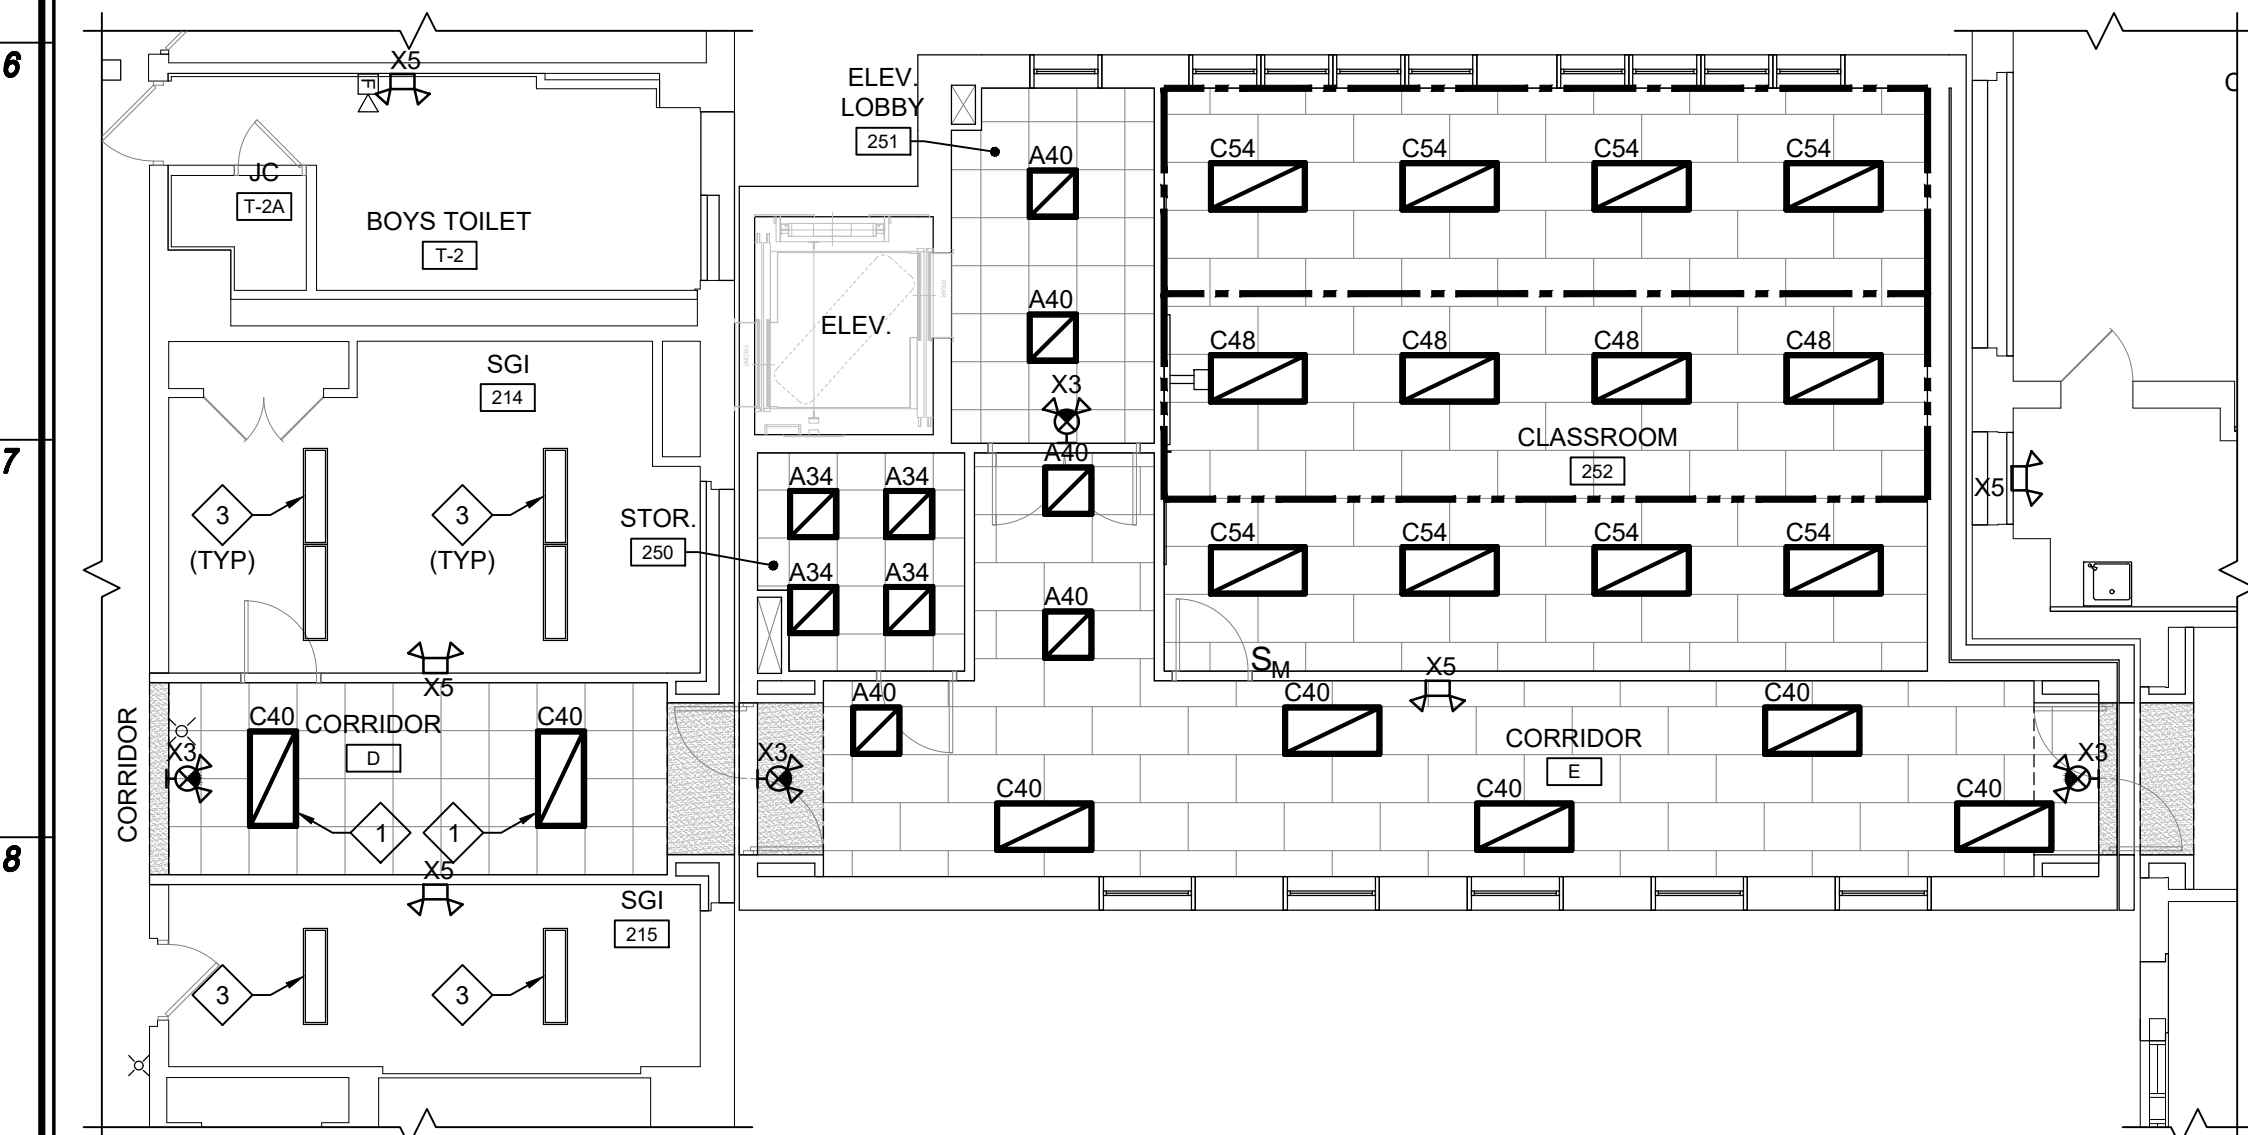


Proposed Lighting Plan - Second Floor

E5.01 1/8" = 1'-0" ALL LIGHTING IN THIS AREA SHALL BE ON CIRCUIT BPL3-13

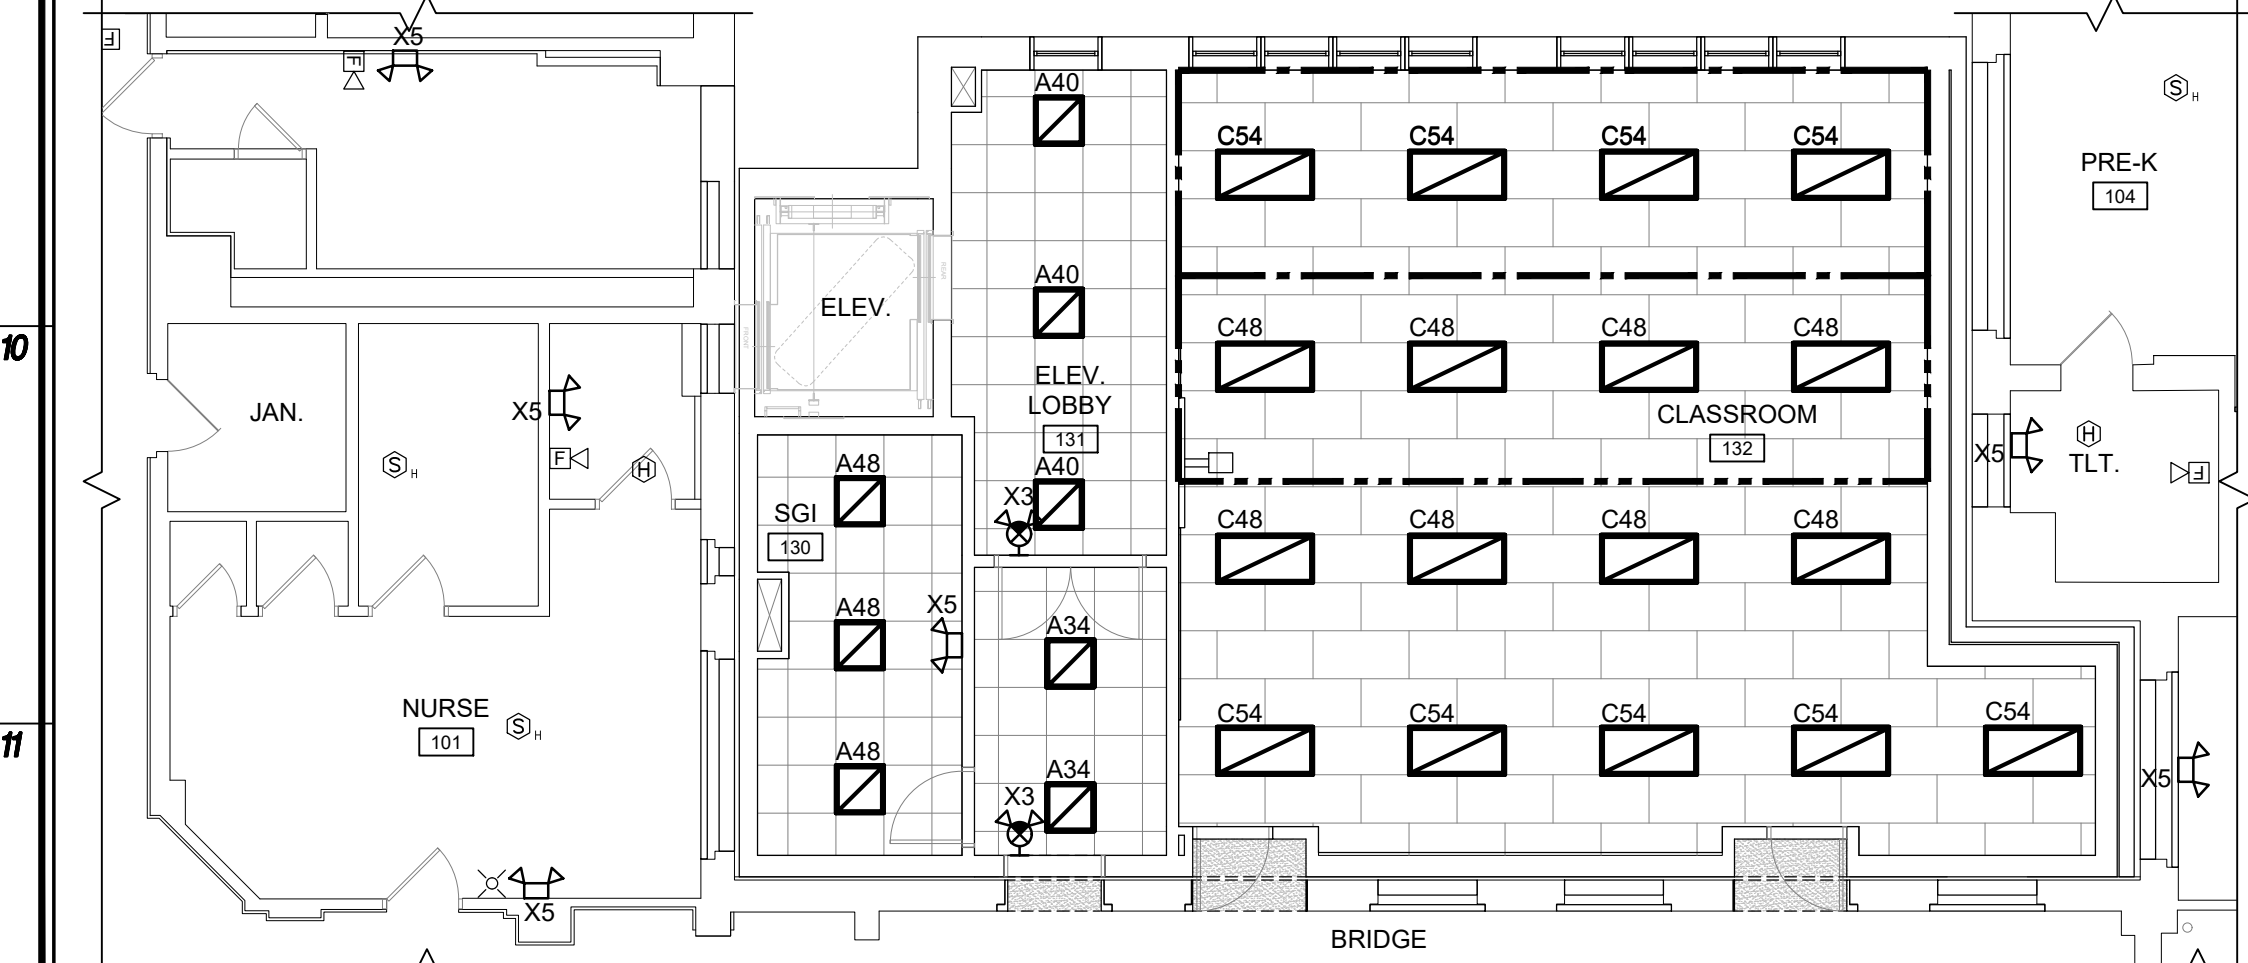

Proposed Lighting Plan - First Floor

E5.01 1/8" = 1'-0" ALL LIGHTING IN THIS AREA SHALL BE ON CIRCUIT BPL0-9

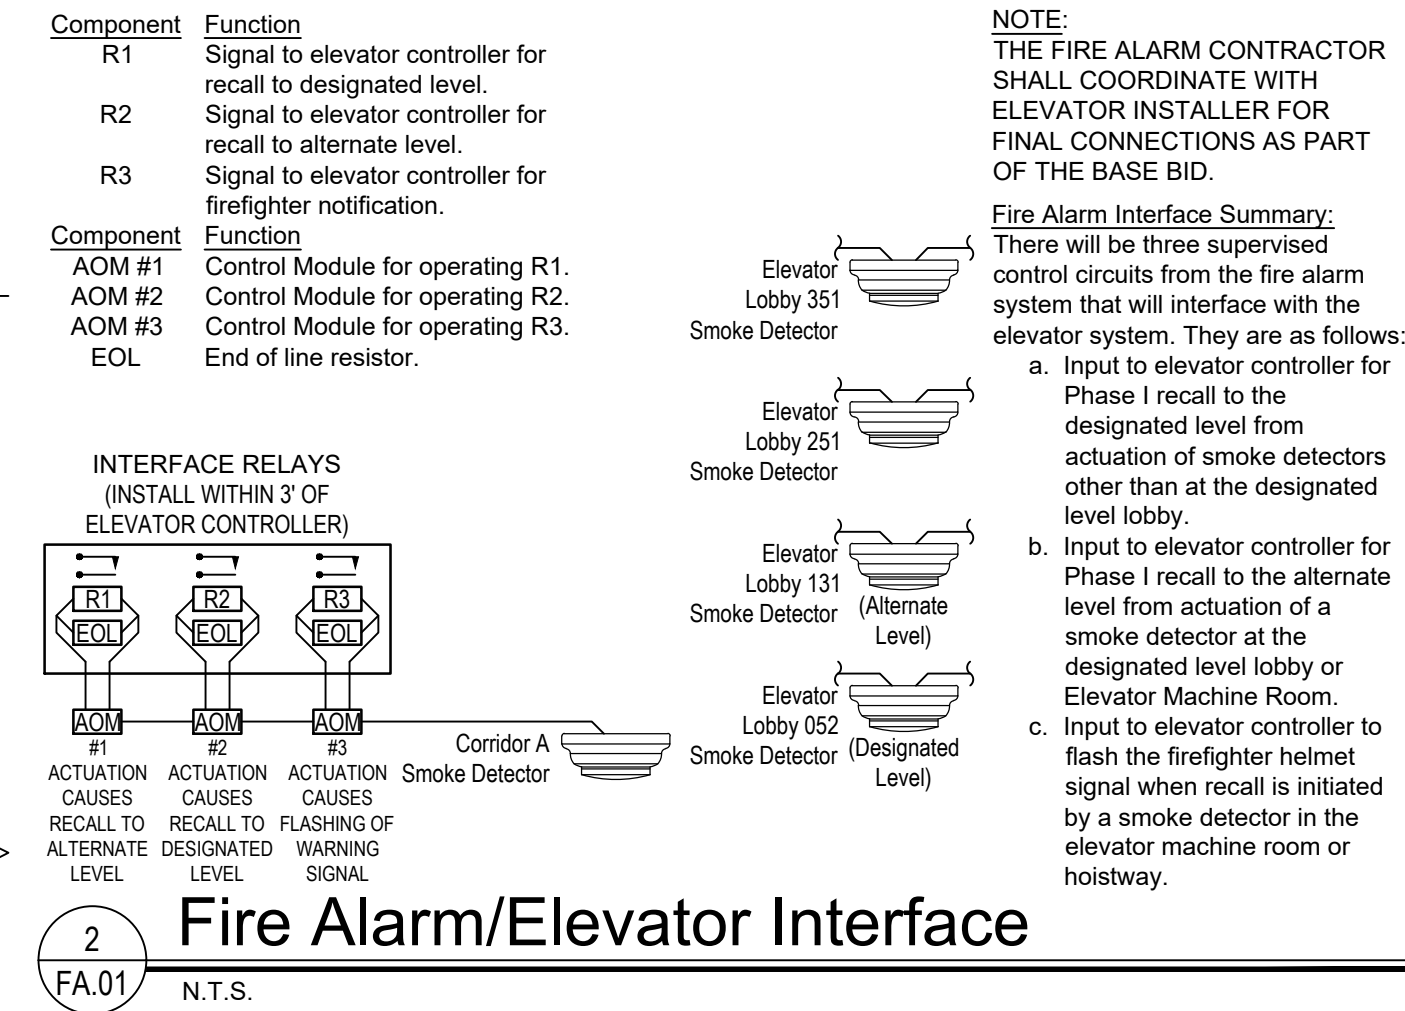

Fire Alarm/Elevator Interface


2 FA.01 N.T.S.

Light Fixture Schedule

SYMBOL	F.P.	MANUF.	MODEL	FIXTURE INFORMATION				LED INFORMATION				KEY NOTES
				DESCRIPTION	VOLT	WATT	MOUNTING	HEIGHT	LUMENS	LPW	CLR	
[Symbol]	A34	LITHONIA	EPANL 2X2 3400LM 80CRI 35K MIN10 ZT MVOLT R56	"EPANEL" LED FLAT PANEL 2x2 - 3400 NOMINAL LUMENS	UNV.	32	CLG. RECESSED	N/A	3225	101	80CRI, 35K	
[Symbol]	A40	LITHONIA	EPANL 2X2 4000LM 80CRI 35K MIN10 ZT MVOLT R56	"EPANEL" LED FLAT PANEL 2x2 - 4000 NOMINAL LUMENS	UNV.	32	CLG. RECESSED	N/A	4025	126	80CRI, 35K	
[Symbol]	A48	LITHONIA	EPANL 2X2 4000LM 80CRI 35K MIN10 ZT MVOLT R56	"EPANEL" LED FLAT PANEL 2x2 - 4800 NOMINAL LUMENS	UNV.	36	CLG. RECESSED	N/A	4446	124	80CRI, 35K	
[Symbol]	B	LITHONIA	FZL1M L96 SMR 6000LMULENS MVOLT 35K 80CRI L802U WH S02 XLR L96 SYM WH R56	"ZL1M" LED STRIPLIGHT 8' LONG - 6000 NOMINAL LUMENS	UNV.	48	CLG. SURFACE	N/A	7261	151	80CRI, 35K	
[Symbol]	C40	LITHONIA	EPANL 2X4 4000LM 80CRI 35K MIN10 ZT MVOLT R56	"EPANEL" LED FLAT PANEL 2x4 - 4000 NOMINAL LUMENS	UNV.	39	CLG. RECESSED	N/A	3914	100	80CRI, 35K	
[Symbol]	C48	LITHONIA	EPANL 2X4 4000LM 80CRI 35K MIN10 ZT MVOLT R56	"EPANEL" LED FLAT PANEL 2x4 - 4800 NOMINAL LUMENS	UNV.	47	CLG. RECESSED	N/A	4771	102	80CRI, 35K	
[Symbol]	C54	LITHONIA	EPANL 2X4 5400LM 80CRI 35K MIN10 ZT MVOLT R56	"EPANEL" LED FLAT PANEL 2x4 - 5400 NOMINAL LUMENS	UNV.	51	CLG. RECESSED	N/A	5143	101	80CRI, 35K	
[Symbol]	D	LITHONIA	VDGE2 LED P3 40K 80CRI VF MVOLT SRM E20WC PE COLOR R56	"VDGE2" LED ARCH. WALL SCONCE 3000 NOMINAL LUMENS W/ EMERG. BATTERY	UNV.	23	WALL SURFACE	REFER TO ELEVATION	3132	136	80CRI, 40K	
[Symbol]	E	GOIHAM	EVO6 35/02 AR WD LSS MVOLT GZ10	"EVO6" ROUND DOWNLIGHT - 250 NOMINAL LUMENS	UNV.	3	CLG. RECESSED	N/A	297	87	80CRI, 40K	
[Symbol]	X1	LITHONIA	EDG1 R EL R56	SURFACE MOUNT LED EDGE-LIT EXIT SIGN - SINGLE FACE - UNIVERSAL MOUNT	120	3	CLG./WALL SURFACE	REFER TO DETAIL	N/A			1.2
[Symbol]	X2	LITHONIA	LHQML ED R HO R56	HIGH OUTPUT UNIVERSAL (TOP/END/BACK) MOUNT COMBO EXIT SIGN & EMERG. LIGHT	120	3	CLG./WALL SURFACE	REFER TO DETAIL	N/A			2
[Symbol]	X3	LITHONIA	LHQML ED R R56	UNIVERSAL (TOP/END/BACK) MOUNT COMBO EXIT SIGN & EMERGENCY LIGHT	120	1	WALL SURFACE	REFER TO DETAIL	N/A			2.4
[Symbol]	X4	LITHONIA	ELAT QWP L0309 R56	REMOTE, DUAL HEAD EMERGENCY LIGHT FOR USE WITH FIXTURE X2	UNV.	N/A	WALL SURFACE	REFER TO DETAIL	N/A			2.3
[Symbol]	X5	LITHONIA	ELM4L R56	DUAL HEAD EMERGENCY LIGHT	UNV.	1	WALL SURFACE	REFER TO DETAIL	N/A			2

Key Notes

- PROVIDE RMR OPTION WHEN INSTALLED WALL MOUNTED
- CONNECT BATTERY TO LINE SIDE OF AREA LIGHTING SWITCH/POWER PACK.
- CONNECT TO INTERIOR EXIT SIGN BATTERY AS PER MANUF.'S INSTRUCTIONS.

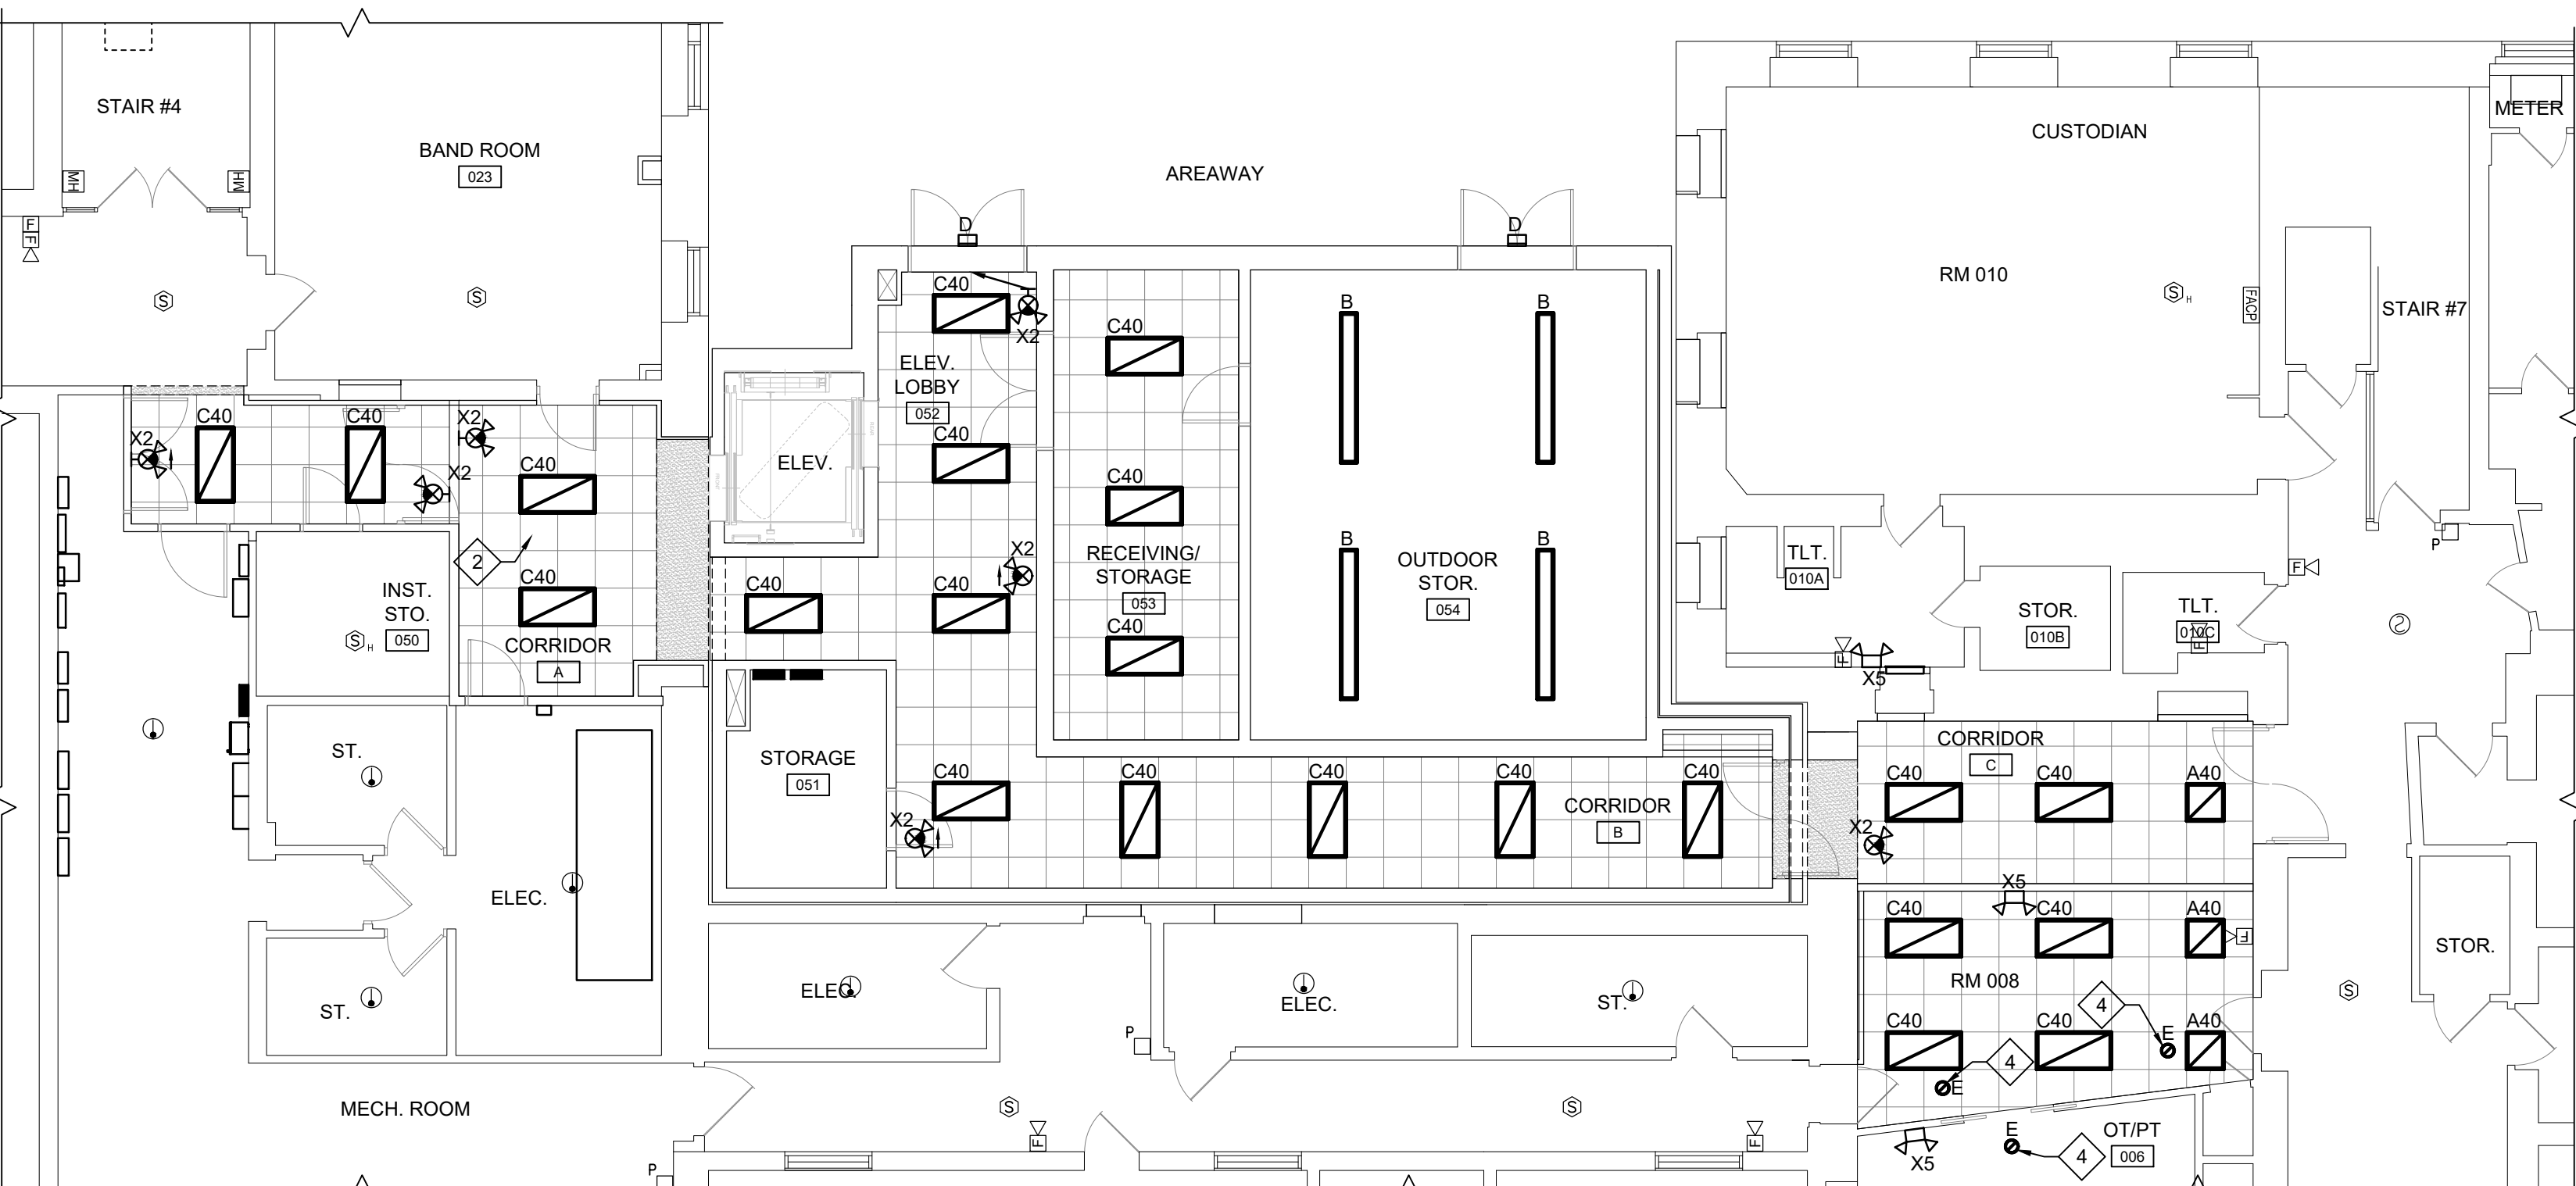

Proposed Lighting Plan - Lower Level

E5.01 1/8" = 1'-0"

ALL LIGHTING IN THIS AREA SHALL BE ON CIRCUIT BPL0-7

Lighting Key Notes

[Symbol] SYMBOL INDICATES LIGHTING KEY NOTE

- CONNECT FIXTURE(S) TO EXISTING CORRIDOR POWER & SWITCHING ARRANGEMENTS.
- REPLACE EXISTING HEAT DETECTOR AND MOUNT AT NEW CEILING.
- EXISTING SURFACE MOUNTED LIGHT FIXTURE. CONTRACTOR RESPONSIBLE TO REMOVE FIXTURES TO ACCOMMODATE THE CONSTRUCTION OF THE NEW CORRIDOR. RECIRCUIT THE REMAINING FIXTURES AS REQUIRED.
- CONNECT FIXTURE TO LINE SIDE OF AREA LIGHTING TO MAINTAIN A MIN. OF 1 FC ALONG THE PATH OF EGRESS AT ALL TIMES.

MICHAEL J. MCGOVERN, R.A.

Revisions:
ISSUE TO BD
11/23/20

LAN ASSOCIATES

PROPOSED LIGHTING PLANS

E5.01