



Drawing Name: S:\Projects\Poughkeepsie_C\ Sewer Rehab\1D Design\08 CAD\AutoCAD\MECH\H2\WPCP - H201.dwg
Date last accessed: 3/25/2020 12:48 PM
Date last plotted: 3/25/2020 1:08 PM
Plotted By: Robert Travis

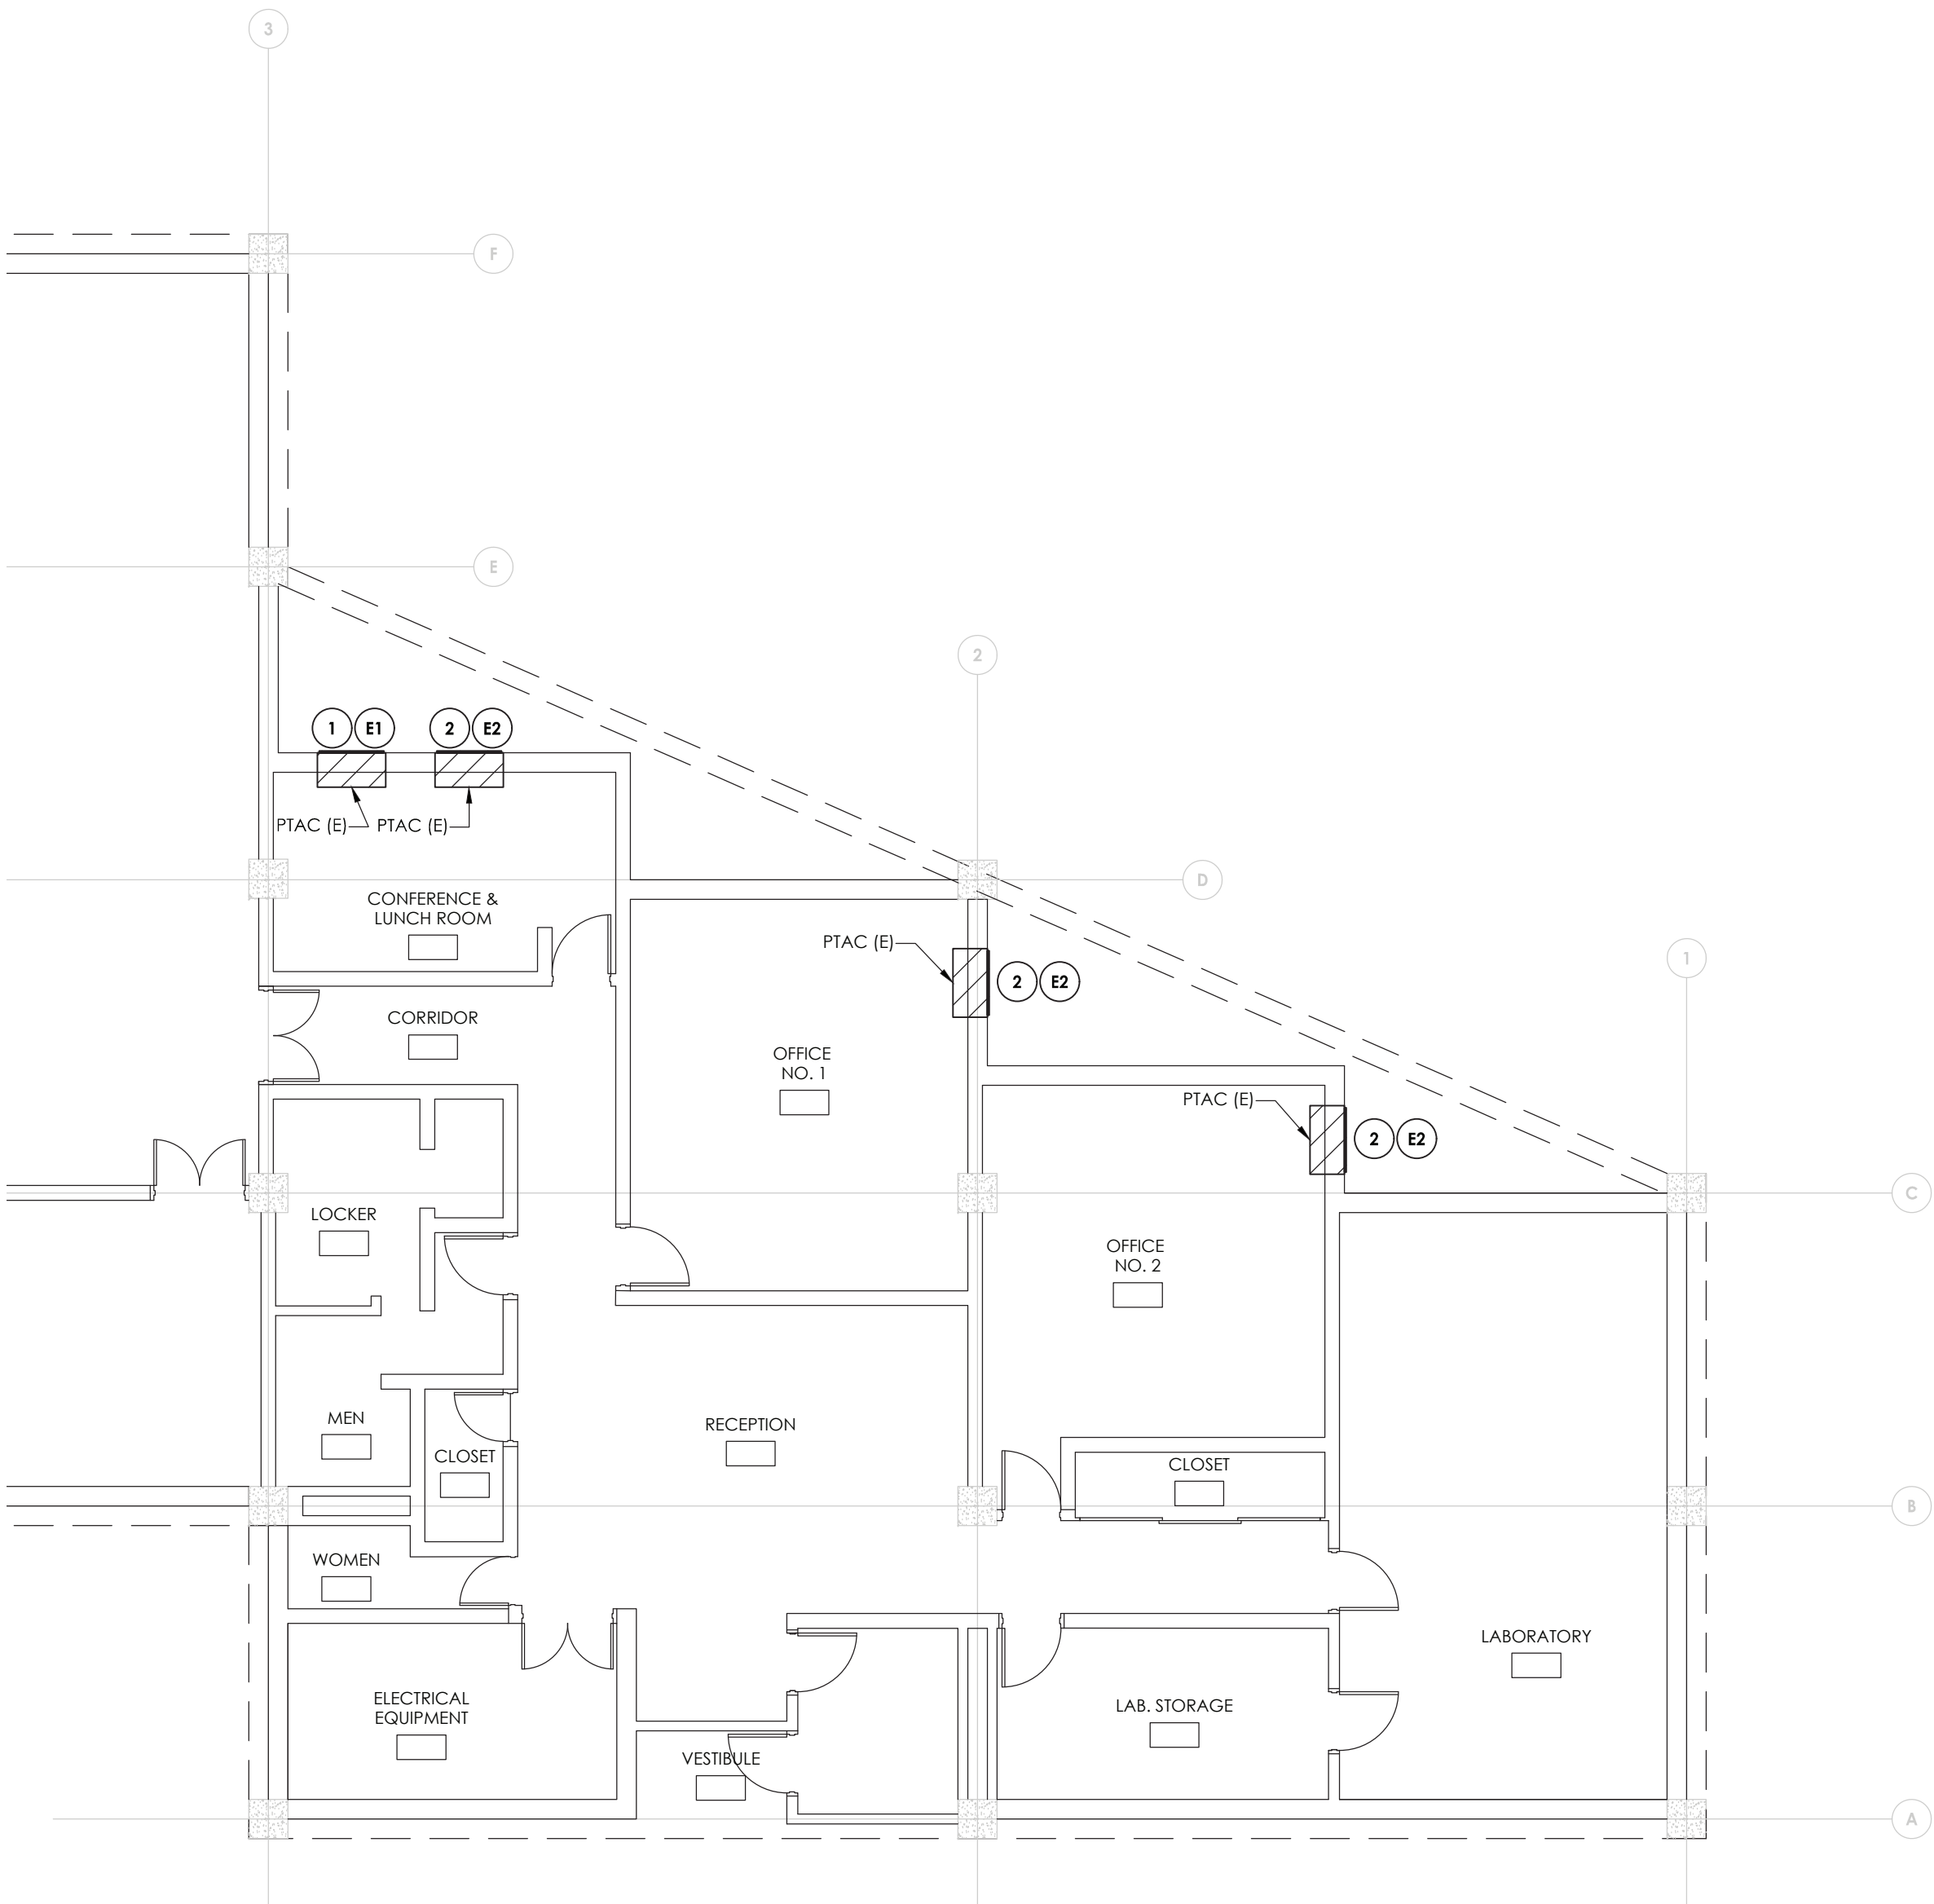

1
H201
HVAC DEMOLITION PLAN
SCALE: 1/8" = 1'-0"

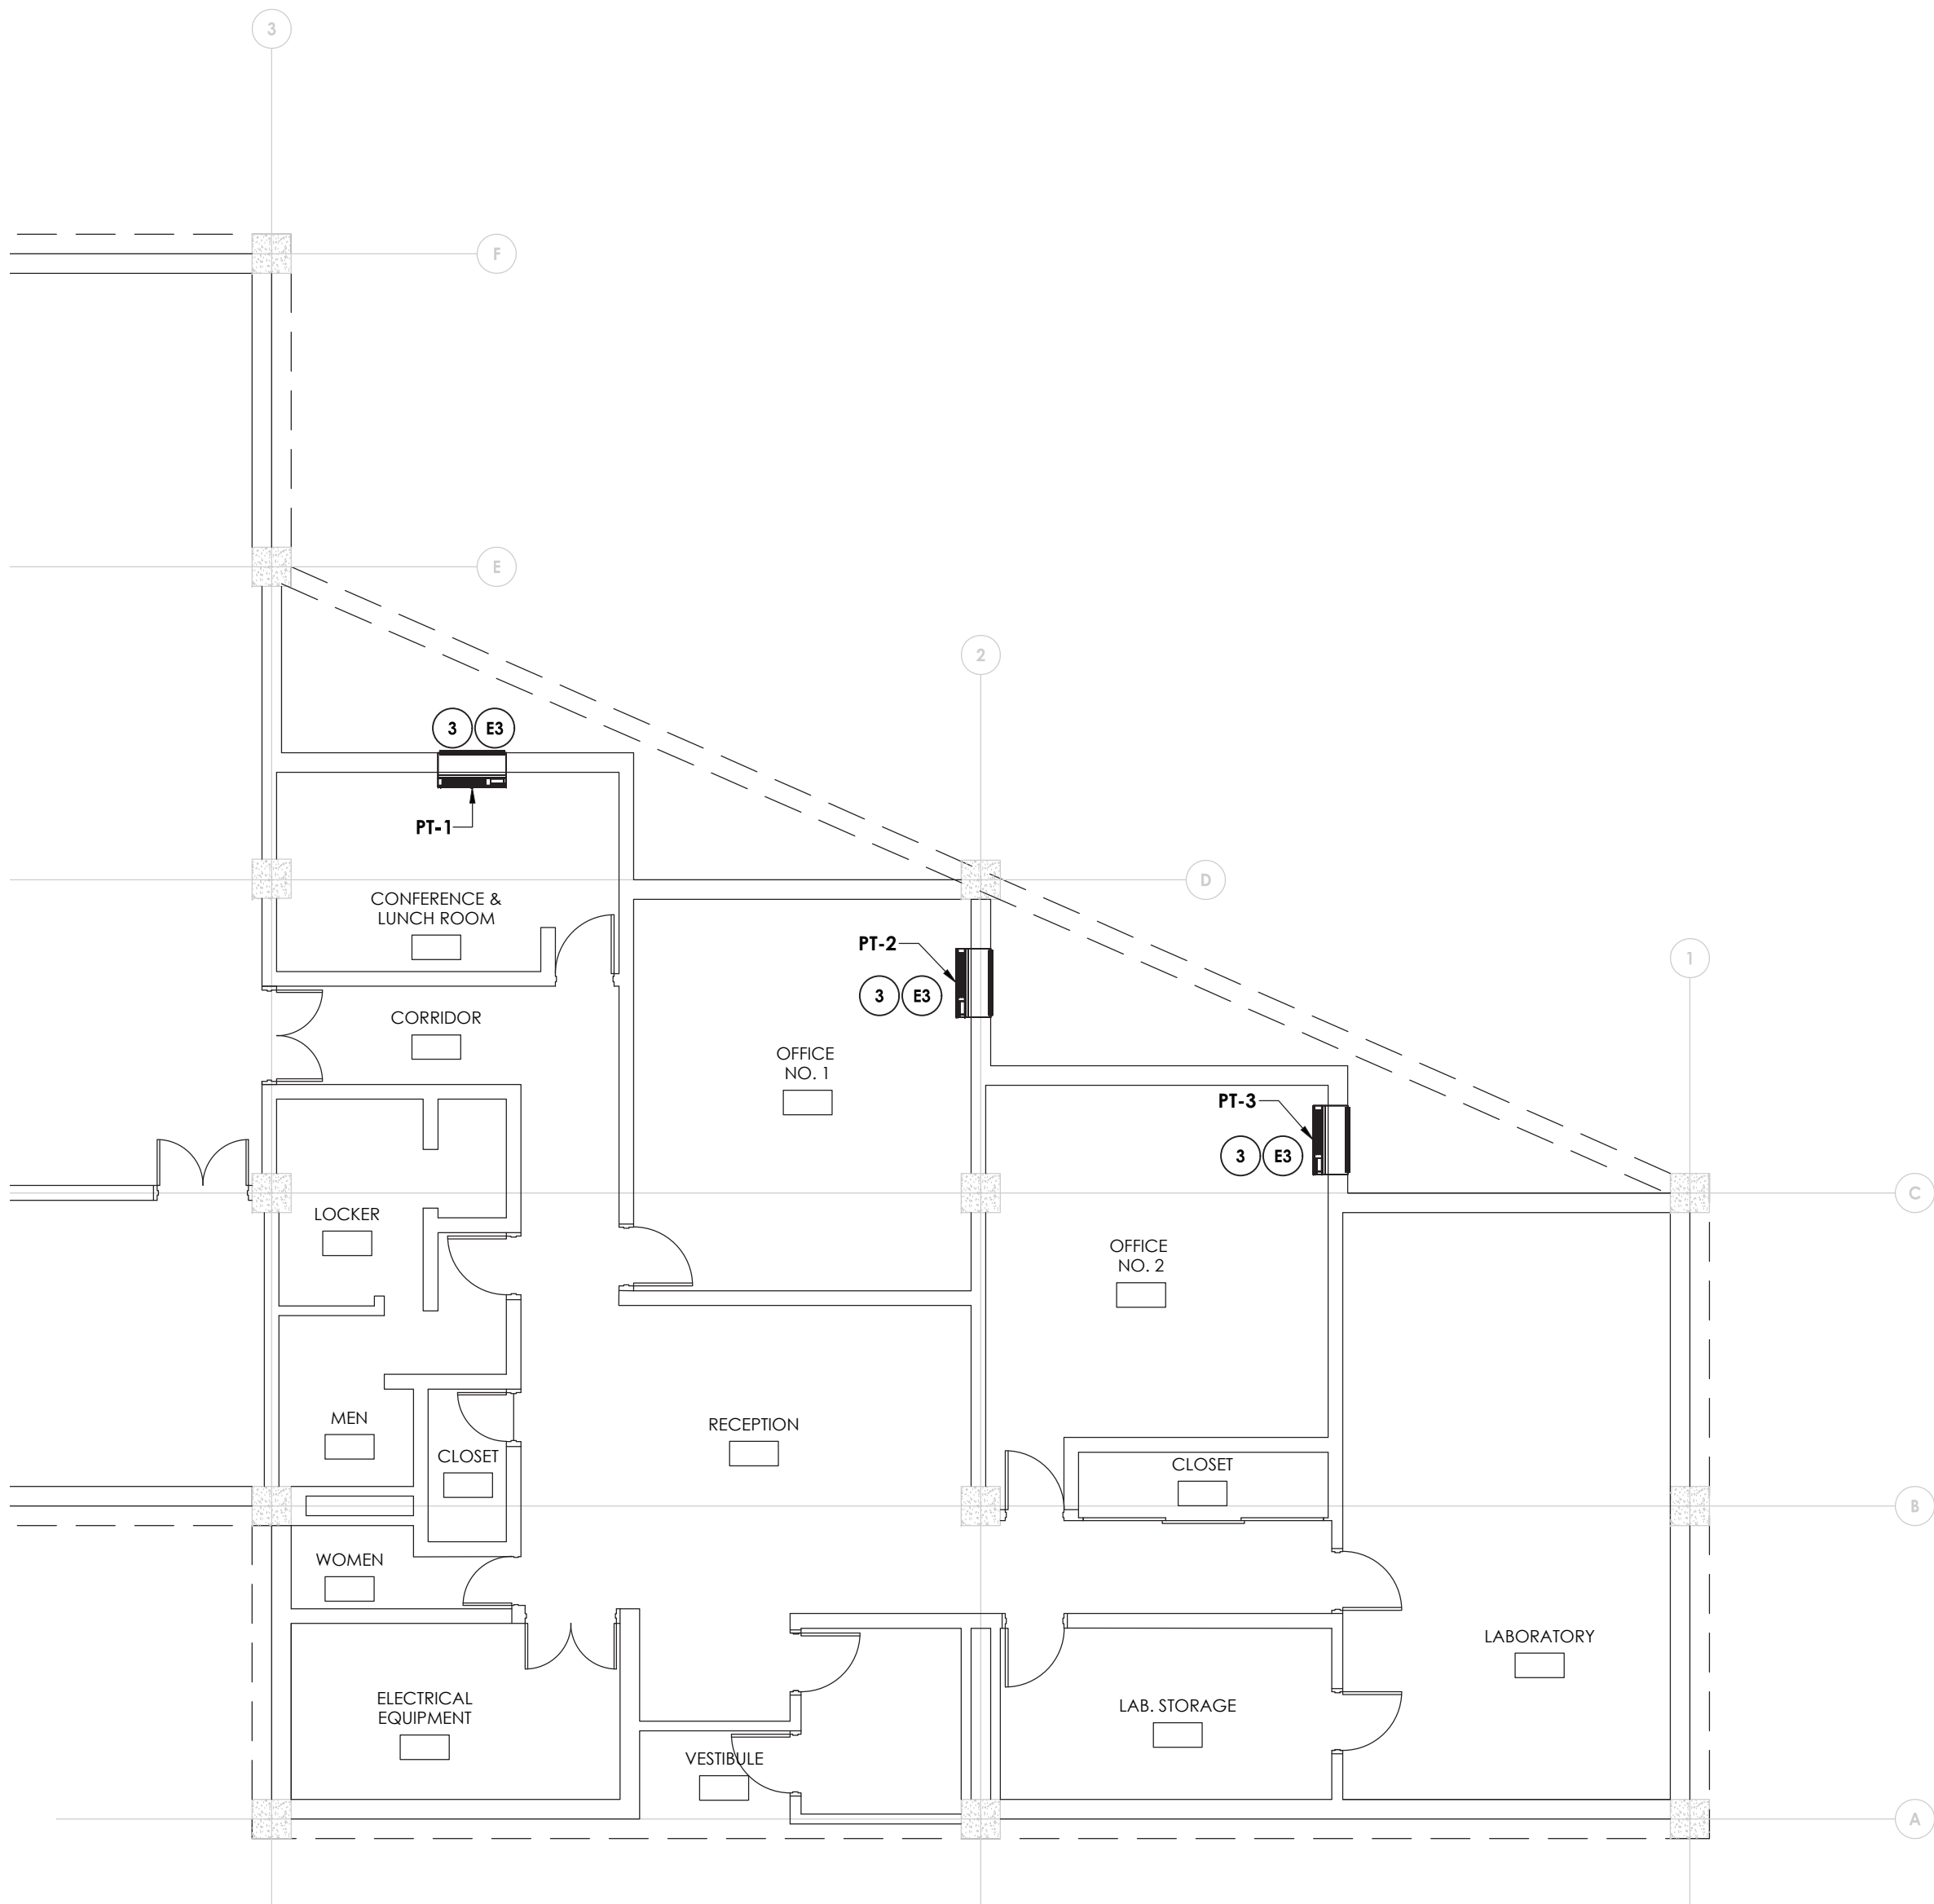


2
H201
HVAC NEW WORK PLAN
SCALE: 1/8" = 1'-0"

PACKAGE TERMINAL AIR CONDITIONER (PTAC) UNIT SCHEDULE													
MARK	LOCATION	COOLING CAPACITY (BTU/H)	HEATING CAPACITY (MBH/KW)	VENTILATION AIR (CFM)	TOTAL CFM	ELECTRICAL DATA				DIMENSIONS (L" X W" X H")	WEIGHT (LBS)	TYPICAL UNIT MFG & MODEL NO.	REMARKS:
						VOLTS	PHASE	MCA	EER				
PT-1	CONFERENCE/ LUNCH ROOM	14,800	12.6 / 3.8	65	340	277	1	17.9	10.0	42 X 21-1/2 X 16-1/16	113	AMANA - PTC154G35A	1, 2
PT-2	OFFICE # 1	14,800	17.1 / 5.0	65	340	277	1	23.9	10.0	42 X 21-1/2 X 16-1/16	113	AMANA - PTC154G35A	1, 2
PT-3	OFFICE # 2	14,800	17.1 / 5.0	65	340	277	1	23.9	10.0	42 X 21-1/2 X 16-1/16	113	AMANA - PTC154G35A	1, 2
REMARKS:													
1. PROVIDE WALL SLEEVE TO MATCH WALL-DEPTH.													
2. PROVIDE ANODIZED ALUMINUM ARCHITECTURAL OUTDOOR GRILLE.													


- KEY NOTES:**
- 1 REMOVE PACKAGE TERMINAL AIR CONDITIONER (PTAC) IN IT'S ENTIRETY, WALL SLEEVE, AND OUTDOOR GRILLE. PATCH AND REPAIR WALL OPENING WEATHER TIGHT WITH LIKE MATERIALS.
 - 2 REMOVE PACKAGE TERMINAL AIR CONDITIONER (PTAC) IN IT'S ENTIRETY, WALL SLEEVE, AND OUTDOOR GRILLE. PREPARE WALL OPENING FOR NEW EQUIPMENT.
 - 3 INSTALL NEW PACKAGE TERMINAL AIR CONDITIONER (PTAC), NEW WALL SLEEVE TO MATCH WALL DEPTH, AND ANODIZED ALUMINUM OUTDOOR GRILLE.

- KEY NOTES: ELECTRICAL**
- E1 DISCONNECT PTAC FOR REMOVAL. REMOVE ALL WIRING AND COUDUIT BACK TO SOURCE. LABEL BREAKER AS SPARE.
 - E2 DISCONNECT PTAC FOR REMOVAL. PULL BACK WIRING AND CONDUIT, TAG FOR RE-USE.
 - E3 CONNECT NEW PTAC UNIT TO EXISTING TAGGED CIRCUITRY. REWORK/EXTEND CONDUIT AND WIRING AS NECESSARY.

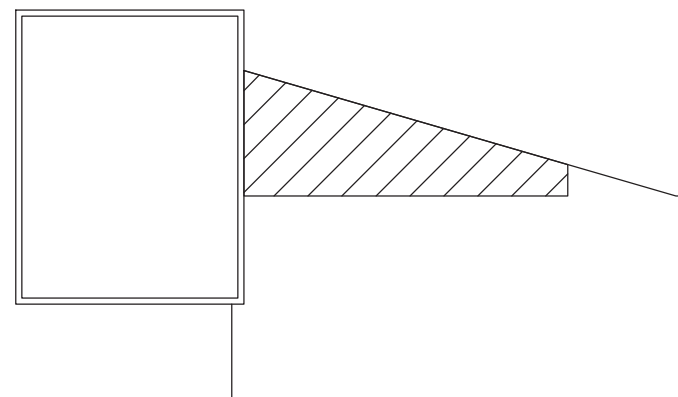

Clark Patterson Lee
ARCHITECTURE | ENGINEERING | PLANNING
50 FRONT STREET, SUITE 202
NEWBURGH, NEW YORK 12550
TEL (845) 567-6700
FAX (845) 567-9614
www.clarkpatterson.com

REVISIONS NO.	DATE	BY	DESCRIPTION
1	03/06/2019	RT	ISSUED FOR EIC REVIEW
2	03/25/2020	RT	ISSUED FOR BID

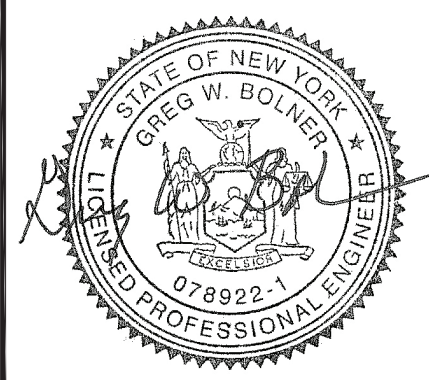

CITY OF POUGHKEEPSIE
ENGINEERING DEPARTMENT
WATER POLLUTION CONTROL PLANT
IMPROVEMENTS
CITY OF POUGHKEEPSIE, NEW YORK

DATE 3/01/2019	DRAWN MD	CHECKED RJT
SCALE 1/8" = 1'-0"		
SHEET TITLE HVAC FIRST FLOOR PLAN DEMOLITION, NEW WORK, & SCHEDULES.		

PROJECT NUMBER
12422.06
WPCP
H201
DRAWING NUMBER