


GENERAL NOTES:

1. BOX SCHEDULES ARE SHOWN FOR THE CONVENIENCE OF THE CONTRACTOR, EACH CONTRACTOR SHALL BE RESPONSIBLE FOR VERIFICATION OF QUANTITIES AND SHALL FURNISH ALL MATERIALS, WHETHER SPECIFIED OR NOT, TO PRODUCE A COMPLETE AND WORKING SYSTEM.
2. CONTRACTOR SHALL CONFIRM LOCATIONS, MOUNTING HEIGHTS, AND MOUNTING CONDITIONS WITH ARCHITECT AND THEATRE CONSULTANT PRIOR TO BOX ROUGHIN.
3. CONTROL RECEPTACLE BACK BOX SIZES MAY VARY FROM SIZES LISTED ON SCHEDULES. DETERMINE MANUFACTURER, CONTRACTOR SHALL PROVIDE BACK BOXES IN ACCORDANCE WITH MANUFACTURER'S SUBMITTALS.
4. DETERMINE ELECTRICAL DRAWINGS AND SPECIFICATIONS FOR ADDITIONAL REQUIREMENTS.
5. EMERGENCY LIGHTING SYSTEM DESIGN AND DEVICES SHOWN ON ELECTRICAL DRAWINGS.

2 CONTROL RISERNTS

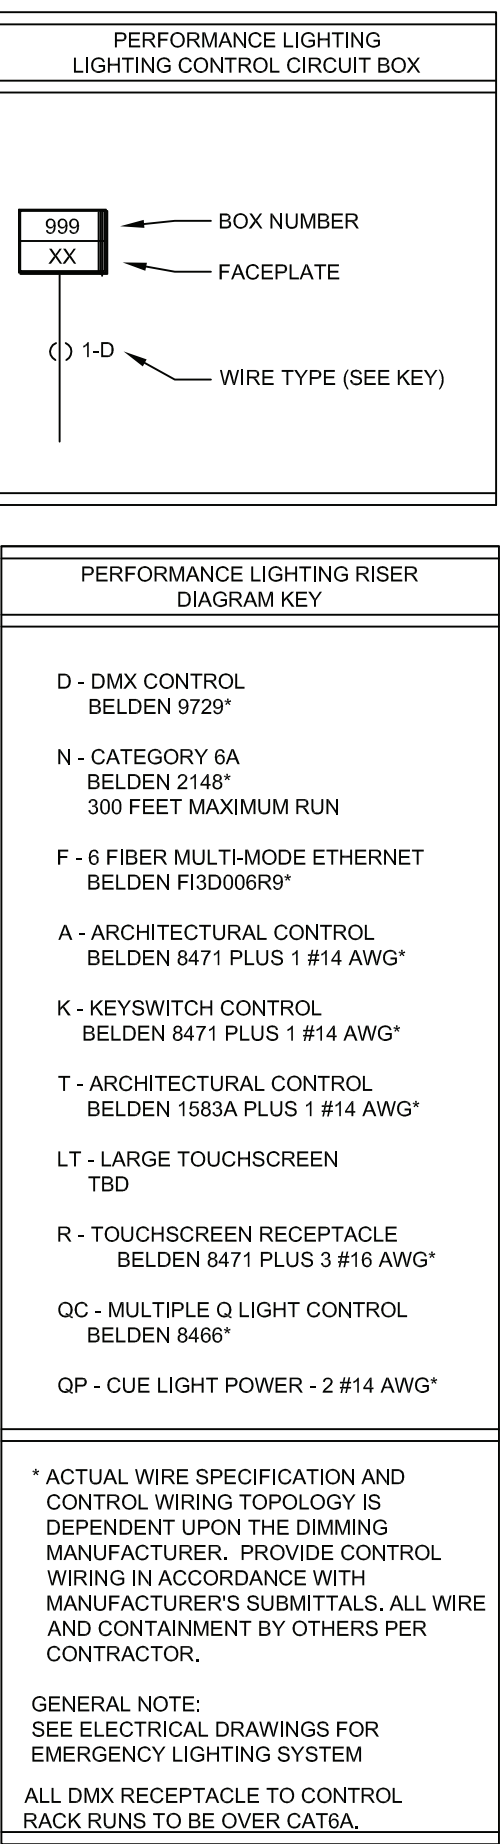

**THEATRE
PROJECTS**

47 Water Street
South Norwalk
Connecticut 06854
United States
+1 203 299 0830
www.theatreprojects.com

PERFORMANCE LIGHTING- PERFORMANCE DIMMING & CONTROL BOX SCHEDULE

Drawn By:	Date:	Drawing Number:
-----------	-------	-----------------

Drawn By: TPC	Date: 07/02/20
Project No.: 234903-20001	

TL111