

- GC SHALL COORDINATE WITH FIRE MARSHALL TO VERIFY IF NEW COOKING EQUIPMENT UPGRADE REQUIRES AN INCREASE OR TEST REPORT OF EXISTING ANSUL SYSTEM.


OF SHEET:



1. PROVIDE EITHER FULL CIRCLE SUPPORT OR SADDLE SUPPORTS FOR INDIVIDUAL SINK DRAIN PIPING FOR 3 & 4 COMPARTMENT SINK PIPING THAT RUNS HORIZONTAL TO FLOOR SINKS.
2. FULL CIRCLE CLAMP SUPPORTS ARE TO BE FACTORY FABRICATED UNITS. NO CONTRACTOR FABRICATED SUPPORTS ARE ALLOWED. MATERIAL TO BE A36 STEEL WITH A GALVANIZED FINISH UNLESS INDICATED OTHERWISE IN SPECIFICATIONS. UPPER AND LOWER MATCHING SADDLES ARE EACH TO ENCOMPASS 170° OF PIPE, AND ARE TO BE FORMED TO ACTUAL PIPE DIAMETER. BASE IS TO BE ANCHORED TO FLOOR, AND INSTALLER IS TO WELD EXTENSION PIPE TO BASE AND COLLAR AFTER INSTALLATION. A NEOPRENE LINER IS REQUIRED WHEN SUPPORTING STEEL OR PVC PIPE. SUPPORTS SHALL BE STANDON MODEL C92 OR APPROVED EQUALS.
3. SADDLE SUPPORTS ARE TO BE FACTORY FABRICATED UNITS. NO CONTRACTOR FABRICATED SUPPORTS ARE ALLOWED. MATERIAL TO BE A36 STEEL WITH A GALVANIZED FINISH UNLESS INDICATED OTHERWISE IN SPECIFICATIONS. SADDLE TO ENCOMPASS 170° OF CIRCUMFERENCE FOR PIPE SIZES UP TO 24", AND 120° FOR LARGER DIAMETER'S. SADDLE IS TO BE FORMED TO ACTUAL PIPE DIAMETER. A NEOPRENE LINER IS REQUIRED WHEN SUPPORTING STEEL OR PVC PIPE. SUPPORTS SHALL BE STANDON MODEL S92 OR APPROVED EQUALS.
4. STANDON MODEL SUPPORTS AS MANUFACTURED BY - MATERIAL RESOURCES INC., FOREST GROVE, OR. 503-533-5268P, 503-533-5501F



3 CHEMICAL SYSTEM CONNECTION

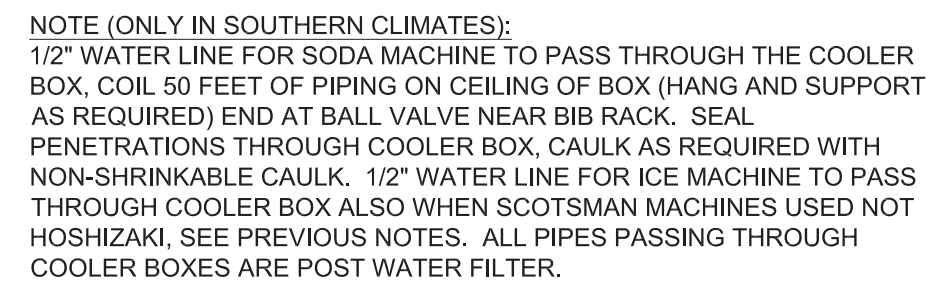

8 WATER FILTER DETAIL

FIVE GUYS JUNE 2016 UPDATE
LIGHT SWITCH BANK / MUSIC VOLUME CONTROLS
 LIGHT SWITCH/MUSIC VOLUME CONTROLS SHALL BE RELOCATED TO THE MANAGERS AREA WHENEVER THE WALL AREA NEXT TO ELIASON DOOR SEPARATING THE KITCHEN AND PREP ROOM IS IN PROXIMITY TO ANY SINK, GREASE CUP, OR OTHER WATER RELATED FIXTURE OR DEVICE THAT MAY CAUSE THE SWITCHES/CONTROLS TO MALFUNCTION/DETERIORATE OVER TIME DUE TO EXPOSURE TO WATER AND OR GREASE.



7 BEV SYSTEM PIPING DIAG-3M



2 CHEMICAL SYSTEM @ MOP SINK

