




BREAK ROOM CONTROL SCHEME
N.T.S.

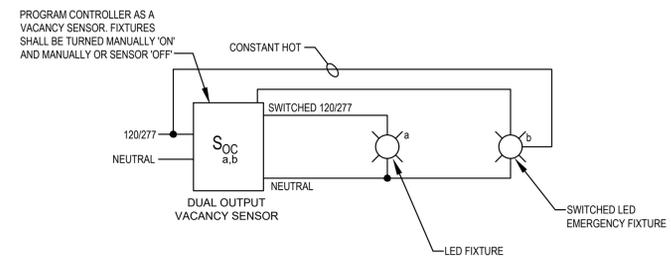


MANAGER'S OFFICE CONTROL SCHEME
N.T.S.

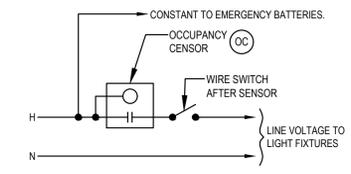


TOILET ROOM OCCUPANCY CONTROL SCHEME
N.T.S.

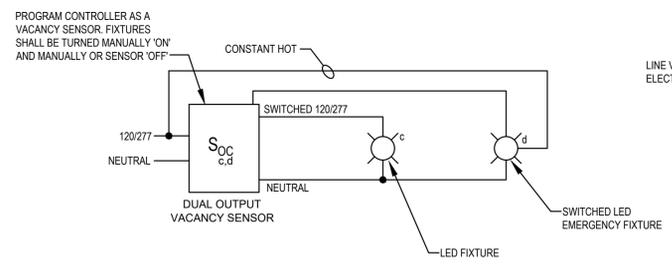

CASH ROOM CONTROL SCHEME
N.T.S.

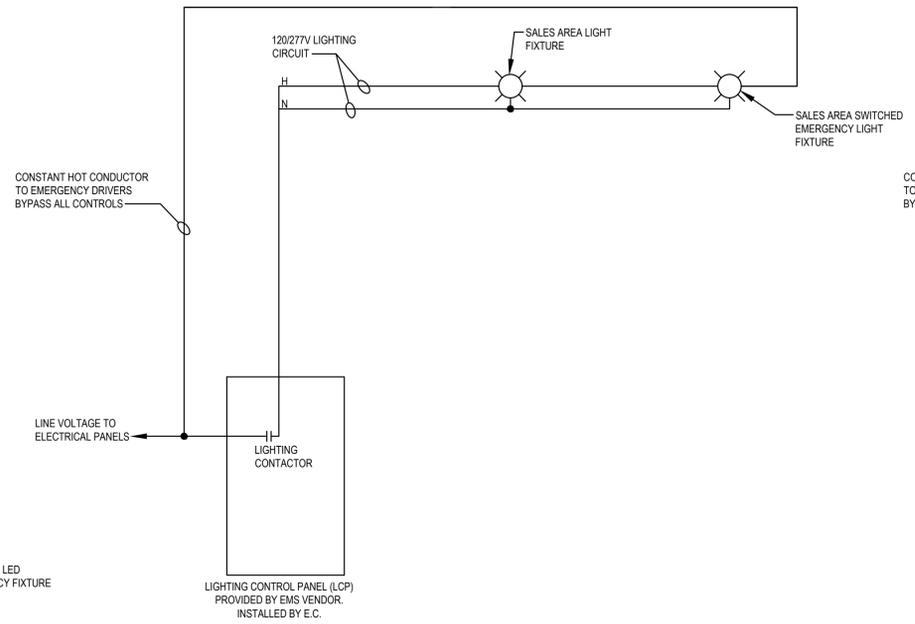

SALES FLOOR CONTROL SCHEME
N.T.S.

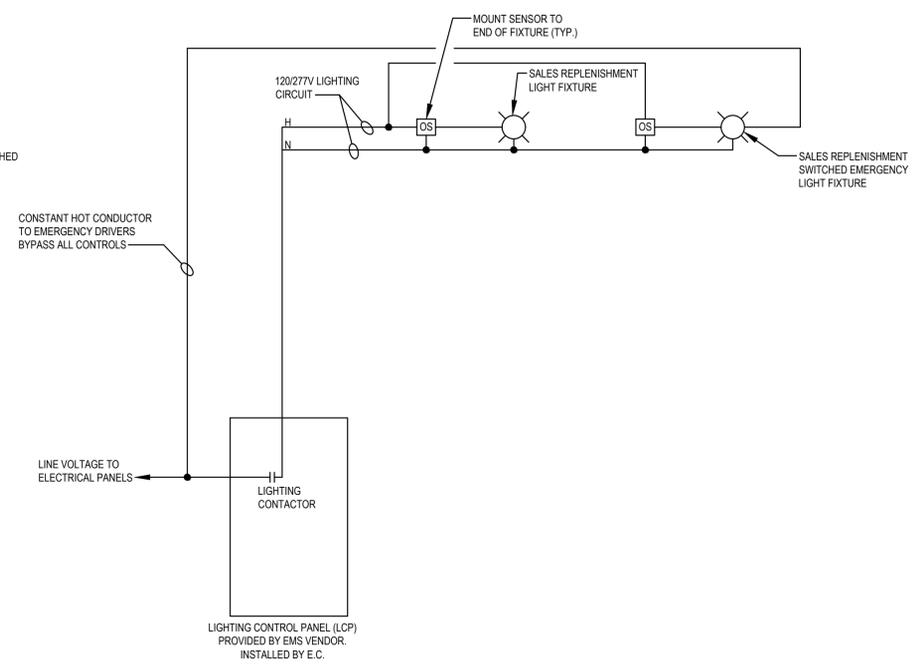

SALES REPLENISHMENT CONTROL SCHEME
N.T.S.

ALL DEVICES SHOWN FOR OCCUPANCY / DIMMING CONTROL INDICATED ON THIS DRAWING ARE NOT PART OF THE SIEMENS EMS SYSTEM (U.O.N). THE ELECTRICAL CONTRACTOR SHALL PURCHASE, WIRE, INSTALL LINE AND LOW VOLTAGE DIMMING SWITCHES, OCCUPANCY/VACANCY SENSORS, RELAYS, ETC.

DO NOT SCALE THESE DRAWINGS

HARBOR FREIGHT TOOLS

314 NY ROUTE 59
NYACK, NY 10960



REVISIONS	
#	DATE
1	
2	
3	
4	
5	
6	
7	
8	
9	

ROOM LIGHTING CONTROL / DIMMING SYSTEM DETAILS

DATE: 9/22/21
JOB NO.: 20420

E1.1A
SHEET NO.

THESE DOCUMENTS CONTAIN INFORMATION PROPRIETARY TO ADA ARCHITECTS SERVICES, P.C. UNAUTHORIZED USE OF THESE DOCUMENTS IS EXPRESSLY PROHIBITED UNLESS AGREED UPON IN WRITING.