

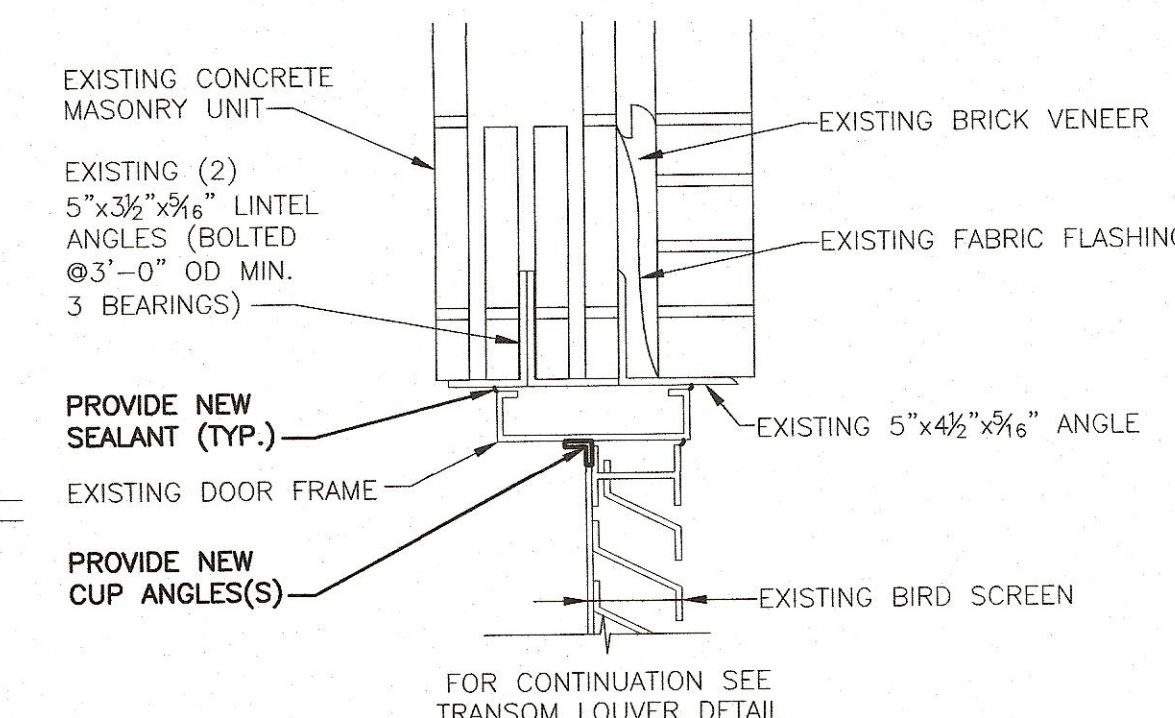
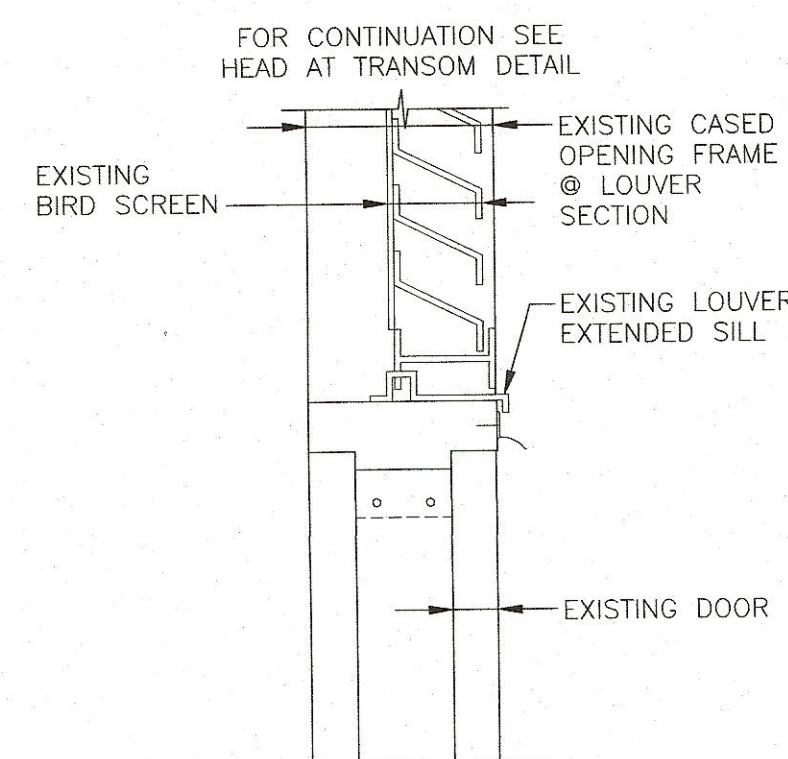
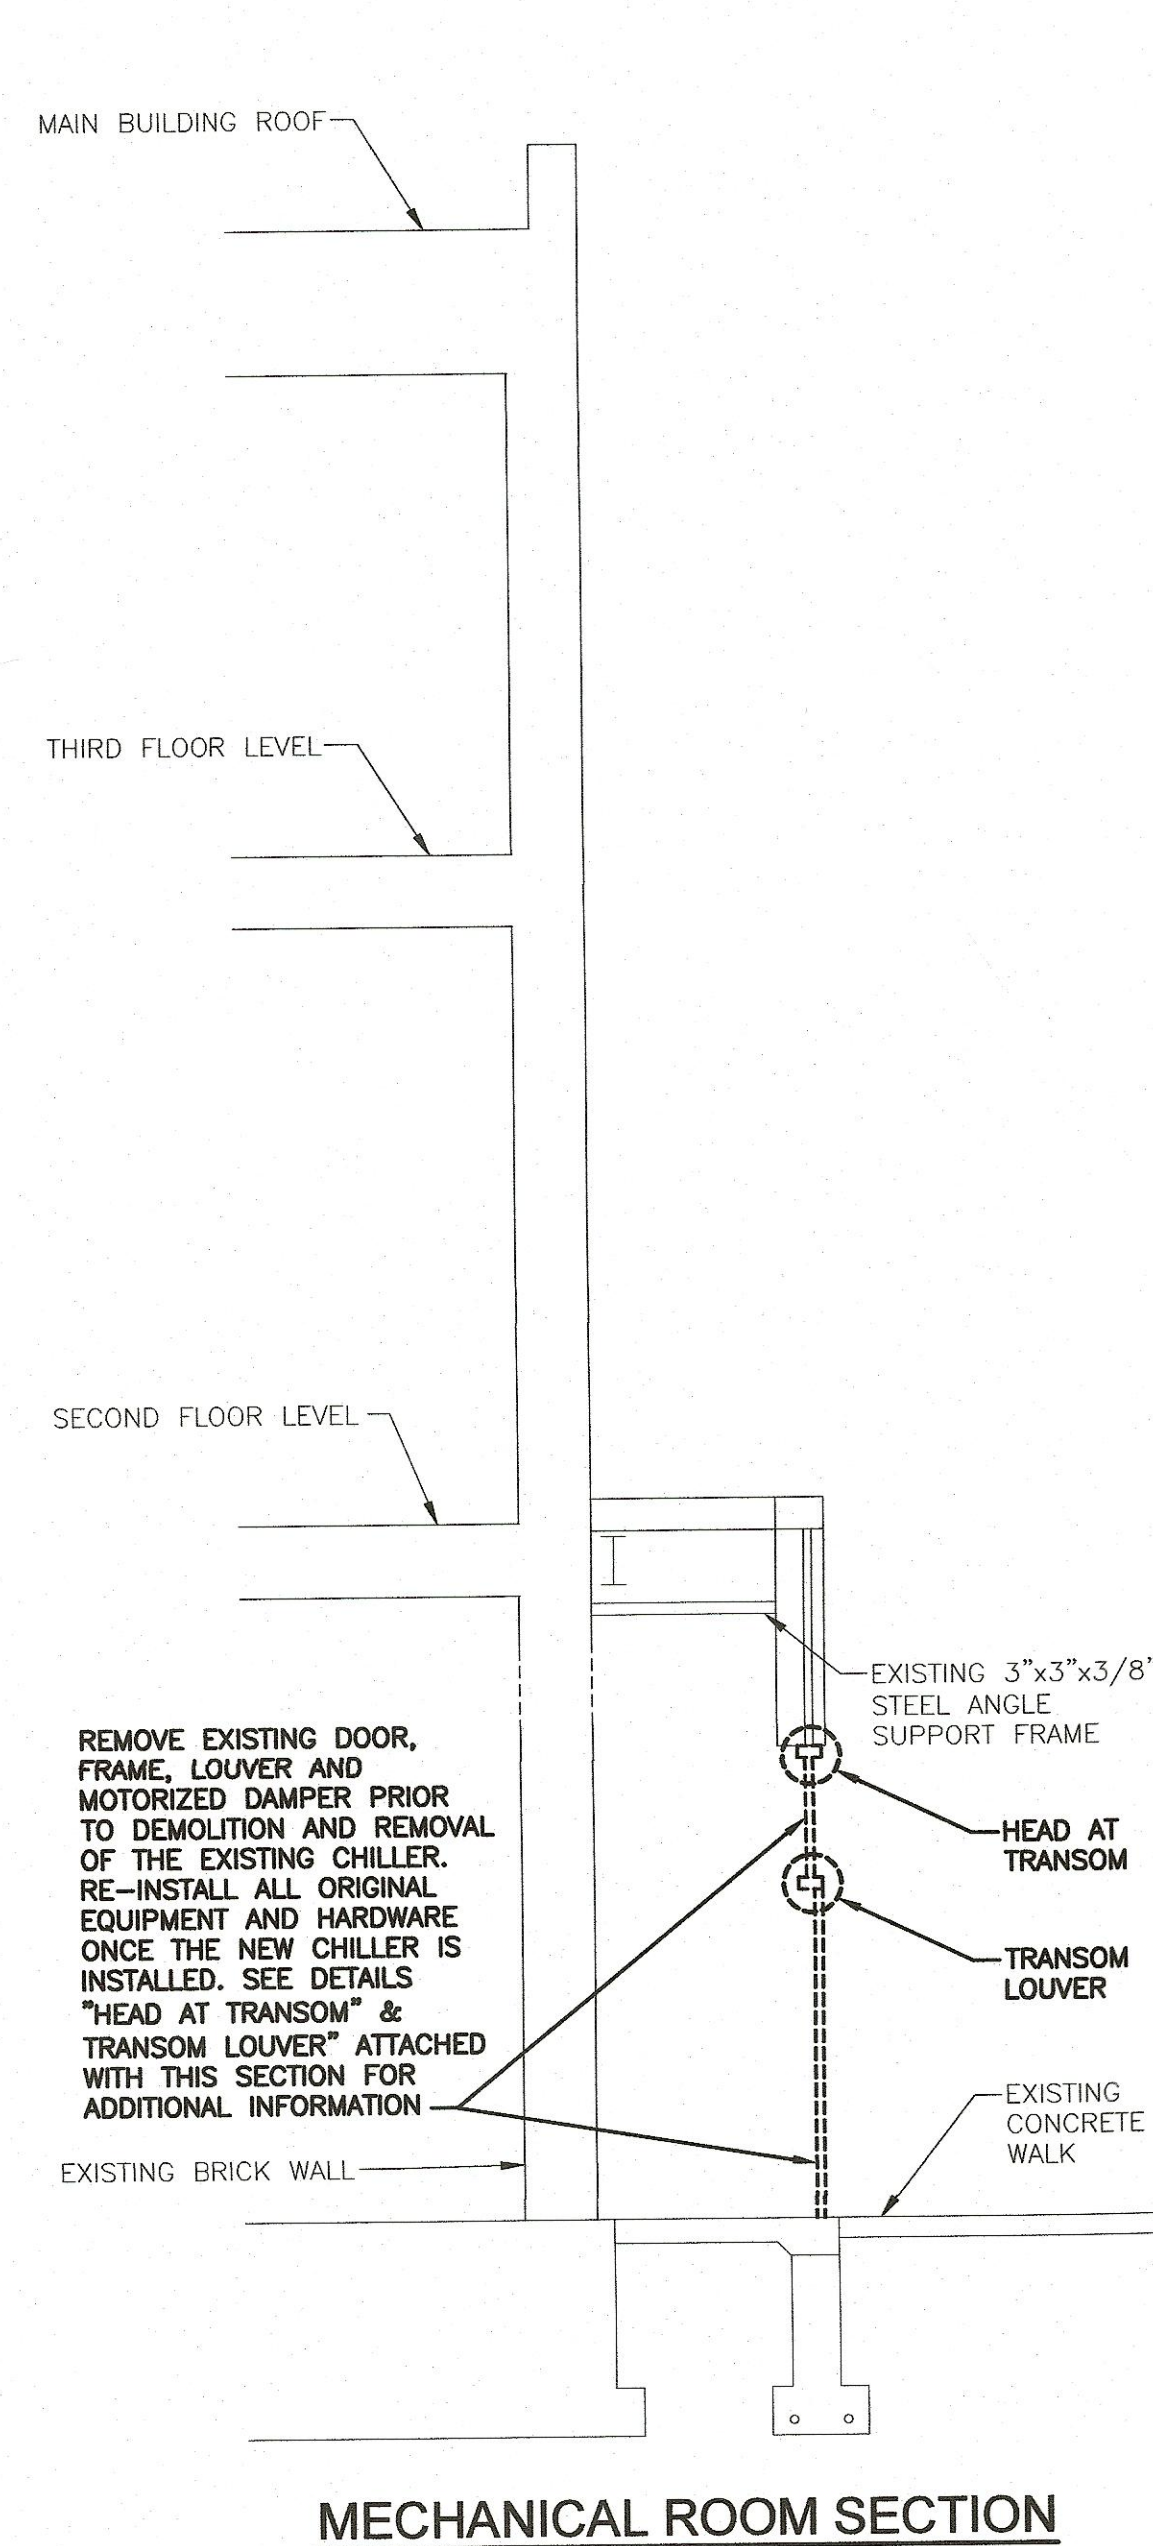
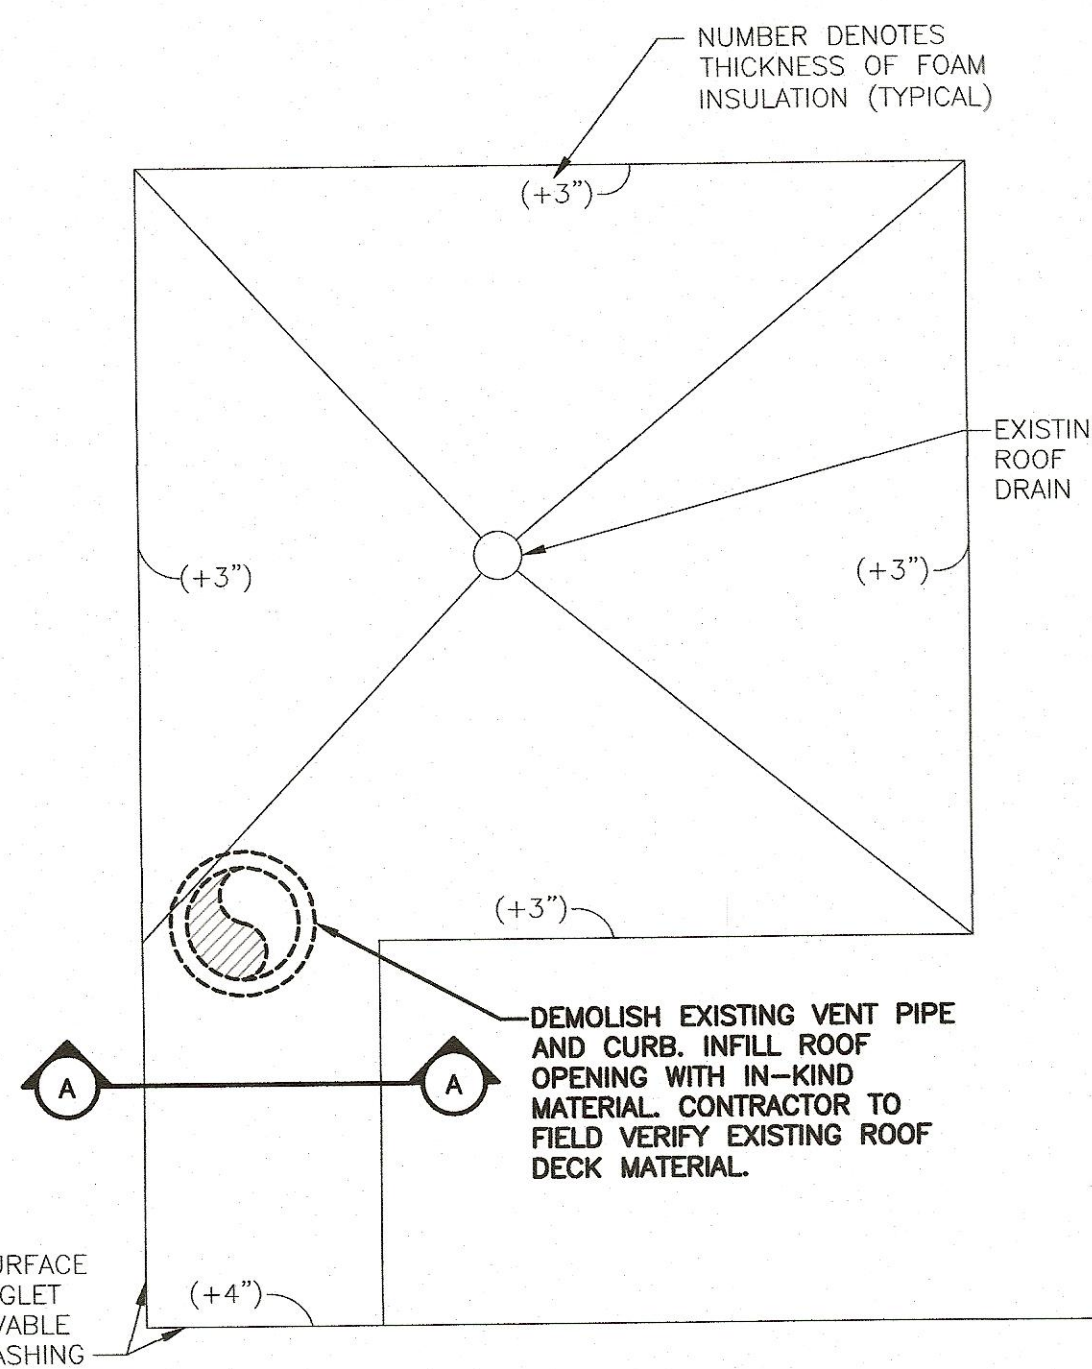
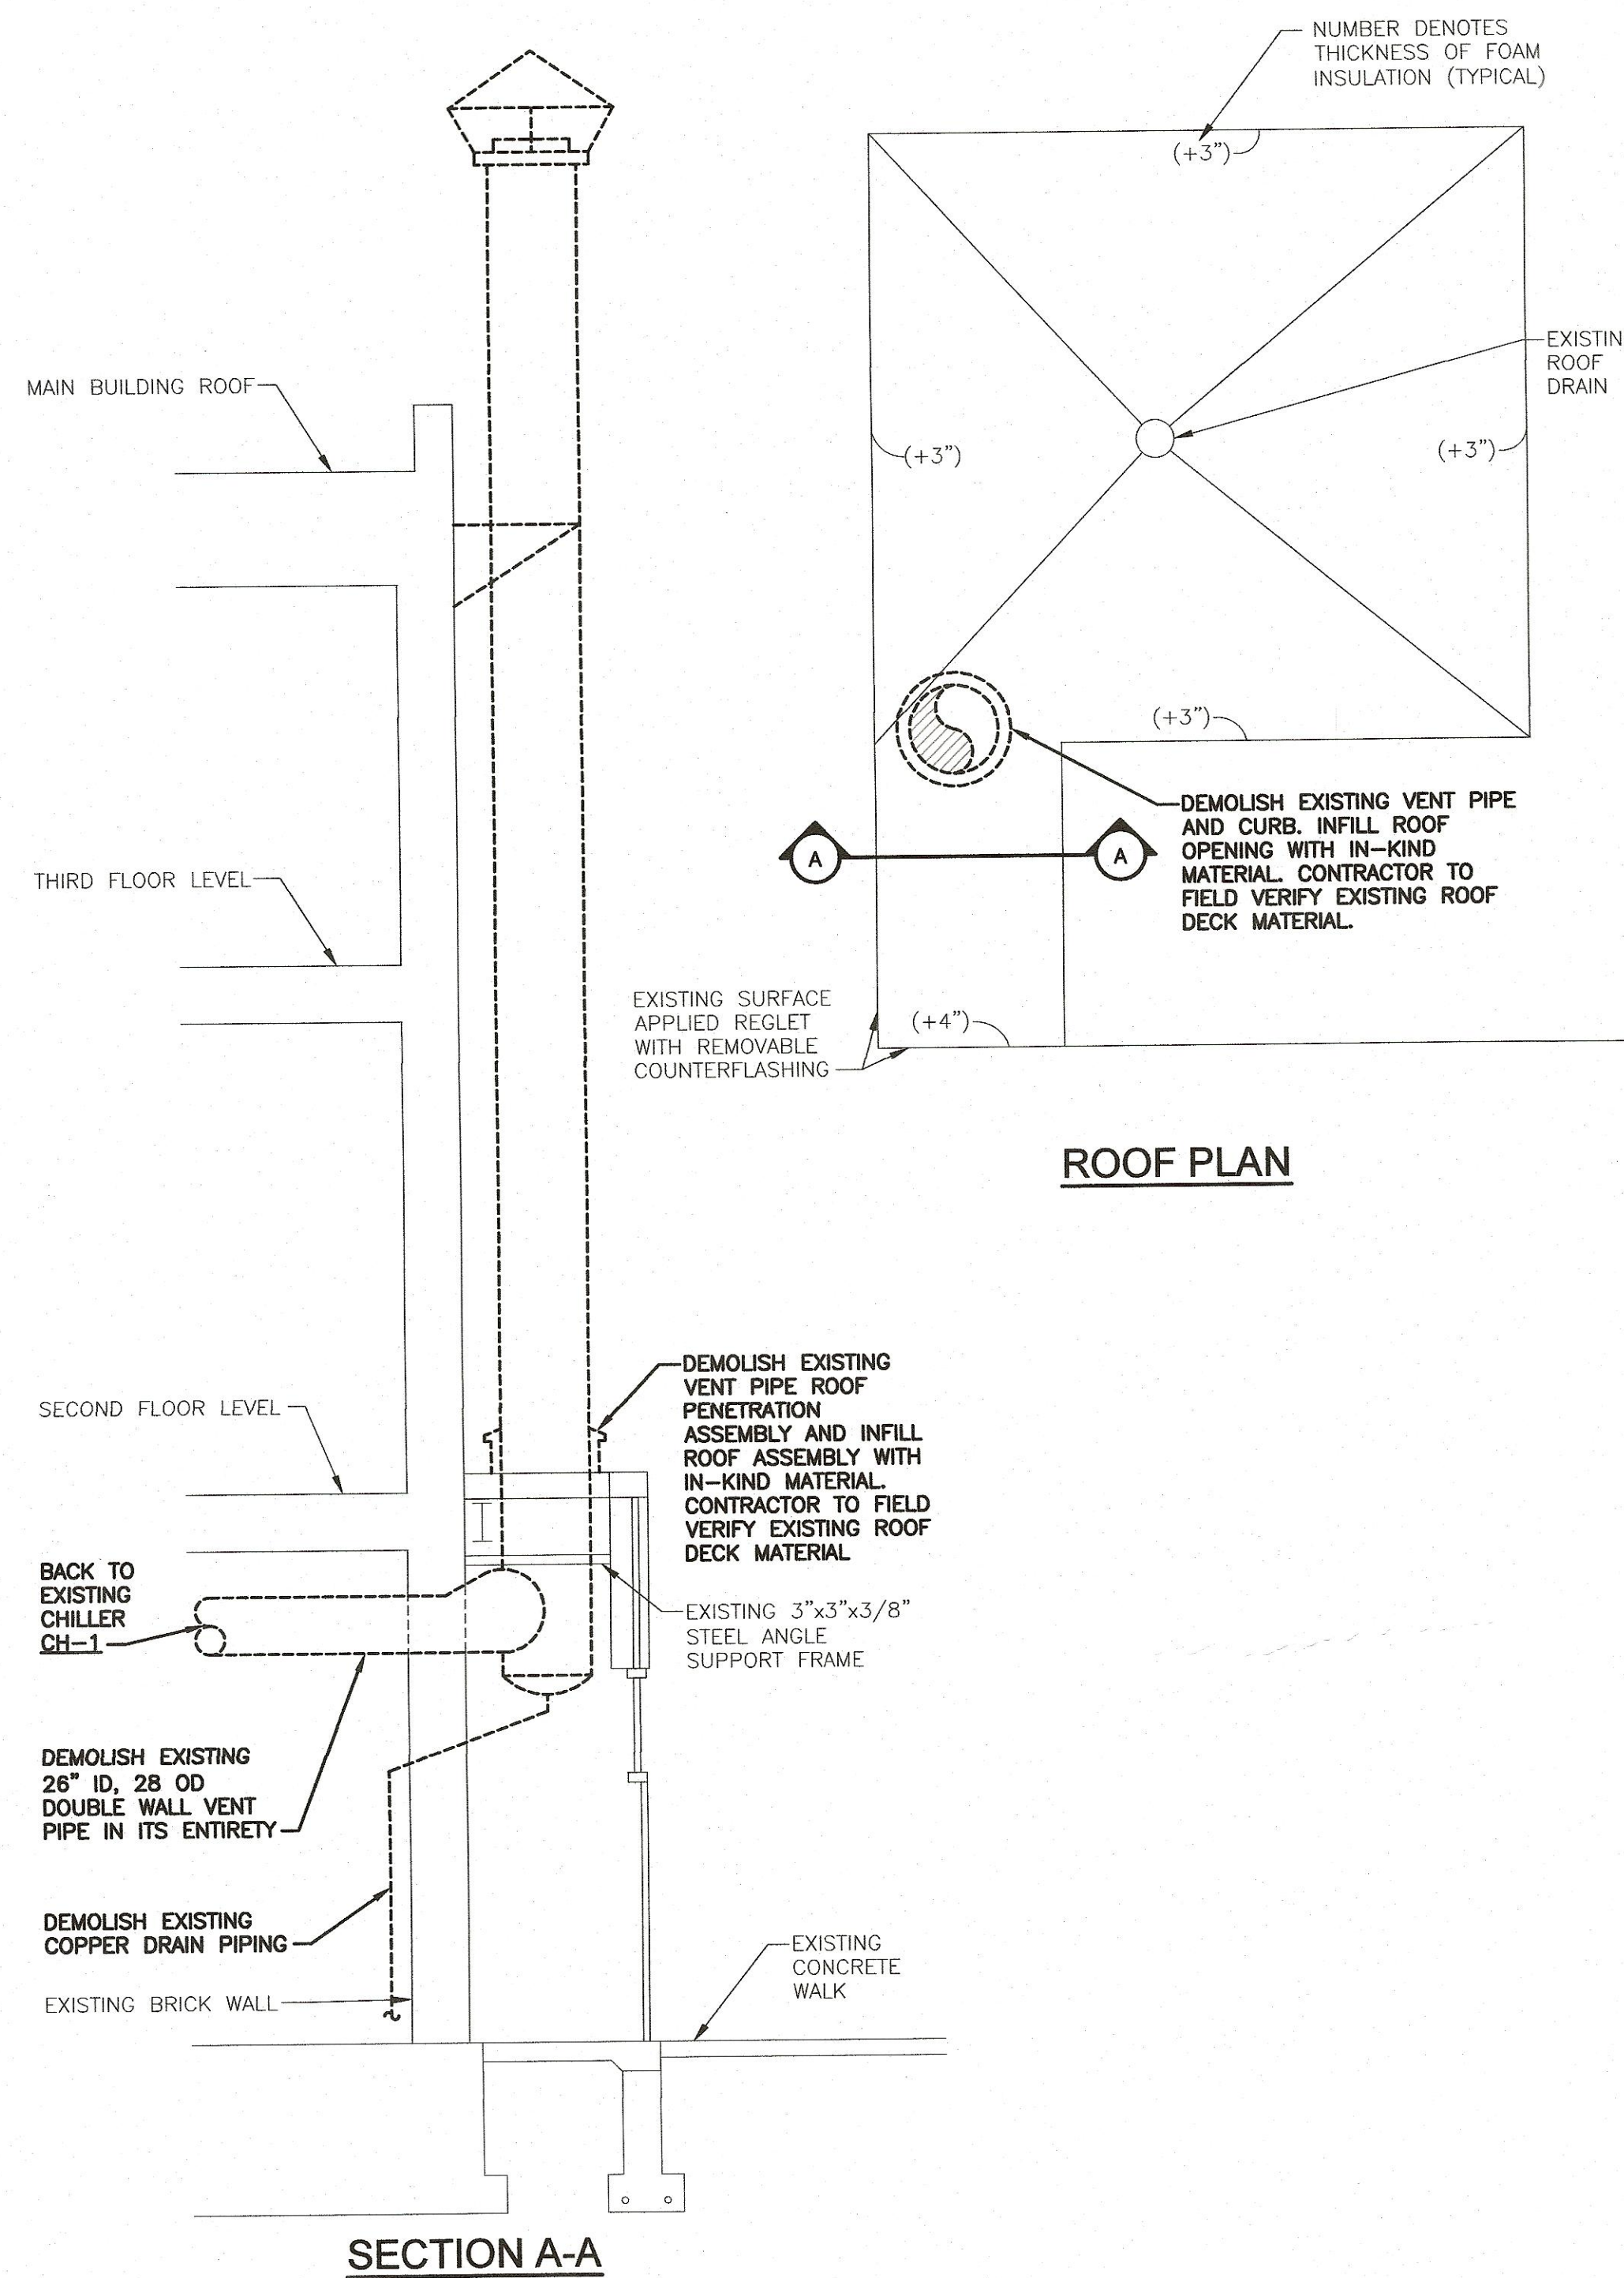
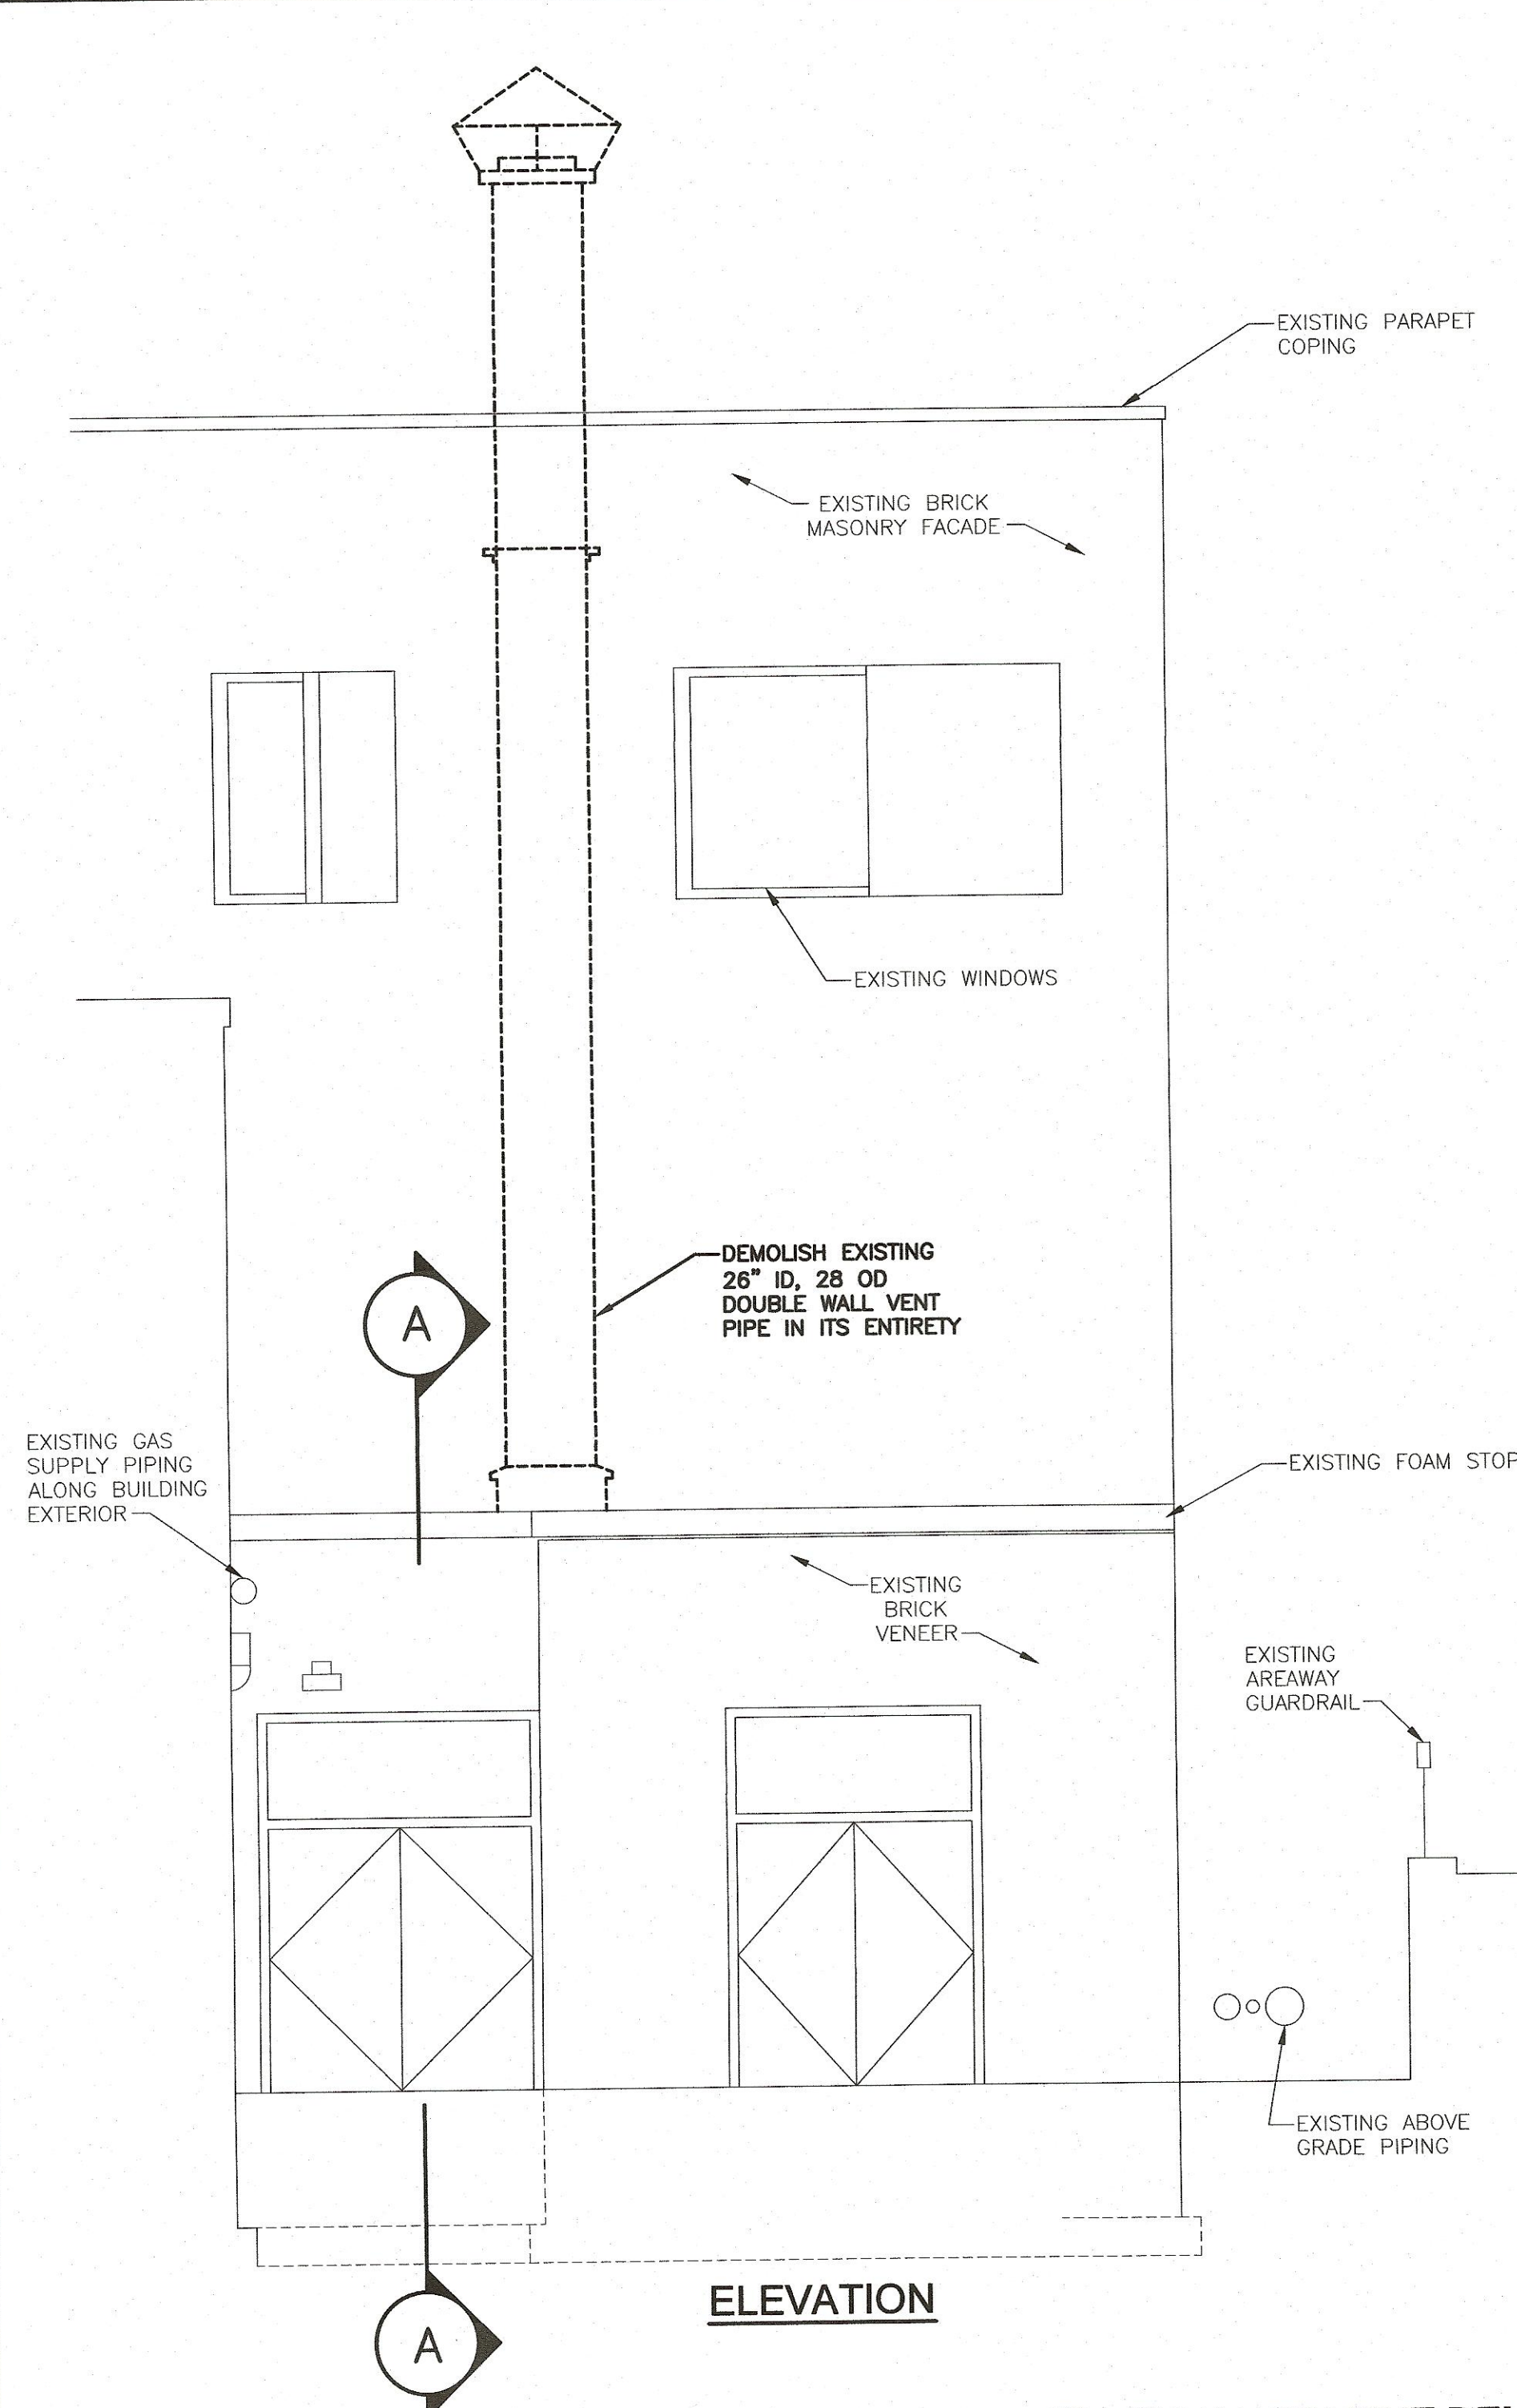
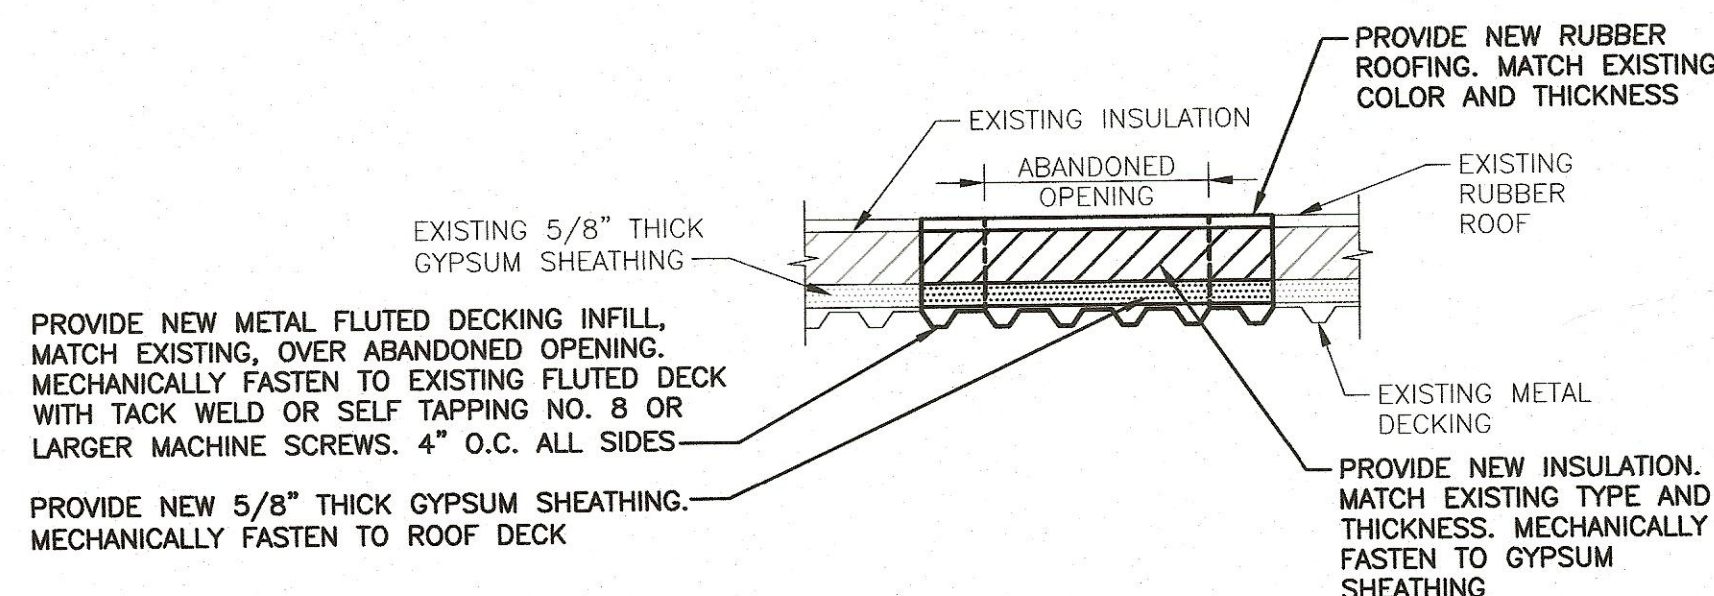


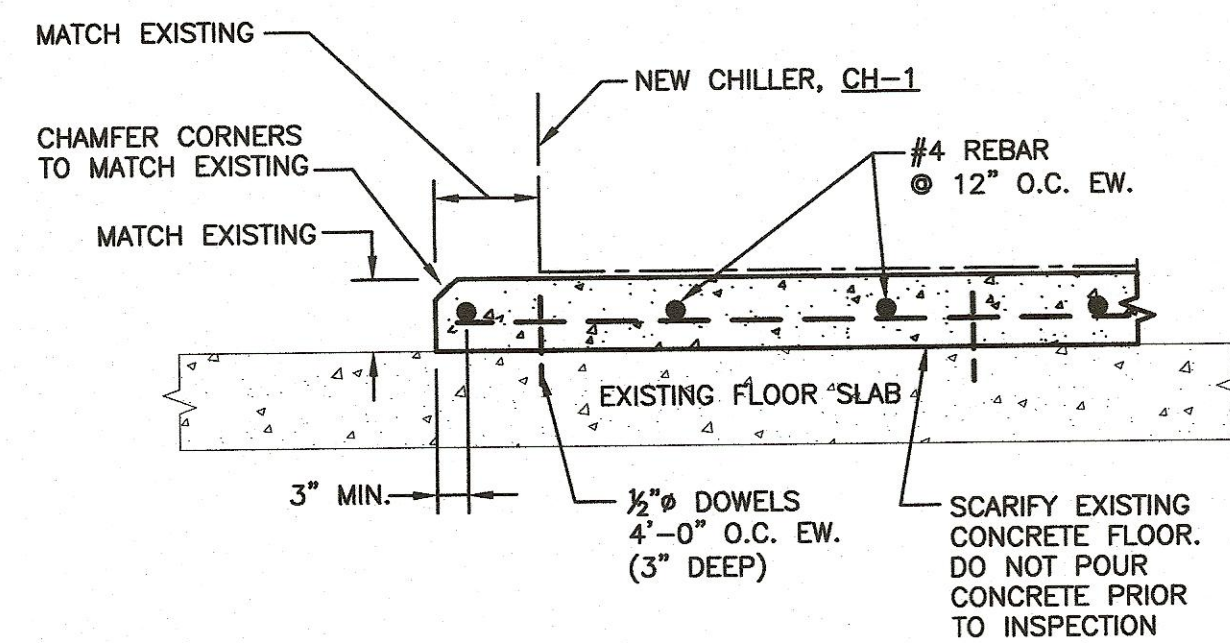

1 EXHAUST VENT DEMOLITION DETAIL
N.T.S.

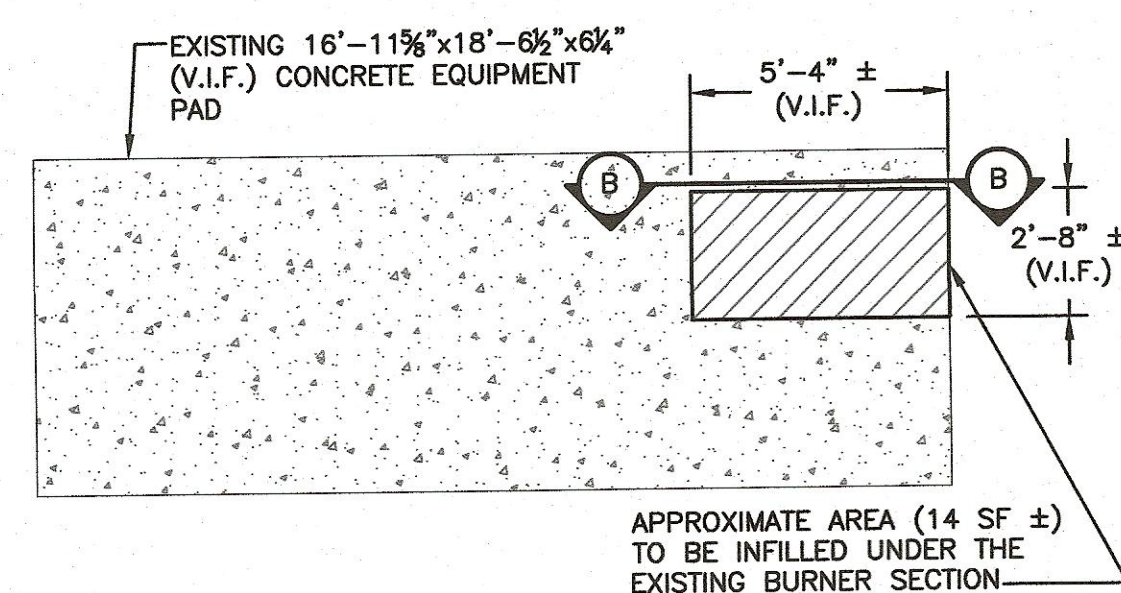

2 MECHANICAL ROOM DOOR REINSTALL DETAIL
N.T.S.

				1	9/2/21	BID
REV #	DATE	REMARKS:	ISSUE #	DATE	ISSUED FOR:	

- GENERAL NOTES:**
- CONTRACTOR TO CONFIRM CHILLER SIZE PRIOR TO CONSTRUCTION.
 - ALL REINFORCING STEEL SHALL BE #4 REBAR GRADE 60.
 - NEW CONCRETE SHALL BE 3,500 PSI @ 28 DAYS.
 - GRIND EXISTING SLAB OF FOREIGN MATERIAL. PREPARE AND PAINT ENTIRE SLAB WITH EPOXY MATERIAL PRIOR TO INSTALLING CHILLER.

3 CONCRETE PAD INFILL DETAIL
SCALE: AS NOTED ABOVE