


WEST COLONNADE — ROOF PLAN
SCALE: 1/8" = 1'-0"

NOTES:


- FOR ADDITIONAL NOTES, ABBREVIATIONS AND SYMBOLS, SEE DRAWING GE-E-01.
- BEFORE ANY LIGHT FIXTURES AND/OR CONTROLS ARE PURCHASED, CONTRACTOR SHALL SUBMIT, FOR APPROVAL BY THE ENGINEER, A COMPLETE SET OF DRAWINGS SHOWING ALL CONTROL COMPONENTS AND WIRING DIAGRAMS.
- FOR ADDITIONAL INFORMATION, SEE LIGHTING FIXTURE SCHEDULE ON DRAWING GE-E-03 AND PANEL SCHEDULE ON DRAWING COL-E-11.
- NEW CABLE AND CONDUIT SHALL BE INSTALLED CONCEALED.
- REFER TO DRAWING COL-E-02 FOR ONE LINE DIAGRAM.
- REFER TO DRAWING COL-E-01 FOR SITE PLAN.
- NUMBER DESIGNATIONS NEXT TO FIXTURES AND/OR CONTROLS INDICATE CIRCUIT NUMBERS ASSOCIATED WITH RELAY PANEL.
- ALL LIGHTING CONTROL COMPONENTS SHALL BE FROM A SINGLE MANUFACTURER, AND MUST BE FROM THE SAME MANUFACTURER AS ALL BUILDINGS WITHIN THE CONTRACT. EQUIPMENT INCLUDES BUT NOT LIMITED TO OCCUPANCY SENSOR, RELAY/POWER PACKS, SWITCHES, RELAY PANELS, PHOTOSENSOR, ETC.
- LIGHTING CONTROLS SELECTED SHALL HAVE THE CAPABILITY TO BE CONNECTED TO A MASTER HEAD-END SYSTEM (FUTURE CONTRACT).
- ALL OUTDOOR LIGHTING SHALL BE POWERED VIA RELAY PANEL WC-RP AS INDICATED ON THE DRAWINGS. RELAY PANEL SHALL BE EQUIPPED WITH BOTH A BUILT-IN TIME CLOCK AND A PHOTOSENSOR CONTROL. EACH RELAY SHALL BE ACUITY BRANDS: ARP-INTENC08NLT-32SR-MVOLT-1VB-HLK-SM-DTC OR APPROVED EQUAL.
- PHOTOCELL SHALL BE SUITABLE FOR OUTDOOR APPLICATIONS AND SHALL BE ACUITY BRANDS: LSA-APS-OL OR APPROVED EQUAL. FINAL LOCATION OF PHOTOCELL SHALL BE DETERMINED DURING CONSTRUCTION BY THE LIGHTING MANUFACTURER.
- SEE DRAWING DT-E-01 FOR WEST COLONNADE WIRING DETAIL.
- ALL LIGHTING SPLICE BOXES SHALL BE NEMA 4X TYPE 316 STAINLESS STEEL.
- CONTRACTOR SHALL INSTALL 2" RIGID GALVANIZED STEEL CONDUITS (WITH INTERNAL PULL ROPE) FOR FUTURE AUDIO USE.
- CONTRACTOR SHALL INSTALL 4-2" RIGID GALVANIZED STEEL CONDUITS WITH INTERNAL PULL ROPE FOR FUTURE USE. TERMINATE BOTH CONDUITS IN A NEMA 4X JUNCTION BOX (STAINLESS STEEL) AT EACH END (TOWER ATTIC LOCATIONS). (SEE KEY NOTE 1).
- INSTALL 1-2" RIGID GALVANIZED STEEL CONDUIT WITH INTEGRAL PULL ROPE FOR FUTURE AUDIO USE.

KEY NOTES:

- ① STUB AND CAP CONDUIT 6" INTO ATTIC SPACE FOR FUTURE USE. PROVIDE WATERTIGHT SEAL FOR ALL CONDUIT PENETRATIONS.

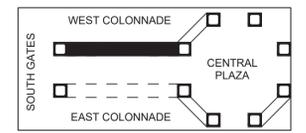

Drawing Name: G:\Savin\Autocad\2060\25-Playland-Mega-2\1\COE-1006.dwg
 Project Name: Comments: All inquiries regarding this drawing(s) or project should be directed to the project engineer.
 Project Code: Comments: All inquiries regarding this drawing(s) or project should be directed to the project engineer.
 Project Code: Comments: All inquiries regarding this drawing(s) or project should be directed to the project engineer.

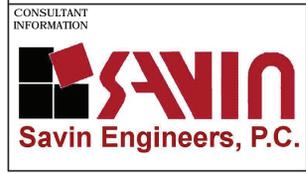


REVISION NUMBER	DATE	MADE BY	APP'D BY	REVISION
1	07/02/2021	RKC	DF	BID ADDENDUM #3

RECORD DRAWING CERTIFICATION			
<input type="checkbox"/> AS BUILT - CHANGES AS NOTED		<input type="checkbox"/> AS BUILT - NO CHANGES	
CONTRACTOR		PROJECT COORDINATOR	
NAME	SIGNATURE	NAME	SIGNATURE
TITLE	DATE	TITLE	DATE

WESTCHESTER COUNTY, NEW YORK
DEPARTMENT OF PUBLIC WORKS AND TRANSPORTATION
DIVISION OF ENGINEERING

**INFRASTRUCTURE REHABILITATION - PHASE 2
PLAYLAND PARK, RYE, NEW YORK
COLONNADE RECONSTRUCTION
WEST COLONNADE ROOF LIGHTING PLAN**


CONTRACT NUMBER 20-530	SHEET NUMBER AD-COL-E-05
DWG No.: Page 67 of 290	
SCALE: AS SHOWN	
DATE: MAY 26, 2021	
DPW FILE NUMBER 1-118-E-454	REV. NO. 0

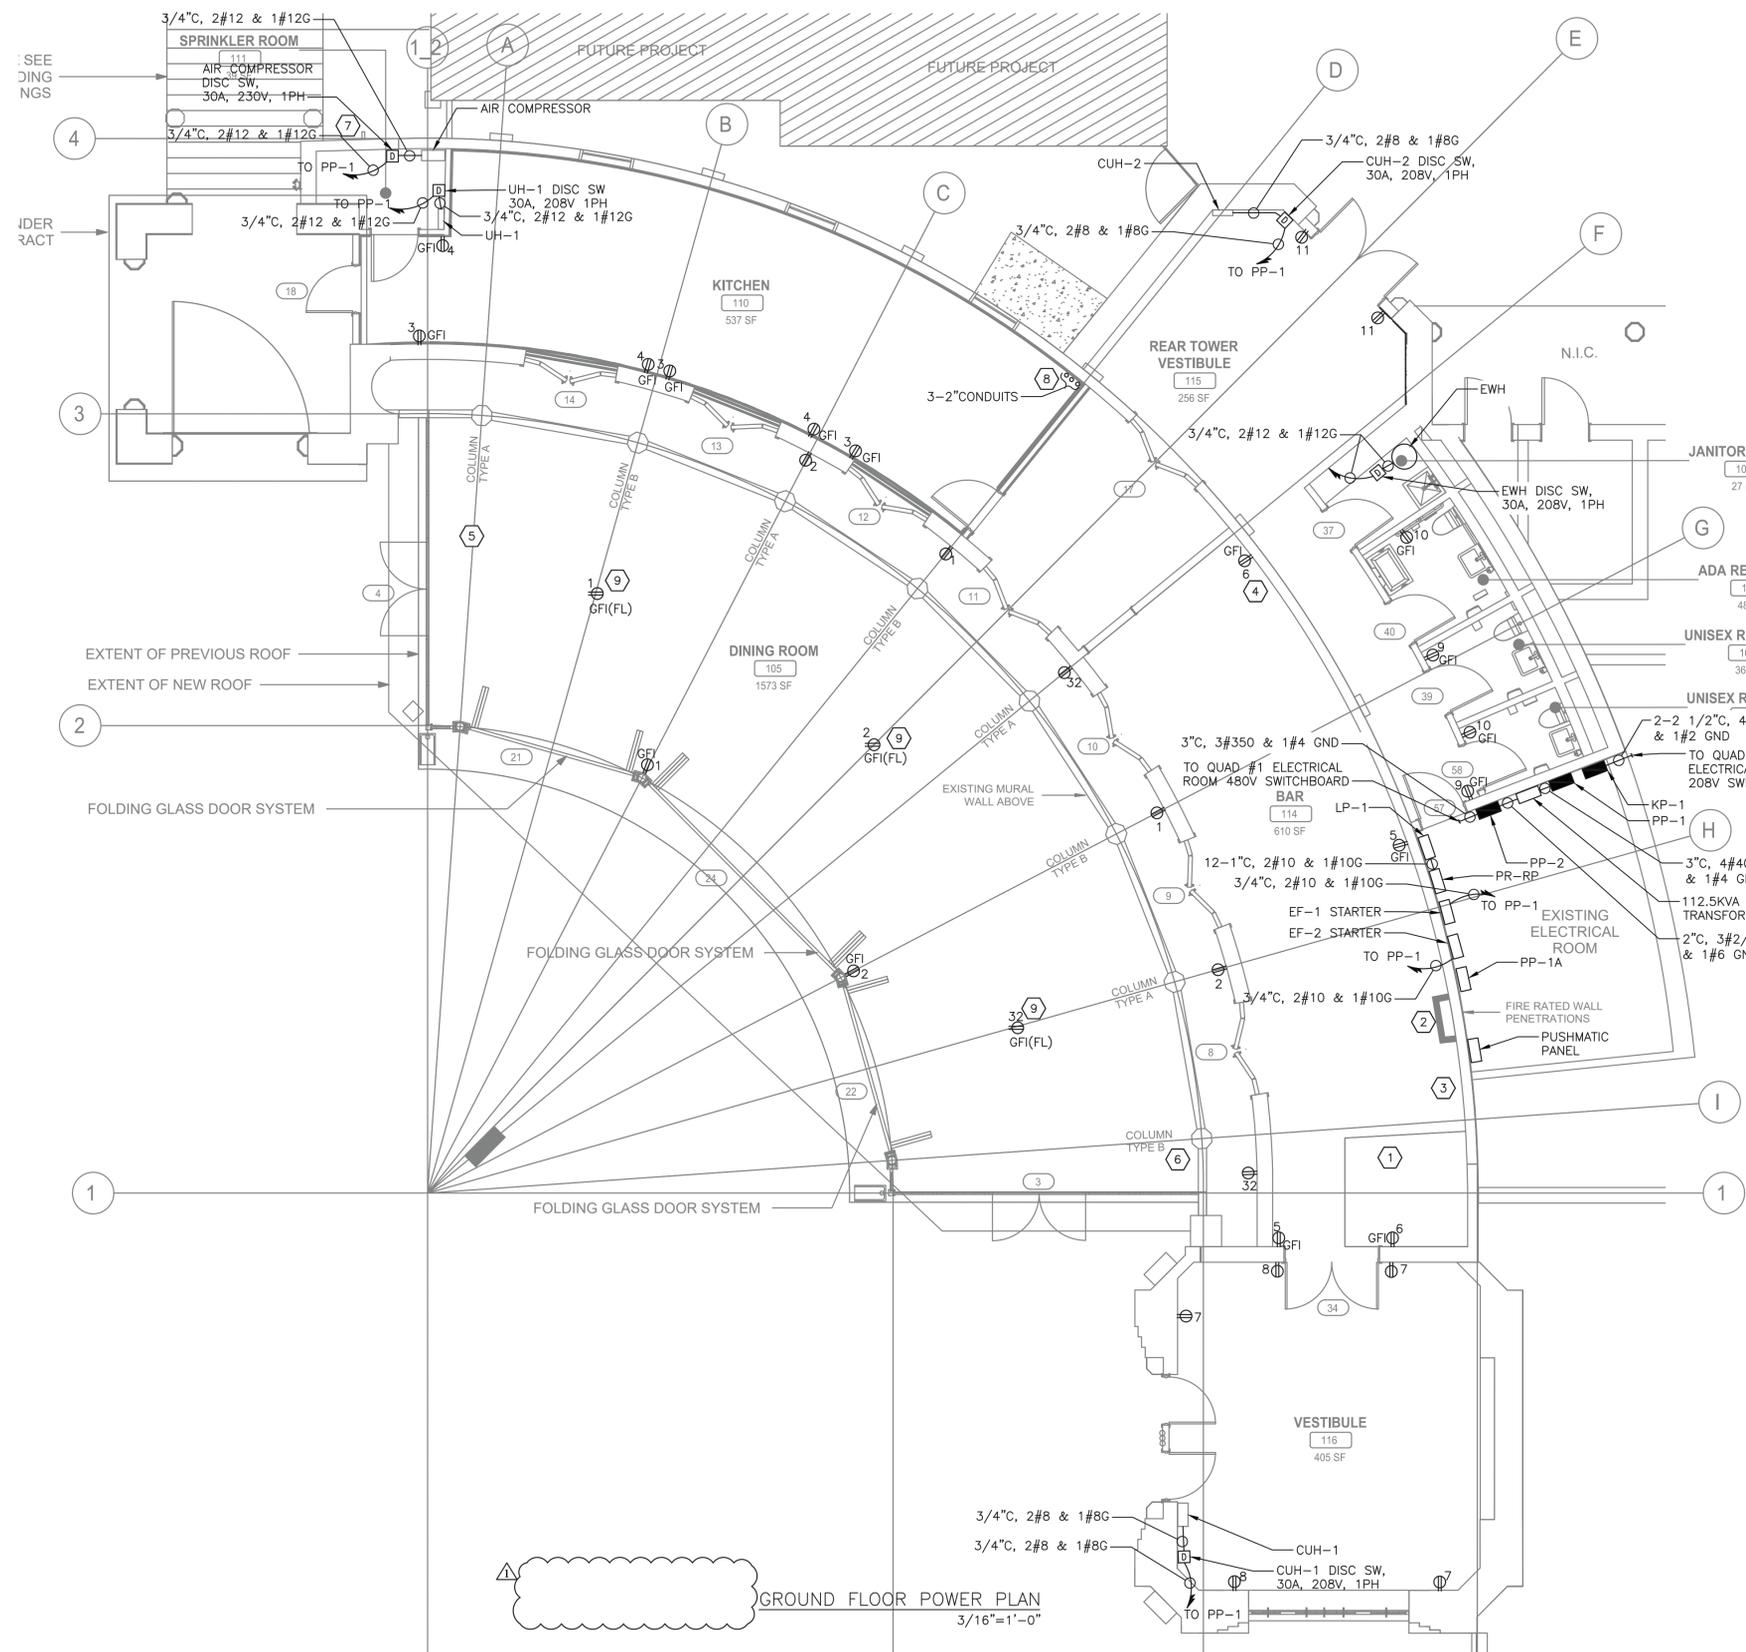

- NOTES:**
- FOR ADDITIONAL NOTES, ABBREVIATIONS AND SYMBOLS, SEE DRAWING GE-E-01.
 - ALL RECEPTACLES DESIGNATORS ARE POWERED VIA PANEL PP-1, UNLESS OTHERWISE NOTED.
 - ALL CIRCUITS SHOWN ON THE DRAWING BUT NOT SPECIFICALLY CALLED OUT ON THE CABLE AND CONDUIT SCHEDULE SHALL BE 3/4" CONDUIT 2#12, 1#12G AWG.
 - ALL HVAC LOW VOLTAGE WIRING SHALL BE PERFORMED BY THE HVAC CONTRACTOR, INCLUDING BUT NOT LIMITED TO LOW VOLTAGE THERMOSTAT WIRING.
 - EXHAUST FAN STARTERS SHALL BE FURNISHED BY THE EXHAUST FAN MANUFACTURER. FOR EXHAUST FAN STARTER REQUIREMENTS, SEE HVAC CONTRACT DRAWINGS AND SPECIFICATIONS.
 - DISCONNECT SWITCHES OUTDOORS, IN RESTROOMS AND/OR IN JANITORS CLOSETS SHALL BE IN A NEMA 3R ENCLOSURE.
 - FOR PANEL SCHEDULE, SEE DRAWINGS PR-E-11 AND PR-E-12.

- KEY NOTES:**
- CONTRACTOR SHALL SPLICE AND EXTEND THE CIRCUITS FROM EXISTING DEC LIGHTING PANEL TO LP-1 LIGHTING PANEL LOCATED IN EXISTING ELECTRICAL ROOM. ASSUME 8-3/4" WITH 2#10 AND 1#10 GND EACH. FOR MORE INFORMATION, SEE PANEL SCHEDULE LP-1 ON DRAWING PR-E-12.
 - FOR ASTHETICS ALL CONDUIT EXITING THE ELECTRICAL ROOM SHALL BE INSTALLED IN THE SHADE (SEE ARCHITECTURAL DRAWINGS FOR DETAILS).
 - CONTRACTOR SHALL SPLICE AND EXTEND THE CIRCUITS FROM KITCHEN PANEL 2 TO PP-1A PANEL LOCATED IN EXISTING ELECTRICAL ROOM. ASSUME 6-3/4" WITH 2#10 AND 1#10 GND EACH. FOR MORE INFORMATION, SEE PANEL SCHEDULE PP-1A ON PR-E-11.
 - CONTRACTOR SHALL SPLICE AND EXTEND THE CIRCUITS FROM EXISTING KITCHEN PANEL 1 TO PP-1A PANEL LOCATED IN EXISTING ELECTRICAL ROOM. ASSUME 16-3/4" WITH 2#10 AND 1#10 GND EACH. FOR MORE INFORMATION, SEE PANEL SCHEDULE PP-1A ON PR-E-11.
 - CONTRACTOR SHALL SPLICE AND EXTEND THE CIRCUITS FROM EXISTING TICKET BOOTH PANEL TO PP-1A PANEL LOCATED IN EXISTING ELECTRICAL ROOM. ASSUME 5-3/4" WITH 2#10 AND 1#10 GND EACH. FOR MORE INFORMATION, SEE PANEL SCHEDULE PP-1A ON PR-E-11.
 - CONTRACTOR SHALL RELOCATE THE EXISTING PUSHMATIC PANEL TO EXISTING ELECTRICAL ROOM. SPLICE AND EXTEND EXISTING BRANCH CIRCUITRY AS REQUIRED. NEW POWER SHALL BE FROM PANEL PP-1A, ASSUME 1 1/2", 3#2 & 1#6G.
 - EXISTING COMMUNICATION BOX SHALL REMAIN OPERATIONAL DURING CONSTRUCTION. CONTRACTOR SHALL PROTECT AND SUPPORT EXISTING DEVICE AND ASSOCIATED CABLE AND CONDUIT DURING CONSTRUCTION.
 - PROVIDE CONDUIT WITH PULL ROPE FOR FUTURE USE. CONDUIT SHALL RUN IN FLOOR SLAB TO NEW ELECTRICAL ROOM. STUB AND CAP CONDUIT 6" AFF. CONDUIT SHALL TERMINATE IN PANEL PP-1.
 - CONTRACTOR SHALL PROVIDE FLUSH MOUNTED ELECTRICAL FLOOR BOXES FOR RECEPTACLES. INSTALL ALL CONDUIT IN FLOOR SLAB.

GROUND FLOOR POWER PLAN
3/16"=1'-0"



Drawing Name: C:\Savin\Autocad\2060\25-Playland-Mega-2\PRE-1001.dwg
 Created by: RKC Date: 07/02/2021 10:40 AM
 Printed by: RKC Date: 07/02/2021 10:40 AM
 Xrefs: [IB-2403E_Weathestatco_3.dwg] [ISG-SU020.dwg] [PR-A-11.dwg] [PR-E-1001.dwg]

CONSULTANT INFORMATION

Savin Engineers, P.C.

CONSULTANT SEAL

REVISION NUMBER	DATE	MADE BY	APP'D BY	REVISION
1	07/02/2021	RKC	DF	BID ADDENDUM #3

RECORD DRAWING CERTIFICATION


AS BUILT - CHANGES AS NOTED AS BUILT - NO CHANGES

CONTRACTOR		PROJECT COORDINATOR	
NAME	SIGNATURE	NAME	SIGNATURE
TITLE	DATE	TITLE	DATE

WESTCHESTER COUNTY, NEW YORK
DEPARTMENT OF PUBLIC WORKS AND TRANSPORTATION
DIVISION OF ENGINEERING

**INFRASTRUCTURE REHABILITATION - PHASE 2
PLAYLAND PARK, RYE, NEW YORK
PLAZA RESTAURANT
GROUND FLOOR POWER PLAN**

CONTRACT NUMBER 20-530	SHEET NUMBER AD-PR-E-07
DWG NO.: Page 162 of 290	
SCALE: AS SHOWN	
DATE: MAY 26, 2021	
DPW FILE NUMBER 1-118-E-549	REV. NO. 0

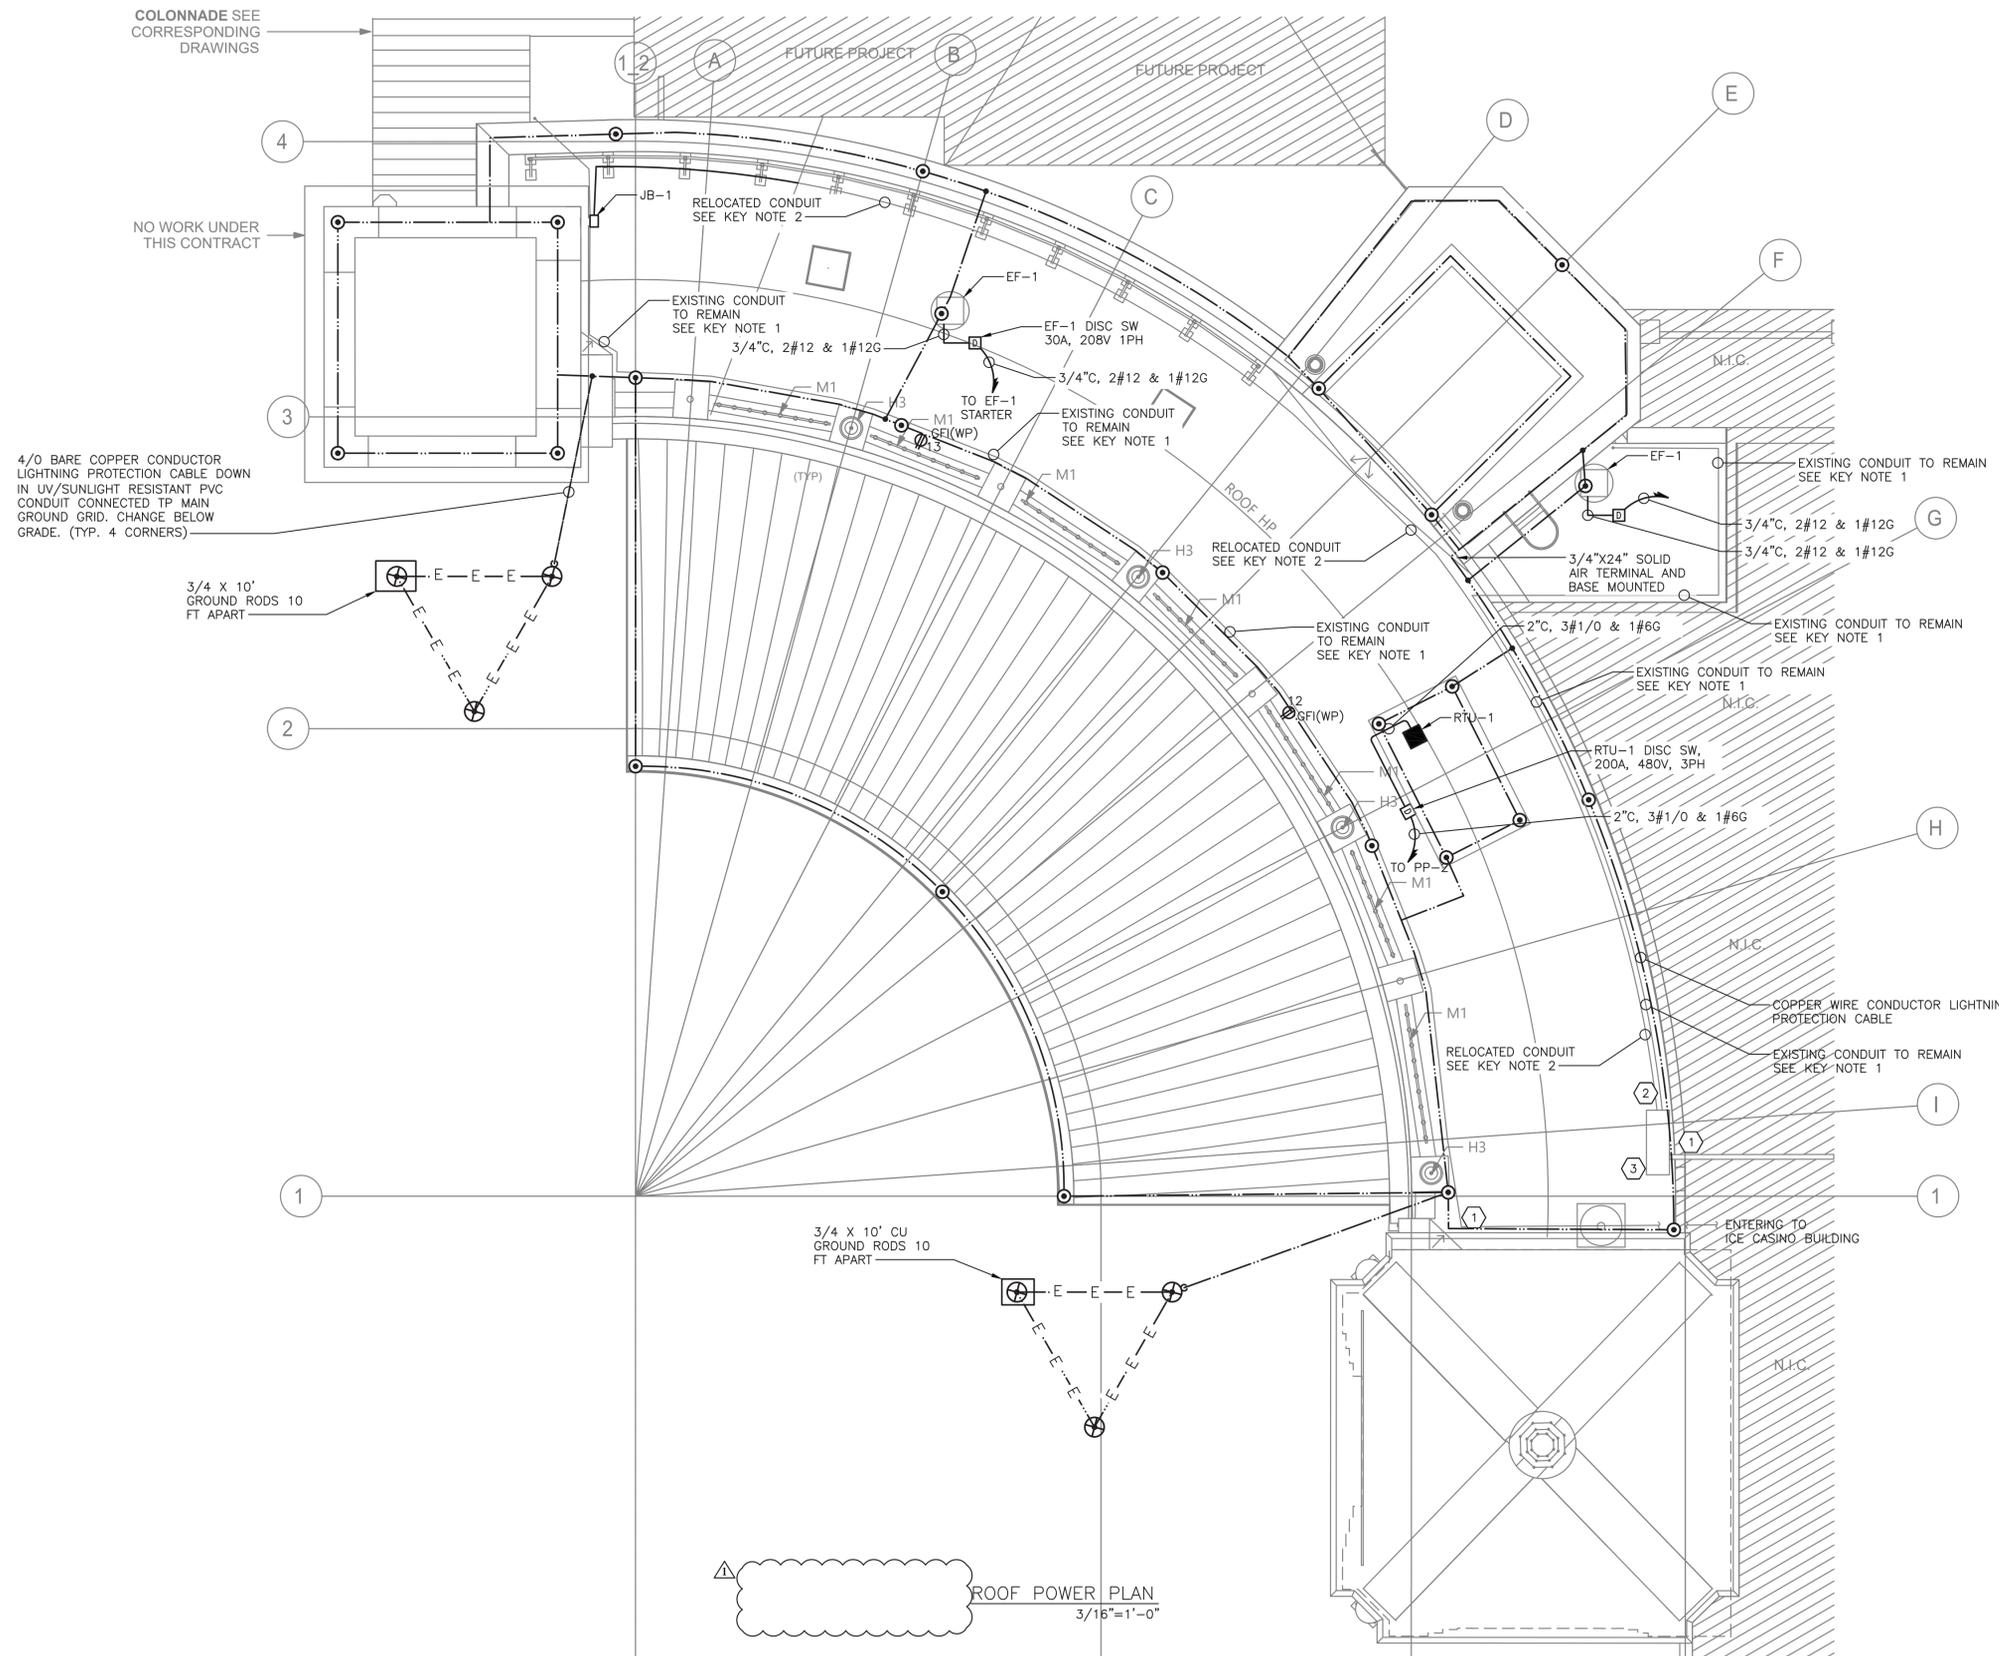


- NOTES:**
- FOR ADDITIONAL NOTES, ABBREVIATIONS AND SYMBOLS, SEE DRAWING GE-E-01.
 - LIGHTNING PROTECTION SYSTEM SHALL BE DESIGNED BY A CERTIFIED LIGHTNING PROTECTION SYSTEM DESIGNER/INSTALLER. DRAWINGS ARE PROVIDED FOR BIDDING PURPOSES ONLY.
 - CONTRACTOR SHALL PROVIDE UL96A MASTER LABEL FOR ENTIRE LPS SYSTEM.
 - ALL CONDUITS SHOWN ON DRAWINGS ARE SHOWN DIAGRAMMATICALLY. CONTRACTOR SHALL FINALIZE ROUTING IN THE FIELD.
 - ALL RECEPTACLES SHALL HOMERUN TO PANEL PP-1, UNLESS OTHERWISE NOTED.
 - ALL HVAC LOW VOLTAGE WIRING SHALL BE PERFORMED BY THE HVAC CONTRACTOR, INCLUDING BUT NOT LIMITED TO LOW VOLTAGE THERMOSTATIC WIRING.
 - ALL CIRCUITS SHOWN ON THE DRAWING BUT NOT SPECIFICALLY CALLED OUT ON THE CABLE & CONDUIT SCHEDULE SHALL BE 3/4" CONDUIT WITH 2#12 & 1#12G AWG. CIRCUITS SHALL INCLUDE BUT ARE NOT LIMITED TO RECEPTACLES.
 - EXHAUST FAN STARTERS SHALL BE FURNISHED BY THE EXHAUST FAN MANUFACTURER. FOR EXHAUST FAN STARTER REQUIREMENTS, SEE HVAC CONTRACT DRAWINGS AND SPECIFICATIONS.
 - DISCONNECT SWITCHES OUTDOORS, IN RESTROOMS AND/OR IN JANITORS CLOSETS SHALL BE IN A NEMA 3R ENCLOSURE.
 - FOR PANEL SCHEDULE, SEE DRAWINGS PR-E-11 AND PR-E-12.

- KEY NOTES:**
- 1 EXISTING CONDUIT TO REMAIN. CONTRACTOR SHALL TEMPORARILY SUPPORT THE CONDUIT DURING CONSTRUCTION AND REINSTALL WHEN THE ROOF WORK IS DONE. ASSUME 1" CONDUIT WITH 3#10 AND 1#10 GROUND.
 - 2 RELOCATED CONDUIT.
 - 3 RELOCATED PULL BOX

ROOF POWER PLAN
3/16" = 1'-0"



Drawing Name: C:\Savin\Autocad\2060\25-Playland-Mega-2\PRE-1002.dwg
 Created: 07/02/2021 10:40 AM
 Printed: 07/02/2021 10:40 AM
 Xrefs: [B_2403E_Weathestatco_3.dwg] [SG-SU000.dwg] [PR-A-13.dwg] [PR-E-1002.dwg]

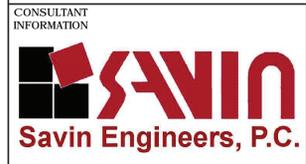


REVISION NUMBER	DATE	MADE BY	APP'D BY	REVISION
1	07/02/2021	RKC	DF	BID ADDENDUM #3

RECORD DRAWING CERTIFICATION			
<input type="checkbox"/> AS BUILT - CHANGES AS NOTED	<input type="checkbox"/> AS BUILT - NO CHANGES		
CONTRACTOR		PROJECT COORDINATOR	
NAME	SIGNATURE	NAME	SIGNATURE
TITLE	DATE	TITLE	DATE


WESTCHESTER COUNTY, NEW YORK
 DEPARTMENT OF PUBLIC WORKS AND TRANSPORTATION
 DIVISION OF ENGINEERING
INFRASTRUCTURE REHABILITATION - PHASE 2
PLAYLAND PARK, RYE, NEW YORK
PLAZA RESTAURANT
ROOF POWER PLAN

CONTRACT NUMBER 20-530	SHEET NUMBER AD-PR-E-08
DWG No.: Page 163 of 290	
SCALE: AS SHOWN	
DATE: MAY 26, 2021	
DPW FILE NUMBER 1-118-E-550	REV. NO. 0

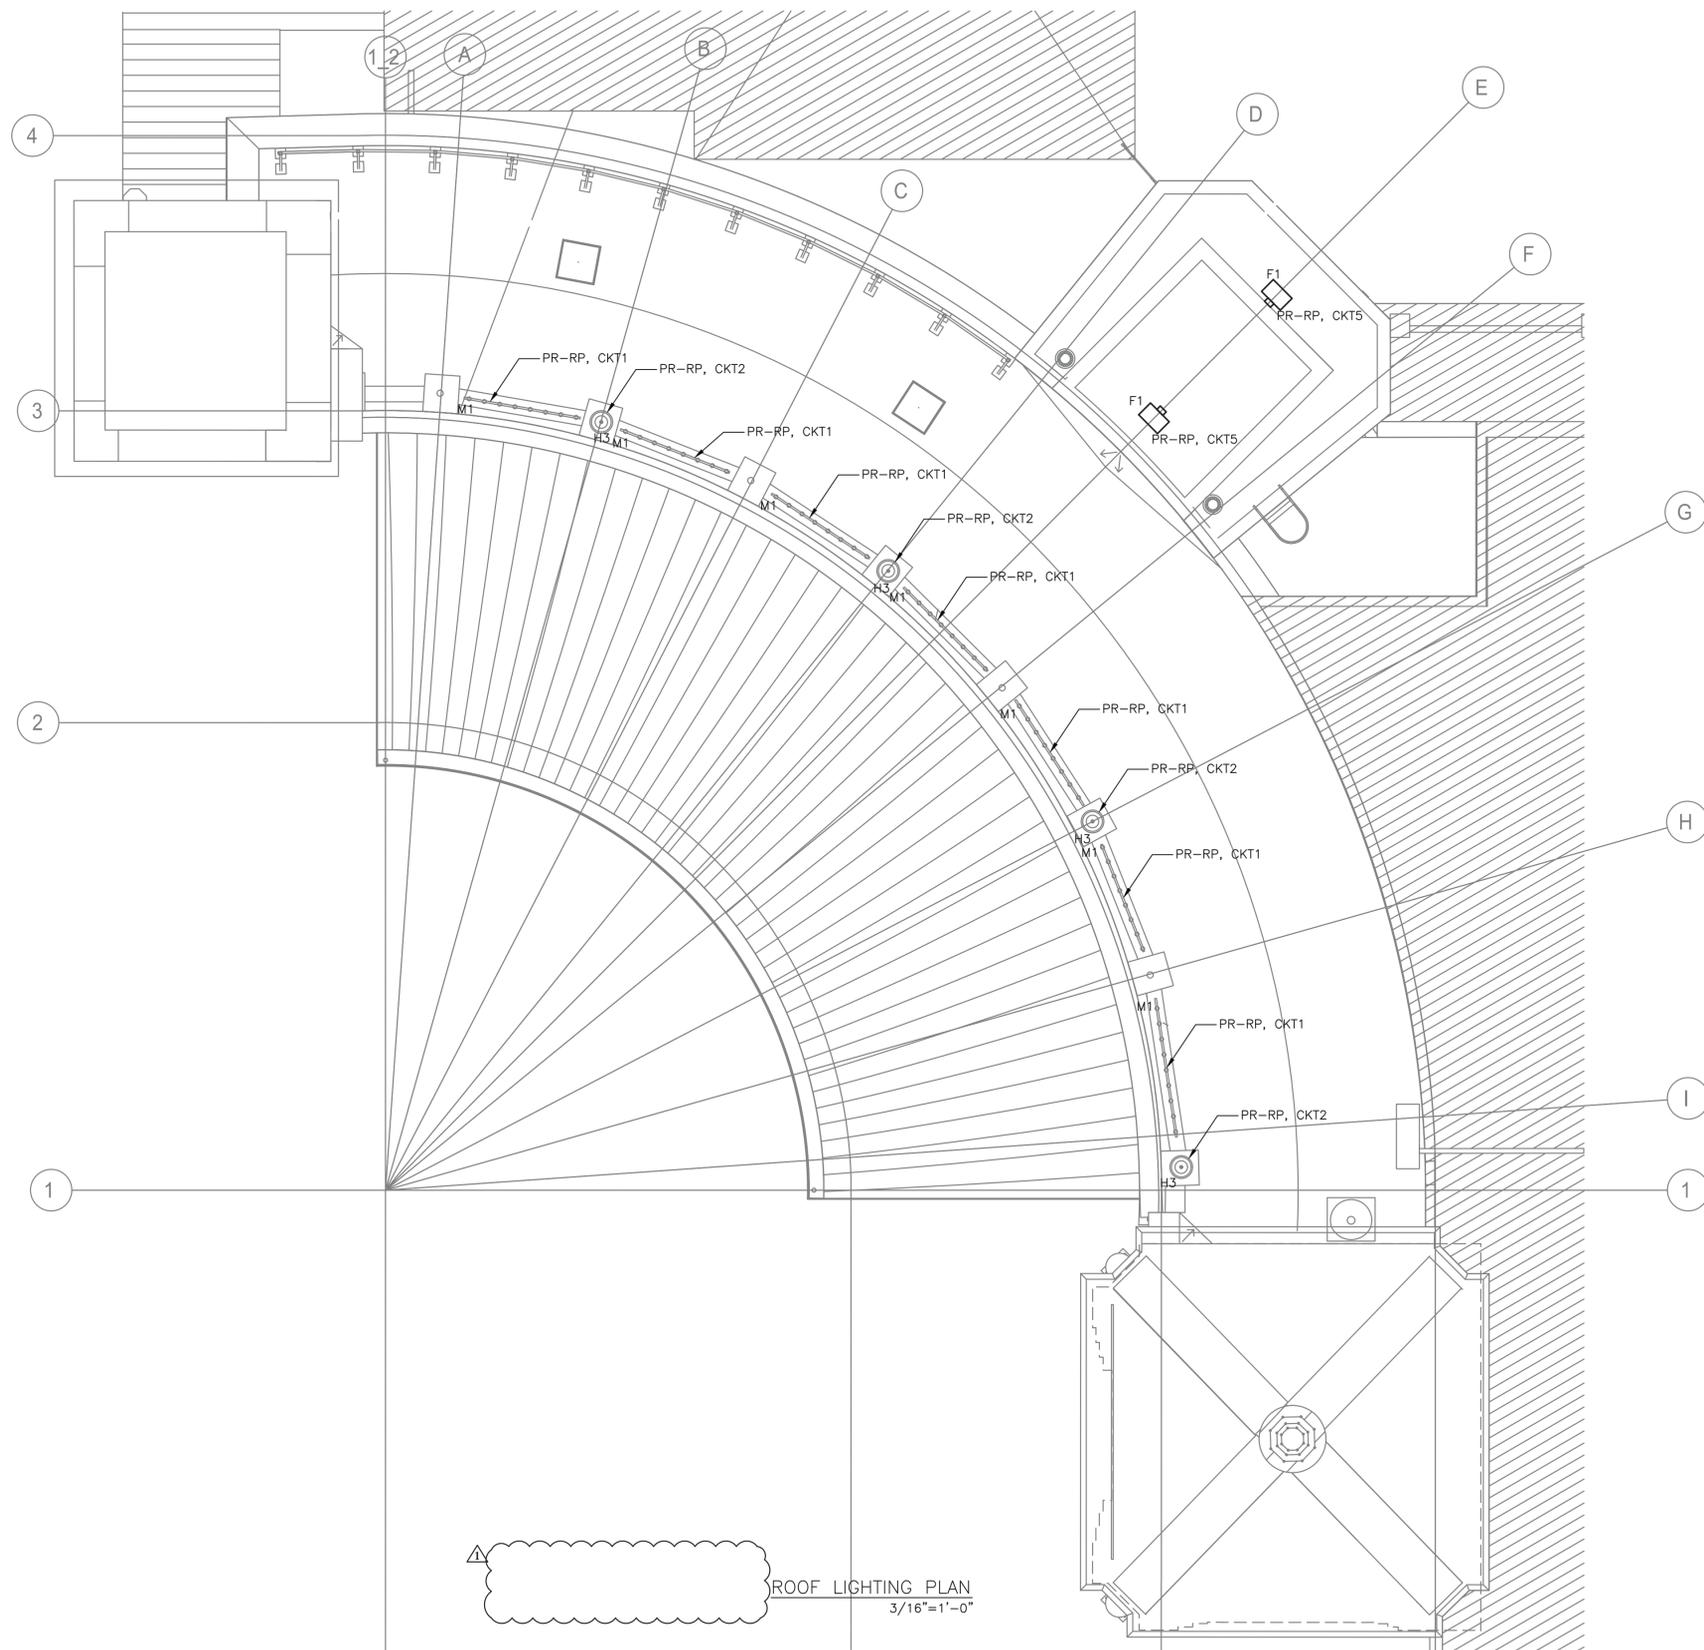


- NOTES:**
1. FOR ADDITIONAL NOTES, ABBREVIATIONS AND SYMBOLS, SEE DRAWING GE-E-01.
 2. ALL EXTERIOR LIGHTING SHALL BE CIRCUITED TO RELAY PANEL PR-RP. CONTRACTOR SHALL CIRCUIT LIGHTING FIXTURES WITH 3/4" CONDUIT, WITH 2#10 & 1#10G AWG, UNLESS NOTED OTHERWISE. CONTRACTOR SHALL DAISY-CHAIN ALL EXTERIOR LIGHT FIXTURES WITH SAME CIRCUIT NUMBER BACK TO LIGHTING PANEL PR-RP.
 3. FOR ADDITIONAL INFORMATION, SEE LIGHTING FIXTURE SCHEDULE ON DRAWING GE-E-03 AND PANEL SCHEDULE ON DWG PR-E-12.
 4. ALL OUTDOOR LIGHTING SHALL BE POWERED VIA RELAY PANEL PR-RP AS INDICATED ON THE DRAWINGS. RELAY PANEL SHALL BE EQUIPPED WITH BOTH A BUILT-IN TIME CLOCK AND A PHOTOSENSOR CONTROL. EACH RELAY SHALL BE ACUITY BRANDS: ARP-INTENCO8NLT-16SR-MVOLT-1VB-HLK-SM-DTC-OR APPROVED EQUAL.

ROOF LIGHTING PLAN
3/16"=1'-0"



Drawing Name: C:\Savin\Autocad\2060\25-Playland-Mega-2\PRE-1004.dwg
 Created: 2 July 2021 10:40 AM
 Printed by: BKilille Date: 2 July 2021 10:40 AM
 Xrefs: [IB_24X3E_Weathestatco_3.dwg] [ISG-SU000.dwg] [PR-A-13.dwg] [PR-E-1005.dwg]

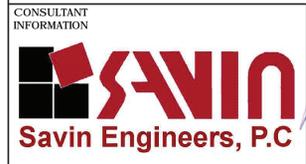

REVISION NUMBER	DATE	MADE BY	APP'D BY	REVISION
1	07/02/2021	RKC	DF	BID ADDENDUM #3

RECORD DRAWING CERTIFICATION			
<input type="checkbox"/> AS BUILT - CHANGES AS NOTED	<input type="checkbox"/> AS BUILT - NO CHANGES		
CONTRACTOR		PROJECT COORDINATOR	
NAME _____	NAME _____	NAME _____	NAME _____
SIGNATURE _____	SIGNATURE _____	SIGNATURE _____	SIGNATURE _____
TITLE _____	TITLE _____	TITLE _____	TITLE _____
DATE _____	DATE _____	DATE _____	DATE _____

WESTCHESTER COUNTY, NEW YORK
 DEPARTMENT OF PUBLIC WORKS AND TRANSPORTATION
 DIVISION OF ENGINEERING
INFRASTRUCTURE REHABILITATION - PHASE 2
PLAYLAND PARK, RYE, NEW YORK
PLAZA RESTAURANT
ROOF LIGHTING PLAN

CONTRACT NUMBER 20-530	SHEET NUMBER AD-PR-E-10
DWG NO.: Page 165 of 290	
SCALE: AS SHOWN	
DATE: MAY 26, 2021	
DPW FILE NUMBER 1-118-E-552	REV. NO. 0