


Drawing Name: G:\Savin\Autocad\2060\25-Playland-Mega-2\GE\GE005.dwg
Printed by: B66666 Date: 2 Jul 2021 10:39 AM Designed by: ---
Xrefs: [TB_24X3E_WestchesterCo_3.dwg] [TSC-SULOG.dwg] [TWS-SP0001.dwg] [TWC-SP0001.dwg] [DBSP-101.dwg]

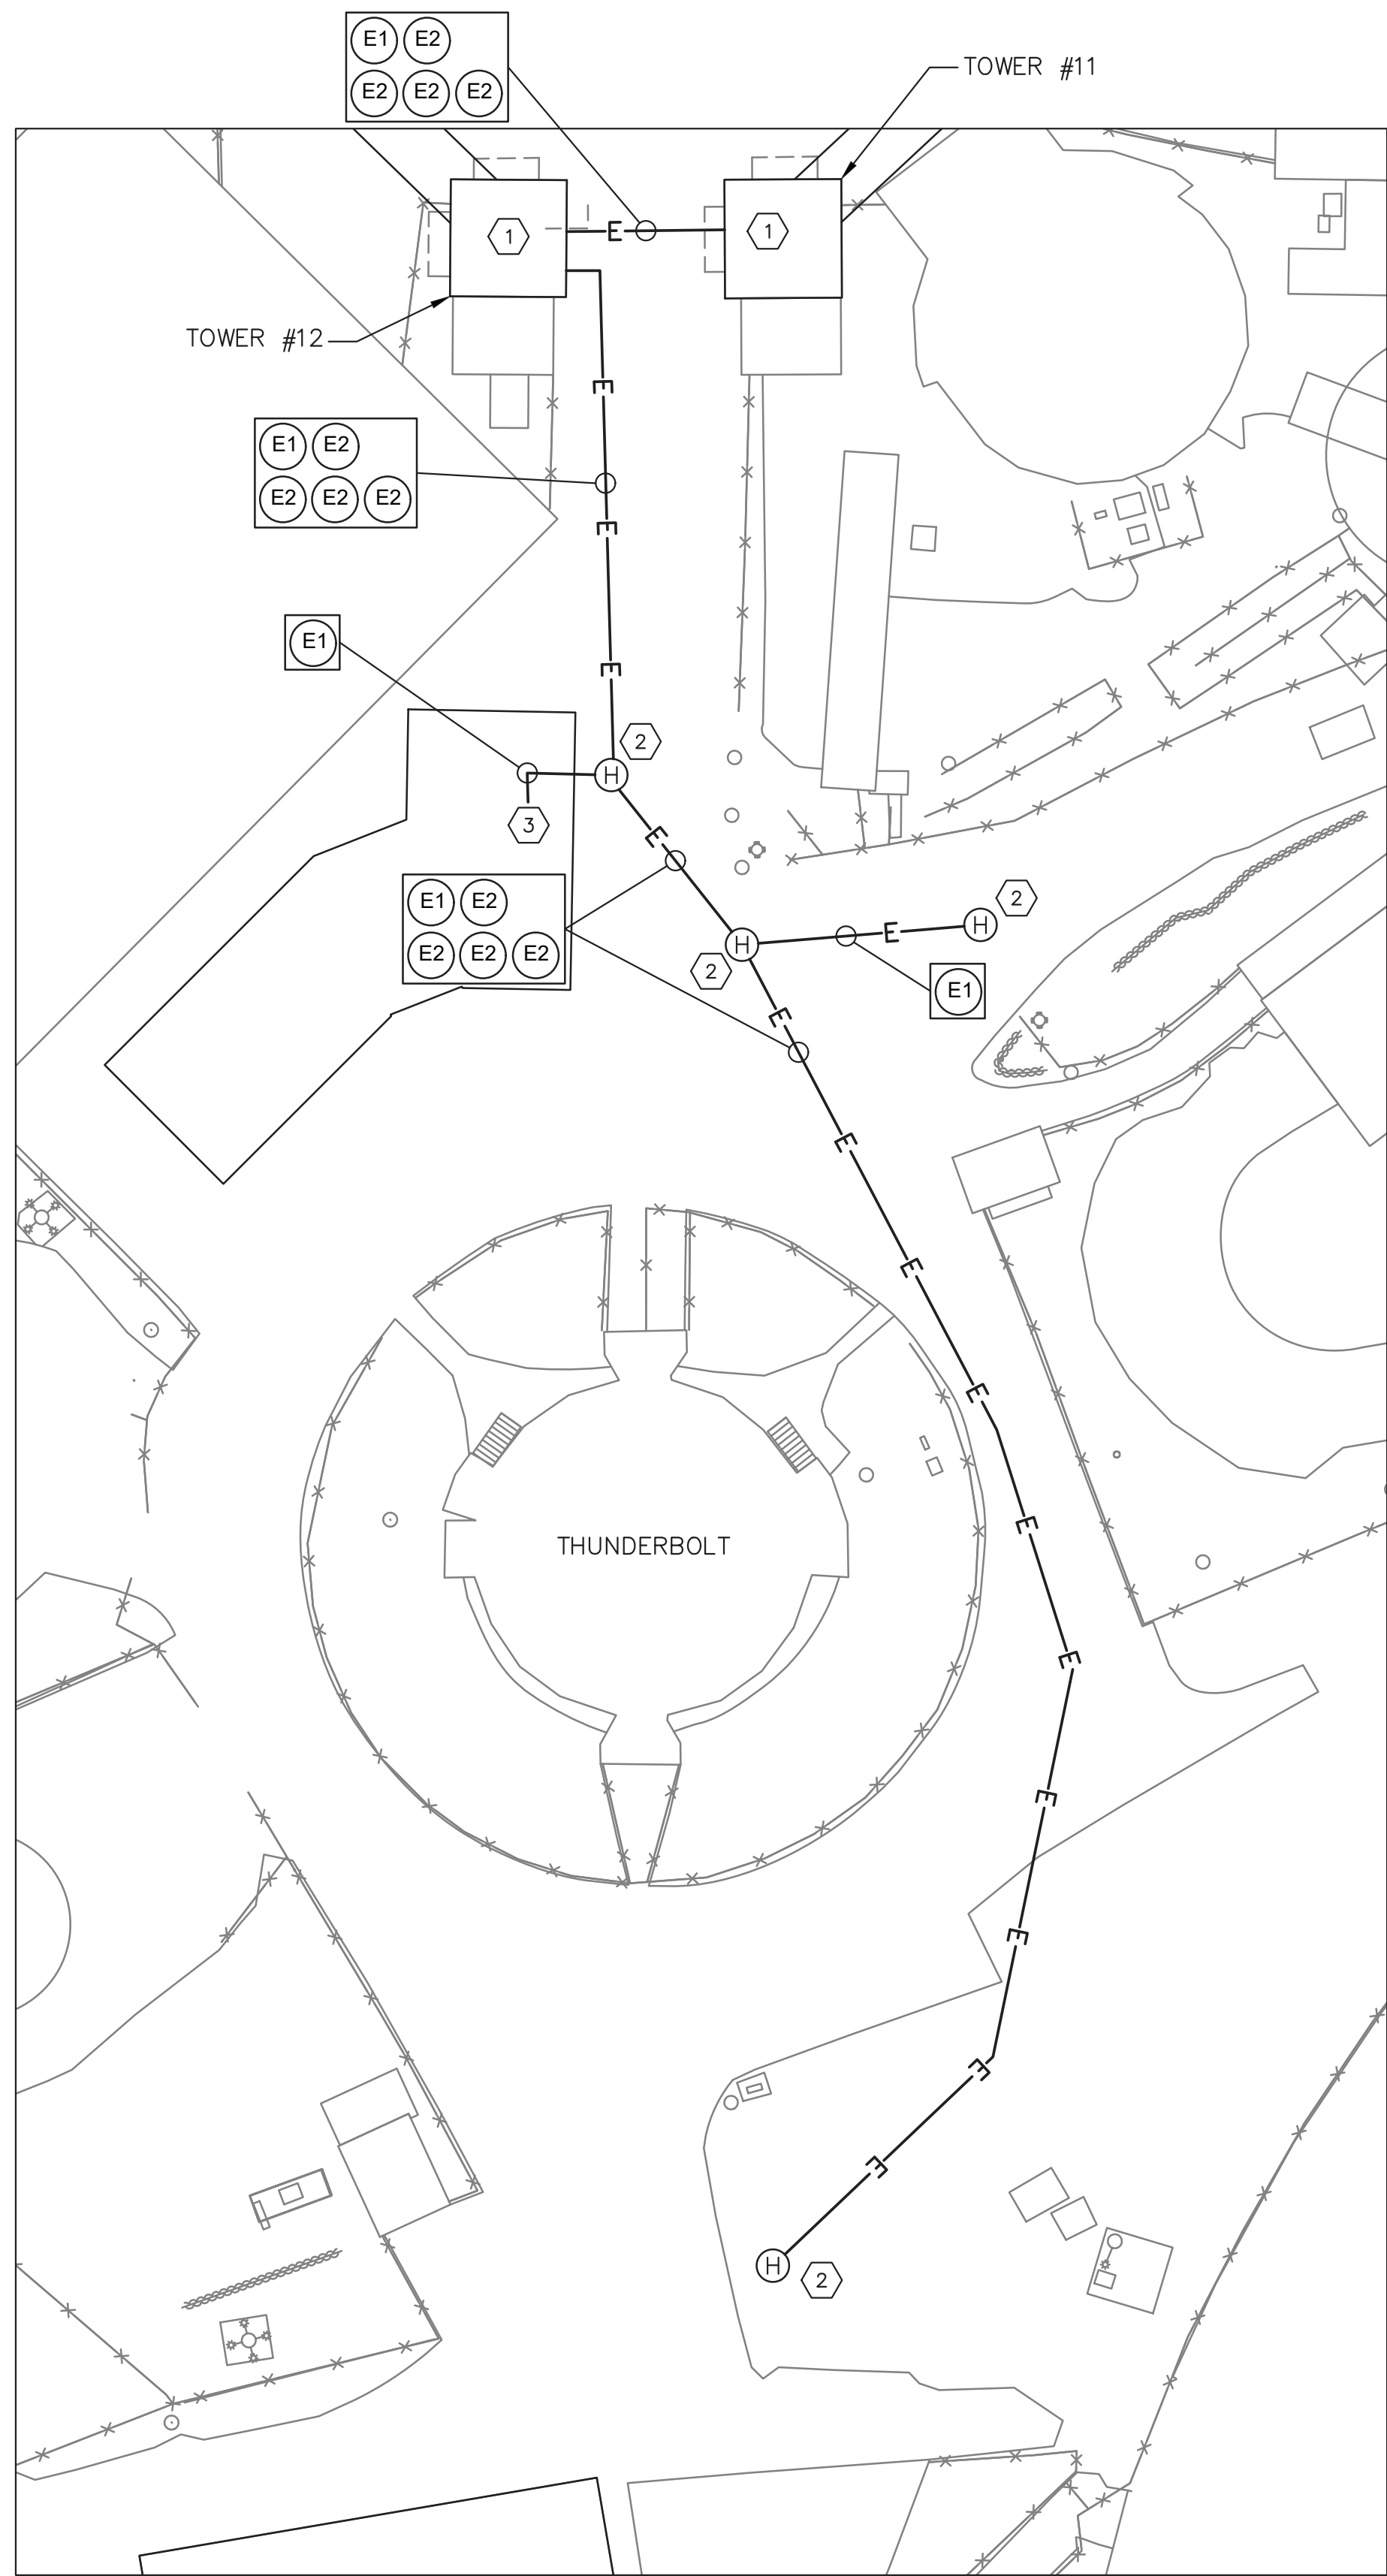

3 ENLARGED PLAN
GE-E-04 SCALE: 1" = 20'


| DUCTBANK SCHEDULE | | |
|-------------------|--------------------|---------|
| NAME | CONDUIT SIZE | REMARKS |
| E1 | 2" C WITH PULLROPE | AUDIO |
| E2 | 2" C WITH PULLROPE | SPARE |

NOTES:


1. FOR ADDITIONAL NOTES AND SYMBOLS, SEE GE-E-01.
2. UNLESS NOTED OTHERWISE, POLYMER CONCRETE HANDHOLES SHALL BE 12"x12"x24". SEE DRAWING DT-E-03 FOR ADDITIONAL INFORMATION.
3. ALL UNDERGROUND CONDUIT SHALL BE SCHEDULE 80 PVC. TRANSITION FROM UNDERGROUND TO ABOVE GROUND CONDUIT USING RIGID GALVANIZED STEEL.
4. SEE DRAWING DT-E-03 FOR UNDERGROUND CONDUIT DUCTBANK DETAIL.

KEY NOTES:

- 1 TOWER WILL HAVE NEW MANHOLE INSTALLED (SEE MAW-1 ADDENDUM STRUCTURAL DRAWINGS FOR ADDITIONAL INFORMATION). INCOMING UNDERGROUND CONDUIT WILL BE ROUTED TO NEW MANHOLE. CONTRACTOR IS ADVISED, UNDER THE MEGA 1 PROJECT, UNDERGROUND CONDUIT WILL BE INSTALLED AND CAPPED 8" PAST THE TOWER FOOTPRINT. MEGA 2 CONTRACTOR WILL INTERCEPT (AT THIS POINT) AND INSTALL NEW CONDUIT AS SHOWN.
- 2 PROVIDE 18" X 18" X 24" POLYMER CONCRETE MANHOLE AT THIS LOCATION.
- 3 INCOMING UNDERGROUND CONDUIT SHALL BE ROUTED TO ATTIC SPACE OF STRUCTURE. CONCEAL EXPOSED CONDUIT AS MUCH AS PRACTICAL. STUB AND CAP CONDUIT FOR FUTURE USE.

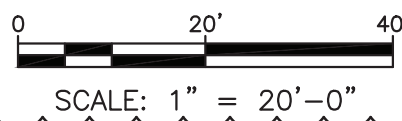

CONSULTANT INFORMATION

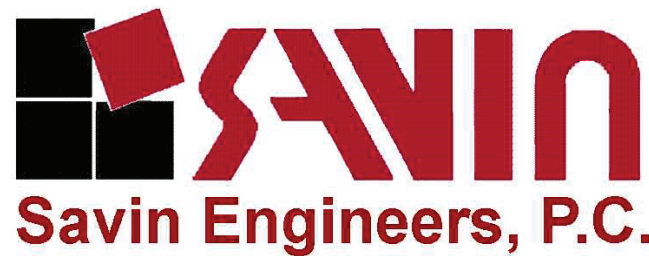

CONSULTANT SEAL



| REVISION NUMBER | DATE | MADE BY | APP'D BY | REVISION |
|-----------------|------------|---------|----------|-----------------|
| 1 | 07/02/2021 | RKC | DF | BID ADDENDUM #3 |

RECORD DRAWING CERTIFICATION

☐ AS BUILT - CHANGES AS NOTED

☐ AS BUILT - NO CHANGES

CONTRACTOR

NAME _____
SIGNATURE _____
TITLE _____ DATE _____

PROJECT COORDINATOR

NAME _____
SIGNATURE _____
TITLE _____ DATE _____

WESTCHESTER COUNTY, NEW YORK
DEPARTMENT OF PUBLIC WORKS AND TRANSPORTATION
DIVISION OF ENGINEERING

INFRASTRUCTURE REHABILITATION - PHASE 2
PLAYLAND PARK, RYE, NEW YORK
GENERAL
DUCT BANK PLAN 2

CONTRACT NUMBER

20-530

SHEET NUMBER

GE-E-05

DWG NO.: Page 290 of 290

SCALE: AS SHOWN

DATE: JULY, 2 2021

DPW FILE NUMBER 1-118-E-676B

REV. NO. 0