




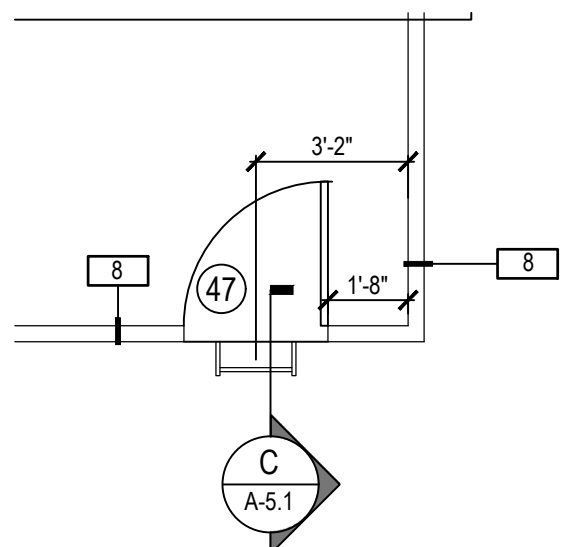


B DUST CAP / LADDER PLAN
SCALE: 1/4" = 1'-0"

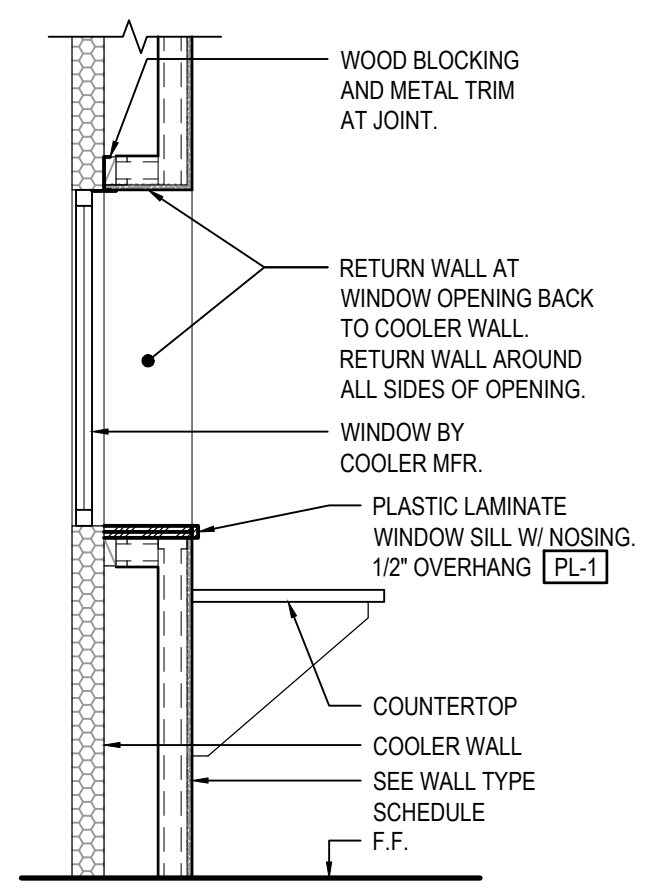


A @ REC'G OFF.
WINDOW SECTION
SCALE: 1/2" = 1'-0"

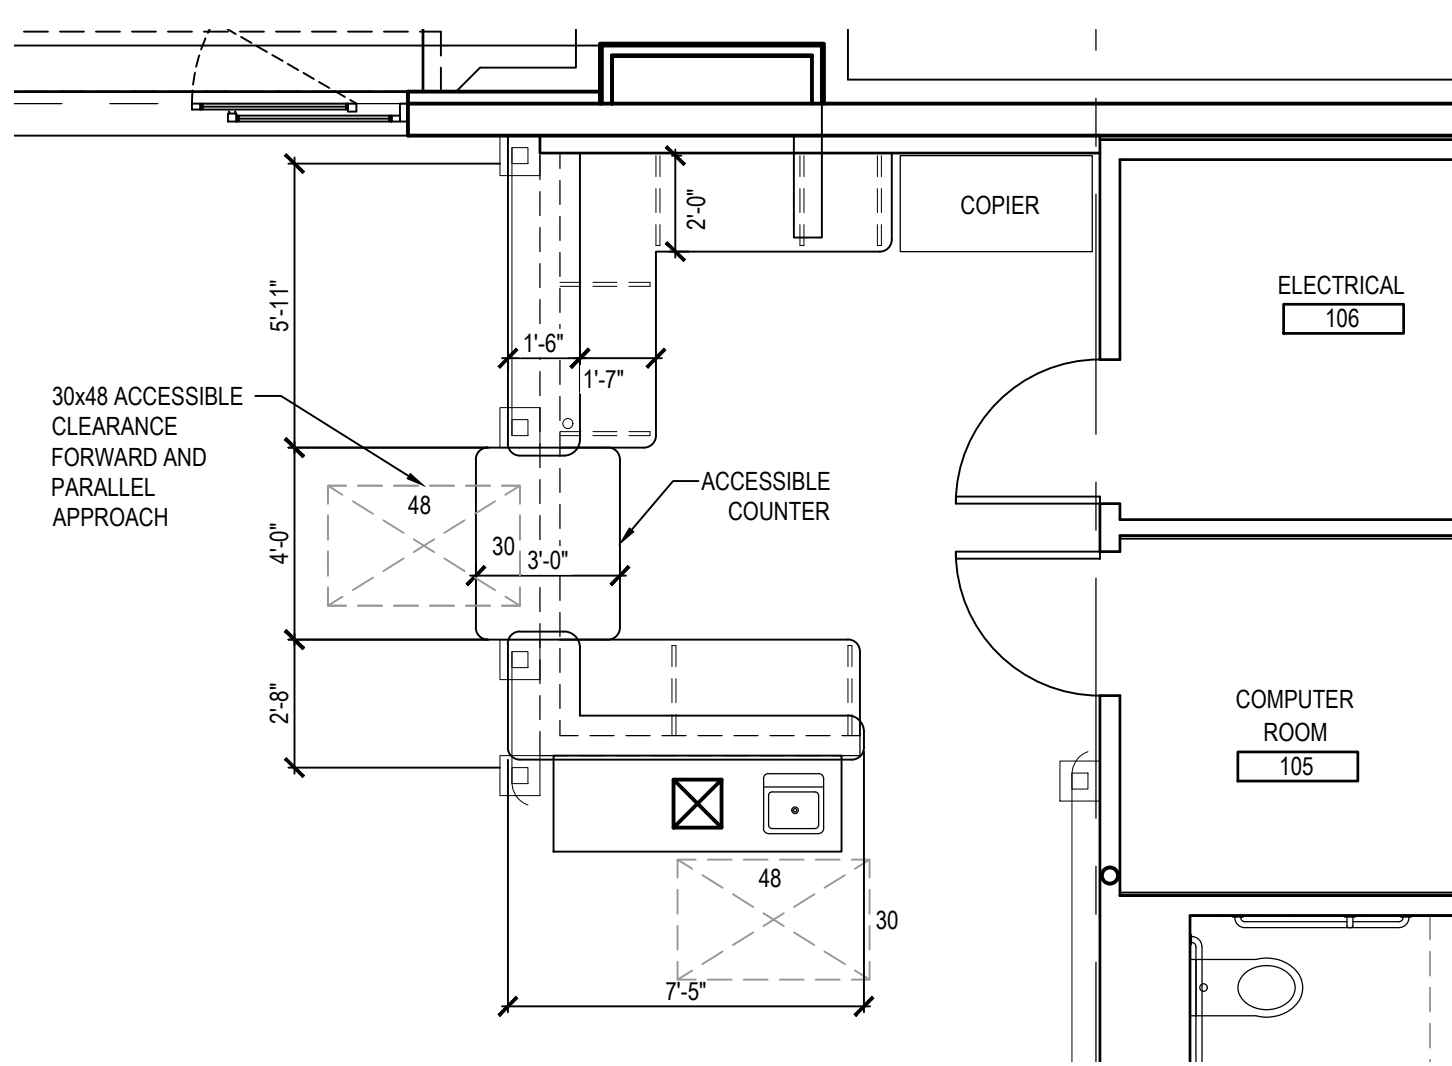


1A CUSTOMER SERVICE
ENLARGED FLOOR PLAN - COUNTERS
SCALE: 1/4" = 1'-0"

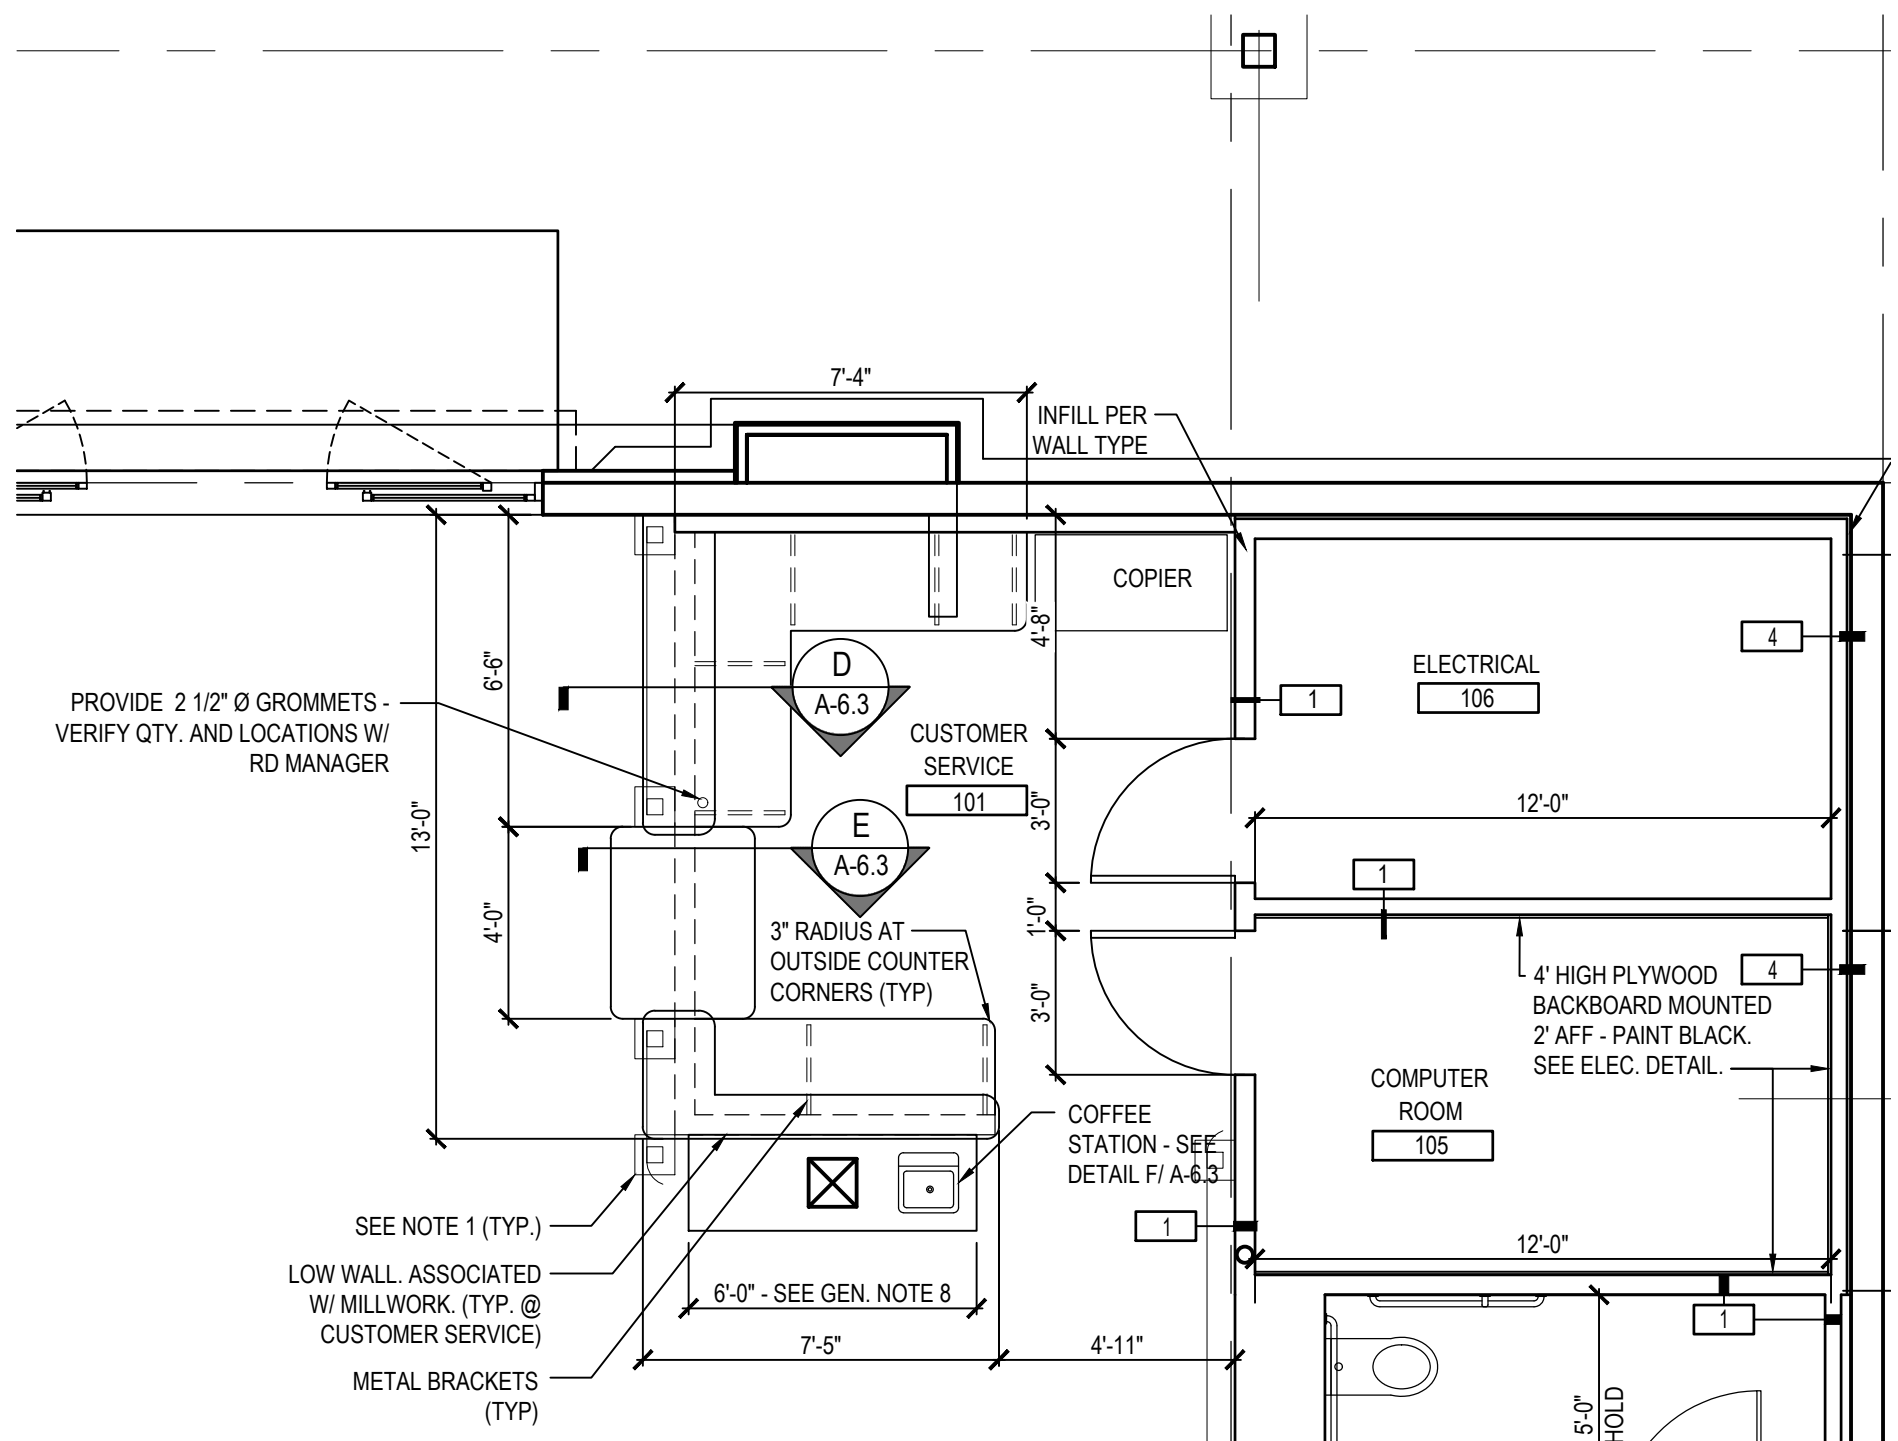


2 CUSTOMER SERVICE/ELECTRICAL ROOM
ENLARGED FLOOR PLAN
SCALE: 1/4" = 1'-0"

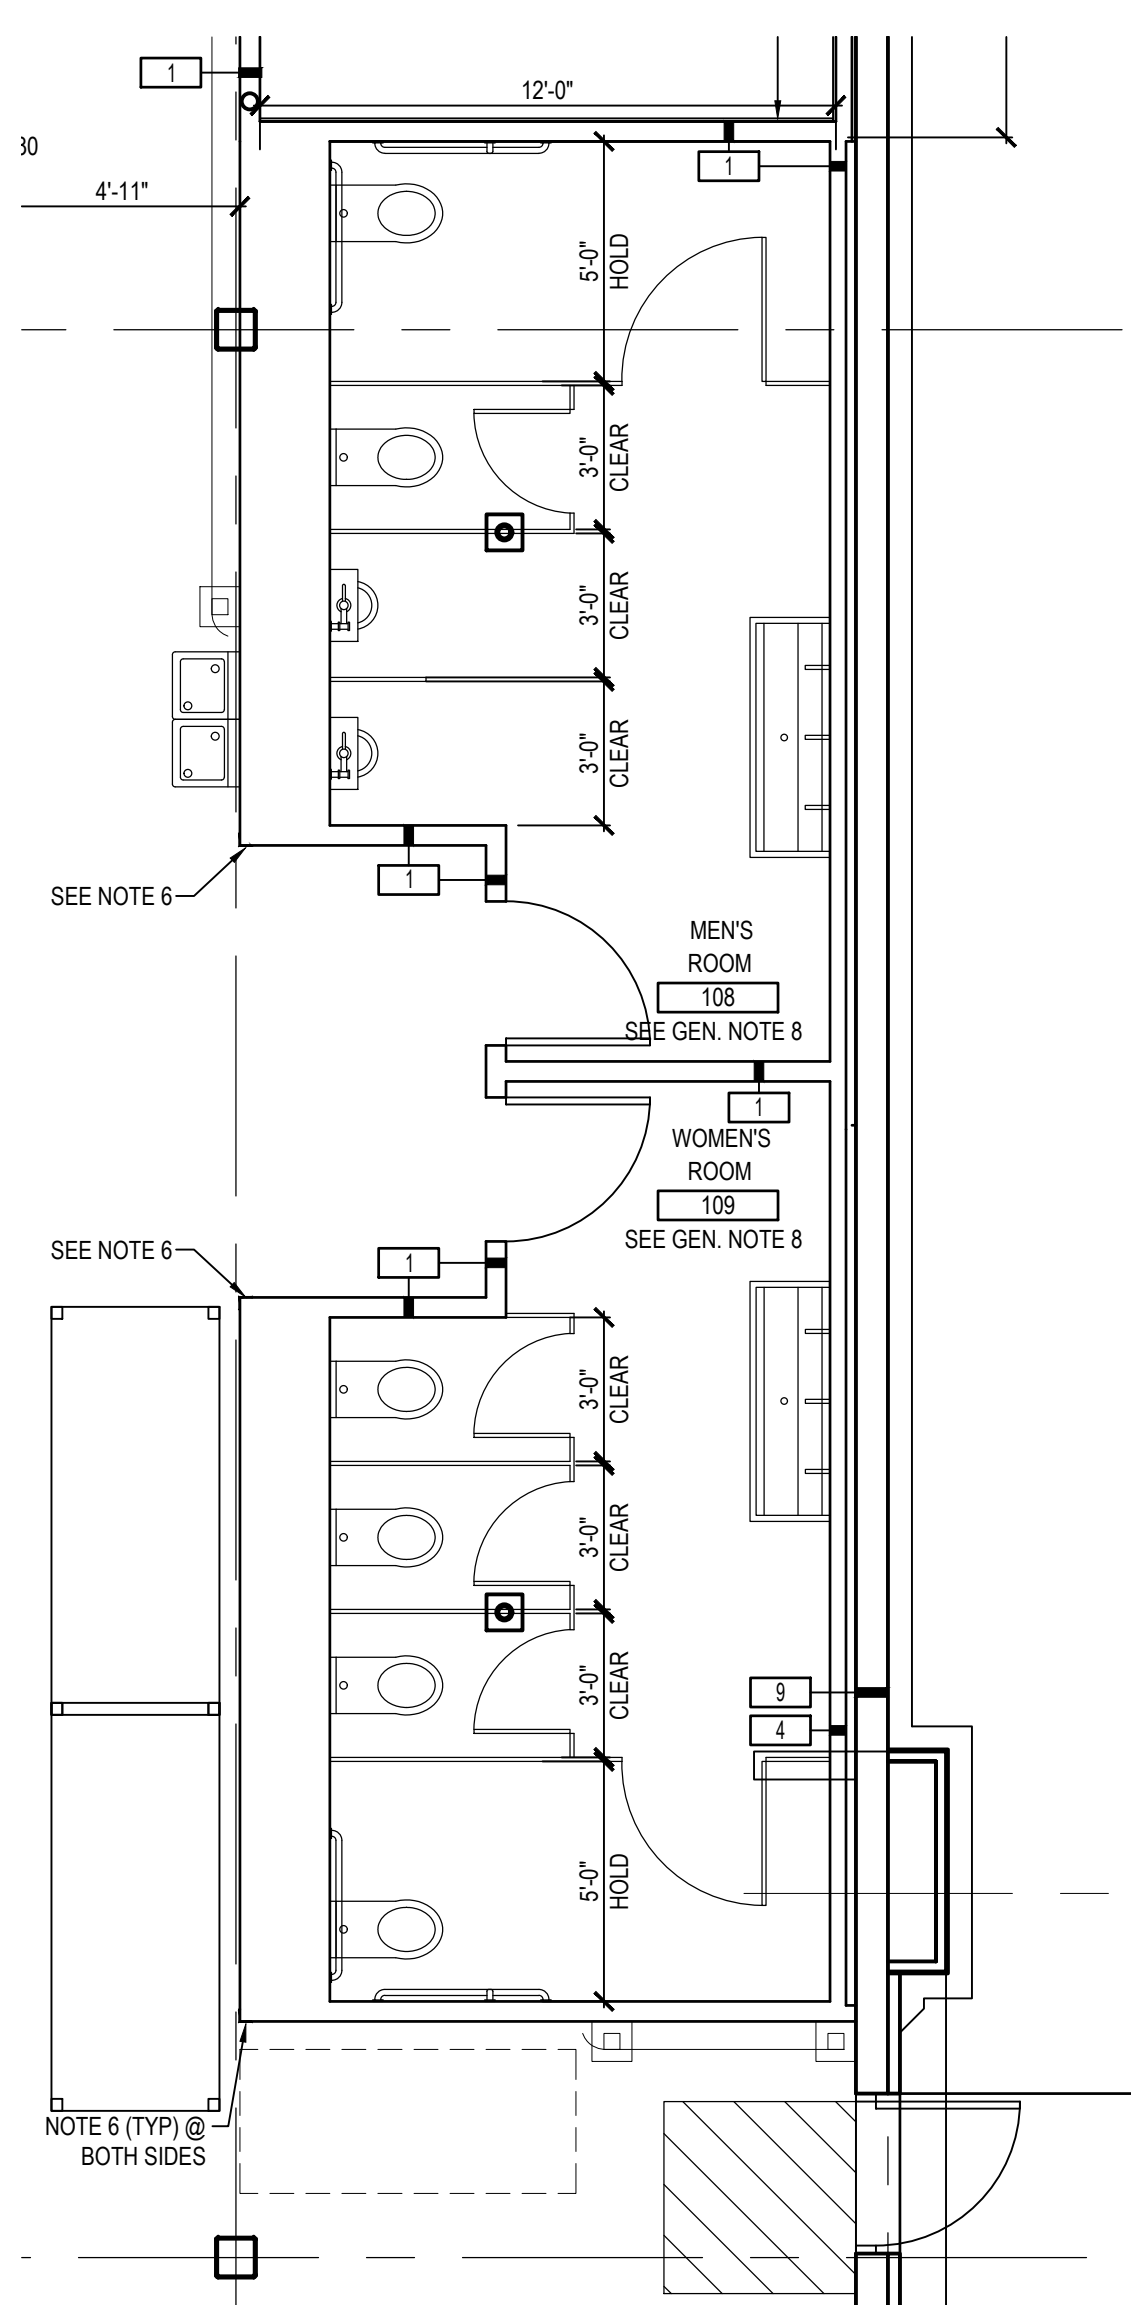

4 PUBLIC RESTROOMS
ENLARGED FLOOR PLAN
SCALE: 1/4" = 1'-0"

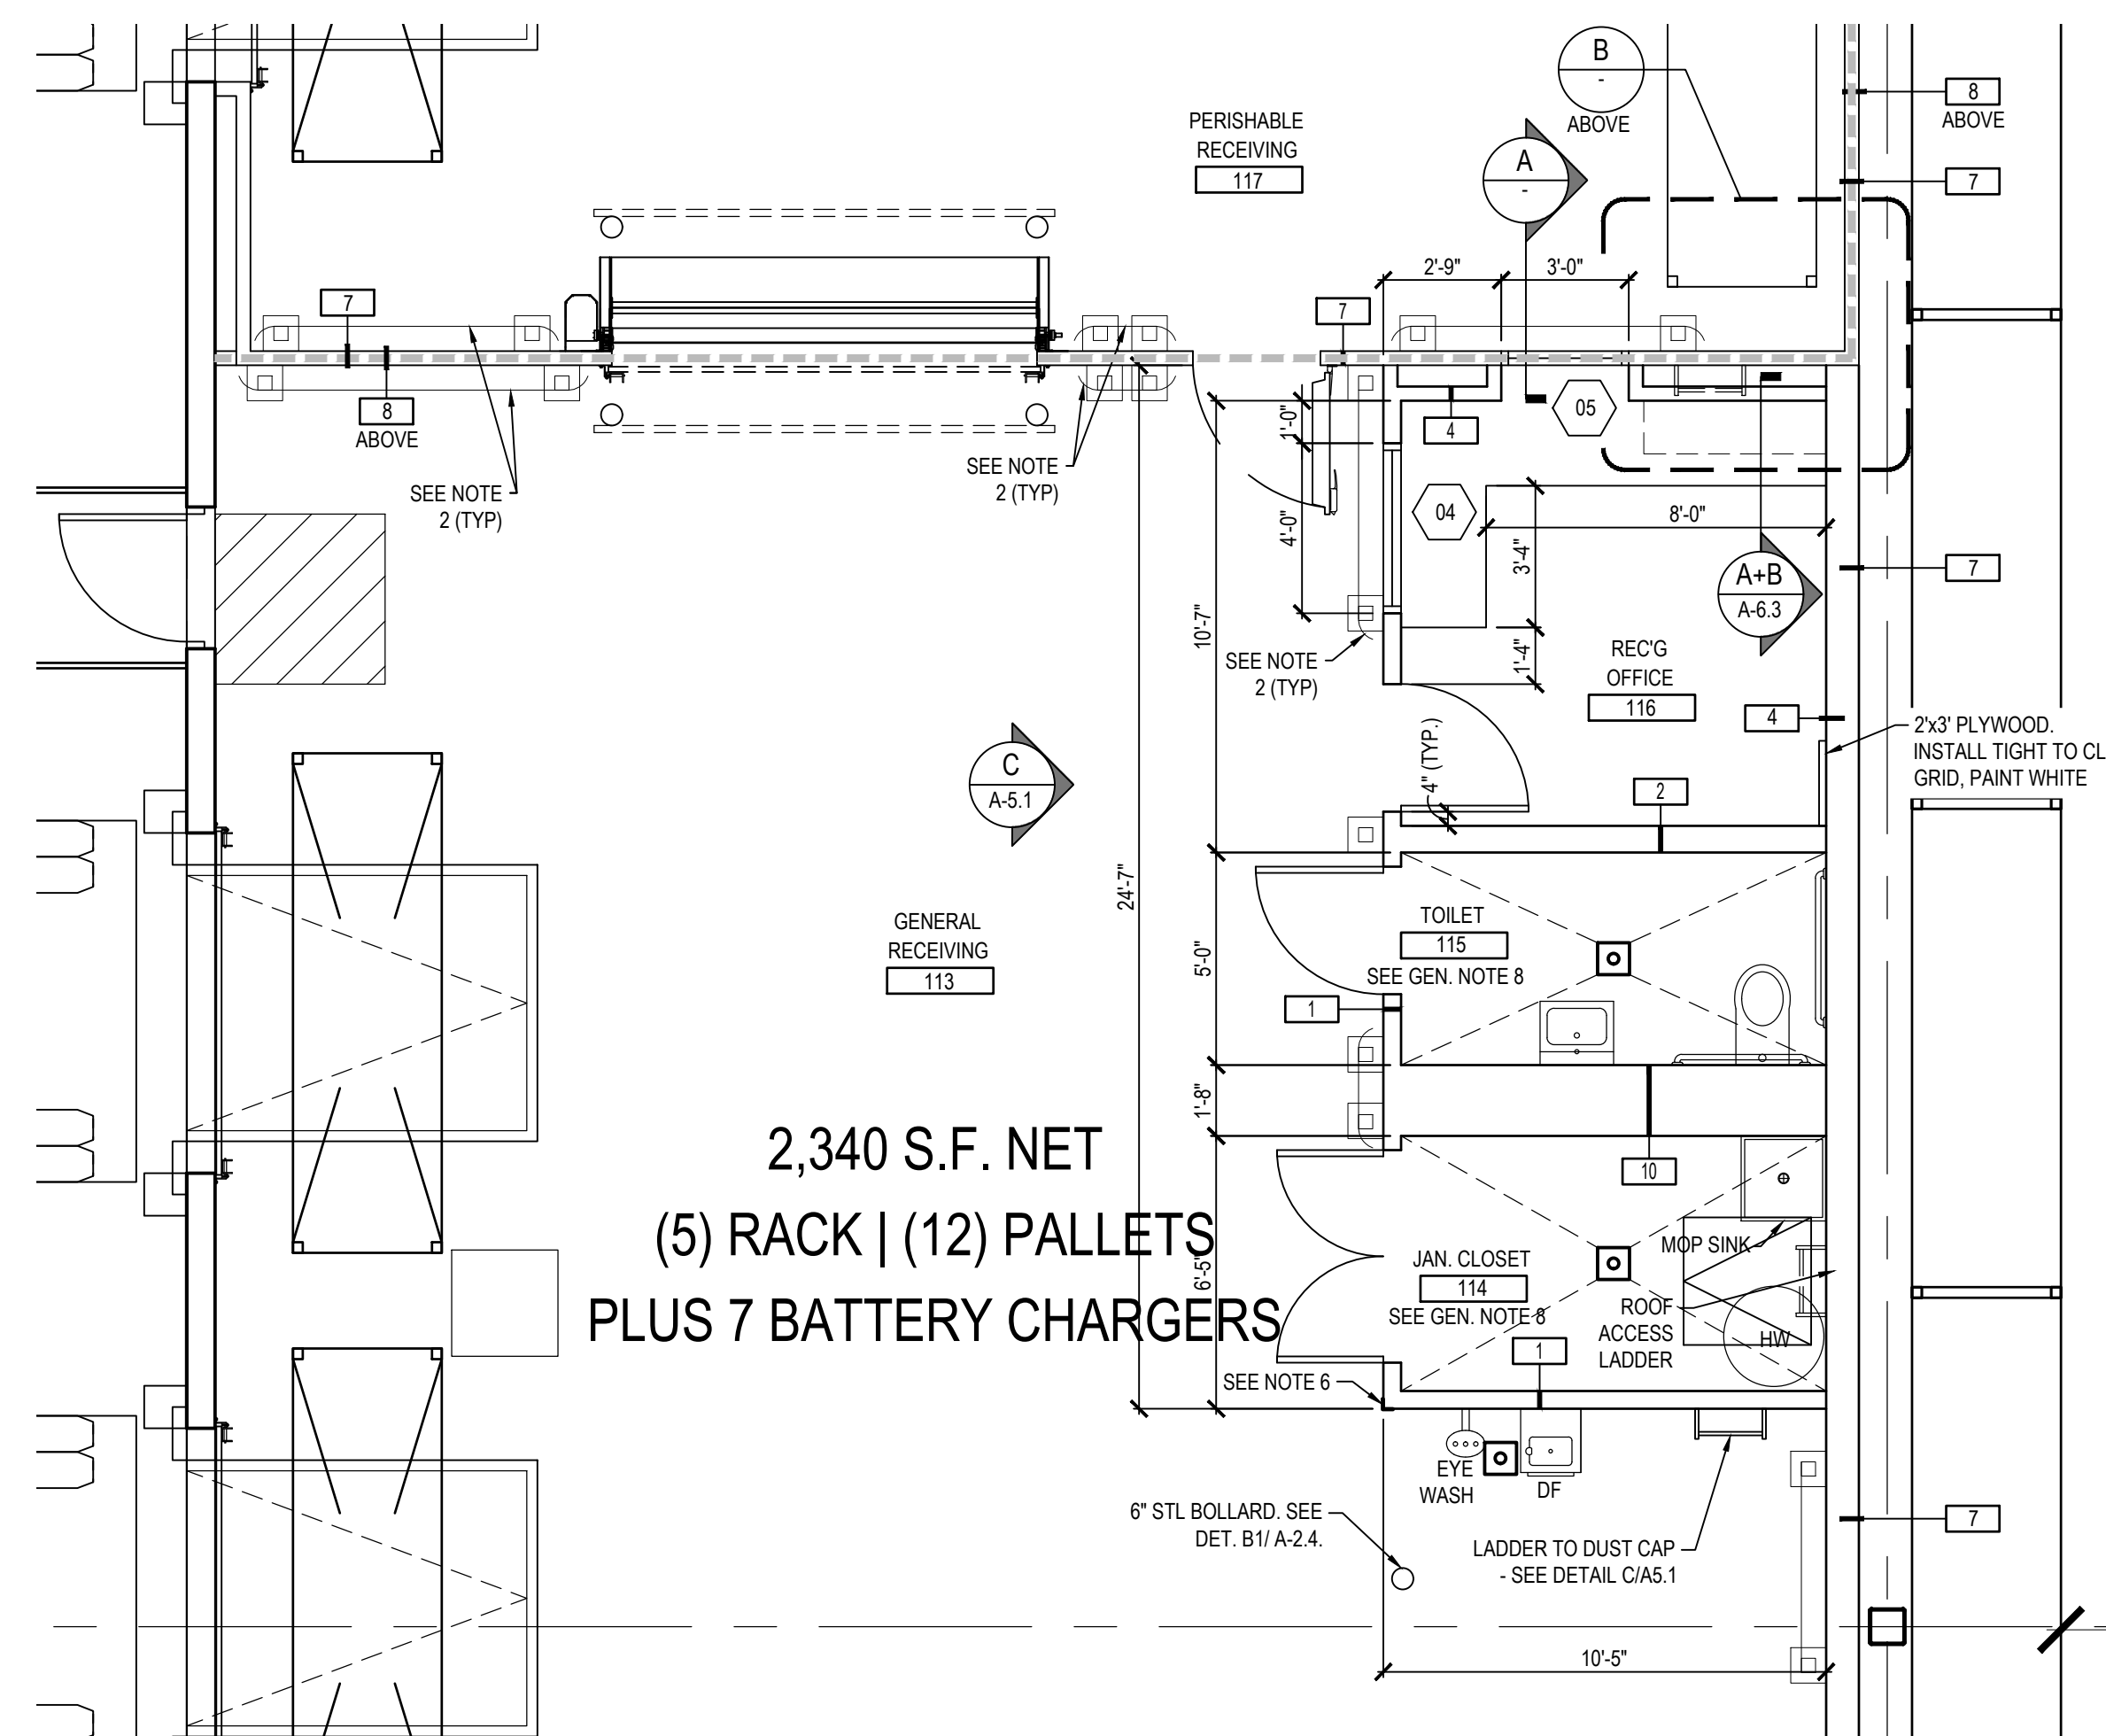

3 GENERAL RECEIVING OFFICES
ENLARGED FLOOR PLAN
SCALE: 1/4" = 1'-0"

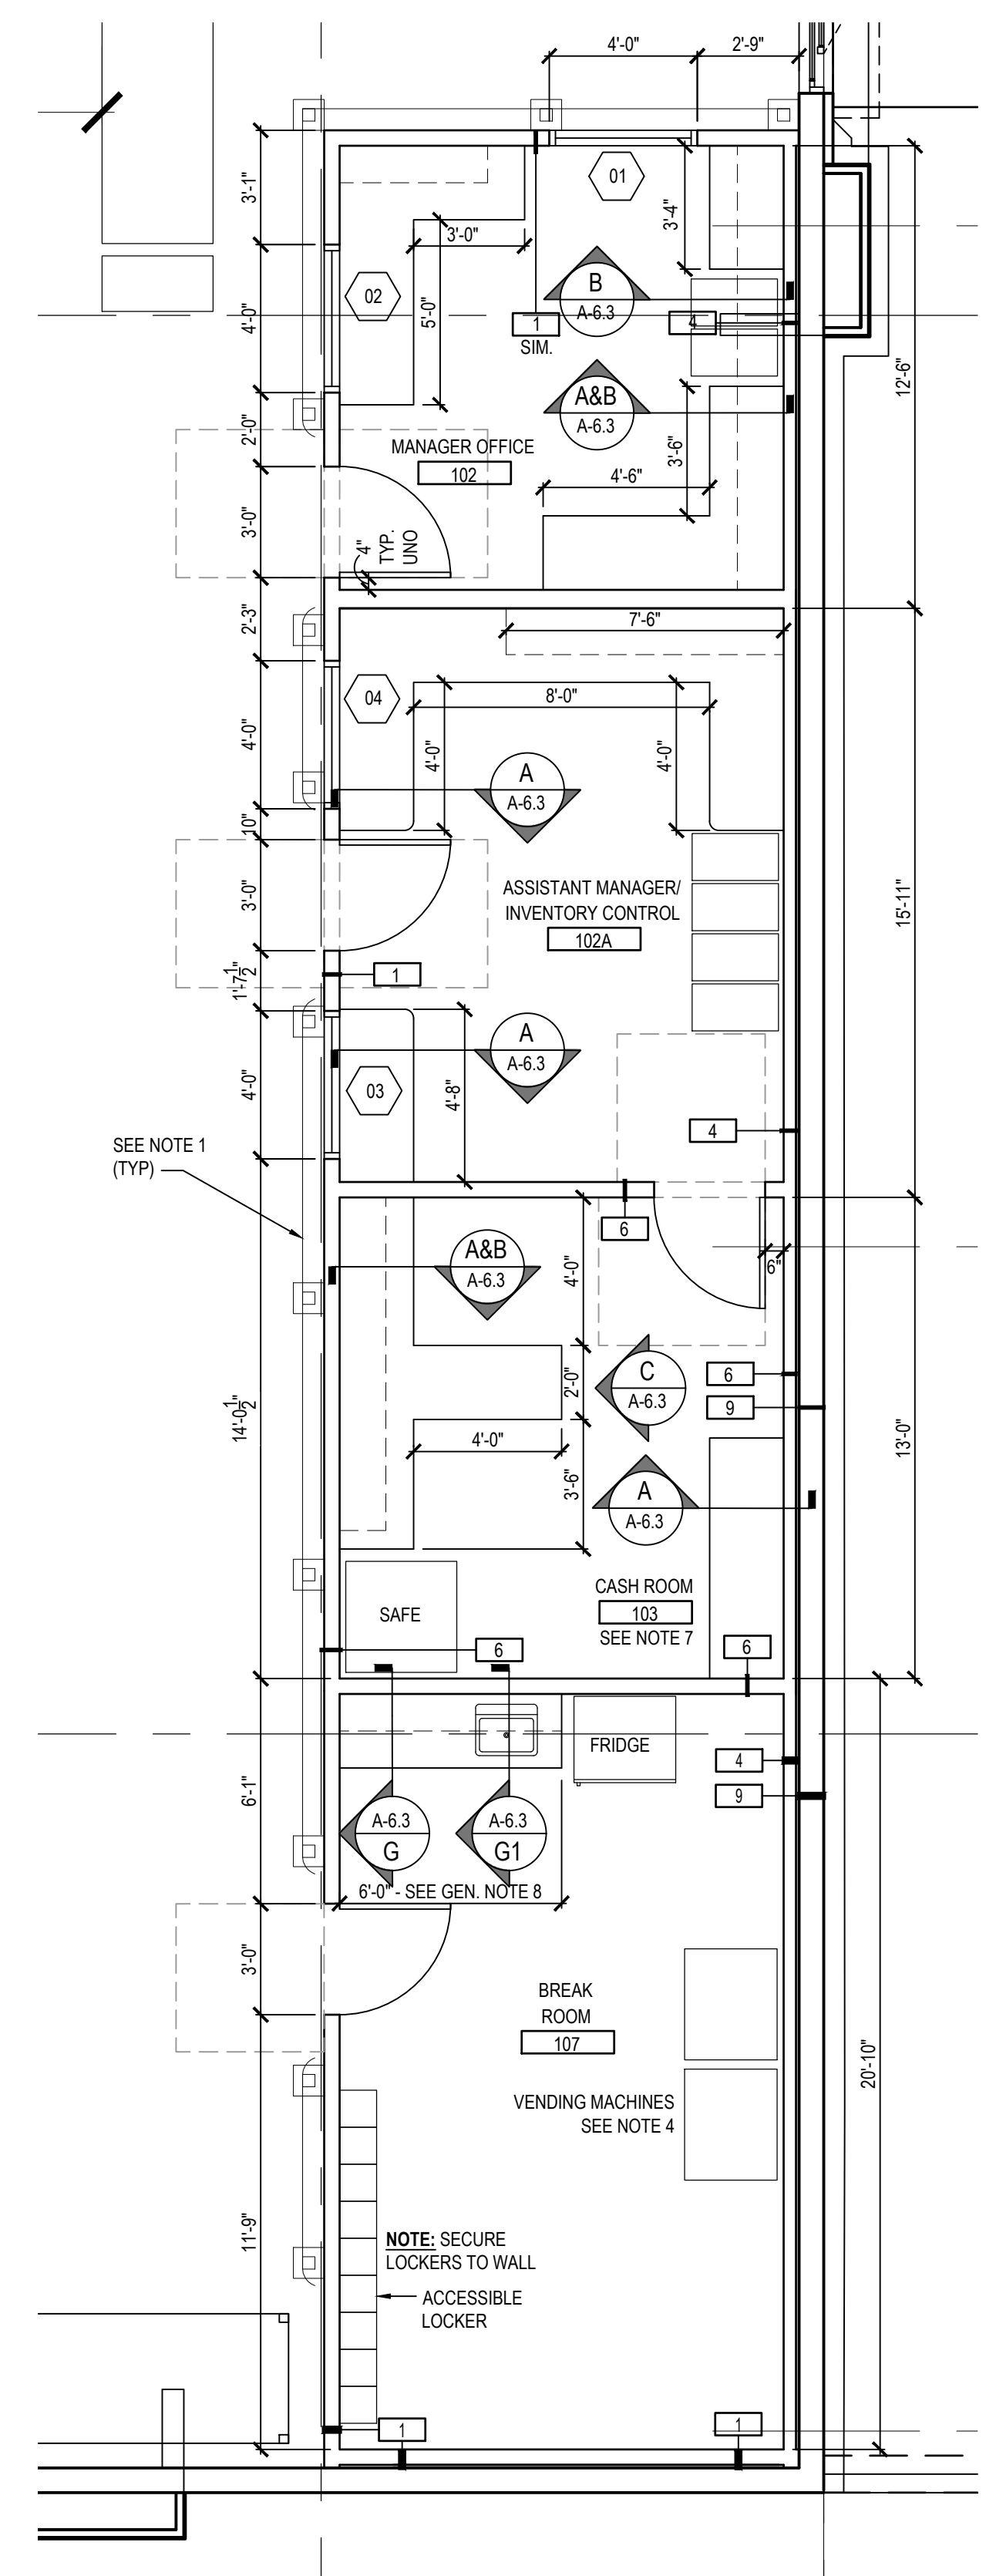

1 FRONT OFFICES/ BREAKROOM
ENLARGED FLOOR PLAN
SCALE: 1/4" = 1'-0"

- GENERAL NOTES:**
- 18" HIGH STEEL BOLLARD w/ OMEGA GUARDRAIL. HOLD GUARDRAIL MIN. AWAY 16" FROM LATCH SIDE OF DOOR.
 - 44" HIGH STEEL BOLLARD w/ OMEGA GUARDRAIL. HOLD GUARDRAIL MIN. 16" AWAY FROM LATCH SIDE OF DOOR.
 - VERIFY ALL MANAGERS STATION LOCATIONS WITH RD REP.
 - ICE MERCHANDISER AND VENDING MACHINES MAY OCCUR. VERIFY LOCATIONS WITH RD REP.
 - INSTALL TIME CLOCK. VERIFY LOCATION WITH RD REP.
 - 3" X 3" 16 GA. STAINLESS STEEL CORNER GUARDS (TYP) - PROVIDE AT 3'-0" LENGTHS WITH 8" M SET AT T.O. VINYL BASE AFF.
 - INSTALL SECURITY MESH ON IN WALLS AND DUST CAP OF CASH ROOM. ATTACHMENT METHOD PER MANUFACTURER'S RECOMMENDATION. SEE WALL TYPE 6 FOR MESH SPECIFICATION.
 - USE M.R. GYP. BD. IN ROOM OR AS INDICATED.
 - OUTSIDE CORNERS ON MILLWORK = 3" RADIUS FOR COUNTERTOPS.

WALL TYPES		
TYPE	DETAIL	DESCRIPTION
1		20 GA. 3-5/8" STEEL STUDS AT 16" O.C. W/ 5/8" GYP. BD. ON BOTH SIDES (U.N.O.) TO 10'-0" A.F.F. WITH BATT INSULATION.
2		18 GA. 8" STEEL STUDS AT 16" O.C. W/ 5/8" GYP. BD. ON EACH SIDE (U.N.O.) TO 10'-0" A.F.F. WITH BATT INSULATION.
3		FULL HT STUD WALL <30'-0" A.F.F.: 16 GA. 8" STEEL STUDS AT 16" O.C. W/ 5/8" GYP. BD. ON BOTH SIDES (U.N.O.) TO UNDERSIDE OF STRUCTURE W/ BATT INSULATION. PROVIDE HORIZ. (LATERAL) BRACING AT 4'-0" A.F.F.
4		FULL HT STUD WALL >30'-0" A.F.F.: 16 GA. 8" STEEL STUDS @ 12" O.C. W/ 5/8" GYP. BD. ON BOTH SIDES (U.N.O.) TO UNDERSIDE OF STRUCTURE W/ BATT INSULATION. PROVIDE HORIZ. (LATERAL) BRACING AT 4'-0" A.F.F.
5		20 GA. 3-5/8" STEEL STUDS AT 16" O.C. W/ 5/8" GYP. BD. ON ONE SIDE TO 10'-0" A.F.F. WITH BATT INSULATION.
6		18 GA. 8" STEEL STUDS AT 16" O.C. W/ 5/8" GYP. BD. ON ONE SIDE TO 10'-0" A.F.F. WITH BATT INSULATION.
7		18 GA. 3-5/8" STEEL STUDS AT 8" O.C. W/ 1 LAYER 5/8" GYP. BD. ON OUTSIDE OF ROOM. 1 LAYER 5/8" GYP. BD. OVER SECURITY MESH* ON CASH ROOM SIDE W/ BATT INSUL. - AT EXT WALL: REPLACE GYP ON OUTSIDE W/ 1" GAP. SEE WALL TYPE 4 NOTE.
8		4" OR 5" COOLER/ FREEZER WALL: PANELS BY REFRIGERATION MANUF. NOTE: PROVIDE 8" AIR GAP BETWEEN COOLER WALL AND EXTERIOR WALL SYSTEM.
9		STUD WALL ON COOLER: 20 GA. 3-5/8" STEEL STUDS AT 16" O.C. W/ 5/8" GYP. BD. ON ONE SIDE (U.N.O.) TO UNDERSIDE OF DECK WITH BATT INSULATION. ALIGN AND FASTEN TO TOP OF COOLER WALL. NOTE: PROVIDE UNFINISHED GYP. BD.
10		EXTERIOR WALL: 8 1/2" INSULATED PRE-CAST CONG. PANELS PER MFR SPECIFICATIONS U FACTOR = 0.074 (R-18.6)
11		11" CAVITY WALL @ RESTROOMS: (2) ROWS OF 18 GA. 3-5/8" STEEL STUDS AT 16" O.C. W/ 5/8" M.R. GYP. BD. ON EACH SIDE OF CAVITY WALL TO 10'-0" A.F.F. WITH BATT INSULATION - HORIZ. BRACING AT 48" O.C.

LEGEND	
	DENOTES PASS THRU RACKS 10'-0" CLEAR OPENING @ MAN DOORS & 12'-0" CLEAR @ OTHER LOCATIONS UNLESS NOTED OTHERWISE
	DENOTES WALL TYPE - SEE WALL TYPE SCHEDULE ON THIS SHEET.
	DENOTES WINDOW NUMBER. SEE SHEET A-6.2 FOR WINDOW SCHEDULE.

KLS ARCHITECT
Kurt L. Schmitz, Architect
17710 Delcor Avenue, Lakewood, Ohio 44107
Phone (216) 521-5131 • Fax (216) 521-4824 • www.klsarchitects.co

Restaurant Depot / BREWSTER, NY
DANBURY ROAD (LOT 48) BLOCK 0002
BREWSTER NY 10509

THESE DOCUMENTS CONTAIN INFORMATION PROPRIETARY TO KLS ARCHITECTS, INC.
UNAUTHORIZED USE OF THESE DOCUMENTS IS EXPRESSLY PROHIBITED UNLESS AGREED UPON IN WRITING.

REVISIONS	
#	DATE
1	
2	
3	
4	
5	
6	
7	
8	
9	
10	

ENLARGED FLOOR PLANS

DATE: 9/10/2020
JOB NO. 19230

A-6.1
SHEET NO.