

SYMBOLS

SYMBOLS	DESCRIPTION	SYMBOLS	DESCRIPTION
	NEW DUCT OR PIPE		REMOTE TEMPERATURE SENSOR
	EXISTING DUCT OR PIPE		CONNECT TO EXISTING
	TO BE REMOVED		POINT OF DISCONNECTION
	FLEX TO DIFFUSER (5'-0" MAXIMUM)		KEY NOTE DESIGNATION
	RISE IN DUCT		TOP EQUIPMENT DESIGNATION BOTTOM UNIT NUMBER (E-SIGNIFIES EXISTING)
	DROP IN DUCT		REFRIGERANT SUCTION PIPING
	FLEXIBLE DUCT CONNECTION		REFRIGERANT LIQUID PIPING
	CEILING DIFFUSER 4 WAY BLOW		PUMPED CONDENSATE PIPING
	CEILING DIFFUSER 3 WAY BLOW		CONDENSATE DRAIN PIPING
	CEILING DIFFUSER 2 WAY BLOW		SHUT-OFF VALVE
	CEILING DIFFUSER 1 WAY BLOW		BALANCE VALVE
	RETURN OR EXHAUST REGISTER		THROTTLING VALVE
	VOLUME DAMPER		MOTOR OPERATED VALVE, THREE WAY
	FIRE DAMPER AND ACCESS DOOR		MOTOR OPERATED VALVE, TWO WAY
	MOTOR OPERATED DAMPER		CHECK VALVE
	UNDERCUT DOOR		GAS COCK
	LOUVERED DOOR		UNION
	THERMOSTAT		STRAINER WITH BLOWDOWN
	SENSOR		RELIEF VALVE
	HUMIDISTAT		PRESSURE GAUGE
	DUCT SMOKE DETECTOR		THERMOMETER
	CO2 DETECTOR		

GENERAL NOTES

- DO NOT SCALE FROM THESE DRAWINGS.
- ALL WORK SHALL COMPLY WITH ALL APPLICABLE CODES, LAWS, ORDINANCES, RULES AND REGULATIONS.
- THE CONTRACTOR SHALL VISIT THE SITE PRIOR TO SUBMITTING HIS BID FOR THE PROPOSED WORK. HE SHALL BE RESPONSIBLE TO VERIFY FIELD CONDITIONS. ANY DISCREPANCIES SHALL BE BROUGHT TO THE ATTENTION OF THE ENGINEER PRIOR TO SUBMISSION OF BIDS IN WRITING.
- CONTRACTOR RESPONSIBLE TO PAY FOR AND SECURE ALL PERMITS AND INSPECTIONS.
- CONTRACTOR RESPONSIBLE FOR THE PROPER CARE OF ALL OWNER'S EQUIPMENT AND/OR FURNISHINGS WHICH ARE REQUIRED TO BE TEMPORARILY REMOVED, STORED OR RELOCATED. CONTRACTOR SHALL REPLACE, REPAIR OR REIMBURSE OWNER FOR ALL DAMAGES TO SUCH PROPERTIES AT FULL REPLACEMENT VALUE AND EQUIVALENCY. CONTRACTOR SHALL ADVISE OWNER FOR DISPOSITION OF REMOVED EQUIPMENT AND/OR MATERIALS.
- ALL CONTRACTORS SHALL PROVIDE CUTTING AND PATCHING FOR THEIR RESPECTIVE TRADES.
- CONTRACTOR'S WORK MAY BE REQUIRED OUTSIDE OF DESIGNATED SPACE. ALL SYSTEMS BEING DEMOLISHED AND REMOVED, MODIFIED, AND/OR TERMINATED SHALL BE FIELD VERIFIED TO INSURE NO WORK PERFORMED, INSIDE OR OUTSIDE OF THE DESIGNATED SPACE, SHALL DISRUPT ANY SERVICES OR SYSTEMS OF ANY OTHER AREAS. IF ANY CONDITIONS ARISE THAT ARE NOT IDENTIFIED ON DRAWINGS, IMMEDIATE NOTIFICATION SHALL BE PROVIDED TO THE ENGINEER OR OWNER. NO WORK SHALL PROCEED WITHOUT APPROVAL FROM ENGINEER OR OWNER.
- DRAWINGS ARE DIAGRAMMATIC IN NATURE AND MAY HAVE TO BE ADAPTED TO COMPLY WITH EXISTING BUILDING CONDITIONS. CONTRACTOR SHALL SUBMIT HVAC SHOP DRAWINGS, INDICATING LOCATIONS, AND ROUTING AND LOCATIONS OF DUCTS, PIPING, AND WIRING.
- DUCTING & PIPING SHOWN ON DRAWINGS SHOW THE GENERAL RUN AND CONNECTIONS. ALL PARTS MAY OR MAY NOT BE SHOWN IN THEIR EXACT POSITION. CONTRACTOR SHALL BE RESPONSIBLE FOR ERECTING THE DUCTING/PIPING SUITABLE IN EVERY RESPECT FOR THE WORK. DUCTING/PIPING SHALL BE INSTALLED SO THAT ACCESS, CLEARANCE, HEADROOM AND PITCH ARE MAINTAINED. CONTRACTORS OF THE VARIOUS TRADES SHALL COORDINATE THE INSTALLATION.
- CONTRACTOR SHALL COORDINATE HIS SCHEDULING WITH THE OWNER AND GENERAL CONTRACTOR TO COMPLY WITH THE OWNERS USAGE OF THE BUILDING.
- UPON CONTRACT AWARD, CONTRACTOR SHALL CONTACT LOCAL UTILITY COMPANY TO SCHEDULE ANY UTILITY UPGRADES. CONTRACTOR SHALL BE RESPONSIBLE TO COORDINATE ALL UTILITY UPGRADES, SECURE ALL PERMITS AND INSPECTIONS.
- ALL CONNECTIONS TO EXISTING BUILDING SERVICES SHALL BE CAREFULLY COORDINATED WITH THE UTILITY CO. AND THE OWNER'S SCHEDULE. SERVICE WORK OF THIS NATURE TO OCCUR DURING UNOCCUPIED BUILDING HOURS. THE CONTRACTOR SHALL BE RESPONSIBLE TO ENSURE THAT ALL EXISTING EQUIPMENT IS OPERATIONAL AFTER ANY SHUTDOWN OCCURS.
- ALL PENETRATIONS THRU WALLS, FLOORS, AND CEILINGS SHALL BE SEALED WITH A UL APPROVED FIRESTOP MATERIAL SUITABLE FOR CONSTRUCTION MATERIAL TO MAINTAIN FIRE, SMOKE, AND DRAFT INTEGRITY OF STRUCTURE.
- ALL CONTRACTORS REMOVING OR INSTALLING ANY EQUIPMENT, PIPES, DUCTS, CONDUITS, ETC. SHALL PATCH ALL SURFACES DISTURBED BY THIS WORK WITH SUITABLE FIRE PROOF MATERIALS AND FINISH TO MATCH ADJACENT SURFACES.
- MECHANICAL CONTRACTOR SHALL BE RESPONSIBLE FOR THE PROPER HANDLING, DISPOSAL, & ASSOCIATED COSTS OF ALL REFRIGERANT MATERIAL, DURING THIS CONTRACT, IN ACCORDANCE WITH ALL FEDERAL, STATE, AND LOCAL CODES AND/OR REGULATIONS.
- THE ELECTRICAL CONTRACTOR TO PROVIDE, INSTALL AND WIRE DUCT MOUNTED SMOKE DETECTORS. ELECTRIC CONTRACTOR SHALL ALSO PROVIDE AND WIRE A REMOTE MONITORING KEY OPERATED TEST AND ALARM STATION FOR EACH DUCT SMOKE DETECTOR. THE REMOTE TEST ALARM STATION SHALL BE MOUNTED AS DIRECTED IN THE AREA OF THE SMOKE DETECTOR.
- THE MECHANICAL CONTRACTOR SHALL REVIEW ALL CONTRACT DOCUMENTS, EXISTING CONDITIONS, AND AS-BUILT CONDITIONS PERTAINING TO THE HVAC SYSTEMS. MECHANICAL CONTRACTOR SHALL PROVIDE ALL EQUIPMENT, MATERIAL, PARTS, SUPPLIES AND LABOR TO BALANCE ALL HVAC EQUIPMENT TO OWNER'S SATISFACTION.
- ALL RECTANGULAR RIGID DUCTWORK SHALL BE CONSTRUCTED OF GALVANIZED SHEET STEEL. FABRICATION OF DUCTWORK AND INSTALLATION SHALL BE IN ACCORDANCE WITH SMACNA STANDARDS AND RECOMMENDATIONS.
- ALL DUCTWORK SIZES SHOWN ON DRAWINGS ARE CLEAR INTERNAL DIMENSIONS.
- ALL NEW SUPPLY AND RETURN AIR DUCTWORK WITHIN 15' OF HVAC UNIT SHALL BE ACOUSTICALLY LINED.
- ALL INTERIOR ROUND DUCTWORK CONCEALED OR EXPOSED IN NON-FINISHED AREA, EG ATTIC, ABOVE CEILING, ETC. SHALL BE SINGLE WALLED EXTERNALLY INSULATED WITH FLEXIBLE DUCTWRAP AND VAPOR BARRIER. SEE SPECIFICATIONS FOR DETAILS.
- ALL FLEXIBLE DUCTWORK SHALL BE CLASS 1, LABELED UL 181. SEE SPECIFICATIONS FOR DETAILS.
- THE MECHANICAL CONTRACTOR TO PROVIDE ALL ROOF CURBS, EQUIPMENT RAILS, SUPPORTS, ROOF PORTALS, AND ASSOCIATED EQUIPMENT TO ENSURE A COMPLETE INSTALLATION FOR NEW HVAC EQUIPMENT. MECHANICAL CONTRACTOR RESPONSIBLE TO PROVIDE EXACT LOCATIONS AND REVIEW AND RELEASED EQUIPMENT SUBMITTALS, OF ROOF CURBS, EQUIPMENT SUPPORTS, ROOF PORTALS, AND ASSOCIATED EQUIPMENT TO THE ARCHITECT. ALL ROOF PENETRATIONS, EQUIPMENT SUPPORTS, ROOF PORTALS AND ASSOCIATED EQUIPMENT SHALL BE INSTALLED BY ROOFING SUB-CONTRACTOR. ROOFING CONTRACTOR SHALL BE BONDED AND ALL WORK SHALL BE DONE SO AS NOT TO VOID ROOF WARRANTY. ROOFING CONTRACTOR SHALL PROVIDE BASE FLASHING, AND PROVIDE TEMPORARY WEATHER-PROOF COVERS UNTIL MECHANICAL CONTRACTOR INSTALLS NEW HVAC UNITS. MECHANICAL CONTRACTOR TO PROVIDE COUNTER FLASHING.

CODE INFORMATION

1	OCCUPANCY TYPE	RETAIL
2	GOVERNING CODES AND REFERENCES	2020 BUILDING CODE OF NEW YORK STATE
		2020 MECHANICAL CODE OF NEW YORK STATE
		2020 PLUMBING CODE OF NEW YORK STATE
		2017 NATIONAL ELECTRICAL CODE
		2020 ENERGY CONSERVATION CONSTRUCTION CODE OF NEW YORK STATE
		2020 FUEL GAS CODE OF NEW YORK STATE
		2020 FIRE CODE OF NEW YORK STATE

DRAWING INDEX

DRAWING NUMBER	DRAWING TITLE
M-001	MECHANICAL SYMBOLS, NOTES & ABBREVIATIONS
M-002	MECHANICAL SPECIFICATIONS
M-003	MECHANICAL SPECIFICATIONS
M-100	MECHANICAL SECOND FLOOR DEMOLITION PLAN
M-101	MECHANICAL ROOF DEMOLITION PLAN
M-200	MECHANICAL SECOND FLOOR PLAN
M-201	MECHANICAL ROOF PLAN
M-300	MECHANICAL SCHEDULES
M-400	MECHANICAL DETAILS
M-401	MECHANICAL DETAILS

ABBREVIATIONS

AFF	ABOVE FINISHED FLOOR	MC	MECHANICAL CONTRACTOR
AD	ACCESS DOOR	NAE	NETWORK AUTOMATION ENGINE
BDD	BACKDRAFT DAMPER	OAI	OUTDOOR AIR INTAKE
BOD	BOTTOM OF DUCT	PC	PLUMBING CONTRACTOR
CD	CEILING DIFFUSER	RR	RETURN REGISTER
CFM	CUBIC FEET PER MINUTE	SR	SUPPLY REGISTER
EC	ELECTRICAL CONTRACTOR	VD	VOLUME DAMPER
EG	EXHAUST GRILLE	WMS	WIRE MESH SCREEN
ER	EXHAUST REGISTER	WR	WALL REGISTER



YONKERS
MEDIUM SCOPE RENOVATION
 928 McLean Avenue
 Yonkers, NY 10704



10 North Park Place
 Suite 400
 Morristown, NJ 07960
 Telephone 973.290.8500
 Facsimile 973.290.8585



Corporate Office
 1800 Route 34, Suite 101
 Wall, NJ 07719
 732.312.8900
 Regional Offices
 Hackensack, NJ
 New York, NY

AMIN H. GOMAA, PE
 PROFESSIONAL ENGINEER, NJ LIC. No. 24GE04042100

Issue	Date & Issue Description	By	Check
01	10/09/20	CTH	JDS
	ISSUED FOR BID		
02	02/03/2021		
	ISSUE FOR PERMIT & PRICING II		
03	07/15/2021		
	ISSUE FOR PERMIT & PRICING VI		

Seal/Signature

Project Name
 YONKERS - MEDIUM RENOVATION

Prototype Layout

CAD File Name

Description
 MECHANICAL SYMBOLS, NOTES & ABBREVIATIONS

Scale
 AS SHOWN

M-001



Ref. North

SPECIFICATIONS

1. GENERAL
 - A. DRAWINGS AND GENERAL & SUPPLEMENTARY CONDITIONS SHALL APPLY TO WORK OF THIS SECTION.
 - B. ALL MATERIALS SHALL BE NEW AND THE BEST OF THEIR RESPECTIVE KINDS, SUITABLE FOR THE CONDITIONS AND DUTIES IMPOSED UPON SAME AT THE BUILDING. MATERIALS SHALL MATCH EXISTING FOR SIMILAR SERVICE EXCEPT AS OTHERWISE NOTED HEREIN. THEY SHALL GENERALLY BE OF REPRESENTATIVE MANUFACTURER. BRAND NAMES ARE SPECIFIED TO INDICATE A STANDARD OF QUALITY ONLY. INSTALLATION OF THE WORK SHALL BE PERFORMED BY SKILLED TRADESMEN.
 - C. CODE COMPLIANCE: ALL WORK SHALL BE INSTALLED IN CONFORMANCE TO BUILDING CODES HAVING JURISDICTION INCLUDING BUT NOT LIMITED TO THE LATEST ADOPTED EDITION OF IBC, NATIONAL ELECTRICAL CODE, NATIONAL FIRE CODE, INTERNATIONAL MECHANICAL CODE, AND INTERNATIONAL FUEL GAS CODE.
 - D. IF ANY UNEXPECTED DISCOVERY OF SUSPECTED HAZARDOUS MATERIALS IS MADE DURING THE COURSE OF WORK, THE CONTRACTOR SHALL REPORT THE DISCOVERY IMMEDIATELY TO THE OWNER. THE CONTRACTOR SHALL STOP ANY WORK THAT MAY DISTURB THE SUSPECTED HAZARDOUS MATERIAL. CONTRACTOR SHALL RESUME WORK AFTER ALL HAZARDOUS MATERIAL HAS BEEN REMEDIATED.
 2. SUBSTITUTIONS
 - A. IF CONTRACTOR IS CONSIDERING SUBSTITUTION OF BASE SPECIFICATION, SUCH EQUIPMENT SHALL MEET OR EXCEED ALL LISTED CAPACITIES, OPERATIONAL EFFICIENCIES AND POWER/CONTROL REQUIREMENTS OF BASE SPECIFIED EQUIPMENT. COSTS FOR ANY REVISIONS TO STRUCTURAL DESIGN OR MECHANICAL/ELECTRICAL REQUIREMENTS DUE TO EQUIPMENT SUBSTITUTIONS SHALL BE PAID BY CONTRACTOR.
 3. VERIFYING EXISTING CONDITIONS, REMOVALS AND ALTERATIONS
 - A. THE CONTRACTOR SHALL VISIT THE PREMISES TO DETERMINE EXISTING CONDITIONS AND COMPARE SAME WITH DRAWINGS AND SPECIFICATIONS AND SATISFY HIMSELF OF ALL CONDITIONS PRIOR TO THE SUBMISSION OF A BID PROPOSAL. NO ALLOWANCE WILL BE MADE FOR FAILURE TO COMPLY WITH THESE REQUIREMENTS AND A BID PROPOSAL SHALL BE CONSTRUED AS EVIDENCE HE HAS DONE SO.
 - B. THE CONTRACTOR SHALL REMOVE, RELOCATE, REPLACE, ADJUST, ADAPT AND MODIFY EXISTING EQUIPMENT AND/OR SYSTEMS AS REQUIRED BY THE DRAWINGS OR SPECIFICATIONS AND AS MAY BE REQUIRED WHEN SUCH WORK IS UNCOVERED AND FOUND TO INTERFERE WITH THE COMPLETION OF WORK IN THIS CONTRACT OR OTHER CONTRACT WORK.
 - C. ALL REMOVED EQUIPMENT AND MATERIAL SHALL BE REMOVED FROM THE PROJECT SITE. PRIOR TO REMOVAL, COORDINATE DISPOSITION WITH OWNER.
 - D. PROVIDE SHUTDOWNS, DRAINING AND REFILLING, RECONNECTIONS AND STARTUPS OF EXISTING SYSTEMS NECESSARY IN CONNECTION WITH THE NEW WORK. COORDINATE SHUTDOWNS WITH THE OWNERS REPRESENTATIVE.
 - E. TEMPORARY SERVICES: PROVIDE TEMPORARY SERVICES DURING THE INTERRUPTION IN SERVICE CREATED BY THE DEMOLITION OF THE EXISTING FACILITY AND UNTIL THE NEW FACILITY BECOMES OPERATIONAL. PROVIDE RENTAL EQUIPMENT OF ADEQUATE CAPACITIES AND ASSUME ALL COSTS RELATED TO THIS INSTALLATION AND OPERATION OF SAME.
 4. COORDINATION
 - A. MECHANICAL CONTRACTOR SHALL COORDINATE HIS WORK WITH ALL OTHER TRADES.
 - B. COORDINATE REFRIGERANT PIPING SIZES, ROUTING & SUPPORTS.
 - C. COORDINATE LOCATION OF ROOF CURBS, EQUIPMENT SUPPORTS, AND ROOF PENETRATIONS.
 - D. COORDINATE LOCATION OF MECHANICAL EQUIPMENT, PIPING AND DUCTWORK WITH THE WORK OF OTHER TRADES, PROVIDING CLEARANCES FOR INSULATION, SERVICING, REMOVAL OF COMPONENTS AND EQUIPMENT DISASSEMBLY.
 - E. VERIFY ALL DIMENSIONS BY FIELD MEASUREMENT.
 - F. SEQUENCE PHASES OF MECHANICAL WORK WITH THE WORK OF OTHER TRADES.
 5. SHOP DRAWINGS
 - A. SUBMIT A MINIMUM FIVE (5) COPIES OF MANUFACTURER'S EQUIPMENT DRAWINGS CONSISTING OF: DIMENSIONAL PLANS, PRODUCT, AND PERFORMANCE DATA, WIRING DIAGRAMS, AND OPERATING AND MAINTENANCE INSTRUCTIONS INCLUDING TROUBLE SHOOTING PROCEDURES.
 - B. WORK SHALL NOT PROCEED PRIOR TO SHOP DRAWING RELEASE BY THE ENGINEER WITH STAMPED NOTATION "NO EXCEPTIONS TAKEN" APPLIED.
 6. RECORD DRAWINGS
 - A. REPRODUCIBLE RECORD DRAWINGS SHALL BE SUPPLIED UPON WHICH CORRECTIONS SHALL BE MADE TO PROVIDE AN ACCURATE AND COMPLETE RECORD OF THE WORK AS INSTALLED.
 - B. AS-BUILT INFORMATION SHALL BE SUBMITTED AS FOLLOWS: WORK SHALL NOT PROCEED PRIOR TO SHOP DRAWING RELEASE BY THE ENGINEER WITH STAMPED NOTATION "NO EXCEPTIONS TAKEN" APPLIED.
 - a. ONE (1) SET OF REPRODUCIBLE DRAWINGS.
 - b. TWO (2) SETS OF PRINTS.
 7. DELIVERY AND STORAGE: DELIVER FACTORY FURNISHED MATERIALS AND EQUIPMENT IN PROPER CONTAINERS AND STORE IN AREA PROTECTED FROM WEATHER, FUMES AND VANDALISM.
 8. REMOVALS: REMOVE EXISTING MATERIALS AND EQUIPMENT INDICATED AND REPLACE WITH NEW MATERIALS AS INDICATED.
 9. CUTTING AND PATCHING
 - A. PERFORM CUTTING AND PATCHING IN A COMPETENT AND WORKMANLIKE MANNER WITHOUT DAMAGE TO WORK OR STRUCTURES TO REMAIN.
 - B. CUT REMOVE AND LEGALLY DISPOSE OF DESIGNATED MATERIALS, EQUIPMENT AND COMPONENTS, INCLUDING BUT NOT LIMITED TO GYPSUM BOARD, CONCRETE, CEILING TILE, DUCTS, PIPING AND OTHER MATERIALS REQUIRING REMOVAL TO INSTALL THE NEW WORK.
 - C. PROTECT THE STRUCTURE, FURNISHINGS, FINISHES AND ADJACENT MATERIALS NOT INDICATED OR SCHEDULED TO BE REMOVED.
 - D. PROVIDE AND MAINTAIN TEMPORARY PARTITIONS OR DUST BARRIERS ADEQUATE TO PREVENT THE SPREAD OF DUST AND DIRT TO ADJACENT AREAS.
 - E. PATCH EXISTING FINISHED SURFACES AND BUILDING COMPONENTS USING NEW MATERIALS MATCHING EXISTING MATERIALS. USE EXPERIENCED INSTALLERS TO RESTORE SURFACE OF MATERIALS BEING PATCHED.
 10. GUARANTEE: THE CONTRACTOR SHALL GUARANTEE, IN WRITING, FOR A PERIOD OF ONE YEAR, COMMENCING FROM THE DATE OF ACCEPTANCE BY THE OWNER, ALL MATERIALS AND WORKMANSHIP PROVIDED AS PART OF THIS PROJECT.
 11. INSPECTION
 - A. UNLESS OTHERWISE INDICATED, THE ARRANGEMENT, POSITION, CONNECTIONS, ETC., SHOWN ON THE DRAWINGS SHALL BE TAKEN AS DIAGRAMMATIC.
 - B. THE RIGHT IS RESERVED BY THE ENGINEER TO MAKE MINOR CHANGES IN LOCATIONS AND ARRANGEMENTS WHEN REQUIRED BY JOB DEVELOPMENT WITHOUT ADDITIONAL COMPENSATION TO THIS CONTRACTOR.
 12. SHEET METAL WORK AND ACCESSORIES
 - A. ALL INTERIOR DUCTWORK SHALL BE CONSTRUCTED OF PRIME QUALITY GALVANIZED SHEET STEEL, ASTM A527, G-90 GALVANIZED.
 - B. ALL EXTERIOR DUCTWORK SHALL BE CONSTRUCTED OF PRIME QUALITY GALVANIZED SHEET STEEL, ASTM A527, G-90 GALVANIZED.
 - C. MATERIAL GAUGES AND CONSTRUCTION SHALL BE IN ACCORDANCE WITH SMACNA LOW PRESSURE DUCT CONSTRUCTION STANDARDS FOR 2" W.G. POSITIVE PRESSURE SUPPLY AND 1" W.G. NEGATIVE PRESSURE DUCT.
 - D. PROVIDE 3/8" 1" O" SCALE SHEET METAL SHOP DRAWINGS OF DUCT LAYOUT INDICATING GAUGES, PRESSURES, FITTINGS, REINFORCING DETAILS, SPACING, SEAM AND JOINT CONSTRUCTION DETAILS.
 - E. ALL SHEET METAL DUCTWORK SEAMS, JOINTS AND FLANGES SHALL BE COATED WITH A WATER BASED LOW VOC MASTIC SEALANT APPROVED FOR SUCH USE.
 13. DUCT LINER
 - A. COMPLY WITH NFPA STANDARD 90A ASTM STANDARD AHC-101. ASTM C 1071, TYPE 2, WITH COATED SURFACE EXPOSED TO AIR STREAM TO PREVENT EROSION OF GLASS FIBERS.
 - B. LINER SHALL BE BY JOHNS MANVILLE GO LINACOUSITIC RC OR APPROVED EQUAL.
 14. INTERIOR DUCTWORK
 - a. THICKNESS 1 INCH, DENSITY 1 1/2 POUNDS. THERMAL PERFORMANCE: "K-FACTOR" EQUAL TO 0.28 OR BETTER, AT A MEAN TEMPERATURE OF 75 DEG. F. FLAME SPREAD RATING NOT MORE THAN 26, SMOKE DEVELOPED RATING NO HIGHER THAN 50 WHEN TESTED IN ACCORDANCE WITH ASTM TEST E-84. MINIMUM R-4.2 VALUE.
 15. EXTERIOR DUCTWORK
 - a. THICKNESS 1 1/2 INCH, DENSITY 1 1/2 POUNDS. THERMAL PERFORMANCE: "K-FACTOR" EQUAL TO 0.28 OR BETTER, AT A MEAN TEMPERATURE OF 75 DEG. F. FLAME SPREAD RATING NOT MORE THAN 50, SMOKE DEVELOPED RATING NO HIGHER THAN 100 WHEN TESTED IN ACCORDANCE WITH ASTM TEST E-84. MINIMUM R-6 VALUE.
 - b. THE INSULATED DUCT ASSEMBLY SHALL BE WRAPPED WITH A SHEET TYPE PROTECTIVE MEMBRANE THAT IS UV AND OZONE RESISTANT ALUMINUM CLAD SURFACE WITH HIGH DENSITY CROSS-LINKED POLYETHYLENE WITH MULTIPLE LAYERS WITH A MINIMUM 10 YEAR WARRANTY. PRODUCT SHALL BE VENTURE CLAD #157/CW WITH WHITE FINISH AS MANUFACTURED BY VENTURE TAPE OR ENGINEER APPROVED EQUAL.
 16. LINER ADHESIVE SHALL COMPLY WITH NFPA STANDARD 90A AND ASTM C 916. LINER TO BE AFFIXED TO DUCT WITH LOW VOC ADHESIVE AND WELD PINS IN ACCORDANCE WITH MANUFACTURER'S RECOMMENDATIONS. INCREASE DUCT SIZE TO COMPENSATE FOR LINER THICKNESS.
 17. DUCT INSULATION
 - A. PROVIDE 1 1/2" THICK 12 PCF DENSITY FIBERGLASS BLANKET INSULATION, ASTM C 533 WITH FOIL FACED VAPOR BARRIER JACKET WITH SELF SEALING LAP ON ALL UNLINED SUPPLY AND RETURN AIR DUCT WORK. MINIMUM R-6 VALUE.
 - B. UL LISTED WITH FLAME SPREAD RATING OF 25 OR LESS AND SMOKE DEVELOPED RATING 50 OR LESS. PROVIDE TIGHT CLOSURE AT POINT OF CONNECTION TO EXISTING INSULATION.
 15. FLEXIBLE DUCT
 - A. PROVIDE FLEXIBLE AIR DUCT WHERE INDICATED ON PLANS ONLY.
 - B. DUCT SHALL BE LISTED BY UNDERWRITERS LABORATORIES UNDER UL STANDARD 181 AS CLASS 1 FLEXIBLE AIR DUCT AND COMPLYING WITH NFPA STANDARDS 90A AND 90B.
 - C. DUCT SHALL BE FACTORY FABRICATED, INSULATED, ROUND DUCT, WITH OUTER JACKET ENCLOSING 1" THICK, GLASS FIBER INSULATED AROUND A CONTINUOUS INNER LINER. REINFORCEMENT SHALL BE STEEL WIRE HELD ENCAPSULATED IN THE INNER LINER. OUTER JACKET SHALL BE GLASS-REINFORCED SILVER MYLAR WITH CONTINUOUS HANGING TAB, INTEGRAL FIBERGLASS TAPE, AND NYLON HANGING CORD. INNER LINER SHALL BE POLYETHYLENE FILM. FLEXIBLE DUCT CLAMP SHALL BE STAINLESS STEEL WITH CADMIUM PLATED HEX SCREWS. MINIMUM INSULATION R-4.2 VALUE.
 17. FLEXIBLE CONNECTORS
 - A. FLAME-RETARDED OR NON COMBUSTIBLE FABRICS, COATINGS AND ADHESIVES COMPLYING WITH UL STANDARD 181, CLASS 1, GLASS FABRIC DOUBLE COATED WITH POLYCHLOROPRENE. MINIMUM WEIGHT 26 OZ. PER SQ. YD.
 - B. JOINTS AT FLEXIBLE CONNECTIONS SHALL BE SEALED WITH GASKET MATERIAL IN ACCORDANCE WITH SMACNA DETAIL FIGURE 2-19. FLEXIBLE CONNECTIONS SHALL BE CONSTRUCTED FROM NEOPRENE FLAME RETARDANT FABRIC.
 18. AIR OUTLETS
 - A. FURNISH & INSTALL SUPPLY AIR CEILING DIFFUSERS & REGISTERS, RETURN/EXHAUST AIR CEILING REGISTERS & GRILLES WITH ALL ALUMINUM OR STEEL CONSTRUCTION. THE FINISH SHALL BE BAKED ENAMEL WITH COLORS TO BE SELECTED BY THE ARCHITECT. MANUFACTURED BY TITUS OR APPROVED EQUAL.
 - B. CONFIGURATION: VOLUME-DAMPER ASSEMBLY AND CONTROL COMPONENTS INSIDE UNIT CASING.
 - C. CASINGS: STEEL OR ALUMINUM SHEET METAL OF THE FOLLOWING MINIMUM THICKNESSES: UPSTREAM PRESSURE SIDE: 0.0239-INCH STEEL. DOWNSTREAM PRESSURE SIDE: 0.0179-INCH STEEL.
 - D. ACCESS: REMOVABLE PANELS TO PERMIT ACCESS TO DAMPERS AND OTHER PARTS REQUIRING SERVICE, ADJUSTMENT, OR MAINTENANCE; WITH AIRTIGHT GASKET AND QUARTER TURN LATCHES.
 - E. VOLUME DAMPER: CONSTRUCTION OF GALVANIZED STEEL WITH PERIPHERAL GASKET AND SELF-LUBRICATING BEARINGS. MAXIMUM DAMPER LEAKAGE: 2 PERCENT OF NOMINAL AIRFLOW AT 1-INCH WG INLET STATIC PRESSURE. DAMPER POSITION: NORMALLY CLOSED.
 - F. REGULATOR ASSEMBLY: EXTRUDED-ALUMINUM OR 20-GAGE GALVANIZED-STEEL COMPONENTS; KEY DAMPER BLADES INTO SHAFT WITH NYLON-FITTED PIVOT POINTS LOCATED INSIDE UNIT CASING.
 19. CONTROLS: DAMPER OPERATOR, THERMOSTAT, AND OTHER DEVICES SHALL BE COMPATIBLE WITH THE EXISTING TEMPERATURE CONTROLS & BUILDING MANAGEMENT SYSTEM (BMS).
 20. TESTING AND BALANCING
 - A. INDEPENDENT TESTING AND BALANCING AGENCY SHALL BE RETAINED BY THE CONTRACTOR TO BALANCE THE AIR AND WATER SYSTEMS. THE TEST AND BALANCE AGENCY SHALL HAVE A STATE OF NEW JERSEY PROFESSIONAL ENGINEER ON STAFF OR RETAINED AS A CONSULTANT.
 - B. THE BALANCER SHALL PERFORM WORK IN ACCORDANCE WITH THE AABC NATIONAL STANDARDS FOR TOTAL SYSTEM BALANCE AND THE LATEST EDITION OF THE ASHRAE HANDBOOK.
 - C. MECHANICAL CONTRACTOR SHALL REVIEW ALL CONTRACT DOCUMENTS AND AS-BUILT CONDITIONS PERTAINING TO THE HVAC SYSTEMS. MECHANICAL CONTRACTOR SHALL PROVIDE ALL EQUIPMENT, MATERIAL PARTS, SUPPLIES AND LABOR TO BALANCE ALL HVAC EQUIPMENT TO OWNER'S SATISFACTION.
 - D. SUBMIT CERTIFIED REPORTS CONTAINING SEAL AND SIGNATURE OF THE TEST AND AIR BALANCE ENGINEER CERTIFYING THAT THE SYSTEM WAS TESTED AND BALANCED IN ACCORDANCE WITH REFERENCED STANDARDS, AND IS OPERATING ACCORDING TO THE CONTRACT DOCUMENTS.
 - E. REPORTS SHALL INCLUDE A SINGLE LINE DIAGRAM OF AIR SYSTEMS WITH AIR OUTLETS IDENTIFIED NUMERICALLY. AIR OUTLETS WILL BE TABULATED IN COLUMNAR FORM WITH THE FOLLOWING DATA PROVIDED FOR EACH NUMERICALLY IDENTIFIED OUTLET:
 - a. REGISTER SIZE
 - b. DIFFUSER SIZE
 - c. FREE AREA IN SQUARE FEET, AIR VELOCITY, REGISTER CONSTANT, CFM.
 - d. FOR EACH FAN SUBMIT DESIGN AND RECORDED CFM, STATIC PRESSURE, FAN RPM AND MOTOR AMPERAGE IN SEPARATE VERTICAL COLUMNS.
 - F. PROCEDURES FOR TESTING, ADJUSTING AND BALANCING EXISTING EQUIPMENT THAT IS TO REMAIN AND BE REUSED:
 - a. PERFORM A PRE-CONSTRUCTION INSPECTION OF EXISTING EQUIPMENT THAT IS TO REMAIN AND BE REUSED.
 - MEASURE AND RECORD THE OPERATING SPEED, AIRFLOW AND STATIC PRESSURE OF EACH FAN.
 - MEASURE MOTOR VOLTAGE AND AMPERAGE. COMPARE THE VALUES TO MOTOR NAMEPLATE INFORMATION.
 - CHECK THE CONDITION OF FILTERS.
 - CHECK THE CONDITION OF COILS.
 - CHECK BEARINGS AND OTHER LUBRICATED PARTS FOR PROPER LUBRICATION.
 - CHECK THE OPERATION OF THE DRAIN PAN AND CONDENSATE DRAIN TRAP.
 - REPORT ON THE OPERATING CONDITION OF THE EQUIPMENT AND THE RESULTS OF THE MEASUREMENTS TAKEN. REPORT DEFICIENCIES.
 - b. BEFORE PERFORMING TESTING AND BALANCING OF EXISTING SYSTEMS, INSPECT EXISTING EQUIPMENT THAT IS TO REMAIN AND BE REUSED TO VERIFY THAT EXISTING EQUIPMENT HAS BEEN CLEANED AND REFRUBISHED.
 - NEW FILTERS ARE INSTALLED.
 - COILS ARE CLEAN AND FINS COMBED.
 - DRAIN PANS ARE CLEAN.
 - FANS ARE CLEAN.
 - BEARINGS AND OTHER PARTS ARE PROPERLY LUBRICATED.
 - DEFICIENCIES NOTED IN THE PRECONSTRUCTION REPORT ARE CORRECTED.
 - c. PERFORM TESTING AND BALANCING OF EXISTING SYSTEMS TO THE EXTENT THAT EXISTING SYSTEMS ARE AFFECTED BY THE RENOVATION WORK.
 - COMPARE THE INDICATED AIRFLOWS OF THE RENOVATED WORK TO THE MEASURED FAN AIRFLOWS AND DETERMINE THE NEW FAN, SPEED, FILTER AND COIL FACE VELOCITY.
 - VERIFY THAT THE INDICATED AIRFLOWS OF THE RENOVATED WORK RESULT IN FILTER AND COIL FACE VELOCITIES AND FAN SPEEDS THAT ARE WITHIN THE ACCEPTABLE LIMITS DEFINED BY EQUIPMENT MANUFACTURER.
 - IF CALCULATIONS INCREASE OR DECREASE THE AIRFLOW RATES BY MORE THAN 5 PERCENT, MAKE EQUIPMENT ADJUSTMENTS TO ACHIEVE THE CALCULATED AIRFLOW AND WATER FLOW RATES. IF 5 PERCENT OR LESS, EQUIPMENT ADJUSTMENTS ARE NOT REQUIRED.
 - AIR BALANCE EACH AIR OUTLET.
 - PROVIDE BALANCING REPORT TO THE ENGINEER FOR APPROVAL. BALANCING REPORT TAKEN SHALL BE USED TO BALANCE THE SYSTEM AFTER CONSTRUCTION.
 20. REFRIGERANT PIPING
 - A. ALL REFRIGERANT PIPING SHALL BE COPPER TYPE ACR WITH MATCHING WROUGHT COPPER FITTINGS.
 - B. ALL JOINTS SHALL BR BRAZED, SOLDER JOINTS NOT PERMITTED.
 - C. PIPING SHALL BE INSTALLED IN ACCORDANCE WITH EQUIPMENT MANUFACTURER'S RECOMMENDATIONS, RECOMMENDED GOOD PRACTICE AND CODE PROVISIONS.
 - D. REFRIGERANT PIPING SHALL BE INSULATED WITH MINIMUM 1/2" THICK EXPANDED FOAM BY ARMAFLEX OR APPROVED EQUAL.
 - E. EXTERIOR INSULATED PIPING SHALL HAVE PVC OR ALUMINUM JACKETING TO PROTECT INSULATION FROM ELEMENTS OR VERMIN.
 - F. PRECHARGED LINE SETS ARE PERMITTED AS A SUBSTITUTION FOR FIELD ASSEMBLED PIPING SYSTEMS IF USED ACCORDING TO THEIR LISTINGS AND REFRIGERANT TYPE.
 21. CONDENSATE DRAIN PIPING
 - A. TYPE M. DRAWN TEMPER COPPER TUBING, WROUGHT COPPER FITTINGS AND SOLDERED JOINTS.
 - B. CONDENSATE DRAIN PIPING INSULATION SHALL BE MINERAL-FIBER, PREFORMED PIPE INSULATION, TYPE I: 1 INCH THICK.
 22. ELECTRIC CONTROLS: 24-V DAMPER ACTUATOR WITH WALL MOUNTED ELECTRIC THERMOSTAT AND APPROPRIATE MOUNTING HARDWARE.
 23. HANGERS AND SUPPORTS
 - A. PIPING:
 - a. PROVIDE PIPE HANGERS AND SUPPORTS IN ACCORDANCE WITH PIPE SIZE AND SPAN SCHEDULES IN THE LATEST ADOPTED EDITION OF IMC.
 - b. ALL PIPING SHALL BE SUBSTANTIALLY SUPPORTED FROM THE BUILDING STRUCTURE. ALL HANGERS, RODS AND SUPPORTS SHALL BE SPECIFICALLY APPROVED FOR USE INTENDED. HANGERS AND SUPPORTS SHALL BE INSTALLED IN STRICT CONFORMITY WITH ALL APPLICABLE CODE REQUIREMENTS.
 - c. WHERE OVERHEAD CONSTRUCTION DOES NOT PERMIT FASTENING OF HANGER RODS, INSERTS, ETC. IN REQUIRED LOCATIONS, THE CONTRACTOR SHALL PROVIDE ADDITIONAL STEEL FRAMING AS REQUIRED AND APPROVED.
 - d. EXPANSION SHIELDS SHALL BE PROVIDED TO SUPPORT HANGER RODS AT REQUIRED INTERVALS. EXPANSION SHIELDS SHALL BE "PHILLIPS" ANCHORS, HLLTI CO., OR APPROVED EQUAL.
 - B. DUCTWORK
 - a. PROVIDE HANGERS AND SUPPORTS FOR ALL RIGID DUCTWORK OF COMPATIBLE MATERIAL AS REQUIRED IN ACCORDANCE WITH SMACNA AND ASHRAE RECOMMENDATIONS.
 - b. DUCTWORK SHALL BE SUPPORTED WHERE REQUIRED WITH RESTRAINING CABLES OR STRAPS.
 - c. ROUND FLEXIBLE DUCTWORK TO BE SUPPORTED AS RECOMMENDED BY DUCT MANUFACTURER.
 23. VIBRATION ISOLATION SYSTEMS
 - A. ALL ROTATING, REVOLVING OR RECIPROCATING EQUIPMENT, SHALL BE FURNISHED WITH SEISMICALLY DESIGNED VIBRATION ISOLATORS, TO PREVENT THE TRANSMISSION OF OBJECTIONABLE NOISES, SOUND OR VIBRATIONS TO THE OCCUPIED SPACES AND TO THE BUILDING STRUCTURES.
 - B. VIBRATION ISOLATORS FOR CEILING SUPPORTED EQUIPMENT SHALL BE SUPPORTED FROM STRUCTURE ABOVE AND HAVE A MAXIMUM LATERAL MOTION UNDER EQUIPMENT STARTUP OR SHUTDOWN CONDITIONS OF 1/4". MOTIONS IN EXCESS SHALL BE RESTRAINED BY SPRING TYPE MOUNTINGS.
 - C. VIBRATION ISOLATOR SHALL BE PROVIDED BY ONE OF THE FOLLOWING MANUFACTURERS:
 - a. MASON INDUSTRIAL
 - b. VIBRATION ELMHAMATOR CO.
 - c. CONSOLIDATED KINETICS CO.
 - d. OR APPROVED EQUAL.
 24. MOTOR STARTERS & CONTROL DEVICES
 - A. FURNISH TO THE ELECTRICAL CONTRACTOR WHO SHALL INSTALL AND WIRE STARTER AND CONTROL EQUIPMENT FOR ALL MOTORS.
 - B. MOTOR STARTERS SHALL BE CUTLER HAMMER, WESTINGHOUSE OR ALLEN-BRADLEY MANUFACTURE, SUITABLE FOR WALL OR ANGLE IRON FRAME MOUNTING.
 - C. GENERAL NOTES:
 - a. ALL STARTERS FOR MOTOR 1/2 HP AND ABOVE SHALL BE MAGNETIC ACROSS-THE-LINE TYPE WITH HOA SWITCH. SUCH STARTERS SHALL BE 208 OR 480 VOLTS, 3 PHASE, 60 CYCLE.
 - b. ALL MAGNETIC STARTERS SUBJECT TO MANUAL START AND IN DIRECT VIEW OF THE MOTORS THEY CONTROL, SHALL HAVE MOMENTARY CONTACT START AND STOP BUTTONS AND PILOT LIGHT BUILT INTO COVER. ALL SELECTOR SWITCHES IN STARTERS SHALL BE OF THE MAINTAIN CONTACT TYPE.
 - c. WHERE STARTERS ARE NOT IN SIGHT OF MOTORS THEY CONTROL, A LOCAL DISCONNECT SWITCH WILL BE PROVIDED BY THE ELECTRICAL CONTRACTOR.
 - d. ALL MAGNETIC STARTERS SHALL HAVE THERMAL OVERLOAD IN EACH PHASE LEG AND LOW VOLTAGE PROTECTION.
 - e. ALL COILS, CORES, RESISTANCE, INSULATION CONTACTS, TRIPPERS, ETC. OF STARTERS AND RELAYS SHALL BE OF THE APPROVED TYPE IN ACCORDANCE WITH MOTOR NAMEPLATE DATA. ALL PARTS SUBJECT TO WEAR, ARCING, ETC., SHALL BE RENEWABLE.
 - f. ALL WIRING, STARTERS, SWITCHES, ETC., SHALL BE IN FULL ACCORDANCE WITH ALL LOCAL AND INSURANCE UNDERWRITERS' CODE REQUIREMENTS.
 - g. FURNISH DETAILED COMPOSITE WIRING DIAGRAMS FOR THOSE INSTALLING THE ELECTRICAL WORK, AND FURNISH SUCH OTHER INFORMATION NECESSARY TO ASSURE THE PROPER CONNECTION AND GROUNDING REQUIREMENTS, OPERATION AND CONTROL OF MOTORIZED EQUIPMENT, INCLUDING INTERLOCKS, AUTOMATIC OR SAFETY CONTROLS AND AUXILIARY CIRCUITS.
 - h. PROVIDE LAMACODE NAMEPLATE ATTACHED TO EACH STARTER IDENTIFYING THE SYSTEM IT SERVES.
25. PIPE COVER SYSTEMS
 - A. PIPE ENCLOSURES SHALL EXTEND FROM FLOOR OR TOP OF FIN-TUBE RADIATION COVER AND TERMINATE JUST ABOVE CEILING.
 - B. SHEET METAL CONTRACTOR SHALL COORDINATE WITH MECHANICAL AND ELECTRICAL CONTRACTOR FOR REQUIRED SIZES AND LOCATION OF PIPE/ELECTRICAL SERVICE COVERS. FINAL SIZES AND LOCATIONS WILL BE PREDICATED ON SLAB CORE LOCATIONS AND INSULATED PIPE SIZES OVERALL.
 - C. LOCATE AND PLACE FORMED METAL ITEMS LEVEL AND PLUMB AND IN ALIGNMENT WITH ADJACENT CONSTRUCTION. PERFORM CUTTING, DRILLING, AND FITTING REQUIRED TO INSTALL FORMED METAL.
 - a. DO NOT CUT OR ABRASE FINISHES THAT CANNOT BE COMPLETELY RESTORED IN THE FIELD. RETURN ITEMS WITH SUCH FINISHES TO THE SHOP FOR REQUIRED ALTERATIONS, FOLLOWED BY COMPLETE REFINISHING, OR PROVIDE NEW UNITS AS REQUIRED.
 - D. FORM TIGHT JOINTS WITH EXPOSED CONNECTIONS ACCURATELY FITTED TOGETHER. PROVIDE REVEALS AND OPENINGS FOR SEALANTS AND JOINT FILLERS AS REQUIRED.
 - E. TOUCHUP PAINTING: IMMEDIATELY AFTER ERECTION, CLEAN FIELD WELDS, BOLTED CONNECTIONS, AND ABRASED AREAS OF SHOP PAINT, AND PAINT EXPOSED AREAS WITH THE SAME MATERIAL AS USED FOR SHOP PAINTING TO COMPLY WITH SSPC-PA 1 FOR TOUCHING UP SHOP-PAINTED SURFACES.
 - a. APPLY BY BRUSH OR SPRAY TO PROVIDE A MINIMUM 2.0-MIL (0.05-MM) DRY FILM THICKNESS.
 - b. RESTORE FINISHES DAMAGED DURING INSTALLATION AND CONSTRUCTION PERIOD SO NO EVIDENCE REMAINS OF CORROSION WORK. RETURN ITEMS THAT CANNOT BE REFINISHED IN THE FIELD TO THE SHOP, MAKE REQUIRED ALTERATIONS AND REFINISH ENTIRE UNIT OR PROVIDE NEW UNITS.
- F. MATERIALS
 - a. SHEET METAL: PROVIDE SHEET METAL WITHOUT PITTING, SEAM MARKS, ROLLER MARKS, STAINS, DISCOLORATIONS OR OTHER IMPERFECTIONS WHERE EXPOSED TO VIEW ON FINISHED UNITS.
 - b. INTERIOR SEALANT: NONSAG, PAINTABLE, NONSTAINING, LATEX SEALANT COMPLYING WITH ASTM C 834; OF TYPE AND GRADE REQUIRED TO SEAL JOINTS IN DECORATIVE FORMED METAL, AND AS RECOMMENDED IN WRITING BY DECORATIVE FORMED METAL MANUFACTURER. USE SEALANT THAT HAS A VOC CONTENT OF NOT MORE THAN 290 G/L WHEN CALCULATED ACCORDING TO 40 CFR 59, SUBPART D (EPA METHOD 24).
 - c. FASTENERS: FABRICATED FROM SAME BASIC METAL AND ALLOY AS FASTENED METAL UNLESS OTHERWISE INDICATED. DO NOT USE METALS THAT ARE INCOMPATIBLE WITH MATERIALS JOINED.
 - PROVIDE CONCEALED FASTENERS FOR INTERCONNECTING FORMED METAL ITEMS AND FOR ATTACHING THEM TO OTHER WORK OR SURFACES.
 - PROVIDE PHILLIPS OVAL-HEAD MACHINE SCREWS FOR EXPOSED FASTENERS UNLESS OTHERWISE INDICATED.
 - d. PRE-ASSEMBLED FORMED METAL ITEMS IN SHOP TO GREATEST EXTENT POSSIBLE TO MINIMUM FIELD SPICINGS AND ASSEMBLY.
26. EQUIPMENT SUPPORTS (CURBS)
 - A. DELEGATED DESIGN: DESIGN RTU SUPPORTS TO COMPLY WITH WIND AND SEISMIC PERFORMANCE REQUIREMENTS, INCLUDING COMPREHENSIVE ENGINEERING ANALYSIS BY A QUALIFIED PROFESSIONAL ENGINEER, USING PERFORMANCE REQUIREMENTS AND DESIGN CRITERIA INDICATED.
 - B. WIND-RESTRAINT PERFORMANCE:
 - a. BASIC WIND SPEED: 115 MPH.F MEMBRANE SYSTEM.
 - C. MANUFACTURER WIND LOADING QUALIFICATION CERTIFICATION: SUBMIT CERTIFICATION THAT SPECIFIED EQUIPMENT WILL WITHSTAND WIND FORCES IDENTIFIED IN "PERFORMANCE REQUIREMENTS" ARTICLE AND IN DIVISION 23 SECTION "VIBRATION AND SEISMIC CONTROLS FOR HVAC PIPING AND EQUIPMENT".
 - d. BASIS FOR CERTIFICATION: INDICATE WHETHER WITHSTAND CERTIFICATION IS BASED ON ACTUAL TEST OF ASSEMBLED COMPONENTS OR ON CALCULATIONS.
 - e. DIMENSIONED OUTLINE DRAWINGS OF EQUIPMENT UNIT: IDENTIFY CENTER OF WIND FORCE AND LOCATE AND DESCRIBE MOUNTING AND ANCHORAGE PROVISIONS.
 - f. DETAILED DESCRIPTION OF EQUIPMENT ANCHORAGE DEVICES ON WHICH THE CERTIFICATION IS BASED AND THEIR INSTALLATION REQUIREMENTS.
- D. COORDINATION DRAWINGS: PLANS AND OTHER DETAILS, DRAWN TO SCALE, ON WHICH THE FOLLOWING ITEMS ARE SHOWN AND COORDINATED WITH EACH OTHER, USING INPUT FROM INSTALLERS OF THE ITEMS INVOLVED:
 - e. STRUCTURAL MEMBERS TO WHICH RTUS WILL BE ATTACHED.
 - f. ROOF OPENINGS
 - g. ROOF CURBS AND FLASHING.
- E. FIELD QUALITY-CONTROL TEST REPORTS.
- F. OPERATION AND MAINTENANCE DATA: FOR RTUS TO INCLUDE IN EMERGENCY, OPERATION, AND MAINTENANCE MANUALS.

SEQUENCE OF OPERATION

- ROOFTOP UNIT:
1. OCCUPIED MODE:
 - a. THE SUPPLY FAN SHALL RUN CONTINUOUSLY. THE DX COOLING SHALL STAGE TO MAINTAIN THE DISCHARGE AIR TEMPERATURE SETPOINT. THE DISCHARGE AIR TEMPERATURE SETPOINT SHALL BE DYNAMICALLY RESET BASED ON THE DEVIATION OF ACTUAL SPACE TEMPERATURE FROM THE ACTIVE SPACE TEMPERATURE SETPOINT.
 2. UNOCCUPIED
 - a. WHEN THE SPACE TEMPERATURE IS ABOVE THE COOLING SETPOINT, THE SUPPLY FAN SHALL START AND THE DX COOLING SHALL BE ENABLED. WHEN THE SPACE TEMPERATURE FALLS BELOW THE COOLING SETPOINT, THE SUPPLY FAN SHALL STOP AND THE DX COOLING SHALL BE DISABLED.
- AIR HANDLING UNIT:
1. EVAPORATOR FAN
 - a. OCCUPIED: FAN SHALL BE ON DURING ALL OCCUPIED PERIODS PER BUILDING SCHEDULE TO PROVIDE CODE REQUIRED MECHANICAL VENTILATION. OUTDOOR AIR DAMPER SHALL BE OPEN TO MINIMUM POSITION DURING ALL OCCUPIED PERIODS.
 - b. UNOCCUPIED: FAN SHALL CYCLE AS NECESSARY TO MAINTAIN ADJUSTABLE SETBACK TEMPERATURE (60°F HEATING / 85°F COOLING) DURING UNOCCUPIED PERIODS PER BUILDING SCHEDULE. OUTDOOR AIR DAMPER SHALL BE CLOSED DURING ALL UNOCCUPIED PERIODS EXCEPT DURING ECONOMIZER OPERATION.
 2. COOLING
 - a. ENGAGE COMPRESSOR 1ST STAGE TO MAINTAIN ADJUSTABLE COOLING SPACE SETPOINT TEMPERATURE (75°F). ENGAGE COMPRESSOR 2ND STAGE AS AVAILABLE WHERE NECESSARY IF 1ST STAGE RUNS CONTINUOUSLY AND DOES NOT ACHIEVE DISCHARGE AIR TEMPERATURE AFTER ADJUSTABLE TIME DURATION (4 MINUTES). CONDENSER FAN(S) SHALL CYCLE AS NECESSARY FOR PROPER COMPRESSOR OPERATION.



YONKERS MEDIUM SCOPE RENOVATION

928 McLean Avenue
Yonkers, NY 10704

10 North Park Place
Suite 400
Morristown, NJ 07960
Telephone 973.290.8500
Facsimile 973.290.8585



Corporate Office
1800 Route 34, Suite 101
Wall, NJ 07719
732.312.8800
Regional Offices
Hackettstown, NJ
New York, NY

AMIN H. GOMAA, PE
PROFESSIONAL ENGINEER, NJ LIC. NO. 24GE04842100

Issue	Date & Issue Description	By	Check
01	10/09/20	CTH	JDS
	ISSUED FOR BID		
02	02/03/2021		
	ISSUE FOR PERMIT & PRICING II		
03	07/15/2021		
	ISSUE FOR PERMIT & PRICING VI		

Seal/Signature

Project Name
YONKERS - MEDIUM RENOVATION

Prototype Layout

CAD File Name


Description
MECHANICAL SPECIFICATIONS

Scale
AS SHOWN

M-002



Ref. North

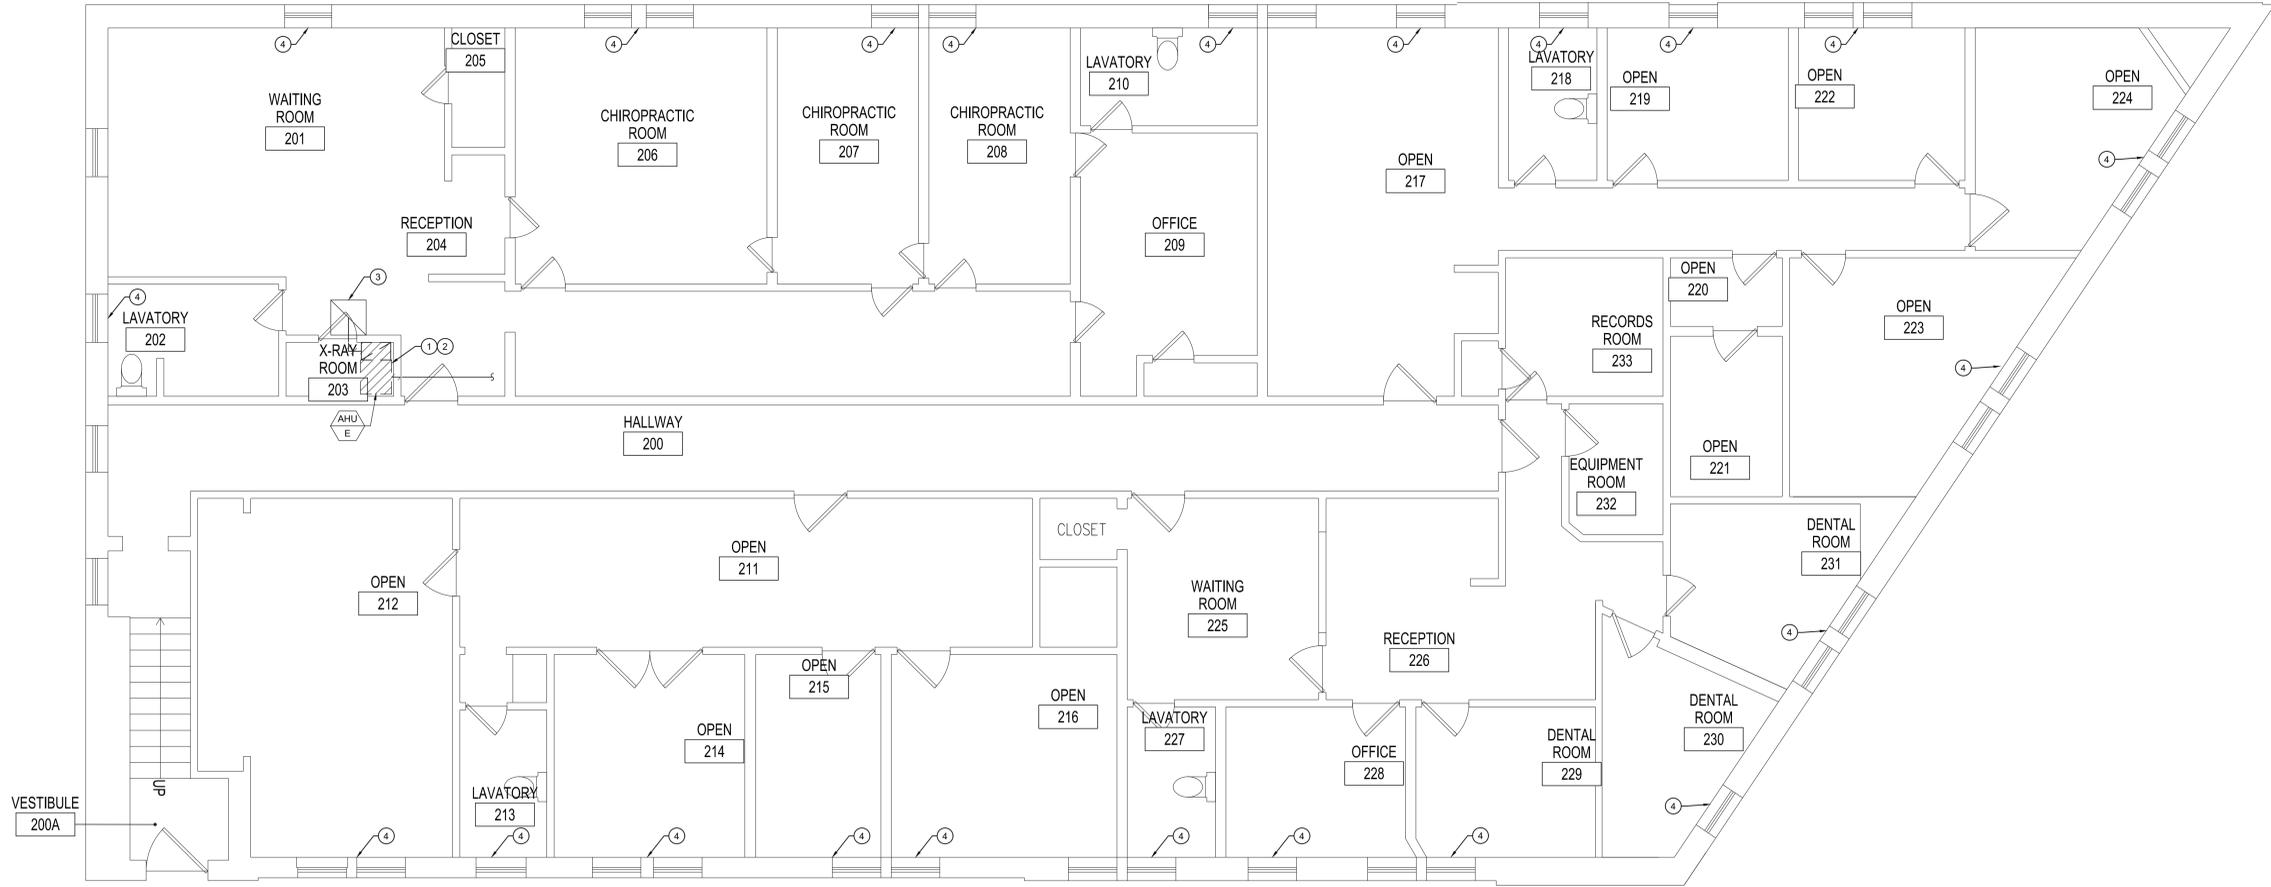

Issue	Date & Issue Description	By	Check
01	10/09/20 ISSUED FOR BID	CTH	JDS
02	02/03/2021 ISSUE FOR PERMIT & PRICING II		
03	07/15/2021 ISSUE FOR PERMIT & PRICING VI		

SECOND FLOOR DEMOLITION PLAN
 SCALE: 1/4" = 1'-0"

- ① REMOVE EXISTING AIR HANDLING UNIT. CONTRACTOR TO DEMOLISH EXISTING REFRIGERANT PIPING FROM INDOOR AIR HANDLING UNIT TO CONDENSING UNIT ON THE ROOF. PATCH ALL SURFACES DISTURBED OR LEFT UNFINISHED BY THIS WORK TO MATCH ADJACENT SURFACES.
- ② REMOVE AND DISCARD THAT PORTION OF EXISTING SUPPLY AND RETURN DUCTWORK AS SHOWN INCLUDING AIR DEVICE, DAMPERS, SUPPORTS, REGISTERS/DIFFUSERS AND ALL ASSOCIATED ACCESSORIES AS SHOWN TO MAINS. MAKE REMAINING DUCTWORK READY FOR CONNECTION TO NEW. SEE FLOOR PLAN FOR ADDITIONAL INFORMATION. PATCH ALL SURFACES DISTURBED OR LEFT UNFINISHED BY THIS WORK TO MATCH ADJACENT SURFACES.
- ③ EXISTING TO REMAIN.
- ④ EXISTING FIN TUBE RADIATORS TO REMAIN IN THIS ROOM. CONTRACTOR SHALL INSPECT ALL RADIATORS AND CONFIRM OPERATIONAL. REPLACE AND/OR REPAIR PARTS OF RADIATORS THAT ARE DEFECTIVE.

KEY NOTES

Seal/Signature

Project Name
 YONKERS - MEDIUM RENOVATION


Prototype Layout

CAD File Name

Description
 MECHANICAL SECOND FLOOR DEMOLITION PLAN

Scale
 AS SHOWN

M-100 Ref. North

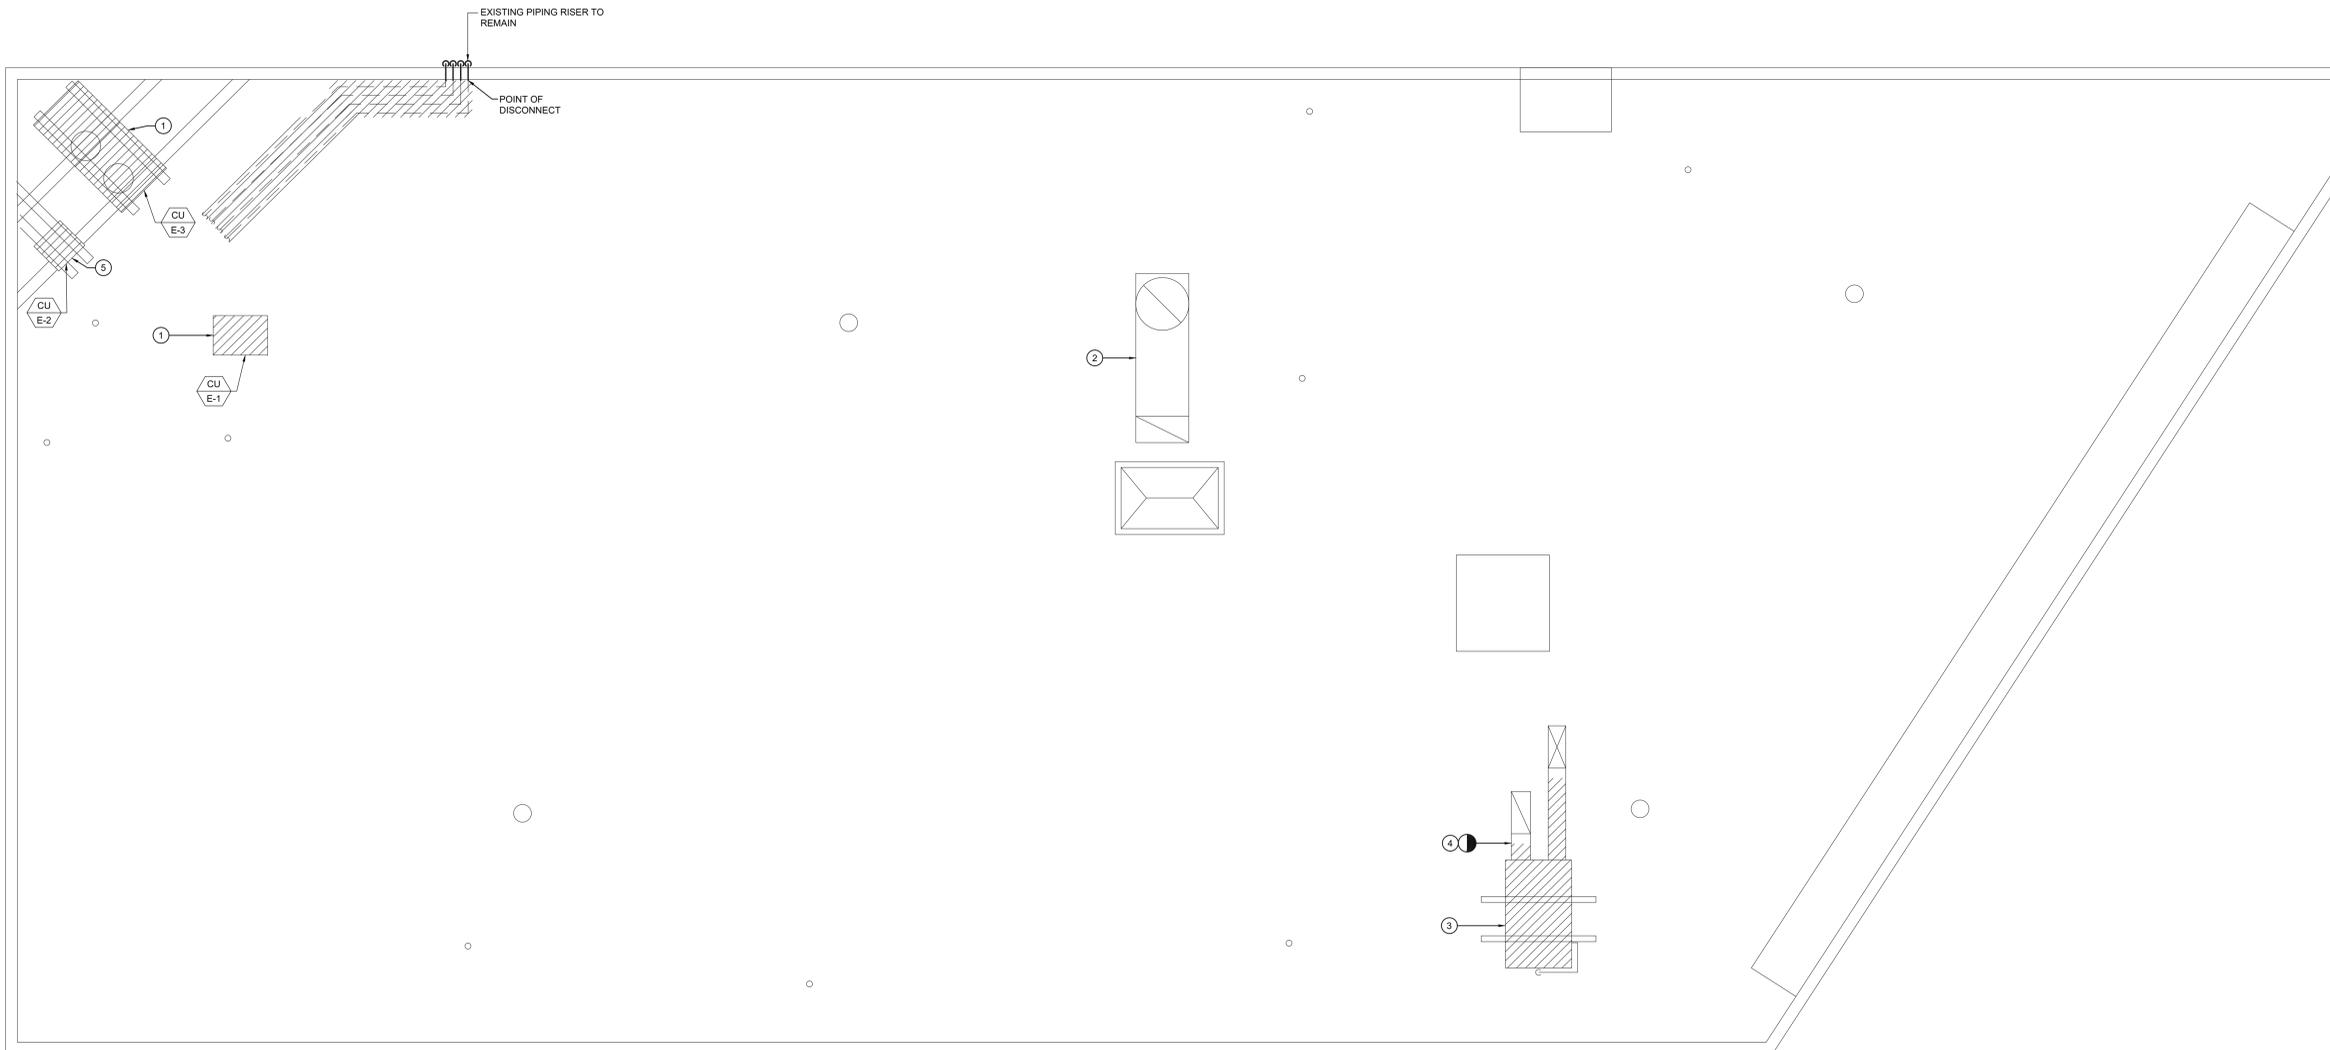

Issue	Date & Issue Description	By	Check
01	10/09/20 ISSUED FOR BID	CTH	JDS
02	02/03/2021 ISSUE FOR PERMIT & PRICING II		
03	07/15/2021 ISSUE FOR PERMIT & PRICING VI		

DEMOLITION PLAN - ROOF PLAN
 SCALE: 1/4" = 1'-0"

- ① REMOVE AND DISCARD EXISTING CONDENSING UNIT, PIPING, SUPPORTS, AND ALL ASSOCIATED ACCESSORIES. SEE GENERAL NOTES. PATCH ALL SURFACES DISTURBED OR LEFT UNFINISHED BY THIS WORK TO MATCH ADJACENT SURFACES.
- ② EXISTING EXHAUST TO REMAIN.
- ③ REMOVE AND DISCARD EXISTING UNIT, DUCTWORK, DAMPERS, REGISTERS/DIFFUSERS, SUPPORTS AND ALL ASSOCIATED ACCESSORIES. INFILL ROOF DECK WITH ASSOCIATED FRAMING AND PROVIDE ROOFING TO MATCH EXISTING & SEAL WEATHERTIGHT. MAINTAIN ROOF WARRANTY AS APPLICABLE. PATCH ALL SURFACES DISTURBED OR LEFT UNFINISHED BY THIS WORK TO MATCH ADJACENT SURFACES.
- ④ REMOVE AND DISCARD THAT PORTION OF EXISTING DUCTWORK INCLUDING DAMPERS, SUPPORTS AND ALL ASSOCIATED ACCESSORIES AS SHOWN. MAKE REMAINING DUCTWORK READY FOR CONNECTION TO NEW PATCH ALL SURFACES DISTURBED OR LEFT UNFINISHED BY THIS WORK TO MATCH ADJACENT SURFACES.
- ⑤ REMOVE AND DISCARD EXISTING UNIT, SUPPORTS AND ALL ASSOCIATED ACCESSORIES. EXISTING REFRIGERANT PIPES TO REMAIN. EXTEND THE EXISTING REFRIGERANT PIPING TO NEW LOCATION. SEE NEW WORK PLAN FOR ADDITIONAL INFORMATION. PATCH ALL SURFACES DISTURBED OR LEFT UNFINISHED BY THIS WORK TO MATCH ADJACENT SURFACES.

KEY NOTES

Seal/Signature

Project Name
 YONKERS - MEDIUM RENOVATION


Prototype Layout

CAD File Name

Description
 MECHANICAL ROOF DEMOLITION PLAN

Scale
 AS SHOWN

M-101 Ref. North

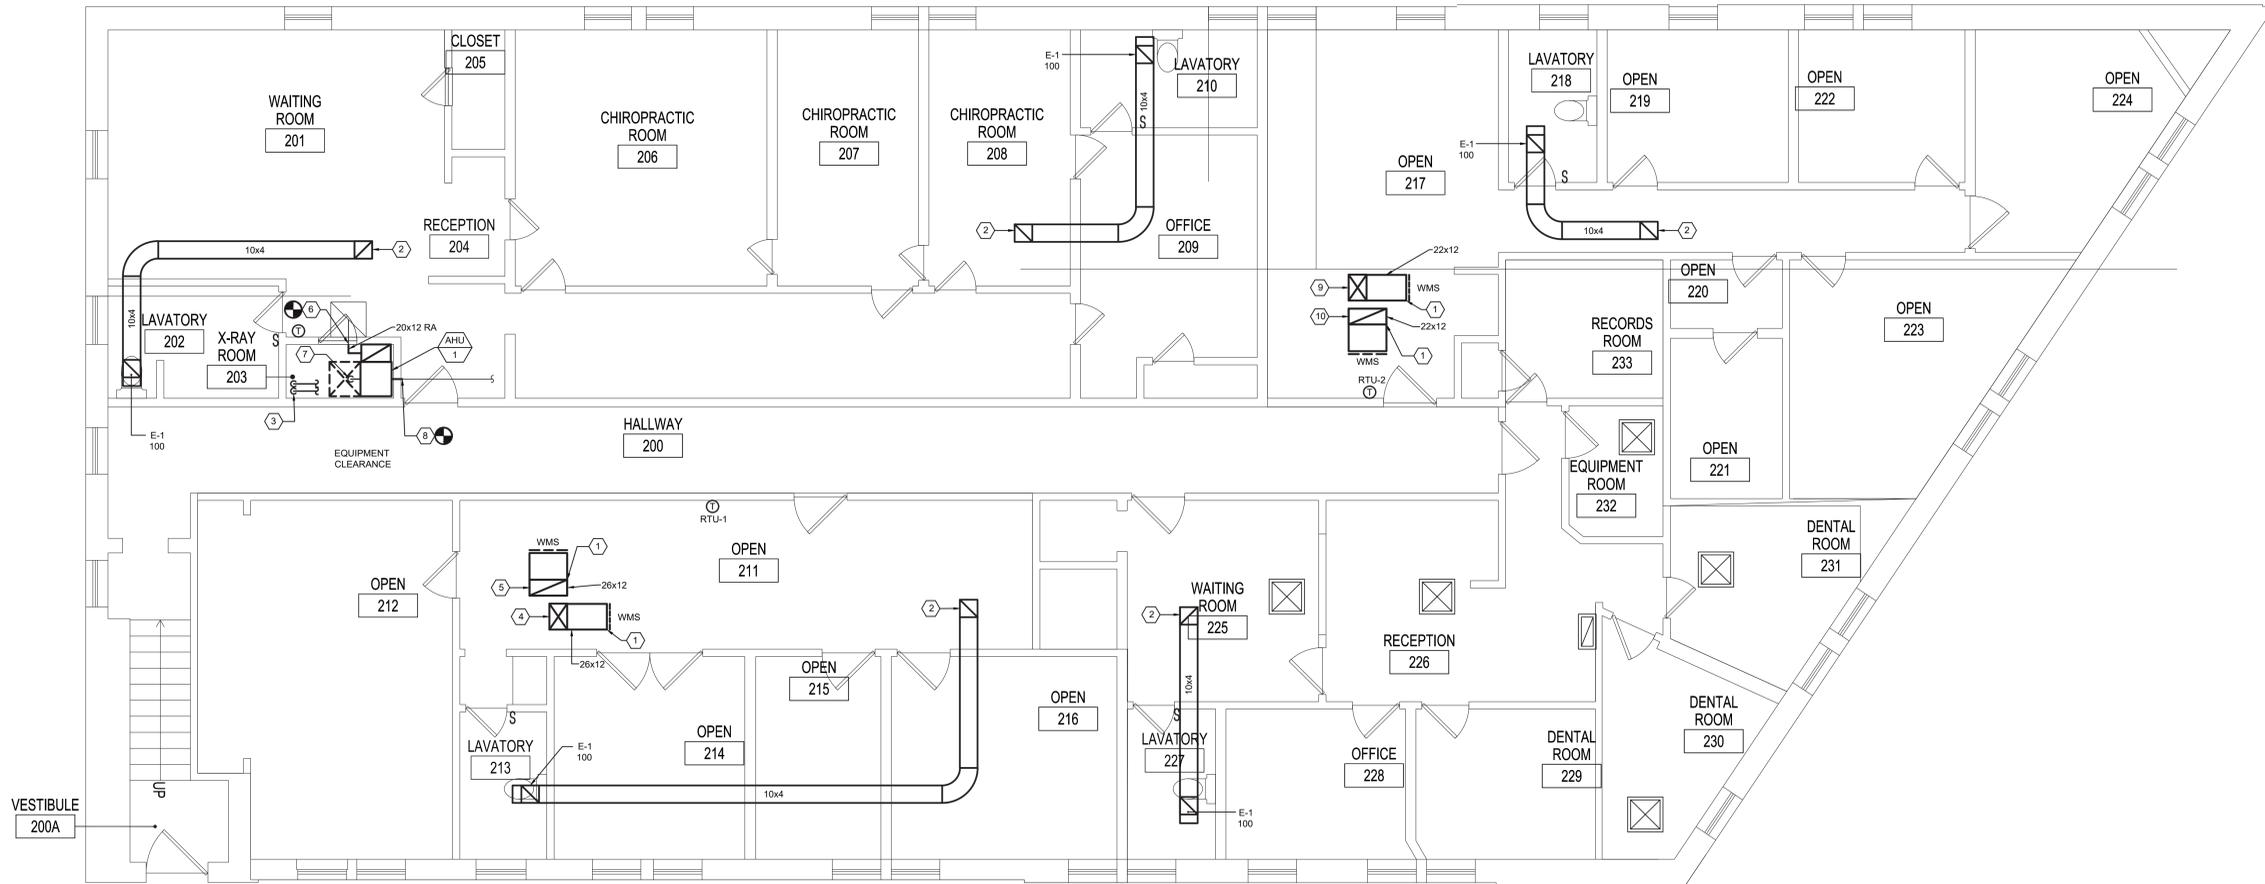

Issue	Date & Issue Description	By	Check
01	10/09/20 ISSUED FOR BID	CTH	JDS
02	02/03/2021 ISSUE FOR PERMIT & PRICING II		
03	07/15/2021 ISSUE FOR PERMIT & PRICING VI		

SECOND FLOOR PLAN
 SCALE: 1/4" = 1'-0"

- ① DUCTWORK TO BE TERMINATED WITH WIRE MESH SCREEN FOR FUTURE TENANT USE.
- ② 10"x4" EXHAUST DUCTWORK UP TO FAN LOCATED ON ROOF. TRANSITION DUCTWORK TO THE FAN AS REQUIRED. REFER TO SHEET M-201 FOR CONTINUATION.
- ③ REFRIGERANT PIPING - SUCTION AND LIQUID UP TO ROOF. SIZE AND ROUTING AS PER MANUFACTURER'S RECOMMENDATIONS. PROVIDE SUPPORTS AS REQUIRED. SEE SPECIFICATIONS FOR ADDITIONAL INFORMATION. LOCATION OF UNIT IS APPROXIMATE. FIELD VERIFY AND COORDINATE WITH ARCHITECT FOR EXACT LOCATION.
- ④ 26x12 SUPPLY DUCT UP TO ROOFTOP UNIT ON ROOF. TRANSITION TO UNIT AS REQUIRED.
- ⑤ 26x12 RETURN DUCT UP TO ROOFTOP UNIT ON ROOF. TRANSITION TO UNIT AS REQUIRED.
- ⑥ CONNECT NEW 20x12 RETURN DUCTWORK TO EXISTING RETURN DUCTWORK AT WALL PENETRATION.
- ⑦ CONTRACTOR TO EXTEND 3/4" CONDENSATE TO EXISTING DRAIN.
- ⑧ CONNECT NEW 20x12 SUPPLY DUCTWORK TO EXISTING SUPPLY DUCTWORK AT WALL PENETRATION.
- ⑧ 22x12 SUPPLY DUCT UP TO ROOFTOP UNIT ON ROOF. TRANSITION TO UNIT AS REQUIRED.
- ⑩ 22x12 RETURN DUCT UP TO ROOFTOP UNIT ON ROOF. TRANSITION TO UNIT AS REQUIRED.

KEY NOTES

Seal/Signature


Project Name
 YONKERS - MEDIUM RENOVATION

Prototype Layout
 CAD File Name

Description
 MECHANICAL SECOND FLOOR PLAN

Scale
 AS SHOWN

M-200 Ref. North

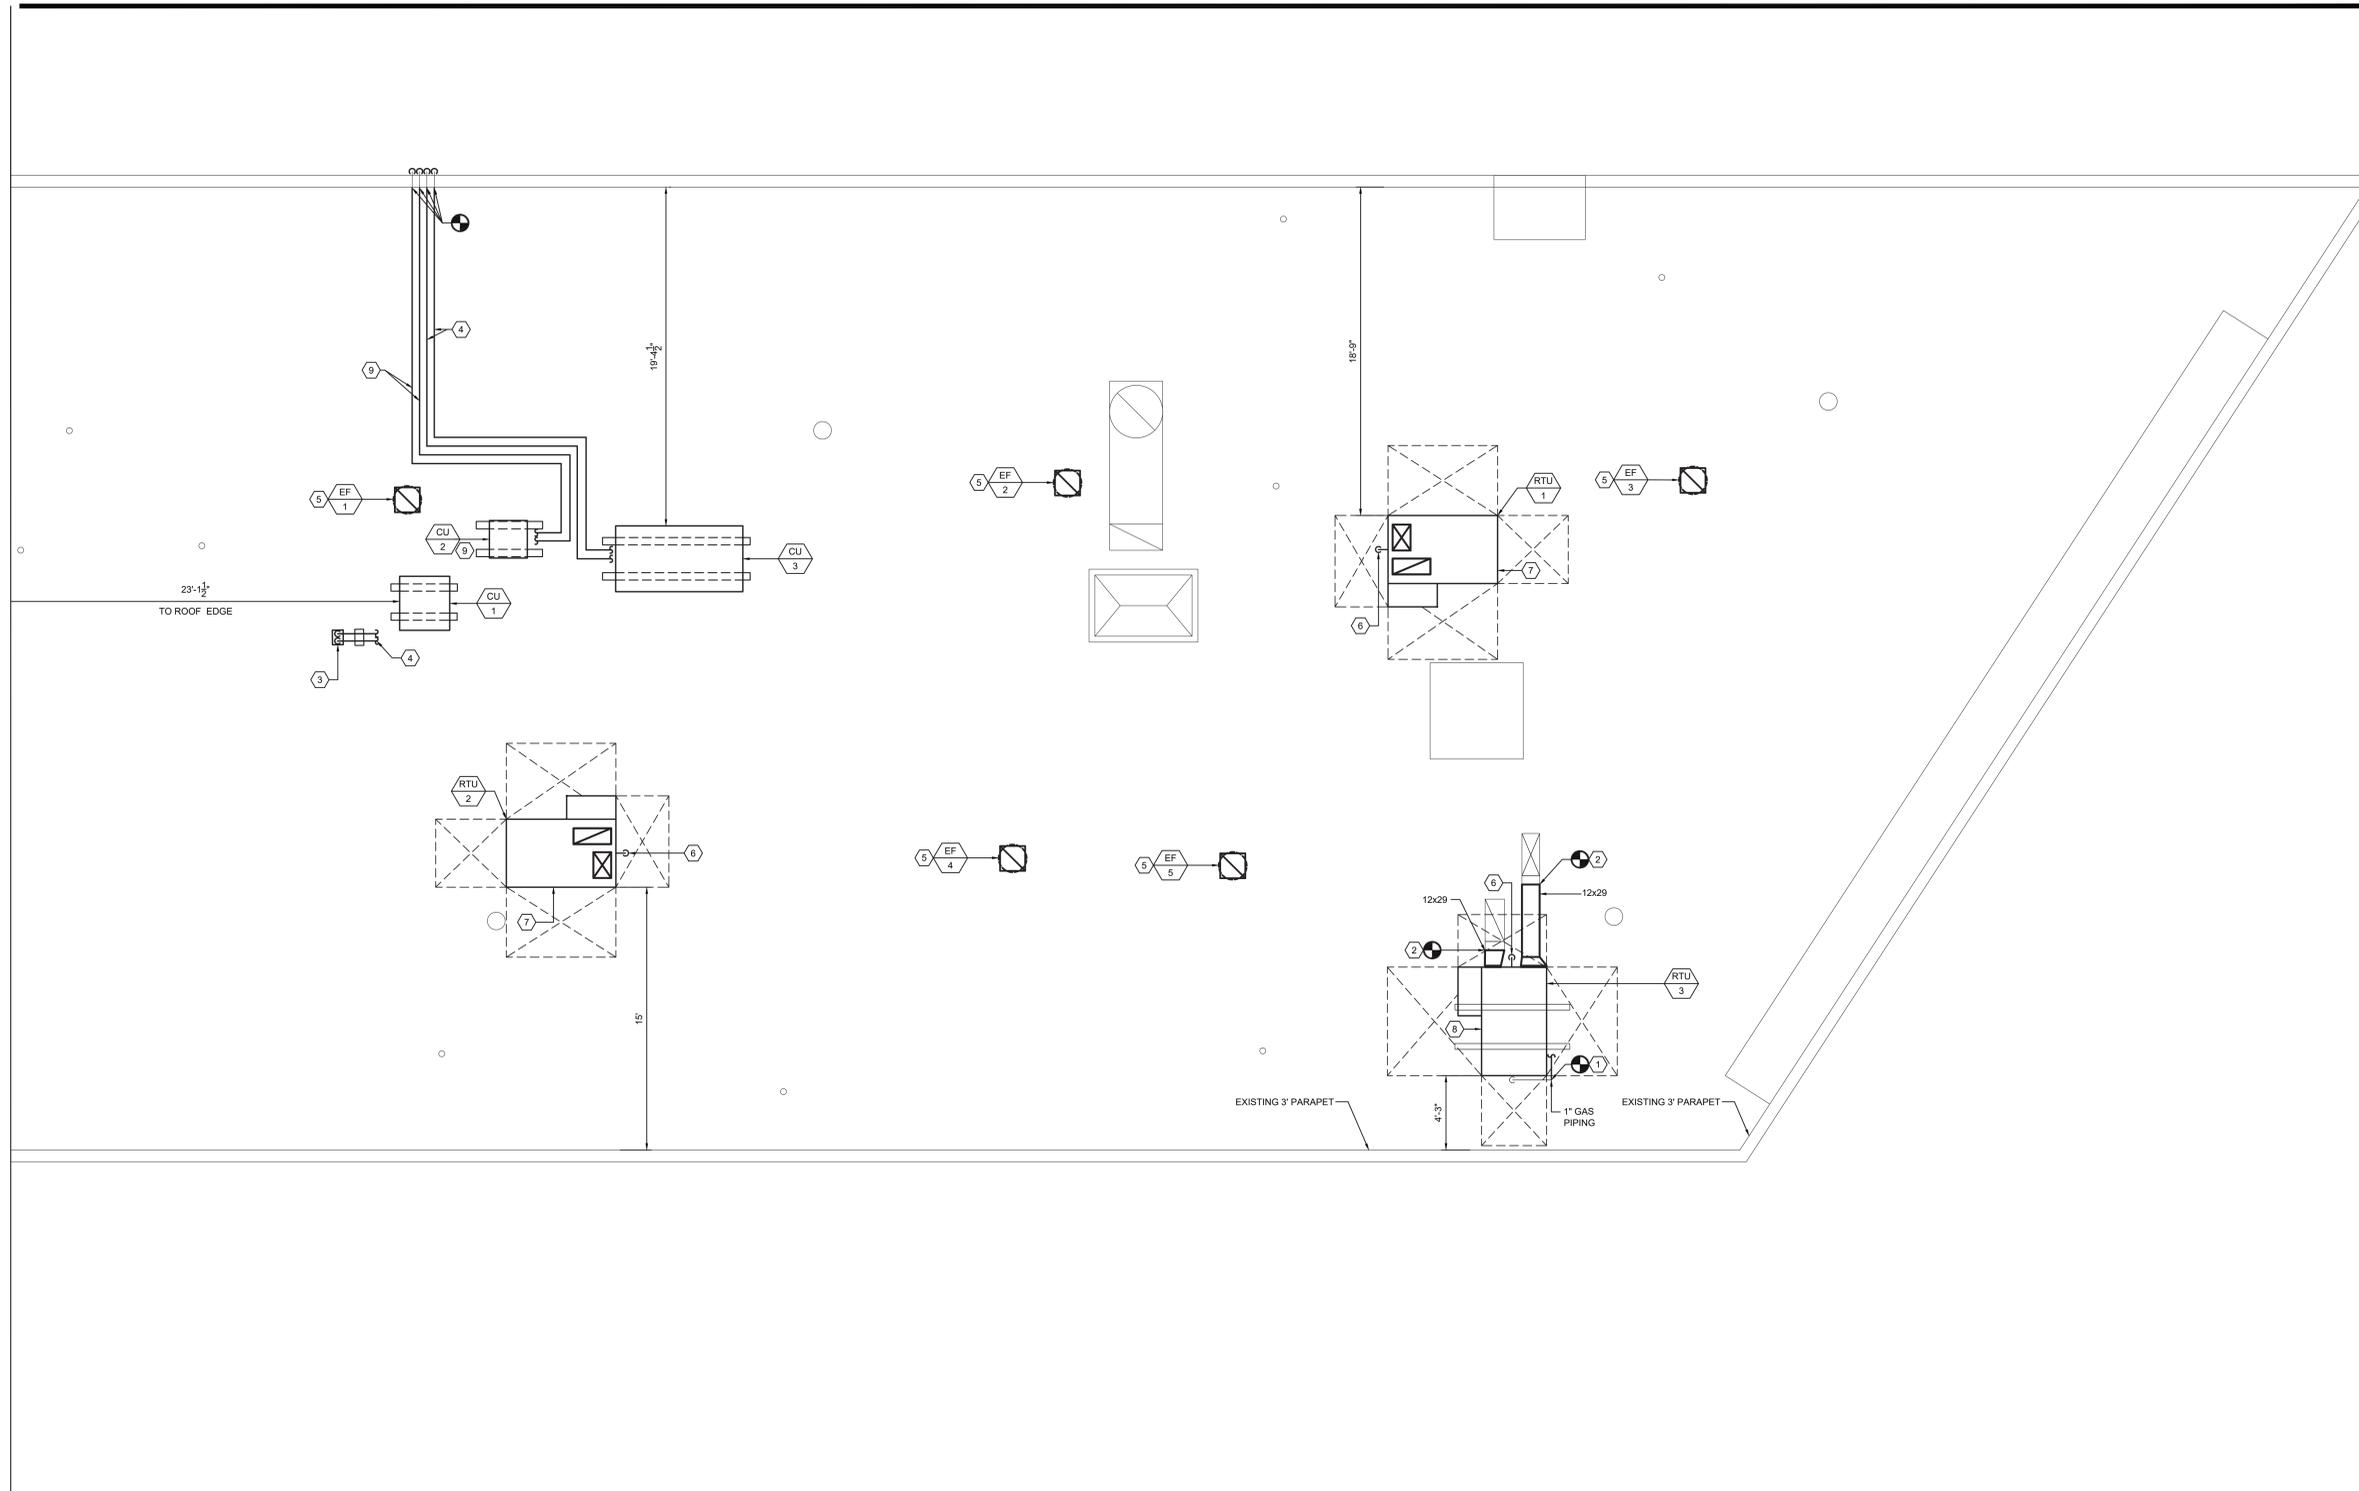

ROOF PLAN
 SCALE: 1/4" = 1'-0"

- ① PROVIDE NEW 1" GAS AND CONNECT TO EXISTING GAS PIPING.
- ② CONNECT TO EXISTING DUCTWORK 6" DOWN FROM ELBOW.
- ③ PROVIDE ROOF PORTAL, PATE CO OR EQUAL. PROVIDE SEPARATE BOOT FOR EACH PIPE. PROVIDE ADDITIONAL BOOTS FOR ELECTRICAL POWER AND CONTROL CONDUITS. DO NOT PASS MORE THAN (1) PIPE THRU EACH BOOT TO FACILITATE PROPER SEALING.
- ④ REFRIGERANT PIPING - SUCTION AND LIQUID UP TO ROOF. SIZE AND ROUTING AS PER MANUFACTURER'S RECOMMENDATIONS. PROVIDE SUPPORTS AS REQUIRED. SEE SPECIFICATIONS FOR ADDITIONAL INFORMATION.
- ⑤ TRANSITION EXHAUST DUCT TO EXHAUST FAN AS REQUIRED.
- ⑥ FULL SIZE CONDENSATE DRAIN WITH MINIMUM 2" DEEP TRAP. DISCHARGE TO SPLASH BLOCK.
- ⑦ PROVIDE NEW WIND-RATED ROOF CURB BY VMC OR ENGINEER APPROVED EQUAL. PATCH ALL SURFACES DISTURBED OR LEFT UNFINISHED BY THIS WORK TO MATCH ADJACENT SURFACES.
- ⑧ SUPPORT FROM EXISTING RAILS. ADD SUPPLEMENTAL SUPPORT AS REQUIRED FOR PROPER INSTALLATION.
- ⑨ CONNECT NEW REFRIGERANT PIPING - GAS & LIQUID TO EXISTING PIPING. FIELD VERIFY EXACT LOCATION AND SIZE OF EXISTING PIPING. COORDINATE WITH UNIT MANUFACTURER FOR PIPE SIZE. SEE PIPING DETAILS FOR ADDITIONAL INFORMATION.

KEY NOTES

Issue	Date & Issue Description	By	Check
01	10/09/20 ISSUED FOR BID	CTH	JDS
02	02/03/2021 ISSUE FOR PERMIT & PRICING II		
03	07/15/2021 ISSUE FOR PERMIT & PRICING VI		

Seal/Signature

Project Name
 YONKERS - MEDIUM RENOVATION

Prototype Layout

CAD File Name

Description
 MECHANICAL ROOF PLAN

Scale
 AS SHOWN

© 2021 FPA - Bank of America Branch Location: 928 McLean Ave, Yonkers, NY 10704. File Name: M-201.dwg
 COPYRIGHT © 2018, FRENCH & PARRELO ASSOCIATES, PA. THE COPYING OR REUSE OF THIS DOCUMENT, OR PORTIONS THEREOF, WITHOUT THE WRITTEN PERMISSION OF FRENCH & PARRELO ASSOCIATES, PA IS PROHIBITED. DUE TO INHERENT ERRORS IN REPRODUCTION METHODS, ERRORS MAY OCCUR WHEN SCALING THIS DRAWING.

SCHEDULES

PACKAGED GAS-FIRED ROOF TOP UNIT SCHEDULE



GENERAL DATA			SUPPLY FAN					COOLING (EVAPORATOR COIL)						NATURAL GAS BURNER				ELECTRICAL DATA			WEIGHT LBS W/CURB & ACCESS.	REMARKS					
PLAN NO.	MANUFACTURER MODEL	AREA SERVED	TOTAL AIR CFM	EXT. STATIC PRESS. IN. WC	FAN SPEED RPM	FAN HP	MIN. OA CFM	EXH. FAN CFM	NOM. TONS	EER	TOTAL MBH	SENS. MBH	EAT. DB °F	EAT. WB °F	LAT. DB °F	LAT. WB °F	INPUT MBH	OUTPUT MBH	AFUE %	STAGES			EAT. DB °F	LAT. DB °F	VOLTS/Ø	MCA	MOP
RTU-3	CARRIER 48LCEA05A-S-0E2C0	FIRST FLOOR TENANT	1600	1.5	1379	2.9 BHP	240	240	4	12.6	44.2	25.9	78	67	63.2	60.8	82/115	66/93	81	TWO	57	95.8	208/3	32	-	777	SEE NOTES

NOTES:

- UNIT SHALL BE SUPPORTED BY EXISTING RAILS. PROVIDE SUPPLEMENTAL SUPPORT AS NECESSARY FOR PROPER MOUNTING.
- PROVIDE DRAIN PAN WITH UL #508 APPROVED WATER DETECTION SENSOR FOR UNIT SHUTDOWN. WIRE CONTROL CIRCUIT THROUGH NC CONTACT.
- PROVIDE UNIT WITH VAV OPERATION.
- PROVIDE WITH COMPARATIVE ENTHALPY ECONOMIZER WITH FAULT DETECTION MONITORING.
- PROVIDE WITH POWER EXHAUST.
- PROVIDE THRU BASE ELECTRIC.
- PROVIDE UNIT MOUNTED NON-FUSED DISCONNECT SWITCH.
- PROVIDE FACTORY POWERED 120V CONVENIENCE RECEPTACLE (ALWAYS HOT) WITH CIRCUIT PROTECTION BY EC.
- PROVIDE HINGED ACCESS DOORS.
- PROVIDE HAIL GUARDS.
- PROVIDE MERV 13 FILTERS.
- PROVIDE BACNET INTERFACE.
- PROVIDE RETURN AIR SMOKE DETECTOR WIRED TO SHUT DOWN UNIT WITH ACCESSORY REMOTE KEY OPERATED TEST STATION. LOCATE TEST STATION NEAR THERMOSTAT.
- PROVIDE 2-STAGE COOLING WITH HUMID-MIZER (HOT GAS REHEAT COIL).
- PROVIDE MINIMUM 2" THICK R-8 RIGID INSULATION AFFIXED TO ENTIRE BOTTOM OF UNIT WITH ADHESIVE AND MECHANICAL FASTENERS. COVER INSULATION WITH VENTURE TAPE MODEL 1577CW OR EQUAL EXTERIOR MEMBRANE WRAP INSTALLED IN ACCORDANCE WITH MANUFACTURER'S RECOMMENDATION.
- PROVIDE MODULATING OUTDOOR AND RETURN AIR DAMPERS FOR ECONOMIZER WITH FAULT DETECTION AS PER ASHRAE 90.1 LATEST EDITION.
- PROVIDE UNIT WITH MODULATING CONTROL WITH VARIABLE SPEED COMPRESSORS.
- AFTER COMPLETING SYSTEM INSTALLATION AND TESTING, ADJUSTING, AND BALANCING RTU AND AIR-DISTRIBUTION SYSTEMS. CLEAN FILTER HOUSINGS AND PROVIDE NEW FILTERS.
- PROVIDE BI-POLAR IONIZATION GENERATOR SERVING RTU-3. BASIS OF DESIGN: GLOBAL PLASMA SOLUTIONS MODEL #GPS-FC24-AC - 120 VAC. PROVIDE 120V POWER.
- PROVIDE PROGRAMMABLE THERMOSTAT.

GRILLES, REGISTERS, AND DIFFUSERS SCHEDULE

MARK	MAKE	MODEL	CFM RANGE	NECK	SIZE	DESCRIPTION	REMARKS
E-1	TITUS	50F	0 - 210	10"x4"	6"x6"	EGGCRATE RETURN AIR GRILLE - CORE OF 1/2"x1/2"x1" ALUMINUM GRID. PROVIDE SQUARE TO ROUND TRANSITION AS NEEDED.	SEE NOTES

NOTES:

- MAXIMUM NOISE CRITERION < 30.
- FINISH WITH STANDARD WHITE BAKED ENAMEL FINISH (#26 WHITE), UNO.
- FURNISH "RAPID MOUNT" FRAMES FOR S-1 & R-1 DEVICES LOCATED IN DRYWALL CEILINGS.
- COORDINATE MOUNTING FRAME WITH CEILING/WALL CONSTRUCTION TYPE.
- PROVIDE DIRECTIONAL BLOW CLIPS WHERE REQUIRED.
- PROVIDE REMOTE CABLE OPERATED VOLUME DAMPERS LOCATED IN INACCESSIBLE CONSTRUCTION.

AIR COOLED CONDENSING UNIT SCHEDULE



PLAN NO.	MANUFACTURER MODEL	EER	COOLING CAPACITY		ELECTRICAL DATA			WEIGHT LBS	REMARKS
			NOM. TONS	TOTAL MBH	VOLTS/Ø	MCA	MOP		
CU-1	TRANE 4TTA048A3000A	13.0	4	48	208/3	18	30	203	SEE NOTES
CU-2	CARRIER 25CHE424AP03	14.5	2	-	208/3	14.2	25	175	SEE NOTES
CU-3	CARRIER 38AUZ016	12.5	15	183.7	208/3	60.8	80	731	SEE NOTES

NOTES:

- MOUNT OUTDOOR UNIT ON MINIMUM 18" HIGH NONISOLATED WIND RESTRAINT RAILS. BASIS OF DESIGN: THE VMC GROUP MODEL #R7000.
- PROVIDE UNIT MOUNTED DISCONNECT SWITCH, LOW AMBIENT CONTROL AND HAIL GUARDS.
- PROVIDE EXPANSION VALVE KIT FROM THE UNIT MANUFACTURER AND ELECTRICAL DISCONNECT.
- PROVIDE FREEZE STAT WITH REFRIGERANT LINE KIT FROM THE UNIT MANUFACTURER WITH INSULATION ON BOTH LINES.
- SWITCH FROM THE UNIT MANUFACTURER.
- PROVIDE CONTROL WIRING DISTRIBUTION INTERLOCKED WITH EQUIPMENT SERVED.

PACKAGED ROOF TOP UNIT SCHEDULE



GENERAL DATA			SUPPLY FAN					COOLING (EVAPORATOR COIL)						ELECTRICAL DATA				WEIGHT LBS W/ ACCESS.	REMARKS			
PLAN NO.	MANUFACTURER MODEL	AREA SERVED	TOTAL AIR CFM	EXT. STATIC PRESS. IN. WC	FAN SPEED RPM	FAN HP	MIN. OA CFM	EXH. FAN CFM	NOM. TONS	SEER	EER	TOTAL MBH	SENS. MBH	EAT. DB °F	EAT. WB °F	LAT. DB °F	LAT. WB °F			VOLTS/Ø	MCA	MOP
RTU-1	CARRIER 90GC-N08B2A3-0F6C0	SECOND FLOOR TENANT	1600	1.5	2323	1.35	240	-	4.0	16	12.2	40	23.6	78	67	64.5	62.3	208/1	38	50	749	SEE NOTES
RTU-2	CARRIER 90GC-N08B2A3-0F6C0	SECOND FLOOR TENANT	1950	1.5	259	1.38	293	-	5.0	16	12.5	56.1	33.7	78	67	61.4	60.6	208/1	41	60	807	SEE NOTES

NOTES:

- MOUNT AND SECURE UNIT ON EXISTING DUNNAGE. PROVIDE SUPPLEMENTAL STEEL SUPPORTS AS REQUIRED.
- PROVIDE DRAIN PAN WITH UL #508 APPROVED WATER DETECTION SENSOR FOR UNIT SHUTDOWN. WIRE CONTROL CIRCUIT THROUGH NC CONTACT.
- PROVIDE UNIT WITH SINGLE ZONE OPERATION.
- PROVIDE WITH COMPARATIVE ENTHALPY ECONOMIZER AND ENTHALPY SENSOR. INCLUDE FAULT DETECTION AND DIAGNOSTIC AS PER 2016 NYCDEC SECTION C403.2.4.7.
- PROVIDE OUTSIDE AIR INTAKE HOOD.
- PROVIDE WITH BAROMETRIC RELIEF.
- PROVIDE THRU BASE ELECTRIC.
- CFC BASED REFRIGERANTS ARE NOT PERMITTED.
- FURNISH DISCONNECT FOR INSTALLATION BY ELECTRICAL CONTRACTOR.
- PROVIDE FACTORY INSTALLED CONVIENCE OUTLET.
- PROVIDE HINGED ACCESS DOORS.
- PROVIDE MOTORIZED OUTSIDE AIR DAMPER AND LOW AMBIENT CONTROL.
- PROVIDE HAIL GUARDS.
- PROVIDE PROGRAMMABLE THERMOSTAT.
- PROVIDE RETURN AIR SMOKE DETECTOR WIRED TO SHUT DOWN UNIT WITH ACCESSORY REMOTE KEY OPERATED TEST STATION. LOCATE TEST STATION NEAR THERMOSTAT.
- PROVIDE BI-POLAR IONIZATION GENERATOR SERVING RTU-1 & 2. BASIS OF DESIGN: GLOBAL PLASMA SOLUTIONS MODEL #GPS-FC24-AC - 120 VAC. PROVIDE 120V POWER.
- CONTRACTOR SHALL BE RESPONSIBLE TO PROVIDE HIGH STATIC DRIVE.
- PROVIDE MERV 13 FILTERS.
- PROVIDE BACNET INTERFACE.

AIR HANDLING UNIT SCHEDULE



PLAN NO.	MANUFACTURER MODEL	LOCATION	AREA SERVED	MIN. OA CFM	SUPPLY FAN				COOLING COIL				FILTERS			ELECTRICAL			MATCH CU-X UNIT	WEIGHT LBS	REMARKS		
					AIRFLOW CFM	ESP IN. H2O	MOTOR HP	MOTOR RPM	TOTAL MBH	SENS. MBH	REFRIG.	EAT. DB °F	EAT. WB °F	LAT. DB °F	LAT. WB °F	TYPE	MIN. MERV RATING	VOLTS/Ø				HP	FLA
AHU-1	AMERICAN STANDARD TEM40C48S41SA	ROOM 203	CHIROPRACT OR SUITE	240	1600	0.7	1-1/2	1075	48	30	R-410A	75.3	65.4	55.5	54.3	PLEATED	8	208/1	1-3/4	6.3	CU-1	138	SEE NOTES

NOTES:

- PROVIDE DRAIN PAN WITH UL #508 APPROVED WATER DETECTION SENSOR FOR UNIT SHUTDOWN. WIRE CONTROL CIRCUIT THROUGH NC CONTACT.
- PROVIDE UNIT MOUNTED NON-FUSED DISCONNECT SWITCH.
- PROVIDE POWERED CONVENIENCE RECEPTACLE (ALWAYS HOT) WITH CIRCUIT PROTECTION.
- PROVIDE HINGED ACCESS DOORS.
- PROVIDE PROGRAMMABLE THERMOSTAT.
- PROVIDE 4" FILTER RACK FOR MERV 13 FILTERS.
- PROVIDE BI-POLAR IONIZATION GENERATOR SERVING AHU-1. BASIS OF DESIGN: GLOBAL PLASMA SOLUTIONS MODEL #GPS-FC24-AC - 120 VAC. PROVIDE 120V POWER.

EXHAUST FAN SCHEDULE



PLAN NO.	MANUFACTURER MODEL	LOCATION	AREA SERVED	FAN TYPE	SYSTEM TYPE	FAN PERFORMANCE			ELECTRICAL DATA				DUCT CORR. (INCHES)	ROOF OPENING (INCHES)	WEIGHT LBS	REMARKS	
						CFM	TOTAL SP. RPM	FAN RPM	HP	RPM	VOLTS/Ø	DRIVE					ØBA
EF-1	GREENHECK G-060-VG	ROOF	LAVATORY 202	DOME CENTRIF.	GEN EXH	75	0.25	1382	1/15	1725	115/1	DIRECT	41	8x8	10.5x10.5	32	SEE NOTES
EF-2	GREENHECK G-060-VG	ROOF	LAVATORY 210	DOME CENTRIF.	GEN EXH	75	0.25	1382	1/15	1725	115/1	DIRECT	41	8x8	10.5x10.5	32	SEE NOTES
EF-3	GREENHECK G-060-VG	ROOF	LAVATORY 218	DOME CENTRIF.	GEN EXH	75	0.25	1382	1/15	1725	115/1	DIRECT	41	8x8	10.5x10.5	32	SEE NOTES
EF-4	GREENHECK G-060-VG	ROOF	LAVATORY 227	DOME CENTRIF.	GEN EXH	75	0.25	1382	1/15	1725	115/1	DIRECT	41	8x8	10.5x10.5	32	SEE NOTES
EF-5	GREENHECK G-060-VG	ROOF	LAVATORY 213	DOME CENTRIF.	GEN EXH	75	0.25	1382	1/15	1725	115/1	DIRECT	41	8x8	10.5x10.5	32	SEE NOTES

NOTES:

- MOUNT FAN ON MINIMUM 12" HIGH SEISMIC/WIND-RATED ROOF CURB.
- PROVIDE NEMA-1 TOGGLE DISCONNECT SWITCH, BIRDSCREEN, & BACKDRAFT DAMPER.
- PROVIDE CONTROLS FROM WALL SWITCH.
- UL 705 LISTED.
- PROVIDE VARI-GREEN ELECTRONICALLY COMMUTATED (EC) MOTOR.
- PROVIDE UNIT-MOUNTED SPEED CONTROLLER FOR BALANCING.

Issue	Date & Issue Description	By	Check
01	10/09/20	CTH	JDS
	ISSUED FOR BID		
02	02/03/2021		
	ISSUE FOR PERMIT & PRICING II		
03	07/15/2021		
	ISSUE FOR PERMIT & PRICING VI		

Seal/Signature

Project Name
YONKERS - MEDIUM RENOVATION


Prototype Layout

CAD File Name

Description
MECHANICAL SCHEDULES

Scale
AS SHOWN

DETAILS

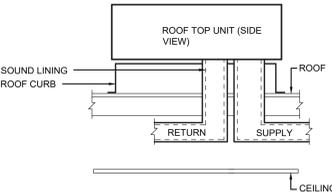

ROOFTOP UNIT DETAIL
NOT TO SCALE

1



NOTES:
1. LOCKING LUGS INTEGRAL WITH VANE.
2. MAXIMUM UNSUPPORTED VANE LENGTH 36".
3. FRAMES BOLTED OR RIVETED TO ELBOW.
4. VANES AND FRAME SAME GAUGE AS ELBOW.

SINGLE THICKNESS
DUCTWORK UNDER 1200 FPM




DOUBLE THICKNESS
DUCTWORK OVER 1200 FPM

NOTES:
1. LOCKING LUGS INTEGRAL WITH VANE.
2. MAXIMUM UNSUPPORTED VANE LENGTH 48".
3. FRAMES BOLTED OR RIVETED TO ELBOW.
4. VANES AND FRAME SAME GAUGE AS ELBOW.


TURNING VANES
NOT TO SCALE

2

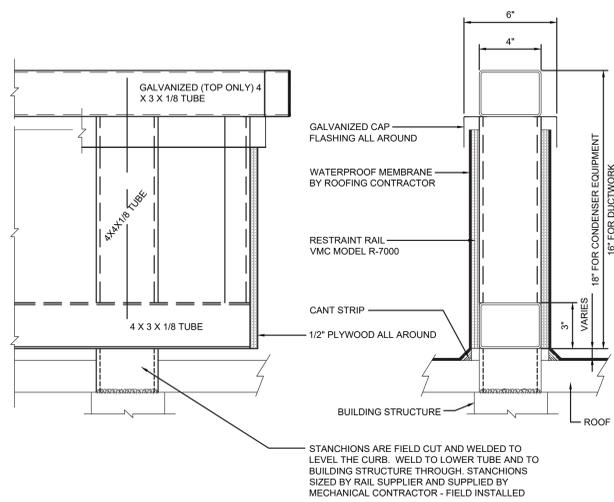


NON-ISOLATED WIND AND SEISMIC RESTRAINT RAIL
NOT TO SCALE

3

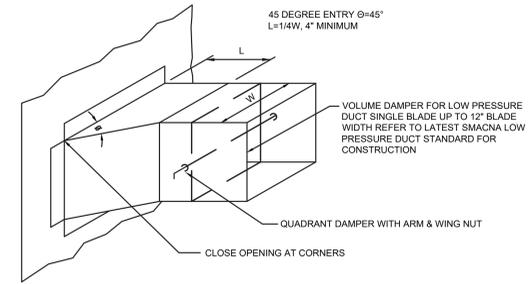

BRANCH CONNECTION DETAIL
NOT TO SCALE


4

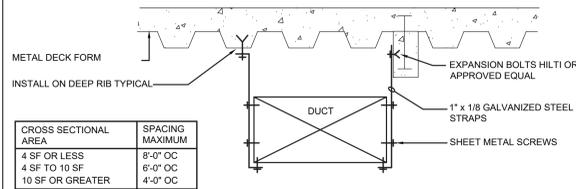

CROSS SECTIONAL AREA	SPACING MAXIMUM
4 SF OR LESS	8'-0" OC
4 SF TO 10 SF	6'-0" OC
10 SF OR GREATER	4'-0" OC


DUCT HANGER DETAIL
NOT TO SCALE

5

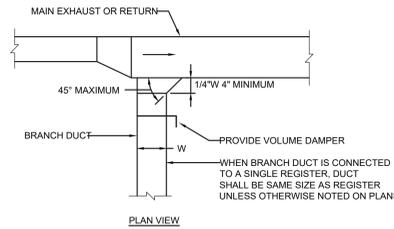


EXHAUST BRANCH DUCT CONNECTION DETAIL
NOT TO SCALE

6

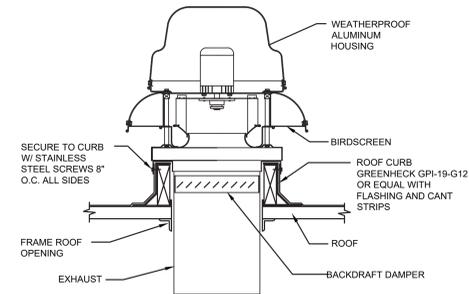


DOWNBLAST EXHAUST FAN DETAIL
NOT TO SCALE

7

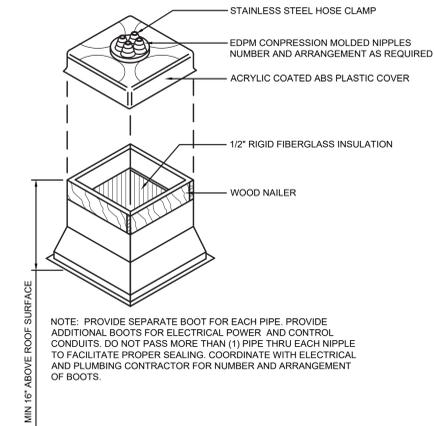


PIPE PORTAL DETAIL
NOT TO SCALE

8

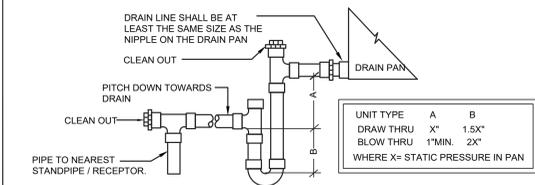


CONDENSATE DRAIN TRAP DETAIL
NOT TO SCALE

9

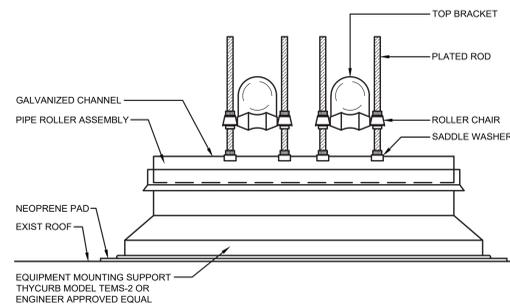


ROOF REFRIGERANT PIPE DETAIL
NOT TO SCALE

10

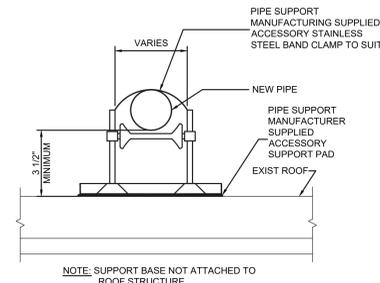

GAS PIPE SUPPORT DETAIL
NOT TO SCALE

11

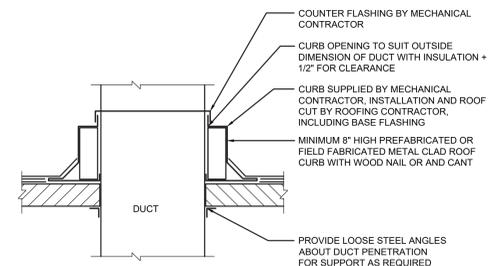

DUCT PENETRATION THRU ROOF DETAIL
NOT TO SCALE

12

Issue	Date & Issue Description	By	Check
01	10/09/20	CTH	JDS
02	02/03/2021		
03	07/15/2021		

Seal/Signature

Project Name
YONKERS - MEDIUM RENOVATION


Prototype Layout

CAD File Name

Description
MECHANICAL DETAILS


Scale
AS SHOWN

DETAILS

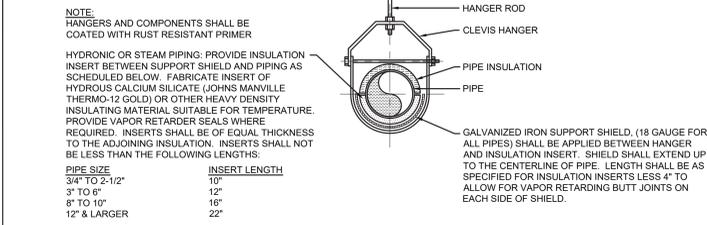

PIPE HANGER DETAIL
NOT TO SCALE

13

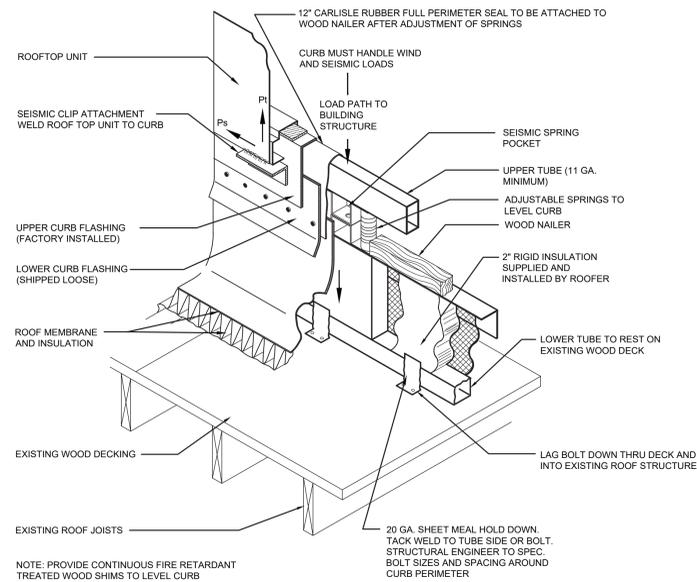

ATTACHMENT OF ISOLATED WIND ROOF CURB ON LEVEL OR PITCHED WOOD BEAM-SUPPORTED ROOF
NOT TO SCALE

14

Issue	Date & Issue Description	By	Check
01	10/09/20	CTH	JDS
	ISSUED FOR BID		
02	02/03/2021		
	ISSUE FOR PERMIT & PRICING II		
03	07/15/2021		
	ISSUE FOR PERMIT & PRICING VI		

Seal/Signature

Project Name
YONKERS - MEDIUM RENOVATION

Prototype Layout

CAD File Name

Description
MECHANICAL DETAILS

Scale
AS SHOWN

M-401

