

TO FAN & LOUVER ACTUATOR FAN DISCONNECT SWITCH 

TYPICAL EXHAUST FAN CONTROL

## NOTES:

BALANCING VALVE

— AIR PURGE VALVE

-AQUASTAT FOR FAN CONTROL

- 1. EXHAUST FANS AND LOUVERS SHALL BE GREENHECK OR APPROVED EQUAL
- 2. HYDRONIC HEATERS SHALL BE MODINE.
- 3. EF3 SHALL HAVE A HONEYWELL T6051A1016/U COOLING THERMOSTAT AS SHOWN. GREENHECK MOTOR STARTER SHALL PROVIDE MANUAL OPERATION
- 4. ALL HYDRONIC HEAT ZONES SHALL HAVE HONEYWELL TH8110U1003 PROGRAMMABLE THERMOSTATS. AQUASTATS SHALL PROVIDE FAN CONTROL.
- 5. EF1 AND EF2 SHALL OPERATE ON A PROGRAMMABLE TIMER AND A MANUAL COUNTDOWN TIMER. CONTROLS FOR EF2 BE MUST EXPLOSION PROOF (NEMA 7) UNLESS LOCATED OUTSIDE THE SPACE
- 6. ALL HWS AND HWR PIPING SHALL INSULATED TYPE L COPPER






LICE								
REVISIONS	DESCRIPTION							
	DATE							
								Т

ON .

SAW MILL PUMP STATION UPGRADES VILLAGE OF MOUNT KISCO WESTCHESTER COUNTY, NY

**HVAC DETAILS** 

SHEET:

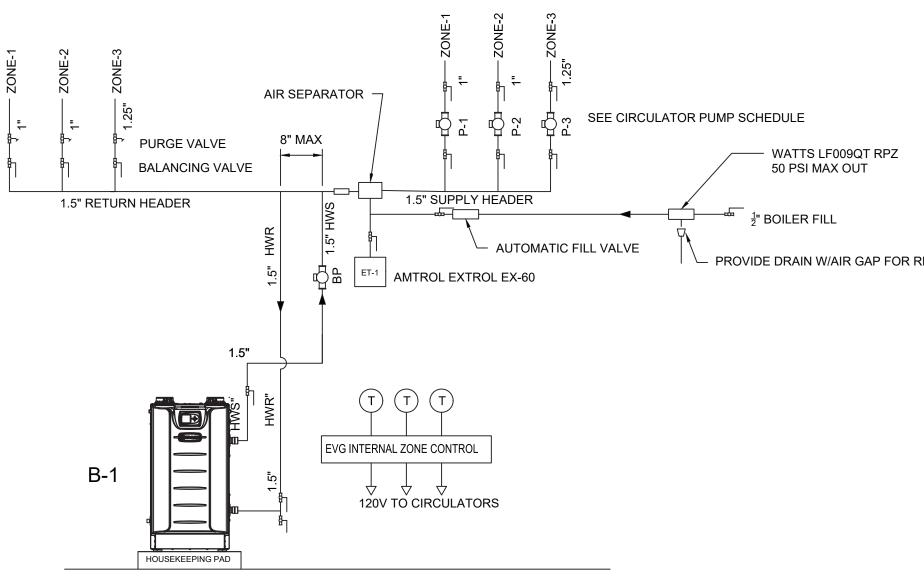


**BOILER SCHEMATIC** 

- PROVIDE DRAIN W/AIR GAP FOR RPZ

BI

WARNING - IT IS A VIOLATION OF NEW YORK EDUCATION LAW SECTION 7209.2, FOR ANY PERSON, UNLESS HE IS ACTING UNDER THE DIRECTION OF A LICENSED PROFESSIONAL ENGINEER OR LAND SURVEYOR, TO ALTER THIS DOCUMENT IN ANY WAY. IF ALTERED THE ALTERING PERSON SHALL COMPLY WITH THE REQUIREMENTS OF NEW YORK EDUCATION LAW, SECTION 7209.2.

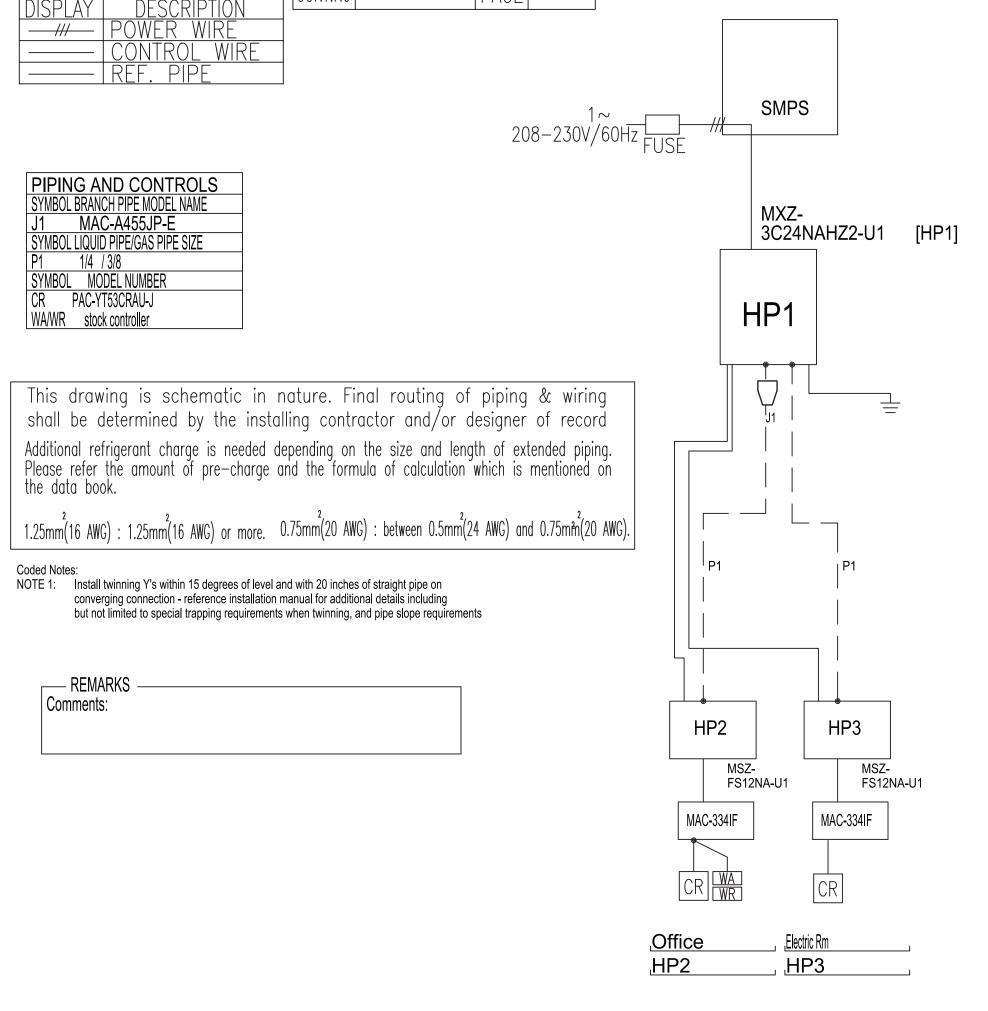

HEAT PUMP SYSTEM SCHEMATIC