



1
A4.1
WALL SECTION -
CONSTRUCTION TYPE: 1
SCALE: 1" = 1'-0"

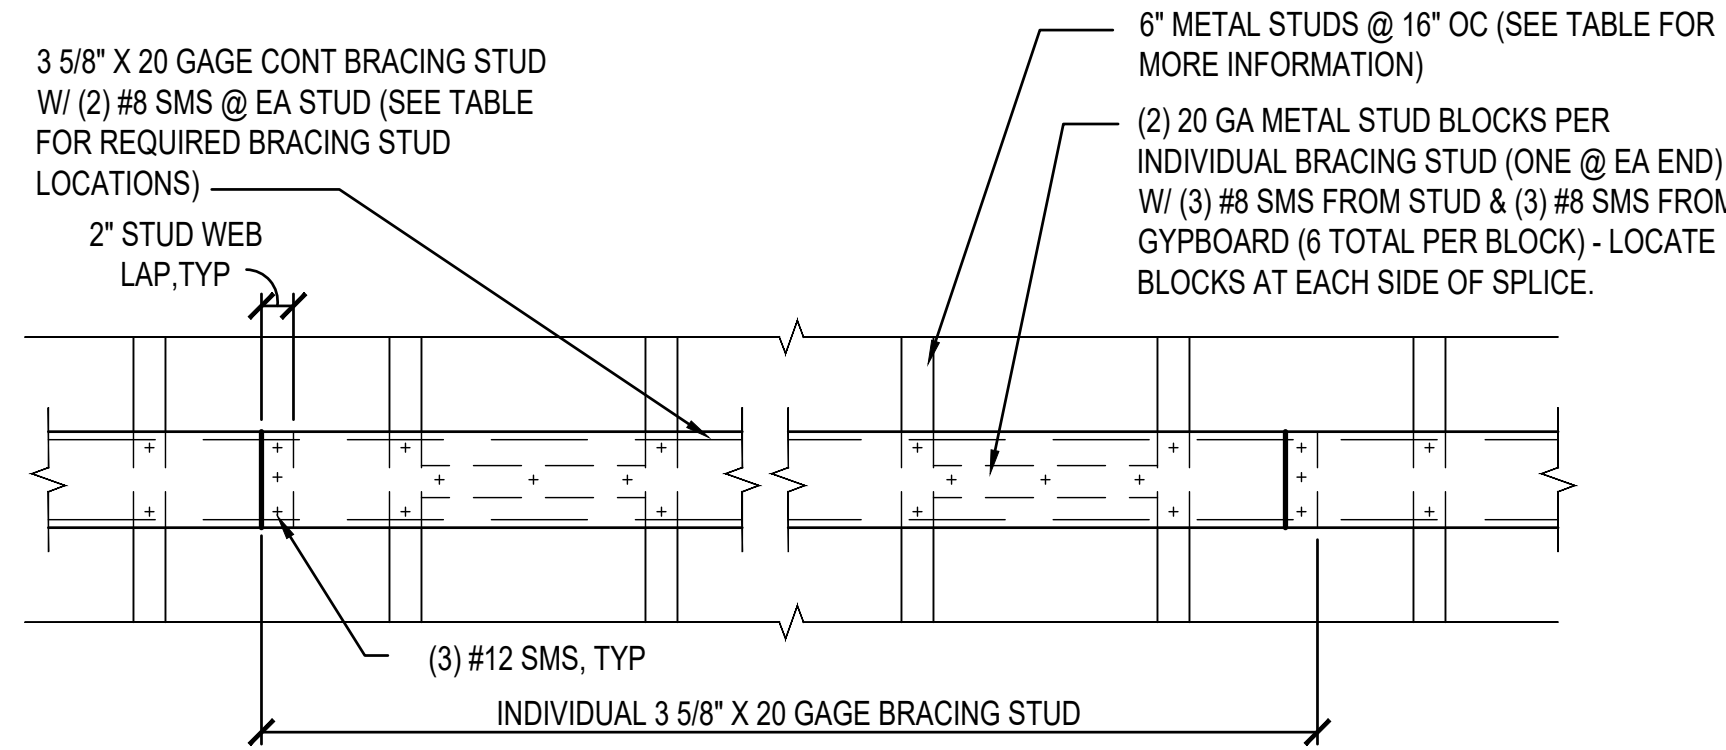


DETAIL
SCALE: 1" = 1'-0"

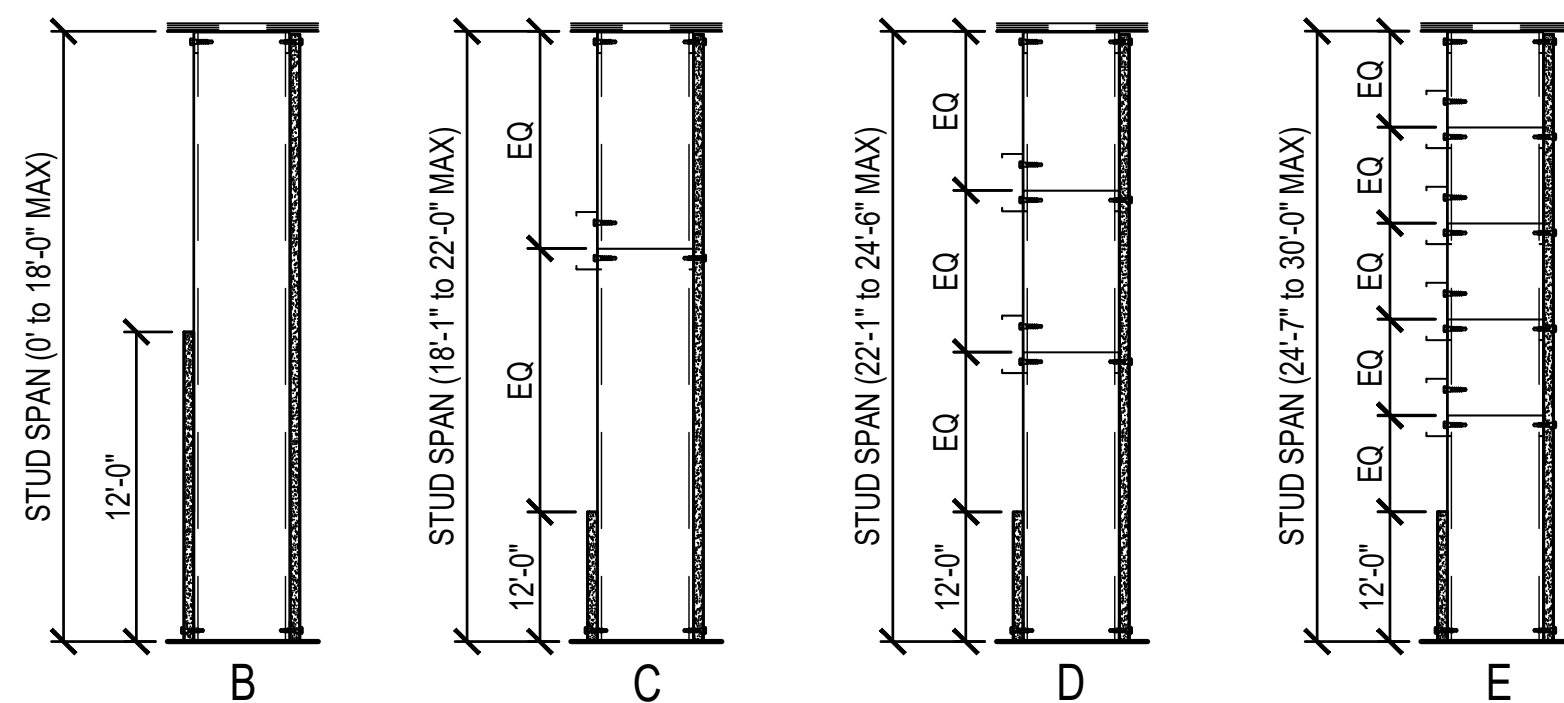


BRACING LOCATION SECTION
SCALE: NTS

| STUD SPAN | STUD GAGE | BRACE SPACING | BRACING LOCATION SECTION |
|-----------|-----------------|---------------------|--------------------------|
| 18' | 20 (600S125-33) | NO BRACING REQUIRED | B |
| 22' | 20 (600S125-33) | 5' OC (MAX) | C |
| 24'-6" | 20 (600S125-33) | 4'-2" OC (MAX) | D |
| 30'-0" | 18 (600S125-43) | 3'-7" OC (MAX) | E |

STUDS MUST MEET MINIMUM SSMA SPECIFICATIONS FOR 600S125 Fy=33 KSI STUDS OF THE SPECIFIED GAGE.

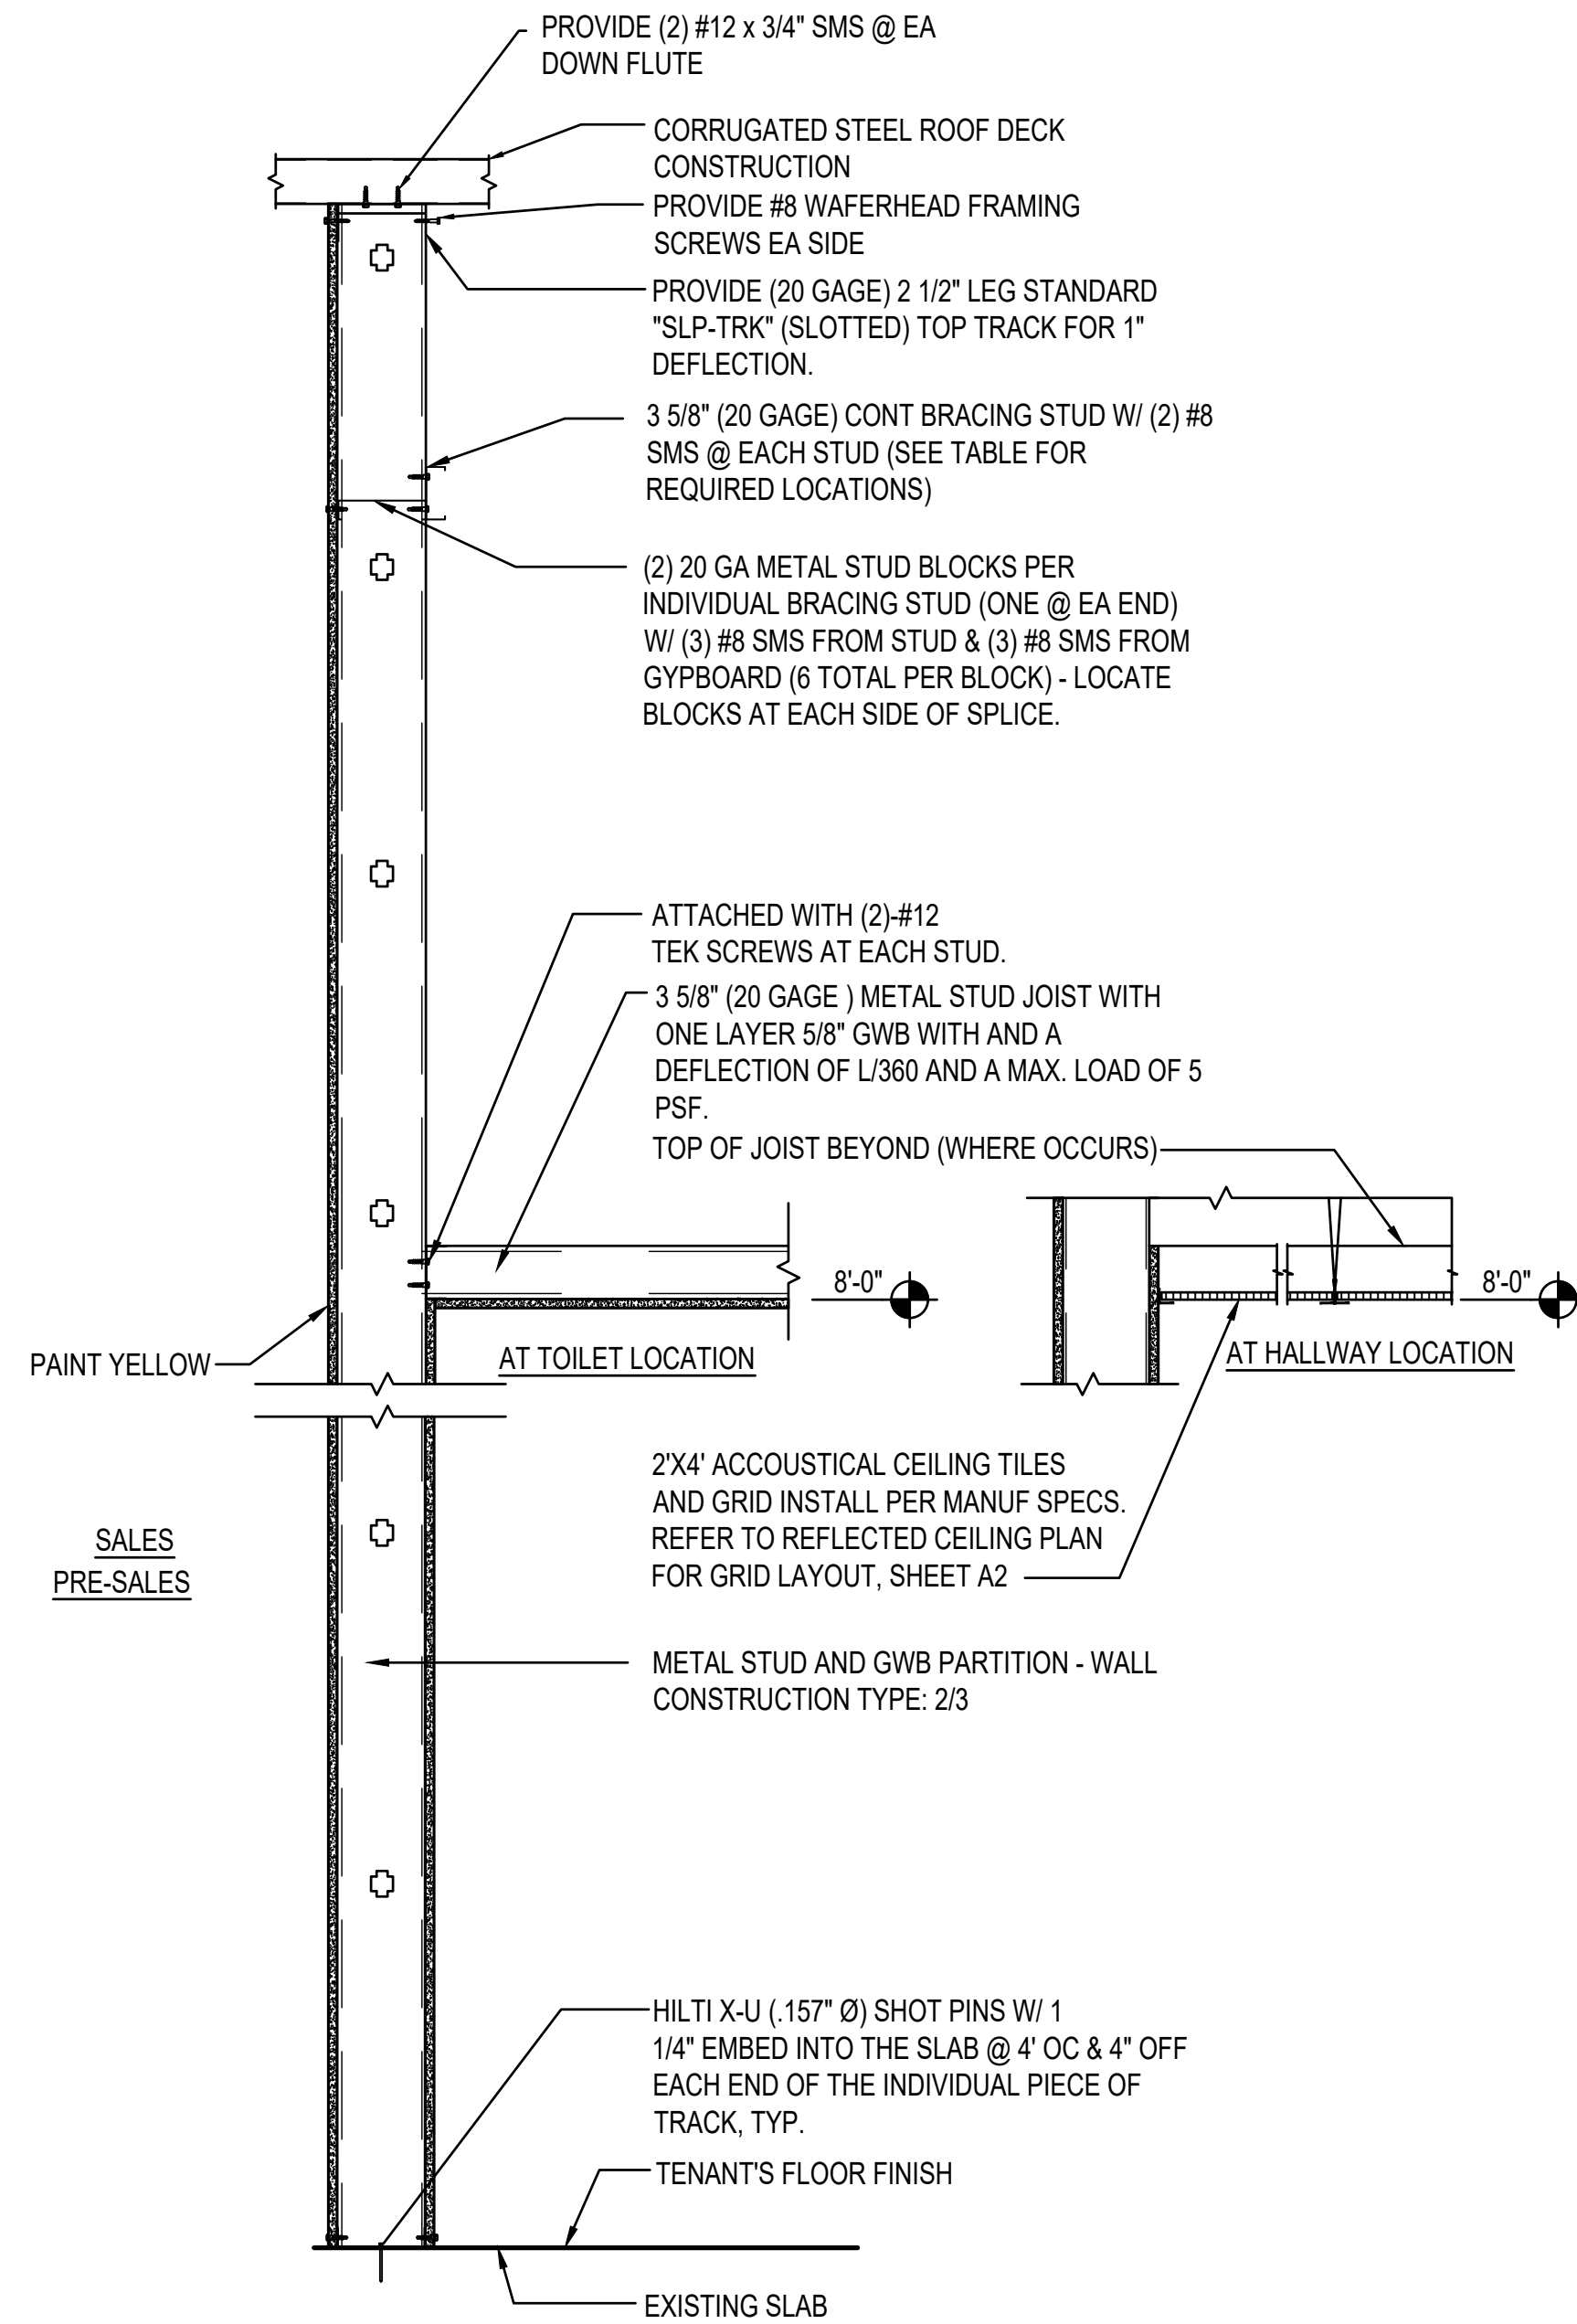

2
A4.1
WALL SECTION -
CONSTRUCTION TYPE: 2
SCALE: 1" = 1'-0"

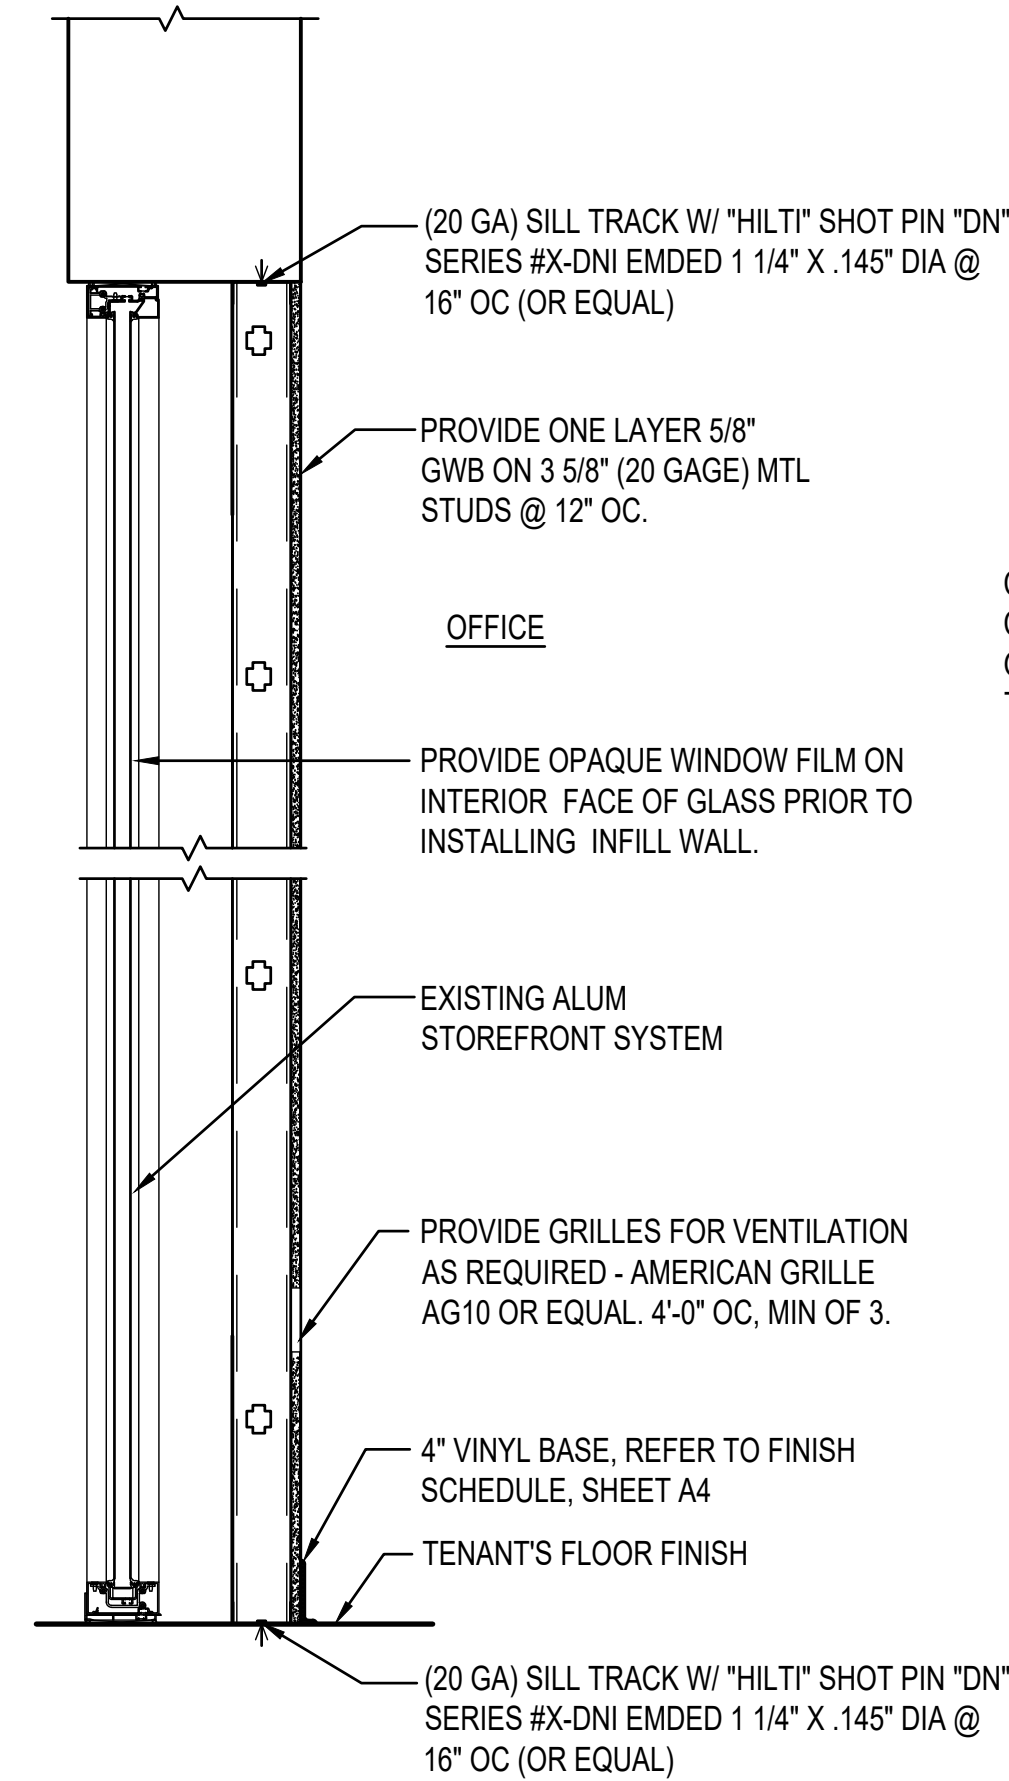

3
A4.1
WALL SECTION TYPE 8
SCALE: 1" = 1'-0"

CONTACT TENANT'S
CONSTRUCTION PM FOR
GRAPHICS INFORMATION PRIOR
TO INSTALLING INFILL WALL.