




* EACH BO IS RATED FOR A MAX LOAD OF 2 AMPS @ 24 VAC

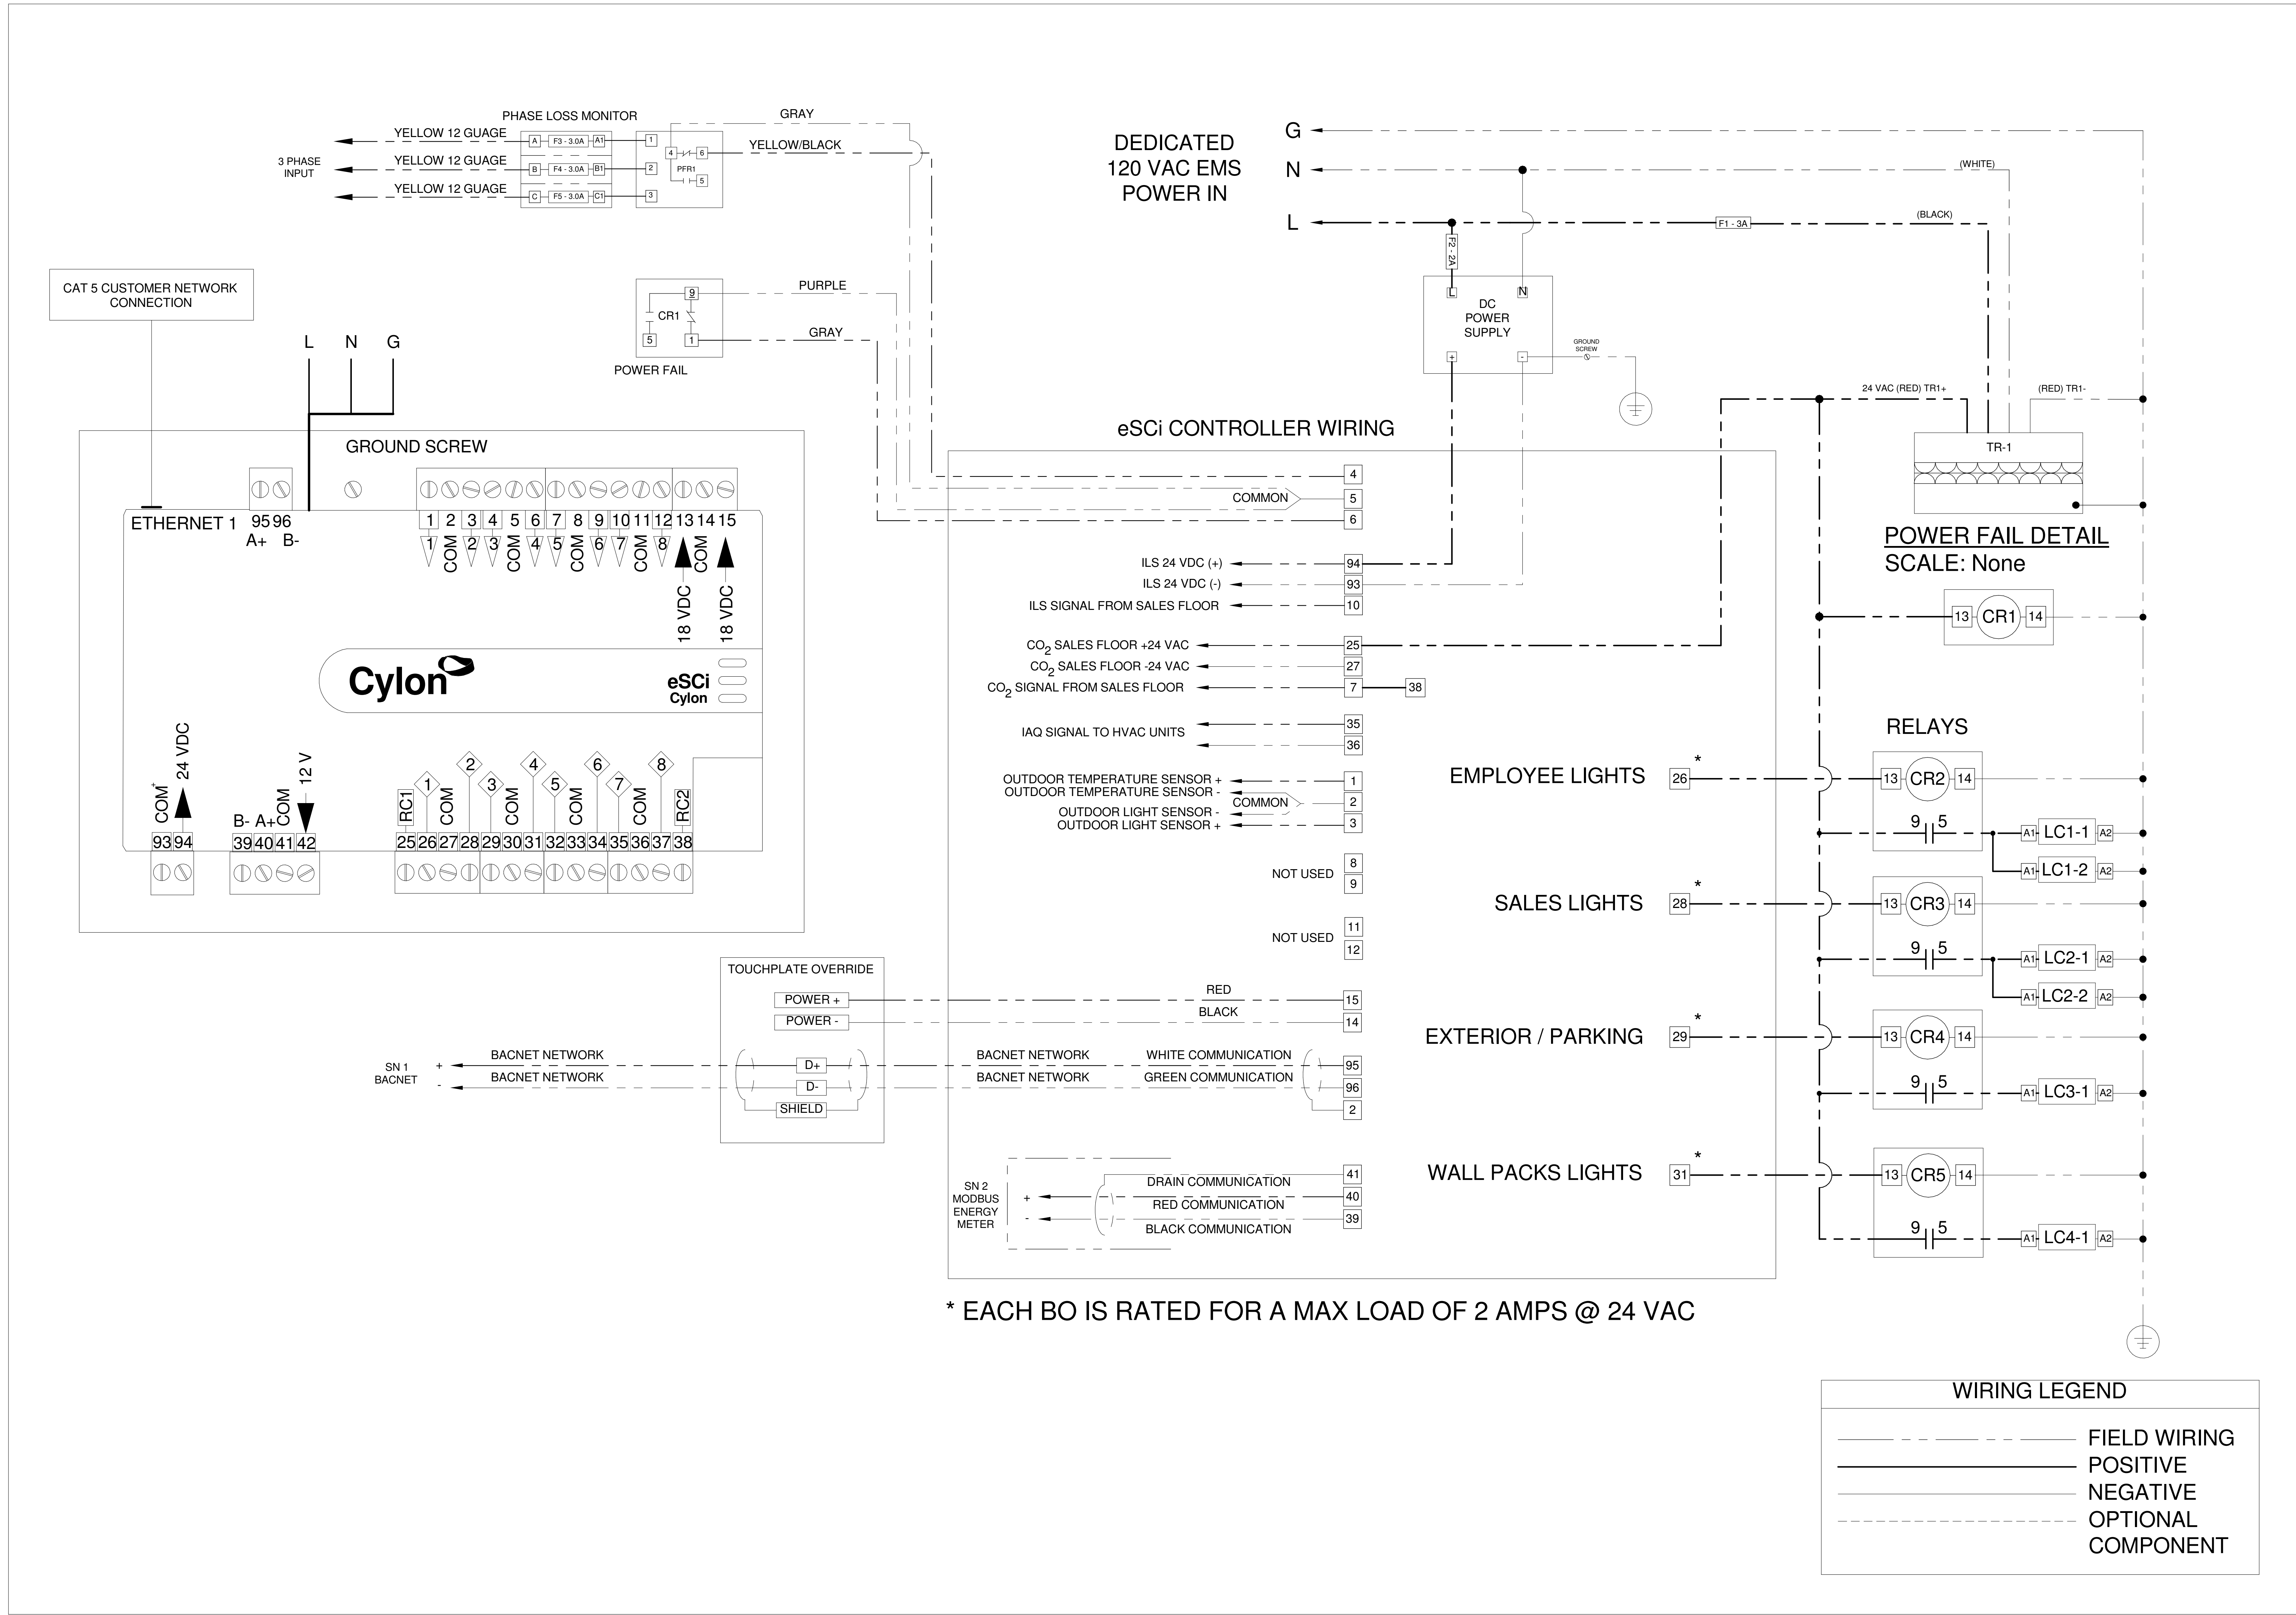

25 Sundial Ave - Suite 310 W
Manchester, NH 03103

DOLLAR TREE FIELD WIRING

(FOR REFERENCE ONLY NOT TO SCALE)

REVISION: 1	DATE: 06/05/20	ECN#: 2390
LOOSE DT OPTION		
REVISION: ----	DATE: ----	ECN#: ----
REVISION: ----	DATE: ----	ECN#: ----
REVISION: ----	DATE: ----	ECN#: ----
REVISION: ----	DATE: ----	ECN#: ----
DRAWN: WPC	CHECKED: CGP	
PART #: 94-402	OPTION: P	

ENERGY
MANAGEMENT
PLAN

EM-3 of 4



description	by	date	mark	revisions

06/15/2022	project	2022.27 / D13216	KLH	RNK	LGK
date	project	designed	drawn	checked	



DOLLAR TREE
166 S. LIBERTY DRIVE - DEAL #13216 / STORE #2573
STONY POINT, NY 10980
EMS DETAILS